


**Appendix J**  
**Water Balance Flow Diagrams**



NOTES:  
1. FLOW RATES BASED ON GALLONS PER MINUTE.

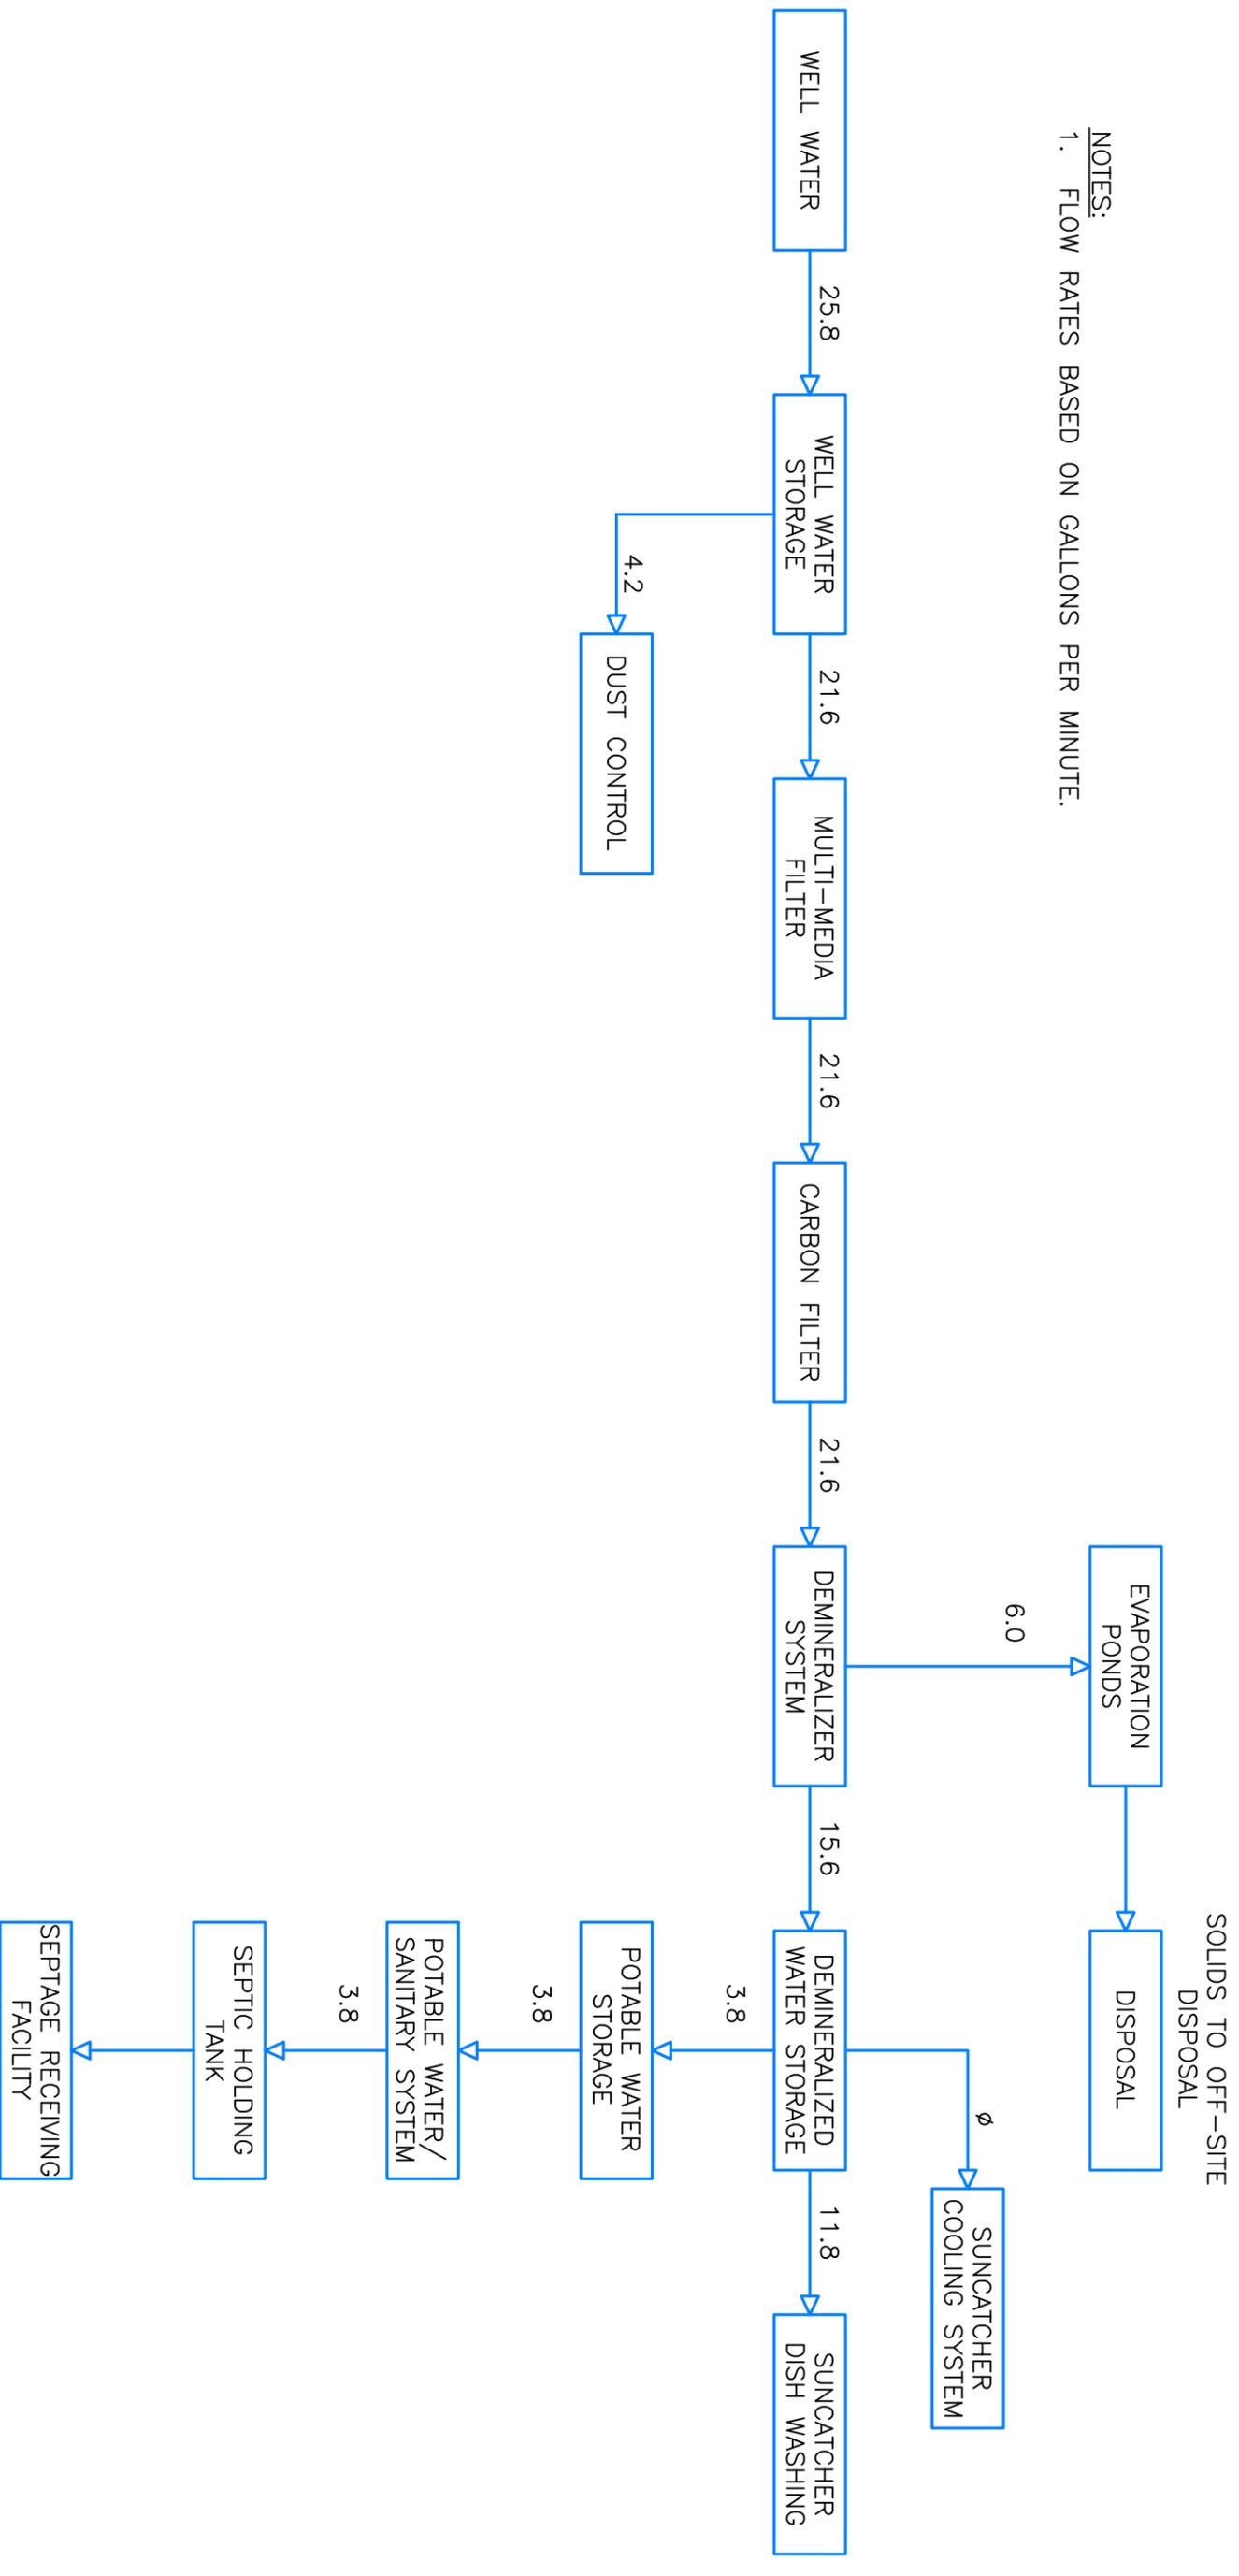

P1	11/18/08	ISSUED FOR PRELIMINARY REVIEW	SD				
NO.	DATE		BY	APP.			

**STANTEC CONSULTING INC.**  
 9400 S.W. BARNES ROAD  
 STE. 200  
 PORTLAND, OREGON, 97225  
 503.297.1631  
 STANTEC.COM

DRN. STC/TB	DES. STC/NJA	CHK. STC/	DATE 11/04/08
SCALE	NONE	App.	DATE

**SES**  
 Stirling Energy Systems

PROJECT: 2000024301


TITLE: WATER BALANCE FLOW DIAGRAM  
 ANNUAL AVERAGE POST CONSTRUCTION

S1-P-0150

SHT.	REV.
1 of 4	P1



NOTES:  
1. FLOW RATES BASED ON GALLONS PER MINUTE.

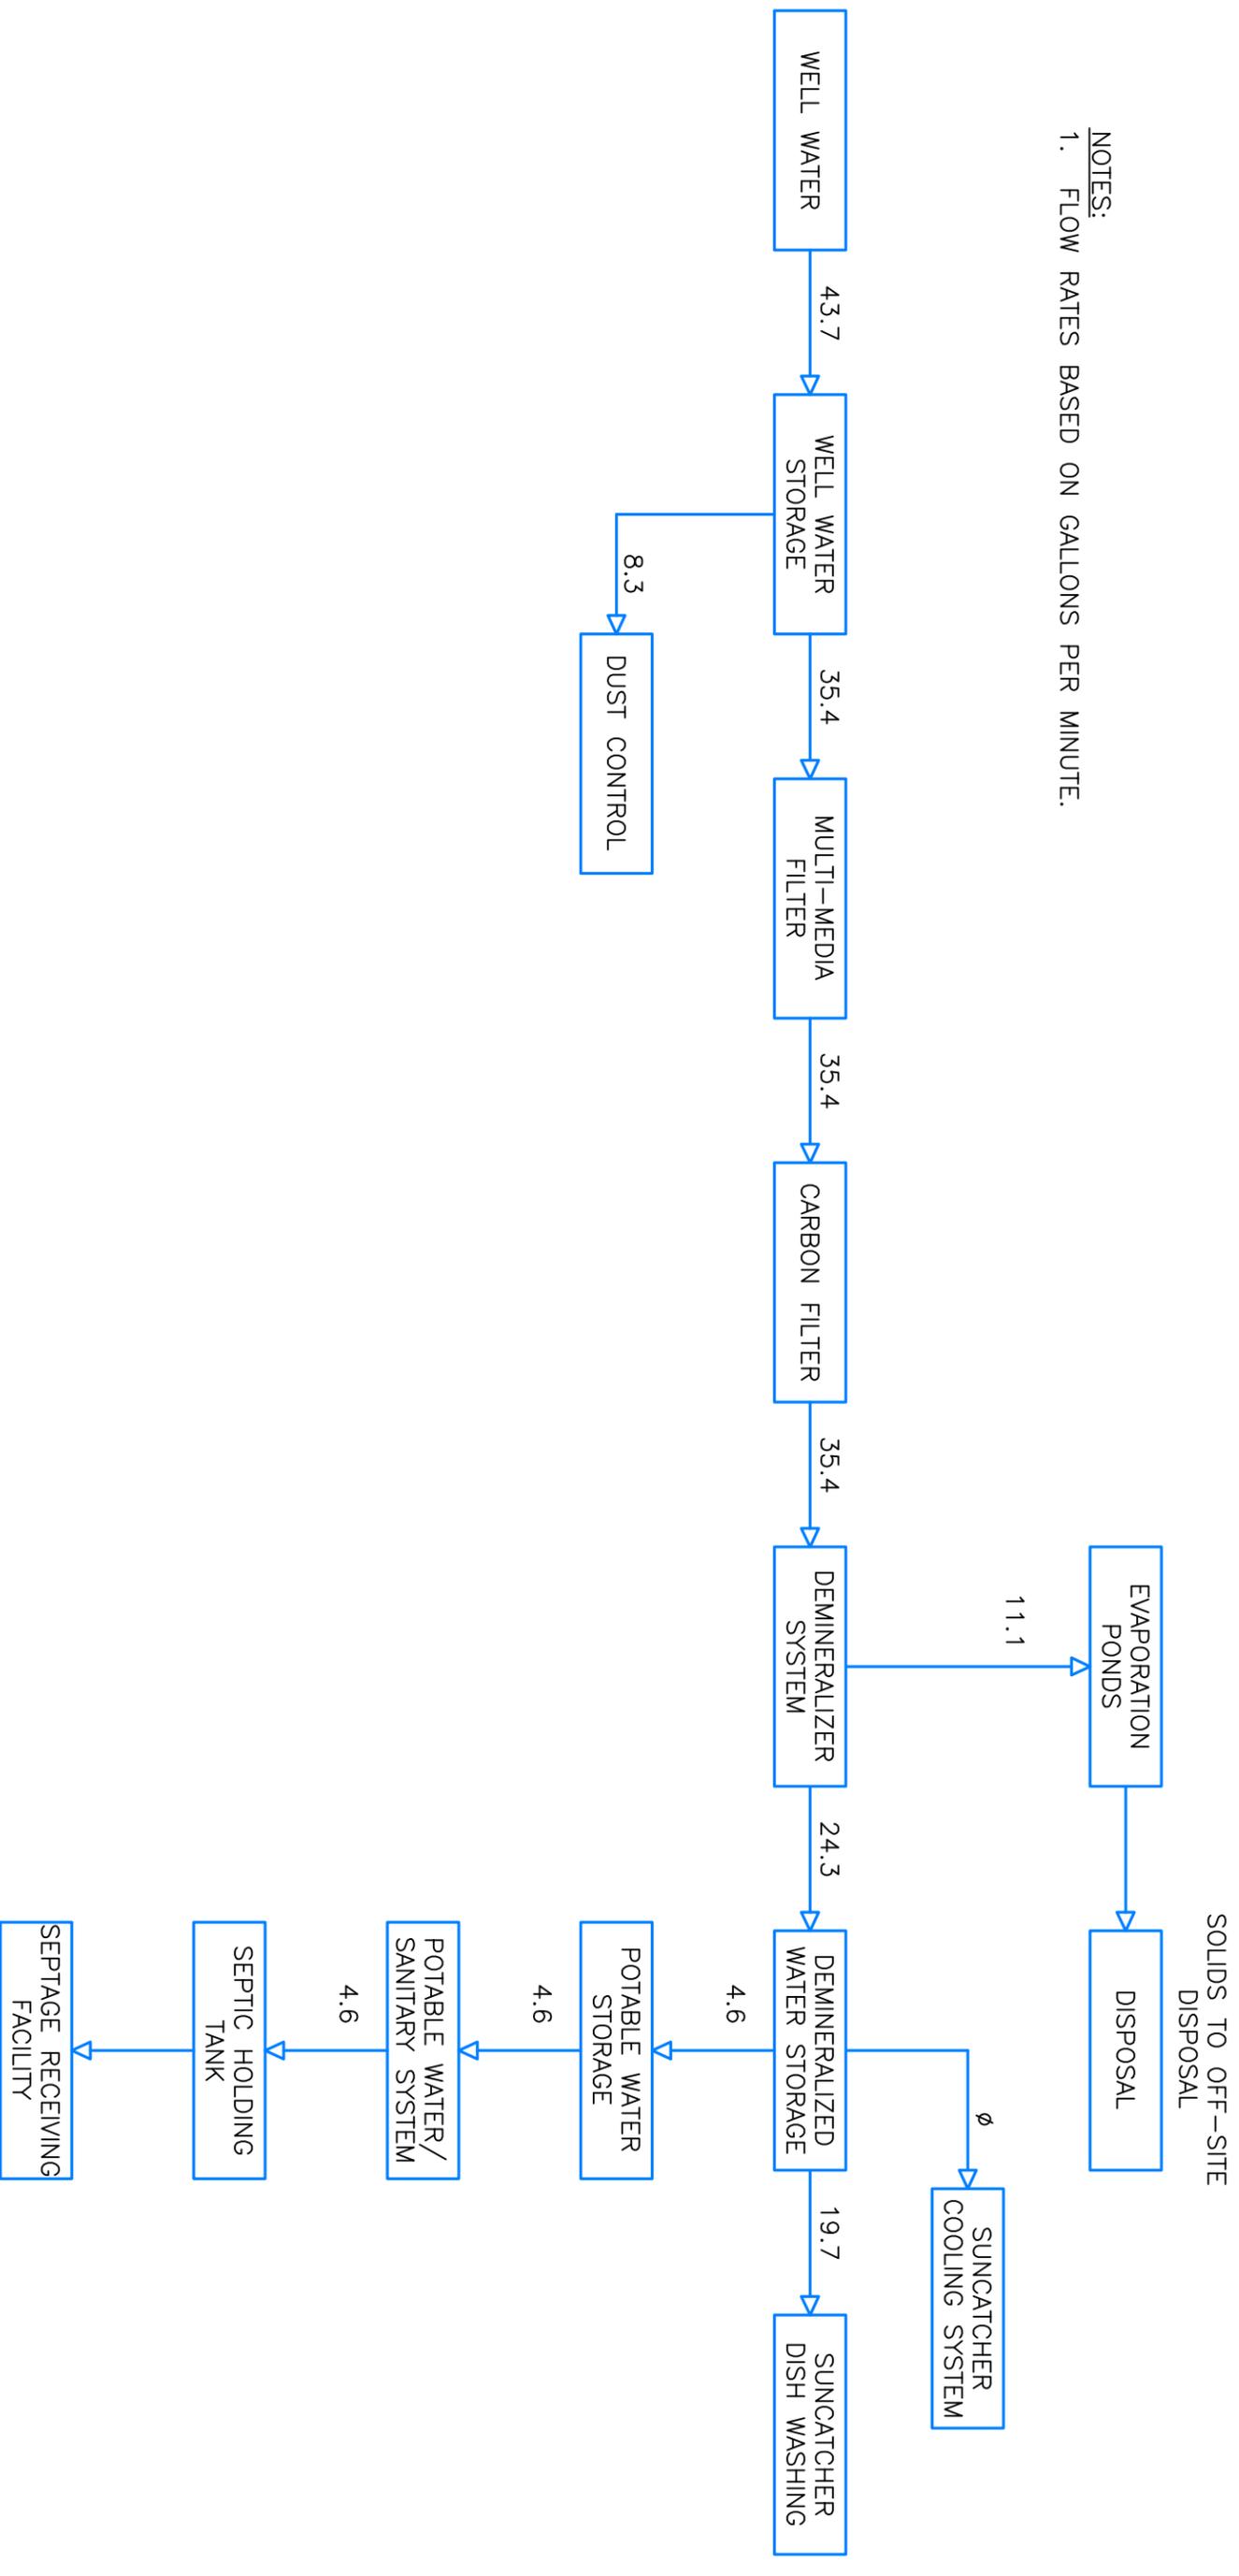

P1	11/18/08	ISSUED FOR PRELIMINARY REVIEW	SD
NO.	DATE		BY

**STANTEC CONSULTING INC.**  
 9400 S.W. BARNES ROAD  
 STE. 200  
 PORTLAND, OREGON, 97225  
 503.297.1631  
 STANTEC.COM

DRN. STC/TB	DES. STC/NJA	CHK. STC/	DATE 11/04/08
SCALE	NONE	App.	DATE

**SES**  
 Stirling Energy Systems

PROJECT: 2000024301


TITLE: WATER BALANCE FLOW DIAGRAM  
 SUMMER PEAK POST CONSTRUCTION

S1-P-0150

SHT.	REV.
2 of 4	P1



NOTES:  
1. FLOW RATES BASED ON GALLONS PER MINUTE.

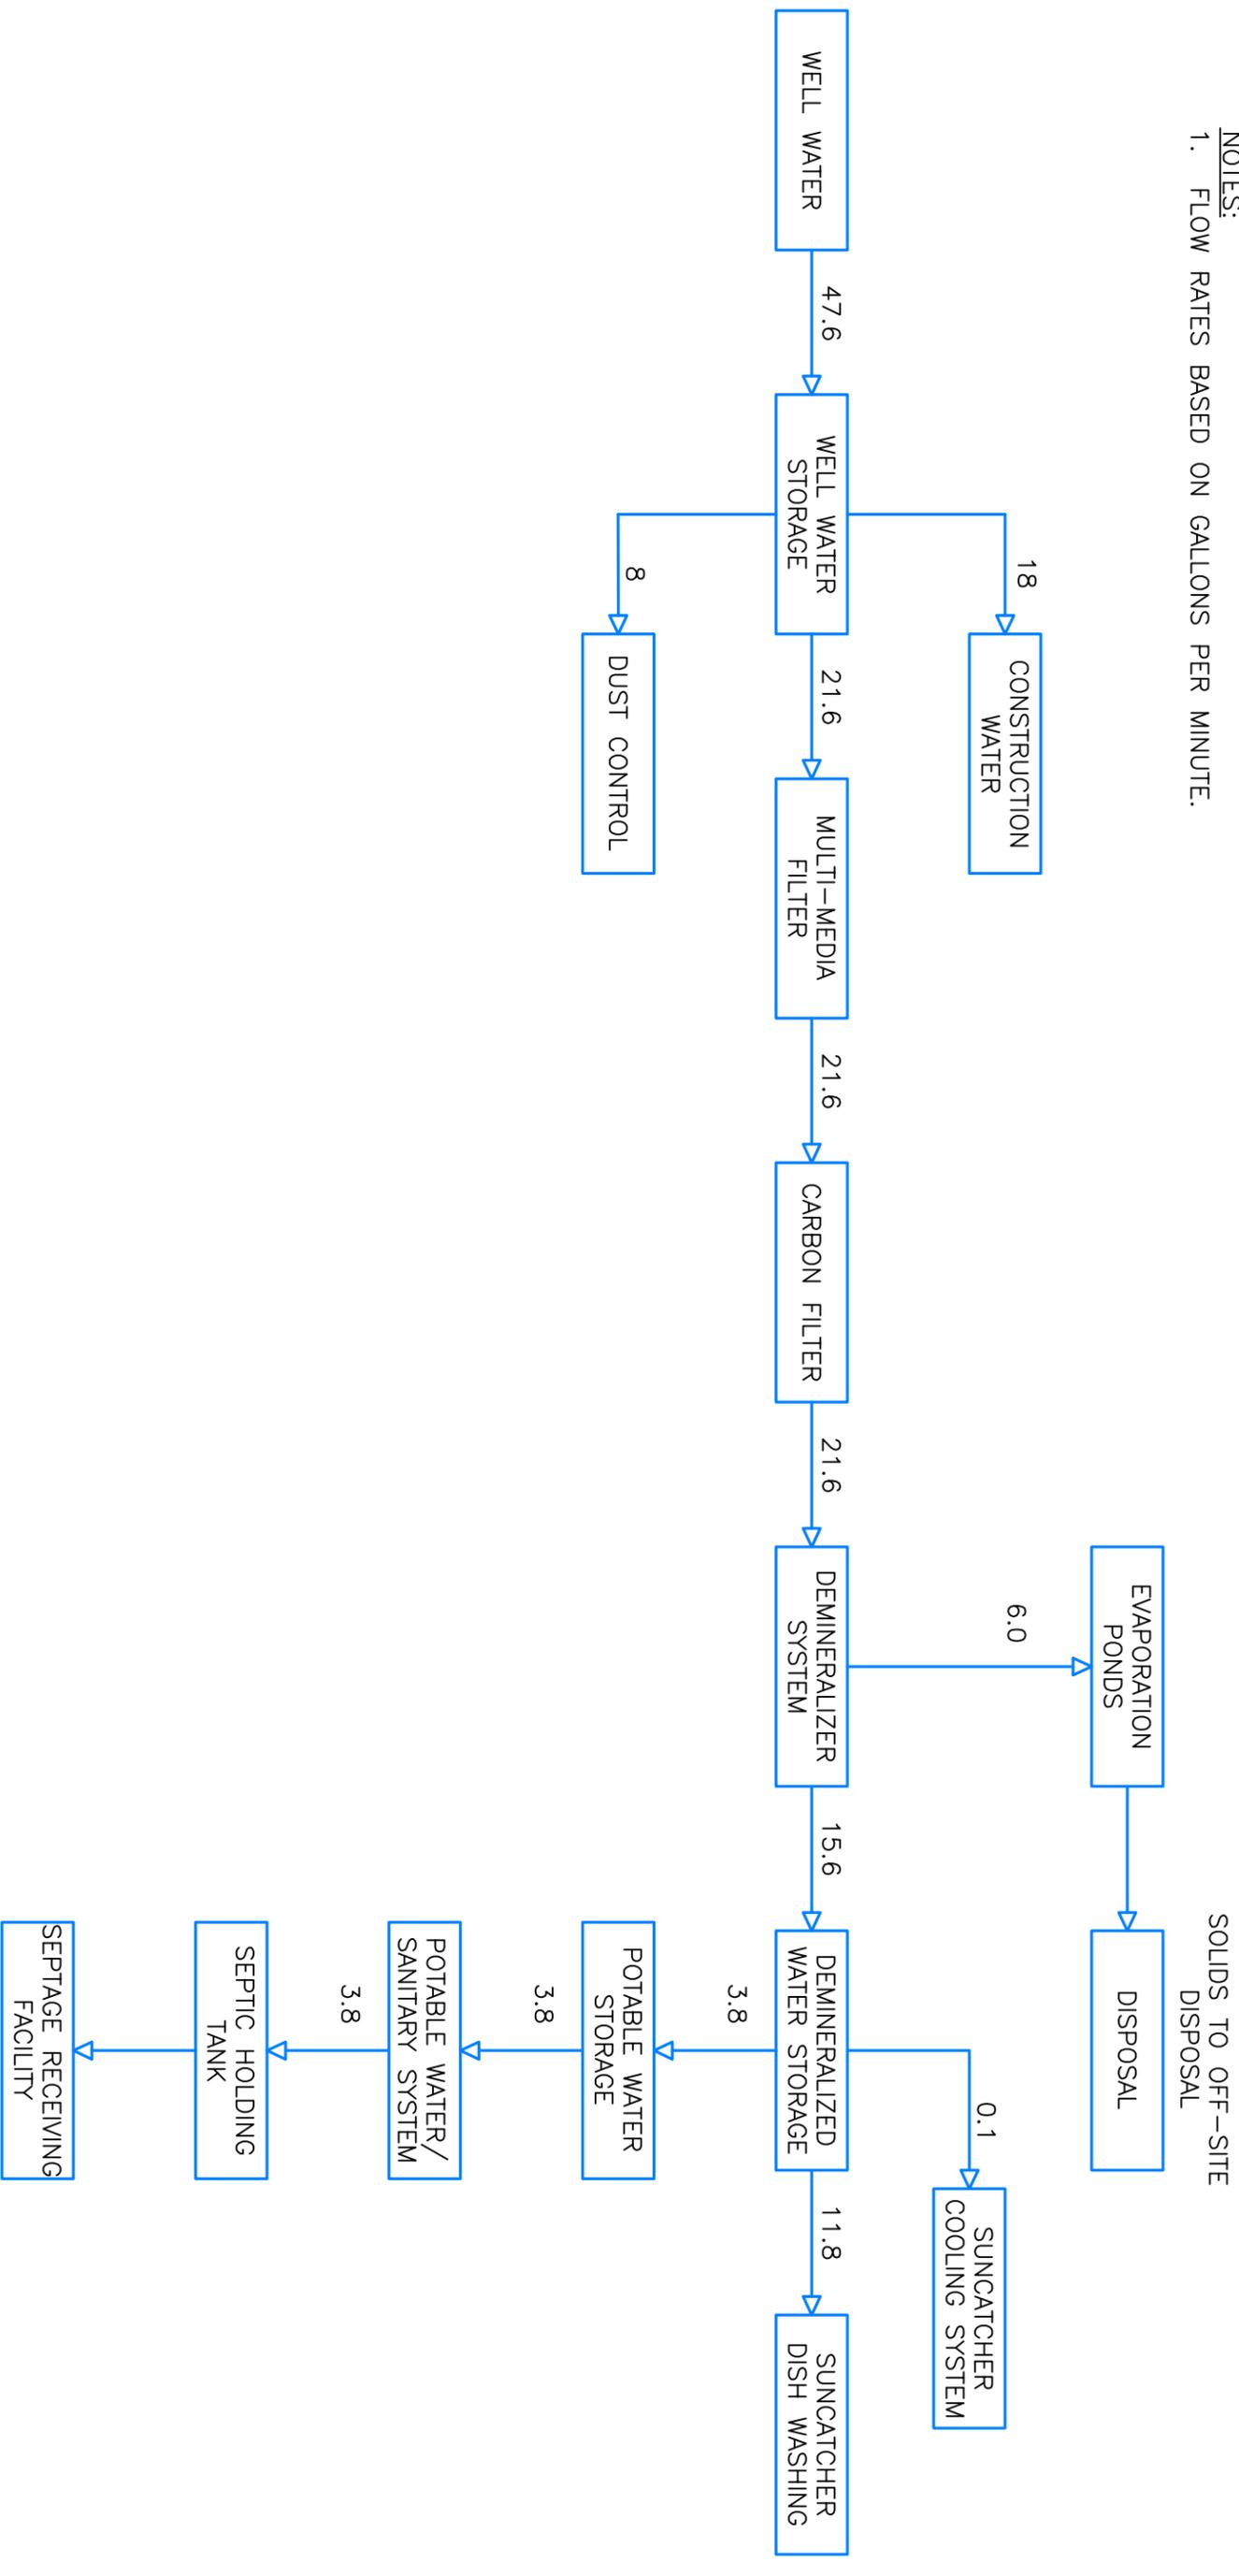

SOLIDS TO OFF-SITE DISPOSAL

P1	11/18/08	ISSUED FOR PRELIMINARY REVIEW	SD			
NO.	DATE		BY	APP.		

**STANTEC CONSULTING INC.**  
 9400 S.W. BARNES ROAD  
 STE. 200  
 PORTLAND, OREGON, 97225  
 503.297.1631  
 STANTEC.COM

DRN. STC/TB | DES. STC/NJA | CHK. STC/ | DATE 11/04/08  
 SCALE | NONE | APP.

**SES**  
 Stirling Energy Systems


PROJECT: 2000024301

TITLE: WATER BALANCE FLOW DIAGRAM  
 ANNUAL AVERAGE DURING CONSTRUCTION

S1-P-0150

SHT. 3 of 4  
 REV. P1



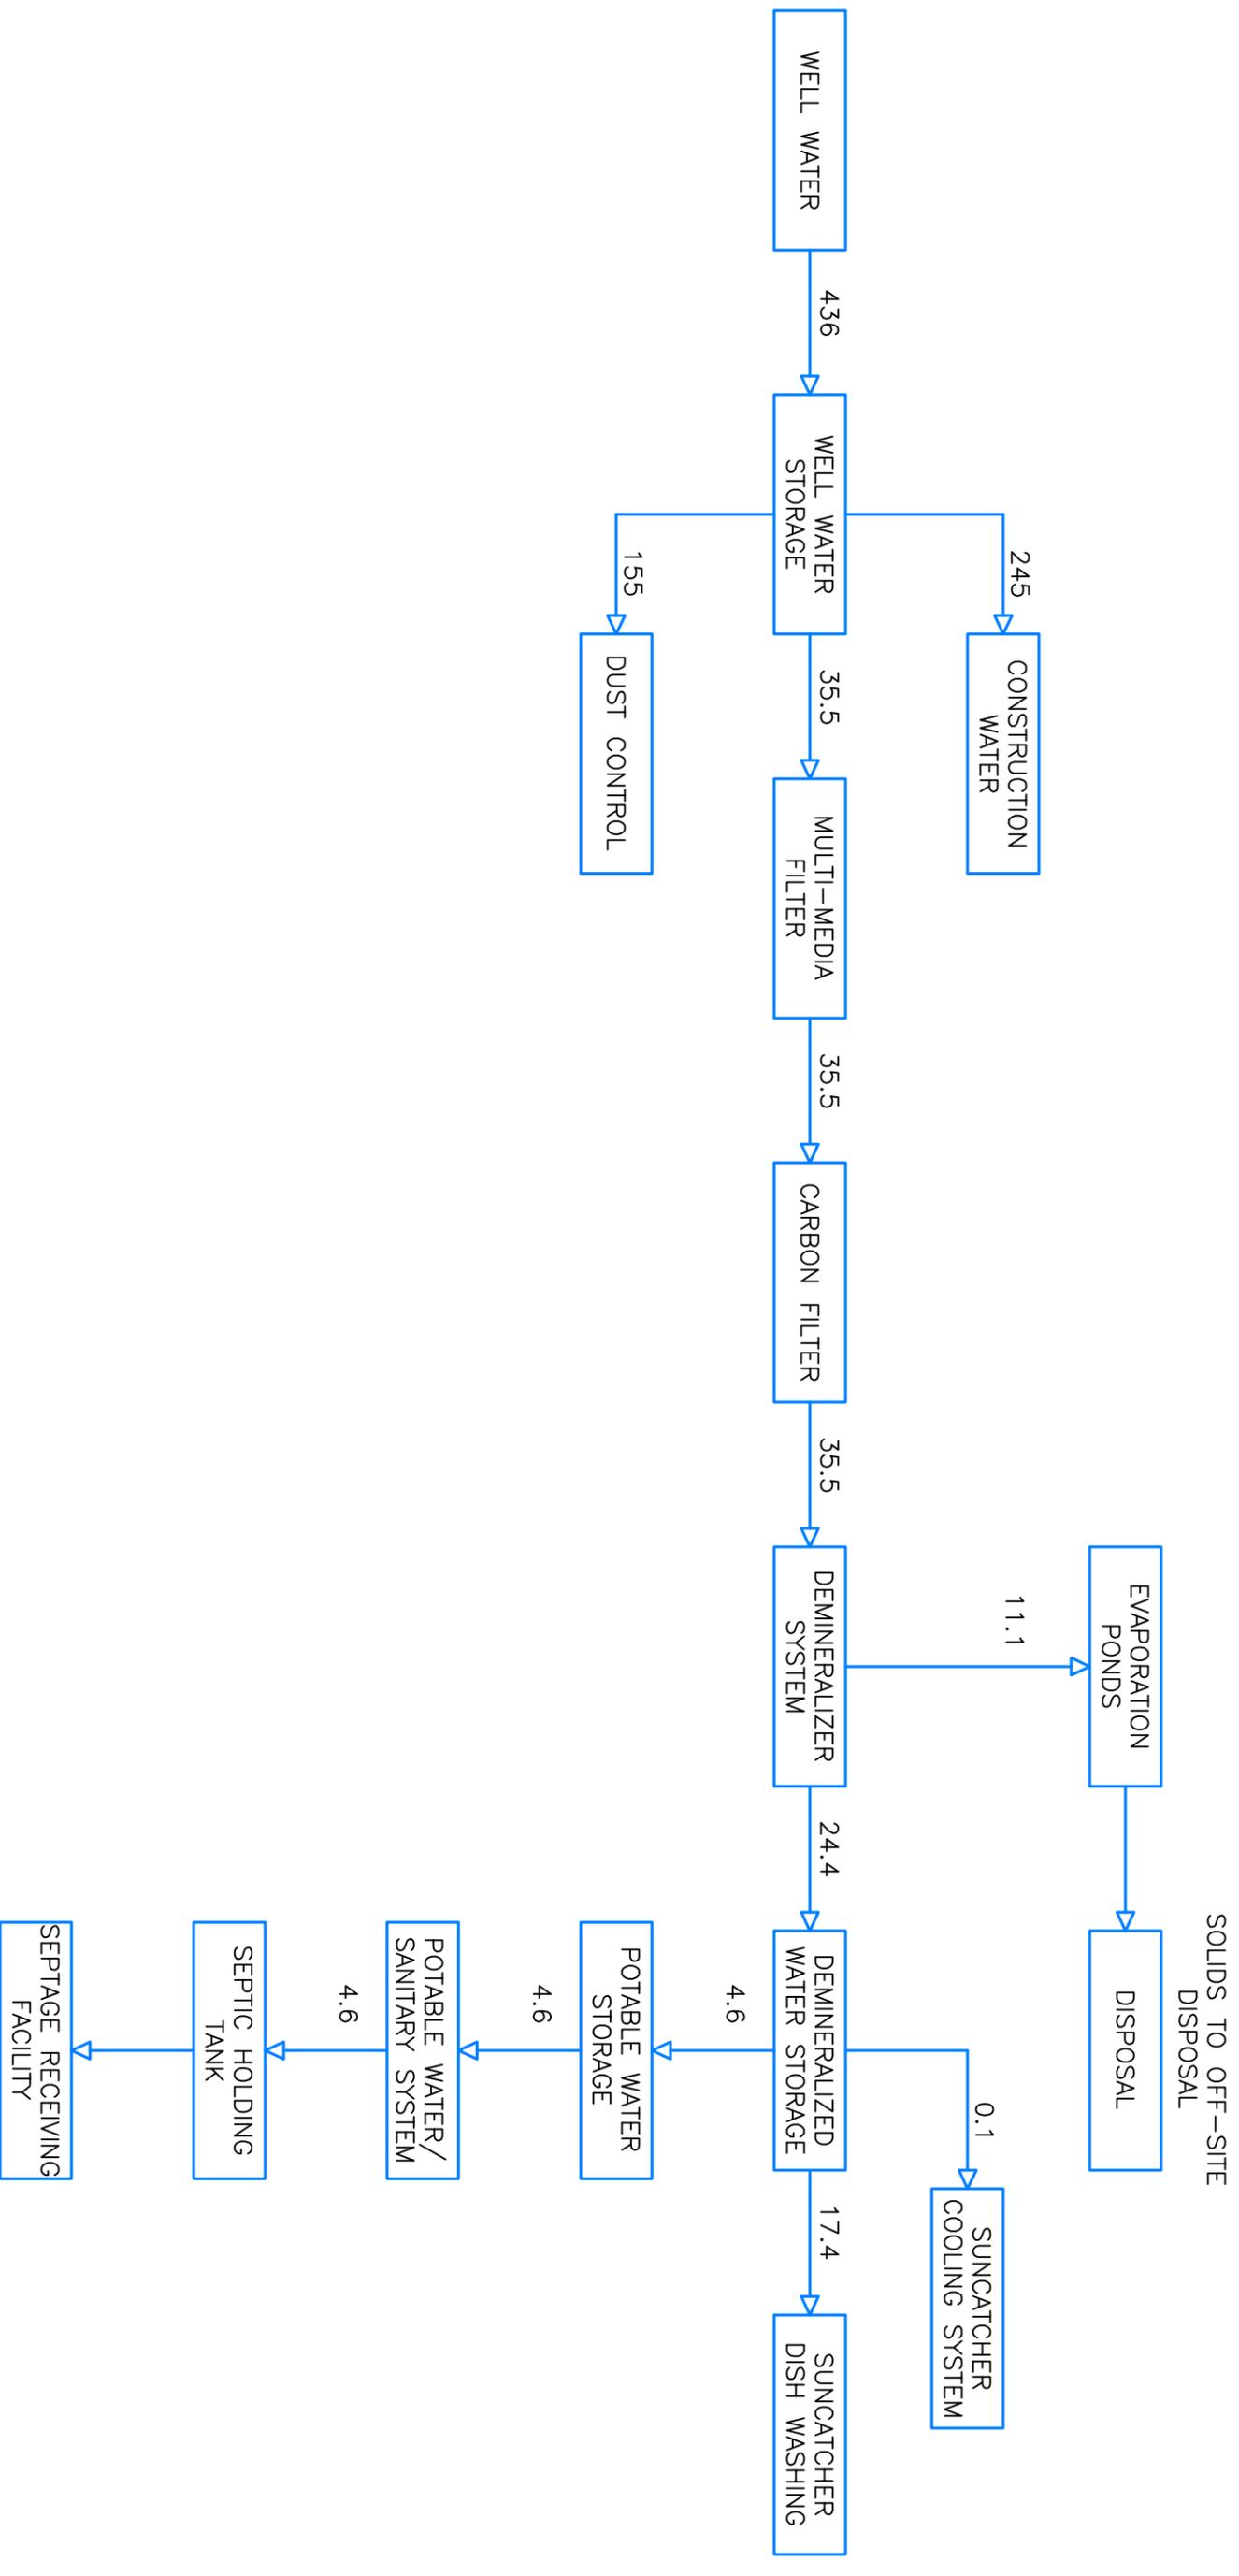

P1 11/18/08 ISSUED FOR PRELIMINARY REVIEW SD

NO.	DATE	BY	APP.

**STANTEC CONSULTING INC.**  
 9400 S.W. BARNES ROAD  
 STE. 200  
 PORTLAND, OREGON, 97225  
 503.297.1631  
 STANTEC.COM

DRN. STC/TB: NONE  
 DES. STC/NUA: NONE  
 CHK. STC/APP.:  
 DATE 11/04/08

**SES**  
 Stirling Energy Systems

PROJECT: 2000024301

TITLE: WATER BALANCE FLOW DIAGRAM  
 SUMMER PEAK DURING CONSTRUCTION

S1-P-0150

SHT. 4 of 4  
 REV. P1