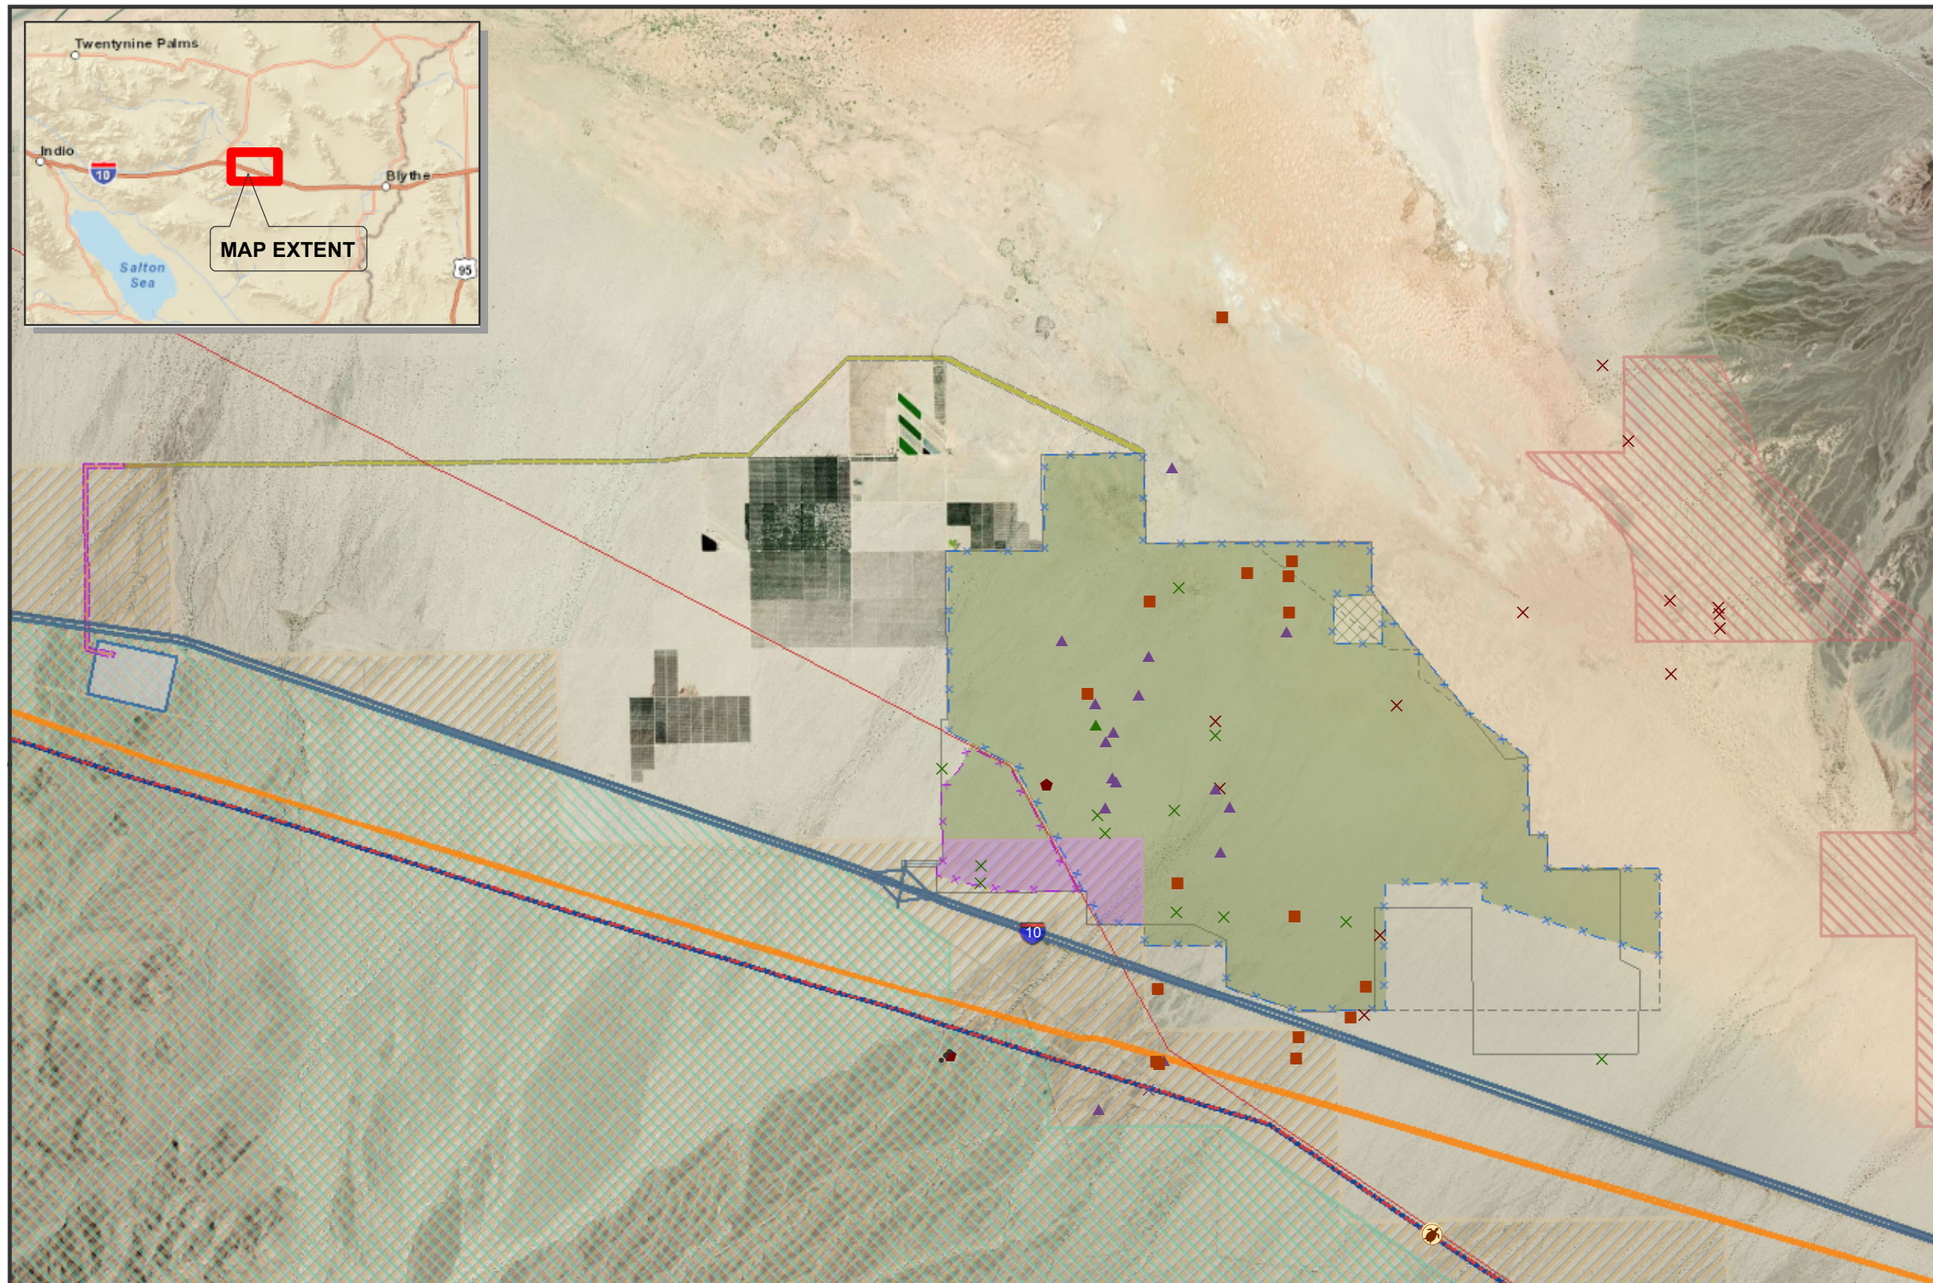

Legend

Existing Transmission
- 500kV - 525kV
- 220kV - 315kV
- SCE 161kV Line
- Natural Gas Pipeline

Palen Solar Project Site (Rev C-1000)
- Common / CLA (218.0 Acres)
- Solar Field Area (3575.5 Acres)

Palen Solar Gen-Tie Corridor (Rev C-1000)
- 120' Permitted Corridor (81.9 Acres)
- 120' Proposed Corridor (18.9 Acres)

Desert Tortoise Observations

Element
- Tortoise Sighting
- Tortoise Bone Fragments - Mineralized
- Tortoise Bone Fragments - Not Mineralized
- Tortoise Bone Fragments – Class 5
- Tortoise Burrow (Active) - Class 1
- Tortoise Burrow - Class 3
- Tortoise Burrow - Class 4 or 5
- Tortoise Pallet - Class 4 or 5
- Tortoise Scat - Class 2

DT Habitat (Project Site)
- Critical Habitat (203.2 Acres)
- Suitable Habitat (3590.3 Acres)

DT Habitat (Access Road)
- Critical Habitat (0.9 Acres)
- Suitable Habitat (0.1 Acres)

DT Habitat (Indirect Impacts)
- Private Land, Suitable Habitat (39.7 Acres)
- SCE 161kV Corridor, Critical Habitat (3.7 Acres)
- SCE 161kV Corridor, Suitable Habitat (8.0 Acres)

DT Habitat (Gen-Tie)
- Permitted Gen-Tie, Critical Habitat (2.7 Acres)
- Permitted Gen-Tie, Suitable Habitat (79.3 Acres)
- Proposed Gen-Tie, Critical Habitat (18.1 Acres)
- Proposed Gen-Tie, Suitable Habitat (0.8 Acres)

PSPP Approved Alternatives
- Alternative 2 Boundary (Dashed)
- Alternative 3 Boundary (Solid)
- SCE Red Bluff Substation
- USFWS Desert Tortoise Critical Habitat
- ACEC
- DWMA

BrightSource

BrightSource Energy, Inc.
1999 Harrison Street, Suite 2150
Oakland, CA 94612

Desert Tortoise Habitat

N W E S

Scale: 1:50,000

0 0.5 1 Miles

Scale correct when printed at 11x17
This map is for planning purposes only. The information herein was compiled from multiple sources and is considered to be reliable, however no representation is made concerning the accuracy of the data.

Project:	Palen Solar	
Date:	Feb 6, 2013	Figure No:
Revision:	C-1000	3
Prepared By:	NS	