


ATTACHMENT F
FIGURE 4.4-3 FAA COMPLIANCE

This page intentionally left blank.

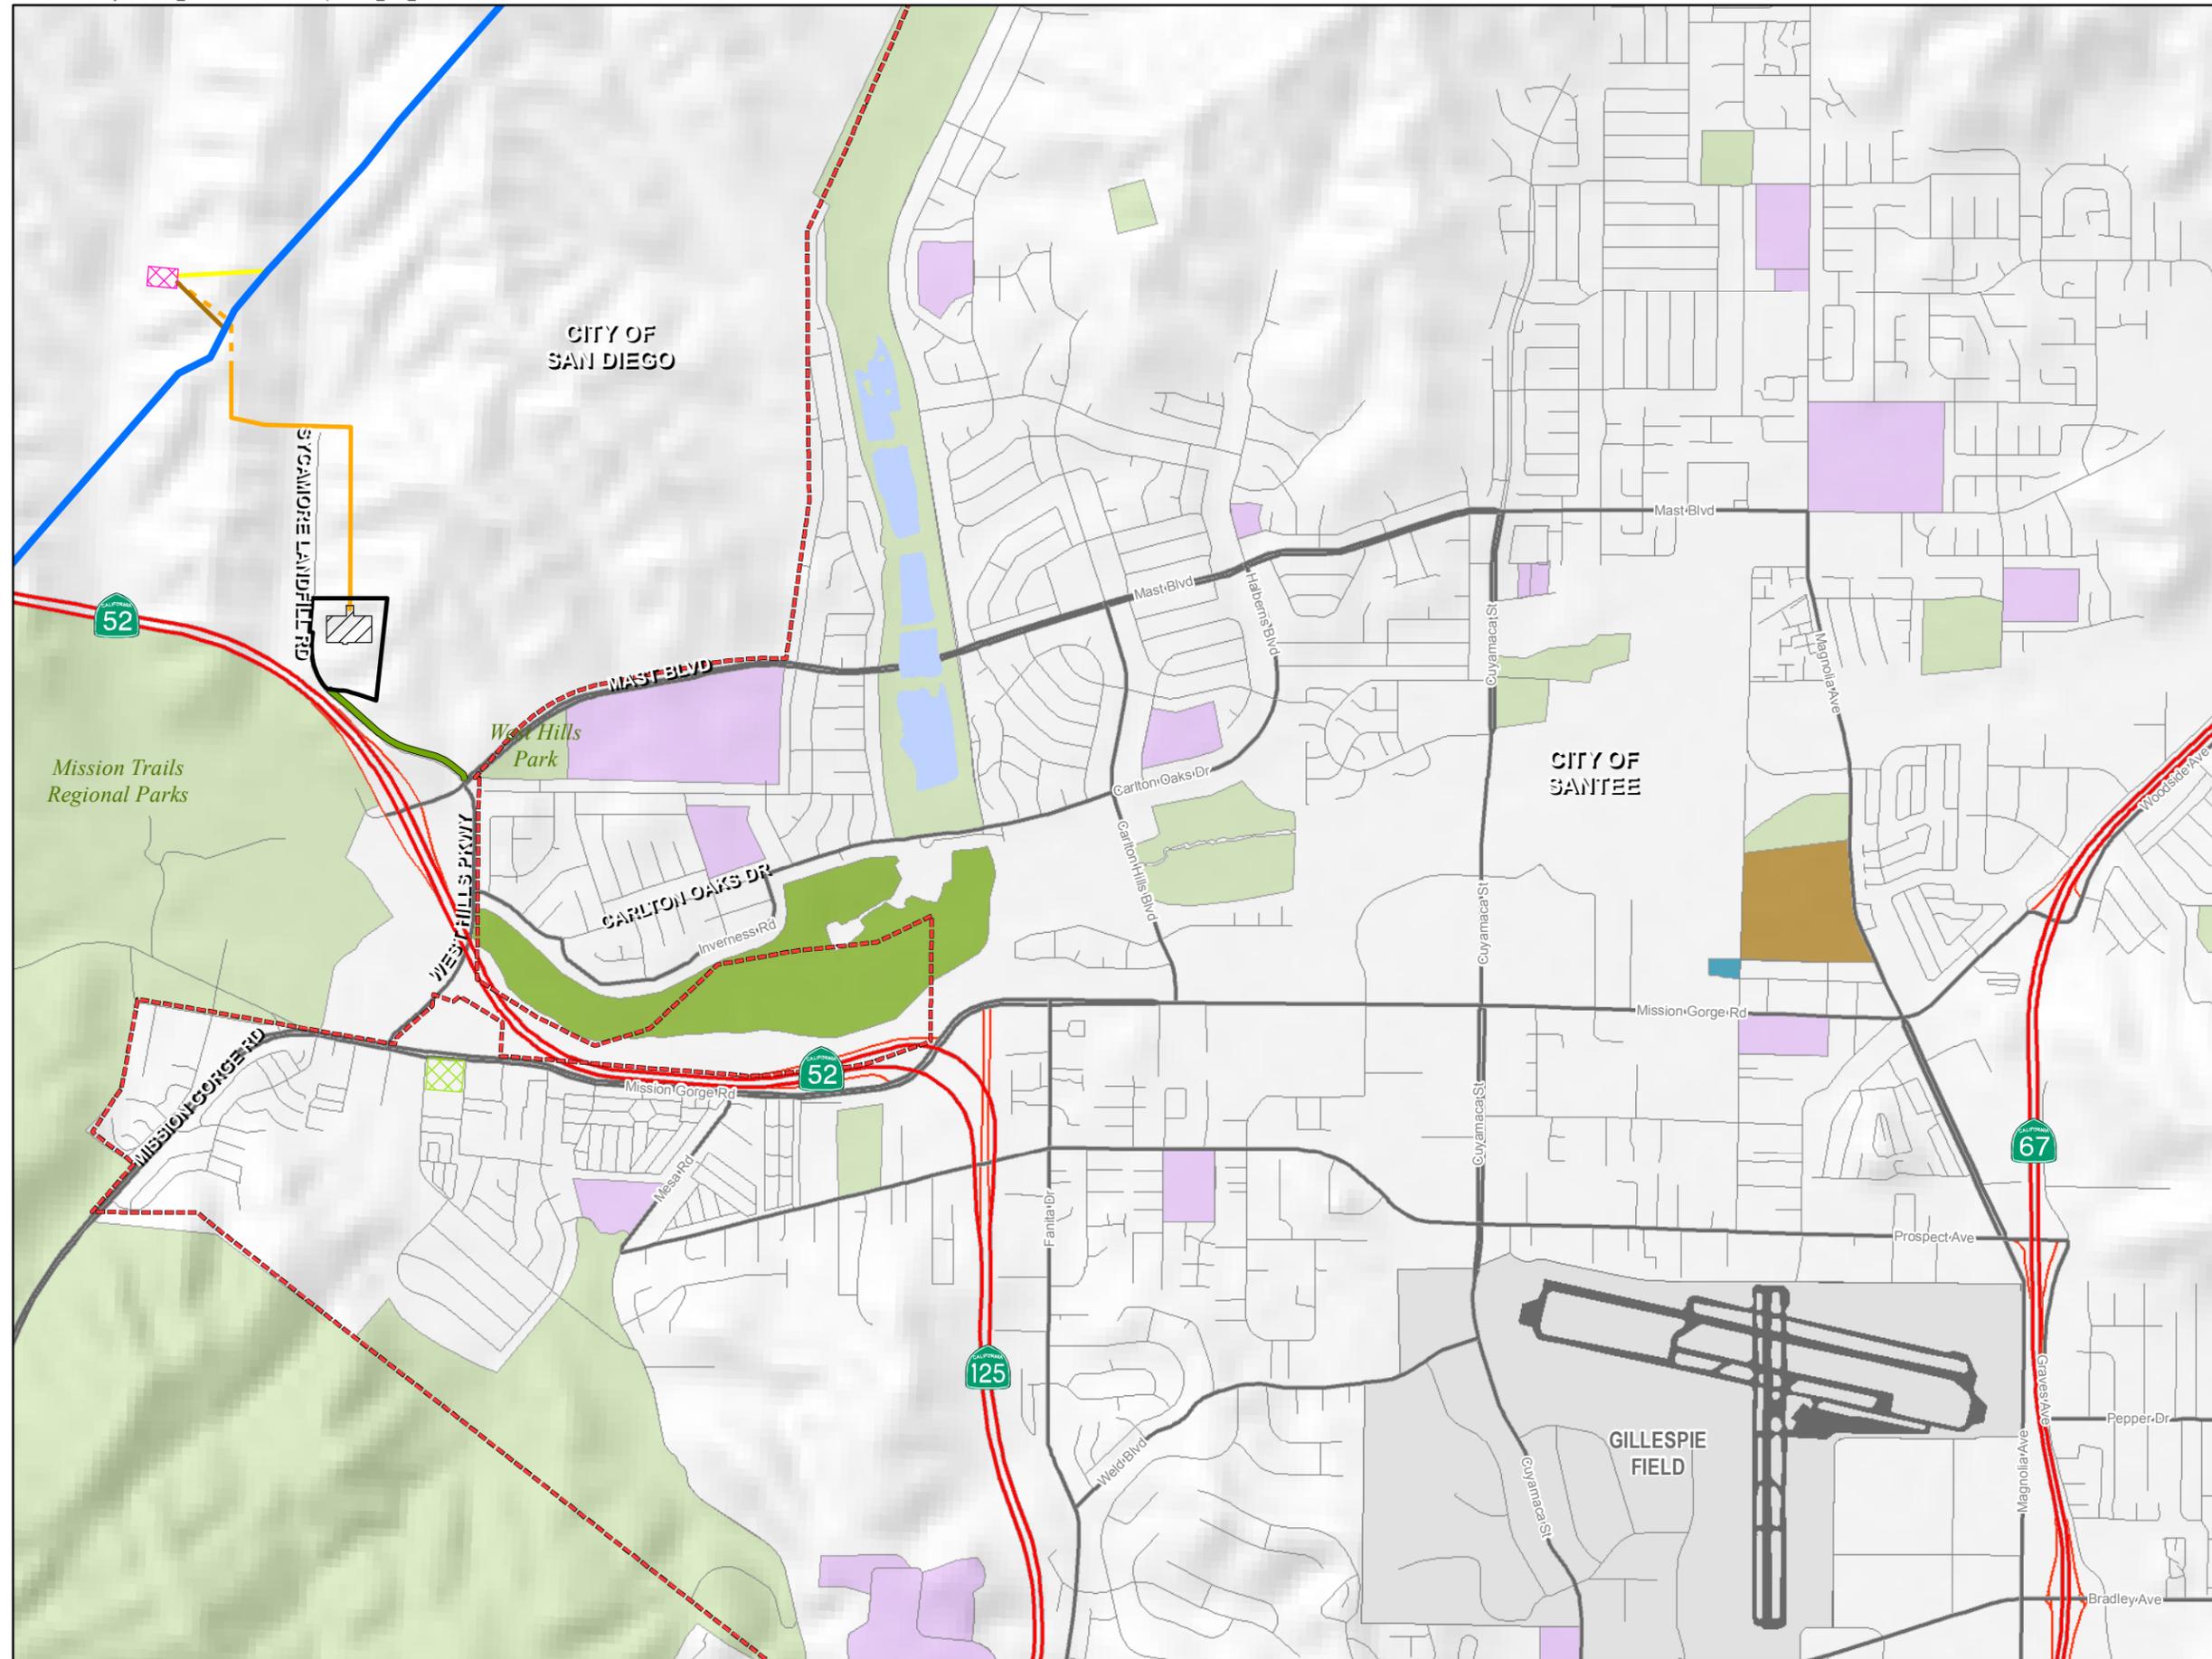

Project Components

- Project Boundary
- Plant Site
- Offsite Parking
- Overhead Gen Tie
- Underground Gen Tie
- North Loop Overhead Line
- South Loop Overhead Line
- Proposed Gas Lateral
- Existing SDG&E 230 kV T-Lines (2)
- Preliminary SDG&E Switchyard

Other Features

- City Boundary
- Hospital
- Detention Facility
- Schools
- Golf Course
- Local Parks
- Airport Boundary
- Airport Runways

QUAIL BRUSH GENERATION PROJECT

**FIGURE 4.4-3
FAA COMPLIANCE**

0 1,000 2,000 4,000
Feet

TETRA TECH EC, INC.