**NOISE - Figure 3**

Cosumnes Power Plant - Valve #190 Elk Grove Compressor Station - Noise Monitoring Location

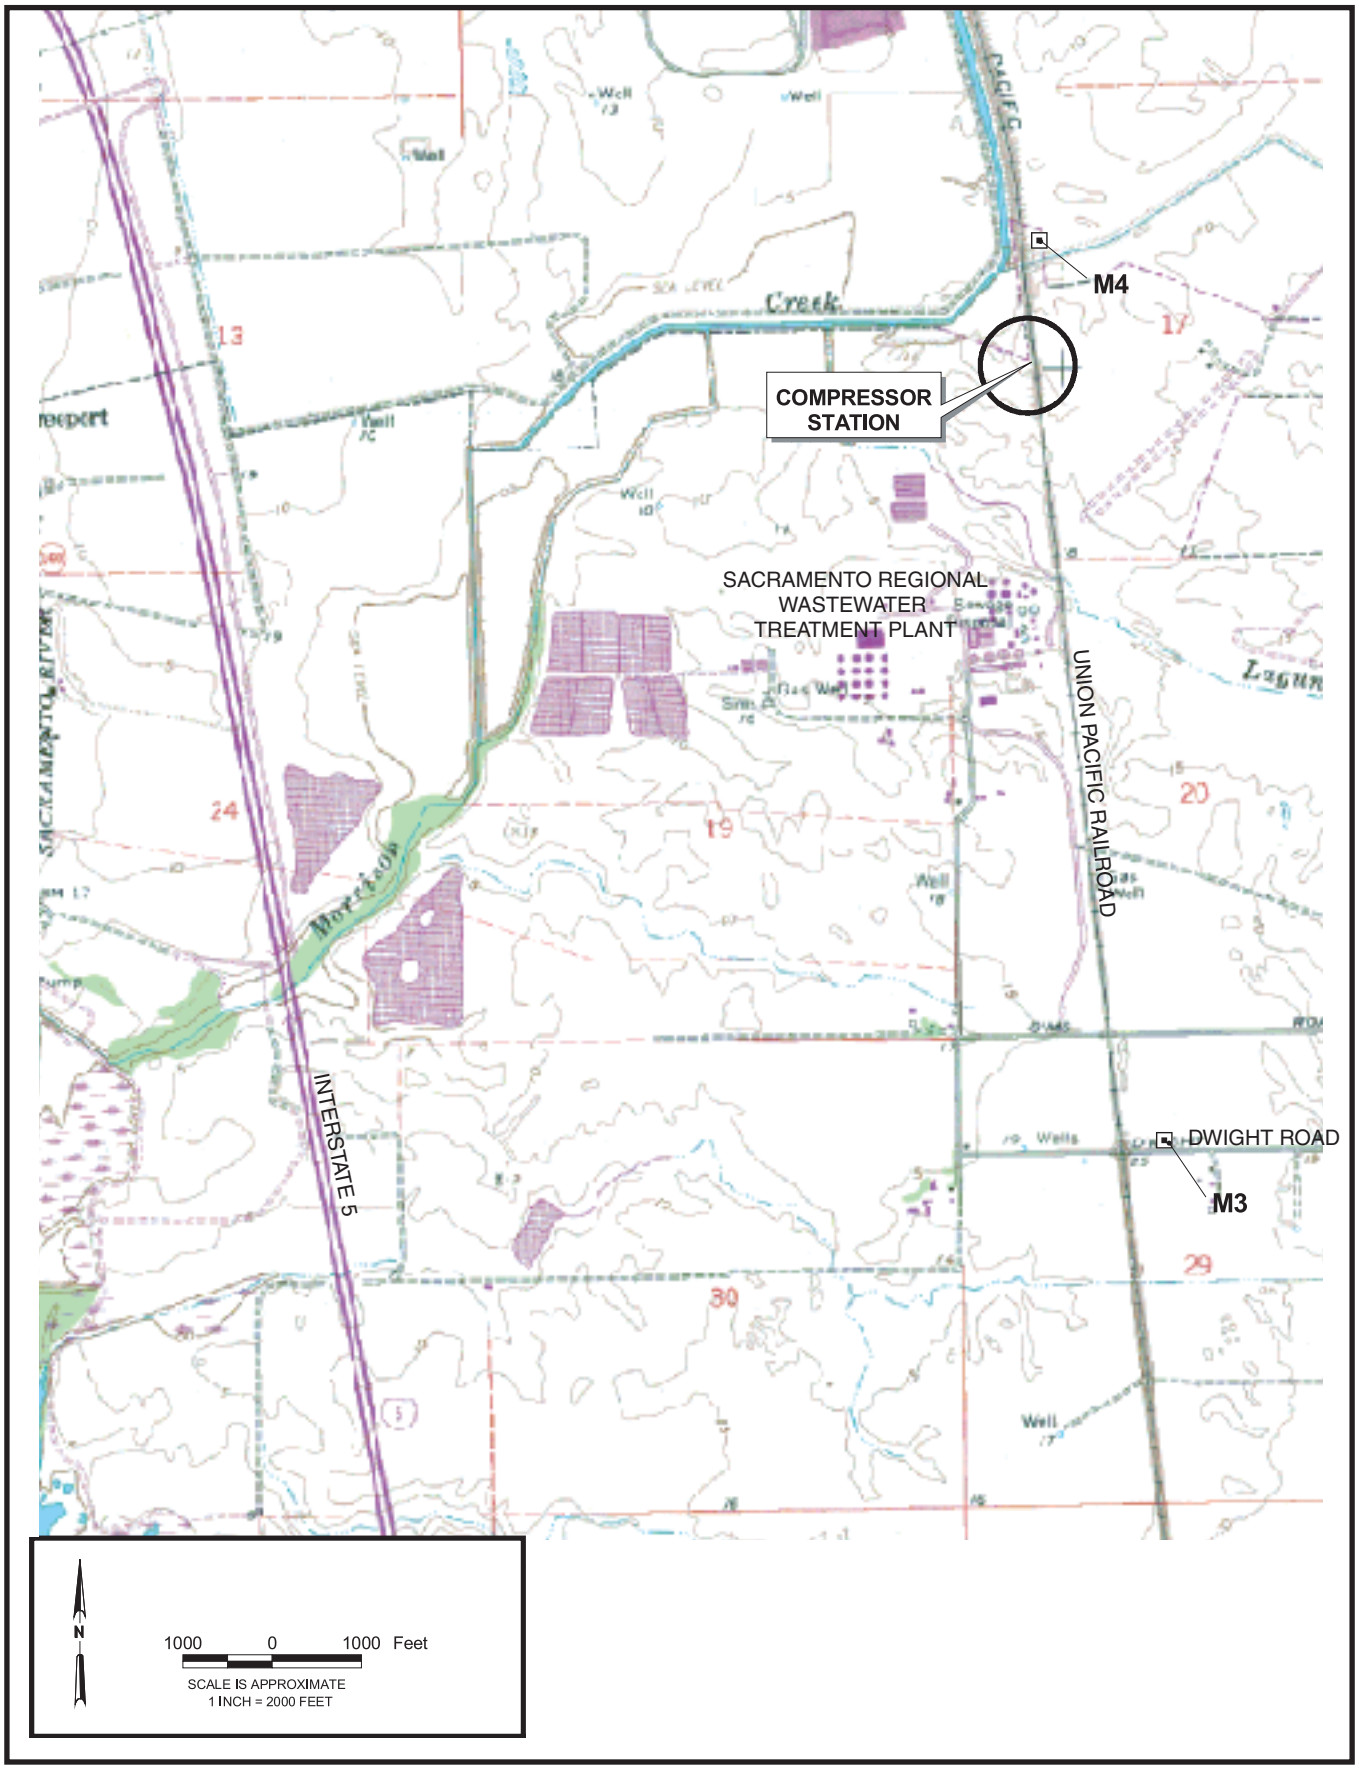


**CALIFORNIA ENERGY COMMISSION, SYSTEMS ASSESSMENT & FACILITIES SITING DIVISION, AUGUST 2002**

SOURCE: SMUD 2002p, Figure 2.5-2