


## Steam Turbine: Generator Model



gentpf

33809 GWFTREY3 13.8 1

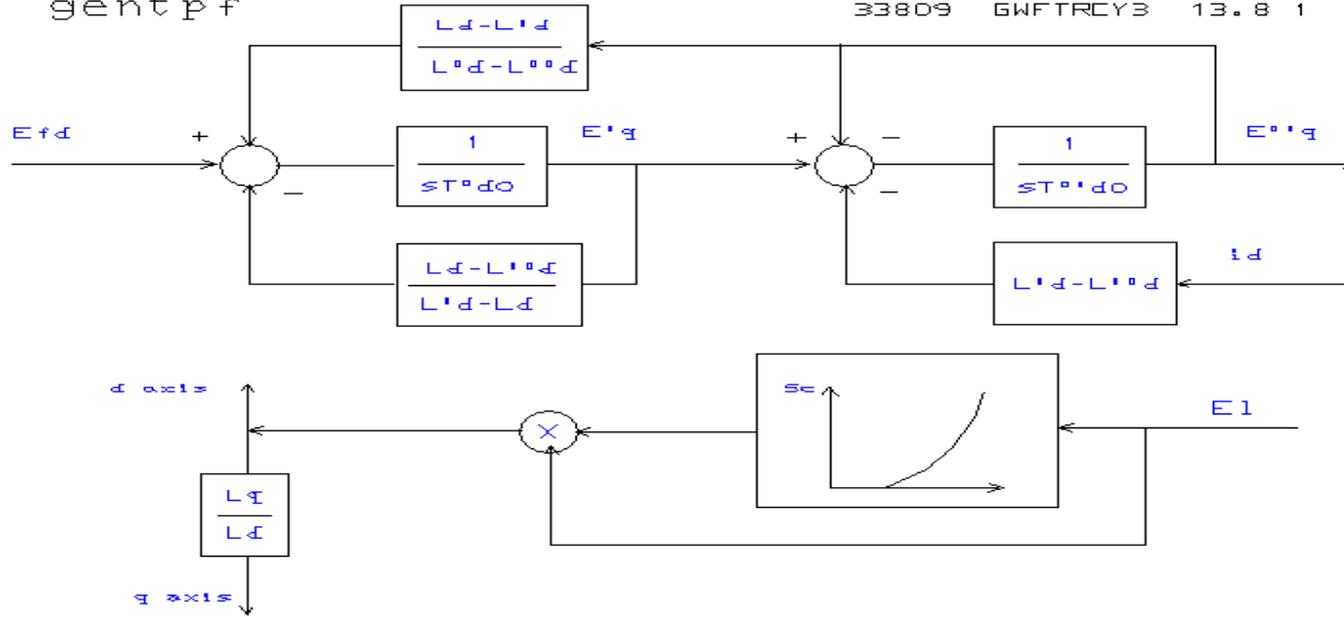

ld	1.8320	lpq	0.7000	tpdo	10.0000	s1	0.2075
lpd	0.2156	lppq	0.1654	tppdo	0.0350	s12	0.5010
lppd	0.1654	ll	0.1040	tppq	1.5000	h	4.1100
lq	1.5900	ra	0.0058	tppqo	0.1000	d	0.0000

<EDIT>

<PRINT>


END

MAX PAGES 15129134 2001

<QUIT>

## Steam Turbine: Excitation Model



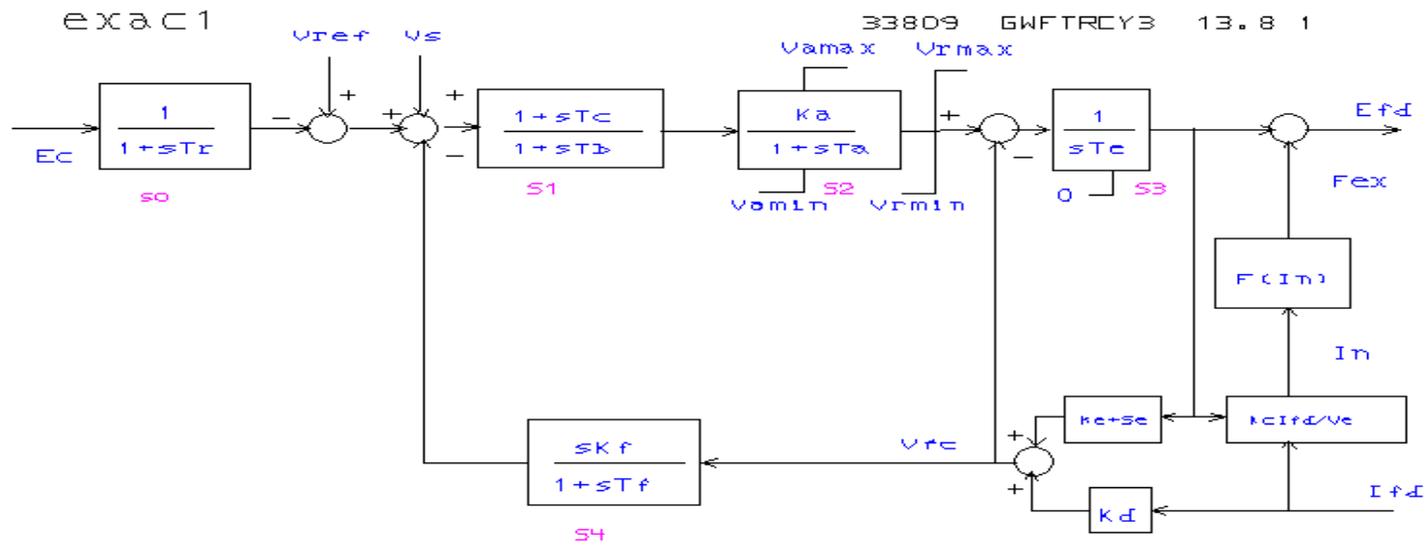

tr	0.0100	ta	0.0400	kf	0.0400	ke	0.8630
tb	0.0167	vamax	5.0000	tf	2.0000	e1	4.0000
tc	0.0100	vamin	-5.0000	kc	0.0000	se1	0.0100
ka	600.0000	te	0.1500	kd	0.1370	e2	5.0000

<EDIT>

<PRINT>

FW-75/MP Mod. Prog. 01 10/00103 0201


<QUIT>

## Steam Turbine: Governor Model



ieeeg1

33809 GWFTREY3 13.8 1

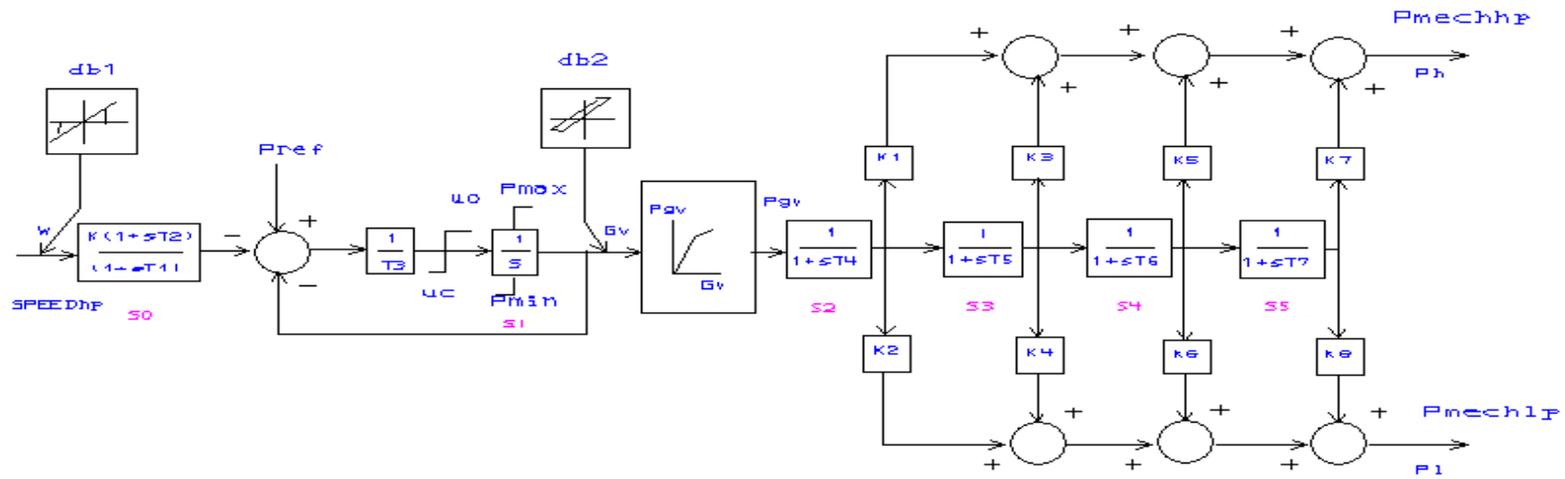

k	21.8300	uo	0.0600	t4	0.1000	k3	0.0000
t1	0.1500	uc	-0.1740	k1	1.0000	k4	0.0000
t2	0.0000	pmax	1.0000	k2	0.0000	t6	1.0000
t3	0.8700	pmin	0.0000	t5	1.0000	k5	0.0000

<EDIT>

<PRINT>

TR/TRANS

MSK Aug 01 15:00:28 EDD1

<QUIT>