2013 Title 24
Nonresidential ACM Reference Manual

Notes to Reviewers:

This draft of the Nonresidential ACM starts with the July PAC workshop. Tracked changes are relative to earlier versions of the 2013 ACM, which include both COMNET and 2008 NACM rules.

Grey Shaded	This is material from the California NACM that has not yet been integrated into the document.
NOTES	RED NOTES ARE USED TO IDENTIFY MATERIAL OR MARK PLACES WHERE MATERIAL HAS BEEN MOVED TO AN APPENDIX BUT NOT SIGNIFICANTLY CHANGED.
Magenta Highlight	Text indicates documentation requirement, to be moved to separate section per CEC requirements.

Questions? Comments? Contact John Arent at jarent@archenergy.com.

Change Log:

Version	Date	Change	Section(s)	Details	Google Code Issue
1.1	11/27/12	Process Loads – Gas and Electric	5.4.8	Separated Process Loads into Gas Process Loads and Electric Process Loads. Removed Process Location. Clarified definitions of terms.	
1.1	11/27/12	Envelope baseline	5.5	Clarified envelope baseline. Removed references to JA4.	
1.1	12/3/12	Roof Type	5.5.3	Clarified that Roof Type is not applicable (google tracker issue #75)	
1.1	12/4/12	Process Load	5.4.8	Separated Gas Process Load from Electric Process Load (issue #90)	
1.1	12/6/12	Fenestration Performance Input Restrictions	5.5.7	Clarify defaults when NFRC ratings are not available for site-built and field-fabricated	
1.1	12/6/12	Complete Building Method	5.4.3	See building descriptors *Lighting Classification Method* and *General Lighting Power*	
1.1	12/7/12	Conditioned,	2.3.2	Clarify that unconditioned	

		Indirectly Conditioned and Unconditioned Spaces		spaces and conditioned spaces may not be included in the same zone	
1.1	12/7/12	Boiler Part-Load Performance Curve	5.8.1	Do not allow user entry – prescribed curve. Possibly we will add different curves for different boiler types (natural draft, forced draft)	
1.1	12/10/12	Design Airflow	5.6.5.1	Clarified that airflow is based on 20F dT for exterior zones and 15F dT for interior zones; added definitions of exterior zone and interior zone	
1.1	12/7/12	Mass Walls	5.5.1	Clarified what layer-by-layer specification to be used for the baseline.	
1.1	12/10/12	Envelope Alterations	5.5.2, 5.5.3	Added clearer definitions of alterations baseline for building envelope	
1.1	12/11/12	Terminal Heating Control Type	5.6.5.1	Added description of Single Maximum control option	
1.1	12/11/12	Minimum skylight area in Fenestration Geometry	5.5.7	Added all criteria that trigger the minimum skylight area / daylit area requirement for large open spaces	
1.1	12/11/12	Floor Type	5.5.5	Updated floor type valid entries to be “not applicable” for new construction and either “mass” or “other” for existing buildings, alterations.	
1.1	12/11/12	Complete Building method “90% rule”	3, 5.4.3	The Standards have a rule that 90% of the building be of the same building type to use the CB method. The software will NOT enforce the rule at the rule set level, but will report an Exceptional Condition if the CB method is used. Also, the General Lighting LPD is based on the *total* floor area for the CB method.	
1.2	12/20/12	Max Outside Air Ratio	5.7.4.1	Clarified input restrictions, based on whether or not FDD is installed	Issue 131
1.2	12/20/12	Economizer Control Type	5.7.4.2	Added additional control types; see building descriptor. Modified Economizer High	Issue 132

				Enthalpy Lockout to include offset	
1.2	12/21/12	Heating Supply Air Temperature by Stage definition typo (SCE)	5.7.5.2	Fixed typo; building descriptor references supply air temperature	Issue 134
1.2	12/21/12	Western Cooling Challenge evap cooling systems	5.7.5.4	Added complete new section to define all relevant building descriptor input restrictions	n/a
1.2	12/21/12	Supply Fan Static Pressure baseline	5.7.3.2	Removed the “not applicable” text and remove text that refers to Supply Fan Brake Horsepower.	Issue 135
1.2	1/4/13	Sensible Cooling Capacity by Stage Definition	5.7.5.2	Modified definition to clarify that this is the fraction of the total sensible cooling capacity, not the sensible heat ratio	Issue 136
1.2	1/4/13	Fan Part-Flow Power Curve	5.7.3.2	PowerMin term in equation should be defined as “Minimum fan power ratio”	Issue 137
1.3	1/8/13	Control System Type	5.6.1	Move building descriptor to section 5.7	Issue 78
1.3	1/8/13	Specification Method	5.5.2	Added C-factor and F-factor to available specification methods	Issue 116
1.3	1/9/13	Mounting Height Above Floor	5.4.3	Added building descriptor for mounting height above floor and rules for adjusting wall display power allowance in tailored method	Issue 130
1.3	1/14/13	Heating Supply Air Temperature by Stage	5.7.5.2	Changed reset example to “-10” from “10”; changed cooling to heating to match intent	Issue 134, Comment 2
1.3	1/21/13	Supply Fan Type	5.8.3	Updated baseline to be not applicable since baseline is a variable-speed fan, not a two-speed fan Variable-speed fan when single zone VAV is required	n/a
1.3	1/25/13	Combining spaces into Zones	2.3.3	Updated rules for combining spaces based on discussions	Not sure
1.3	1/25/13	Tailored method separate allowances for wall display, floor display, ornamental	5.4.3	Added three new building descriptors to specify each custom allowance	Issue 128
1.3	1/25/13	General Lighting	5.4.3	General Lighting Exceptional	n/a

		Allowance Exceptions		Power White Board Length	
1.4	2/5/13	Supply Fan Brake Horsepower	5.7.3.2, 5.7.3.3, 5.7.3.4	Added rule restricting the proposed supply fan bhp to be 95% of the motor (nameplate) horsepower. This requires a NEW INPUT for motor horsepower. Recommended by Taylor Engineering	JS comment
1.4	2/5/13	Replaced ARI designation with AHRI	5.7	Updated acronym due to industry change	Issue #140
1.4	2/7/13	Clarified Hot Water Pump Power baseline	5.8.5	Added 19 W/gpm baseline for hot water pumps	n/a
1.4	2/12/13	Lighting Schedules	5.4.3	Modified definition to remove allowance of different schedules for different lighting circuits for compliance	h/a
1.4	2/12/13	Design Day Schedules	2.6.2	Reference Appendix 5.4B schedules to be used in design day sizing runs	n/a
1.4	2/12/13	Condenser Type	5.7.5.2	Fixed specification for built-up systems	n/a
1.4	2/15/13	Chiller Type	5.8.2	Revised chiller type list: Reciprocating Screw Scroll Centrifugal Direct Fired Single Effect Absorption Direct Fired Double Effect Absorption Indirect Fired Double Effect Absorption	Issue #156
1.5	2/19/13	Supply Fan Low Speed Ratio, Supply Fan Low Power Ratio	5.7.5.2	Revised baseline to be consistent with VSD supply fan; power ratio comes from “Any Fan with VSD” curve	Issue #148
1.5	2/25/13	Added new building descriptors for FPFC	5.7.5.6	Added new building descriptors and set baseline fan power.	n/a
1.5	3/6/13	Supply Fan Brake	5.7.3.2	Revised rule that modifies	JS comment

		Horsepower		the proposed supply bhp to be based on user-entered bhp and MHP	
1.5	3/6/13	Return/Relief Fans	5.7.3.3	Relief fan is only in standard design if economizer is present.	JS comment
1.5	3/11/13	Heating Source	5.7.6.1	Revised System 1 (PTAC) heating source to Hot Water	Issue 144
1.5	3/15/13	Condenser Flow Type	5.7.5.2	Changed from Fixed to Two-Position	JS comment
1.5	3/15/13	Pre-heat Coil Capacity	5.7.6.2	Changed baseline from Same as Proposed to Not applicable	JS comment
1.5	3/15/13	Outside air control method	5.7.4.1	Changed baseline from Same as Proposed to Average Flow	JS comment
1.5	3/15/13	Boiler Control	5.8	Changed hot water return temperature from 130F to 140F (more typical of non-condensing boilers)	JS comment
1.5	3/15/13	Unmet load hours	Chapter 2, Chapter 5	Changed definition of unmet load hour to be by zone, and modified requirement that no zone may have more than 150 UMLH	team meeting outcome
1.5	3/15/13	Chiller Minimum Unloading Ratio	5.8.2	Constrain proposed design input to be at least 10%	JS comment
1.5	3/15/13	Duct Leakage requirements	5.7.5.2	Removed exception for high-rise residential and hotel/motel guestrooms. Either the duct leakage baseline applies or it doesn't, but shouldn't be "Same as Proposed"	JS comment
1.6	3/27/13	Return Air Path	5.7.3.3	Baseline for systems 3-11 is always ducted return (not same as proposed).	Issue #20
1.6	3/27/13	Fenestration Geometry (skylight area in baseline)	5.5.7	Modified baseline to be max of 10% for buildings with atria > 55 ft and 5% for other buildings (numbers were swapped)	Issue #85
1.6	3/27/13	Fenestration Geometry, Fenestration Construction	5.5.7	Added Standard Design rules for additions and alterations	n/a
1.6	3/27/13	Custom Lighting Power and related	5.3.2	Modified Custom Lighting Power definition to cover only	Issue #175

		building descriptors		tailored lighting; clarified rules for summing individual tailored lighting components; added very valuable display case to tailored method, added area definitions to area category exceptions	
1.6	3/27/13	Night-Cycle HVAC Fan Control	5.7.2.1	Constrain proposed and baseline to Cycle on Any Zone	Issue #171
1.6	3/27/13	Total Cooling Capacity Sensible Cooling Capacity	5.7.5.1	Changed rule for converting gross cooling capacity to net cooling capacity; clarified inputs to be gross capacity	Issue #142
1.6	4/1/13	Reference Method Updates	3	Updated Ruleset Implementation tests and Software Sensitivity Tests	n/a
1.6	4/1/13	**SYSTEM MAP**	5.7	New, simpler system map	n/a
1.6	4/1/13	Ground reflectance	5.2.3	Clarified rule with fixed inputs based on climate zone	n/a
1.6	4/1/13	Return/Relief Air Rated Capacity	5.7.3.2	Updated baseline relief cfm to be based on supply cfm, minus exhaust cfm and minus 0.05 cfm/sf	JS issue #76
1.6	4/1/13	Exhaust Fan Design Static Pressure	5.7.3.4	Removed input restriction	JS issue #81
1.6	4/1/13	Garage Exhaust Fan Control Method	5.7.3.5	Fixed input restriction above 10,000 cfm to be “CO Control”	JS issue #84
1.6	4/1/13	Maximum Outside Air Ratio, Economizer Integration Level	5.7.4	Added logic for partially integrated economizer – workaround sets maximum outside air ratio to 0.85	n/a
1.7	4/3/13	Duct Surface Area, Duct Surface Area Outdoors, Duct Insulation Level	5.7.5.2	Removed these building descriptors; not required for ducts in unconditioned space	n/a
1.7	4/3/13	Natural Ventilation	5.3.6	Clarified how natural ventilation can be used; removed Natural Ventilation Schedule	Issue #77
1.7	4/4/13	Hot Water Supply Temperature Reset	5.8.1	Recommended change to be not allowed for non-condensing boiler (SDD)	JS issue #131
1.7	4/4/13	Chilled Water Supply Temperature Reset	5.8.1	Added language for adjustment of CHW return temp when CHW supply temp is adjusted	JS issue #138

1.7	4/4/13	Cooling Tower Capacity Control Cooling Tower Low-Speed Airflow Ratio	5.8.3	Removed motor size condition for VSD fan baseline; second descriptor is not applicable	JS issue #142,143
1.7	4/4/13	Overriding Schedules	5.6.1, 5.7.2.2	Modified proposed design input restrictions for space temperature schedule, cooling, heating and AHU schedule to be prescribed. No overrides.	Issue #170
1.7	4/5/13	Receptacle Loads and Schedules	5.4.6	Change to Prescribed values from Appendix 5.4A. No overrides.	n/a
1.7	4/5/13	Receptacle Loads, Gas Power, Process Loads	5.4.6, 5.4.9	Prescribed latent fraction and radiative/convective split for receptacle loads, gas power, and now allow user inputs for latent and sensible radiative/convective split for process loads	Issue #169
1.7	4/5/13	Boiler Heat Loss	5.8.2	Removed Boiler Heat Loss term – always 2% for electric and 0% for gas	Issue #145
1.7	4/5/13	Fenestration Geometry	5.5.7	Clarified skylight area limits for buildings with atria	Issue #85
1.7	4/5/13	Water Heating Peak Use	5.9.1	Cleaned up language, only allow input in gph/person	Issue #45
1.7	4/5/13	Outdoor Air – Ventilation Control	5.6.5.4	Some clarifications to min airflow for labs	JS issue

Table of Contents

1. Overview **1-11-1**
1.1 Purpose 1-11-1
1.2 Modeling Assumptions 1-11-1
1.3 Scope 1-11-1
1.4 Organization 1-11-1
1.5 California ACM 1-2
1.6 Compliance 1-31-3
1.6.1 Type of Project Submittal 1-31-3
1.6.2 Scope of Compliance Calculations 1-31-3
1.6.3 Climate Zones 1-51-5
1.6.4 Time Dependent Valuation 1-51-5
1.7 Approval Process 1-51-5
1.7.1 Application Checklist 1-51-5
1.7.2 Types of Approval 1-61-6
1.7.3 Challenges 1-71-7
1.7.4 Decertification of Compliance Software Programs 1-71-7
1.8 Vendor Requirements 1-91-9
1.8.1 Availability to Commission 1-91-9
1.8.2 Enforcement Agency Support 1-91-9
1.8.3 User Support 1-91-9
1.8.4 Compliance Software Vendor Demonstration 1-91-9

2. General Modeling Procedures **2-12-1**
2.1 General Requirements for Data from the User 2-12-1
2.1.1 General 2-12-1
2.1.2 Building Envelope Descriptions 2-12-1
2.1.3 Space Use Classification 2-12-1
2.1.4 Treatment of Descriptors Not Fully Addressed By This Document 2-12-1
2.2 Thermal Zones, HVAC Zones and Space Functions 2-2
2.2.1 Definitions 2-2
2.3 Software Modeling Requirements for Zones 2-32-3
2.3.1 Required Zone Modeling Capabilities 2-32-3
2.3.2 Modeling Requirements for Unconditioned Spaces 2-42-4
2.3.3 Space Use Classification Considerations 2-42-4
2.4 Unmet Load Hours 2-52-4
2.5 Calculation Procedures 2-72-6
2.6 HVAC Capacity Requirements and Sizing 2-92-8
2.6.1 Specifying HVAC Capacities for the Proposed Design 2-92-8
2.6.2 Sizing Equipment in the Standard Design 2-92-8
2.7 Ventilation Requirements 2-102-9

3. Software Requirements **3-13-1**
3.1 General Requirements 3-373-1
3.1.1 Scope 3-373-1
3.1.2 Calculation Methods 3-373-1
3.1.3 Climate Data 3-383-2
3.1.5 Time Dependent Valued (TDV) Energy 3-383-2
3.1.6 Thermal Mass 3-383-2
3.1.7 Modeling Space Temperature 3-383-2
3.1.8 Heat Transfer between Thermal zones 3-383-3
3.1.9 Control and Operating Schedules 3-393-3
3.1.10 Loads Calculation 3-393-3
3.1.11 Systems Simulation 3-403-4
3.1.12 Managing User Input 3-423-6

3.2 Special Documentation and Reporting Requirements 3-433-8
3.2.1 Building Envelope 3-433-8
3.2.2 Interior Lighting 3-443-8
3.2.3 Exterior Lighting 3-453-9
3.2.4 Infiltration Data 3-453-9
3.2.5 HVAC Exceptional Conditions 3-453-9
3.3 ASHRAE Standard 140-2007 Tests 3-473-11
3.4 Reference Method Tests 3-473-11
3.4.1 Compliance Margin Tests 3-473-11
3.4.2 Ruleset Implementation Tests 3-633-28
3.5 California Calculation Procedures 3-713-35

4. Content and Format of Standard Reports 4-14-1
4.1 Overview 4-14-1
4.1.1 Content 4-14-1
4.1.2 Format 4-14-1
4.2 Electronic Format: XML 4-14-1
4.3 Hard Copy Format: PDF 4-14-1

5. Building Descriptors Reference 5-15-1
5.1 Overview 5-15-1
5.1.1 Definition of Building Descriptors 5-15-1
5.1.2 HVAC System Map 5-2
5.1.3 Organization of Information 5-55-4
5.2 Project Data 5-65-4
5.2.1 General Information 5-65-4
5.2.2 Building Model Classification 5-75-6
5.2.3 Geographic and Climate Data 5-85-7
5.2.4 Site Characteristics 5-125-10
5.2.5 Calendar 5-125-10
5.3 Thermal Zones 5-135-11
5.3.1 General Information 5-135-11
5.3.2 Interior Lighting 5-145-12
5.3.3 Receptacle Loads 5-155-13
5.3.4 Occupants 5-155-13
5.3.5 Infiltration 5-155-13
5.3.6 Natural Ventilation 5-175-15
5.3.7 Thermal Mass 5-185-16
5.4 Space Uses 5-195-17
General Information 5-195-17
5.4.1 5-195-17
5.4.2 Occupants 5-205-18
5.4.3 Interior Lighting 5-225-19
5.4.4 Daylighting Control 5-335-25
5.4.5 Receptacle Loads 5-415-32
5.4.6 Commercial Refrigeration Equipment 5-425-33
5.4.7 Elevators, Escalators and Moving Walkways 5-475-38
5.4.8 Process, Gas 5-495-40
5.5 Building Envelope Data 5-535-43
5.5.1 Materials 5-535-43
5.5.2 Construction Assemblies 5-555-45
5.5.3 Roofs 5-575-47
5.5.4 Exterior Walls 5-605-49
5.5.5 Exterior Floors 5-655-50
5.5.6 Doors 5-675-52
5.5.7 Fenestration 5-695-53
5.5.8 Below Grade Walls 5-785-61

5.5.9 Slab Floors in Contact with Ground ..... 5-79~~5-62~~
5.5.10 Heat Transfer between Thermal zones ..... 5-82~~5-64~~
5.6 HVAC Zone Level Systems 5-82~~5-65~~
5.6.1 Space Temperature Control ..... 5-83~~5-65~~
5.6.2 Terminal Device Data ..... 5-84~~5-66~~
5.6.3 Terminal Heating ..... 5-85~~5-67~~
5.6.4 Baseboard Heat ..... 5-87~~5-69~~
5.6.5 Zone Level Air Flow ..... 5-87~~5-69~~
5.7 HVAC Secondary Systems 5-95~~5-76~~
5.7.1 Basic System Information ..... 5-99~~5-80~~
5.7.2 System Controls ..... 5-101~~5-82~~
5.7.3 Fan Systems ..... 5-108~~5-88~~
5.7.4 Outdoor Air Controls and Economizers ..... 5-124~~5-101~~
5.7.5 Cooling Systems ..... 5-127~~5-104~~
5.7.6 Heating Systems ..... 5-155~~5-128~~
5.7.7 Humidity Controls and Devices ..... 5-166~~5-138~~
5.8 HVAC Primary Systems 5-169~~5-142~~
5.8.1 Boilers ..... 5-169~~5-142~~
5.8.2 Chillers ..... 5-174~~5-146~~
5.8.3 Cooling Towers ..... 5-184~~5-156~~
5.8.4 Water-side Economizers ..... 5-190~~5-162~~
5.8.5 Pumps ..... 5-192~~5-164~~
5.8.6 Thermal Storage ..... 5-197~~5-168~~
5.8.7 Heat Recovery Equipment ..... 5-200~~5-172~~
5.8.8 Plant Management ..... 5-201~~5-172~~
5.9 Miscellaneous Energy Uses 5-202~~5-174~~
5.9.1 Water Heating ..... 5-202~~5-174~~
5.9.2 Exterior Lighting ..... 5-212~~5-183~~
5.9.3 Swimming Pools ..... 5-212~~5-184~~
5.9.4 Other Electricity Use ..... 5-212~~5-184~~
5.9.5 Other Gas Use ..... 5-213~~5-184~~
5.10 On-Site Power Generation 5-214~~5-185~~
5.11 Common Data Structures 5-214~~5-185~~
5.11.1 Schedule ..... 5-214~~5-185~~
5.11.2 Holidays ..... 5-214~~5-186~~
5.11.3 Surface Geometry ..... 5-215~~5-186~~
5.11.4 Opening Geometry ..... 5-215~~5-186~~
5.11.5 Opening Shade ..... 5-215~~5-186~~
5.11.6 Construction Assembly ..... 5-215~~5-186~~
5.11.7 Fenestration Construction ..... 5-215~~5-186~~
5.11.8 Material ..... 5-215~~5-186~~
5.11.9 Slab Construction ..... 5-216~~5-187~~
5.11.10 Exterior Surface Properties ..... 5-216~~5-187~~
5.11.11 Occupant Heat Rate ..... 5-216~~5-187~~
5.11.12 Furniture and Contents ..... 5-216~~5-187~~
5.11.13 Reference Position in a Space ..... 5-216~~5-187~~
5.11.14 Two Dimensional Curve ..... 5-216~~5-187~~
5.11.15 Three Dimensional Curve ..... 5-216~~5-187~~
5.11.16 Temperature Reset Schedule ..... 5-216~~5-188~~

Table of Figures and Tables

Figure 1 – Hierarchy of Space Functions, HVAC Zones and Thermal Zones ..... 2-3~~2-3~~

Figure 2 – Calculation Process for Title 24 Compliance and Reach ..... 2-8~~2-7~~
Figure 3 – Information Flow ..... 5-1~~5-1~~
Figure 4 – Example Stepped Daylight Control ..... 5-39~~5-30~~
Figure 5 – Example Dimming Daylight Control ..... 5-39~~5-31~~
Figure 6 – Dual Maximum Control Sequence ..... 5-89~~5-70~~
Figure 7 – SAT Cooling Setpoint Reset based on Outdoor Air Temperature (OAT) ..... 5-105~~5-85~~
Figure 8 – Example of SAT heating setpoint reset based on outdoor air temperature (OAT). ..... 5-107~~5-87~~
Table 1: Compliance Options ..... 1-4~~1-4~~
Table 2 – Input Types and Restrictions ..... 3-42~~3-6~~
Table 3-Climate Zones Tested ..... 3-49~~3-13~~
Table 4 – Baseline Runs for Test Cases ..... 3-59~~3-24~~
Table 5 – HVAC System Map 5-2
Table 6 – HVAC System Descriptions 5-2
Table 7- Lighting Specification ..... 5-23~~5-20~~
Table 8 – Light Heat Gain Parameters for Typical Operating Conditions ..... 5-32~~5-24~~
Table 9 – USDOE Requirements for Refrigerated Casework (kWh/d) ..... 5-43~~5-34~~
Table 10 – Default Power for Walk-In Refrigerators and Freezers (W/ft²) ..... 5-44~~5-35~~
Table 11 – Unit Energy Consumption Data for Elevators, Escalators and Moving Walkways ..... 5-48~~5-39~~
Table 12 – Standard Design Building Below-Grade Wall Construction Assemblies ..... 5-79~~5-62~~
Table 14 – Baseline Building Terminal Heat Type ..... 5-86~~5-68~~
Table 16 – System #3 and System #4 Descriptions ..... 5-96~~5-77~~
Table 17 – System #5 Description ..... 5-97~~5-78~~
Table 18 – System #6 Description ..... 5-97~~5-78~~
Table 19 – System #7,8 Description ..... 5-98~~5-79~~
Table 20 – System #9 Description ..... 5-98~~5-79~~
Table 21 – System #10 Description ..... 5-98~~5-79~~
Table 22 – System #11 Description ..... 5-99~~5-80~~
Table 23 – Baseline Building System Type ..... 5-100~~5-81~~
Table 24 – Building Descriptor Applicability for Fan Systems ..... 5-108~~5-88~~
Table 25 – Baseline Building Fan Control Method ..... 5-110~~5-90~~
Table 26 – Minimum Nominal Efficiency for Electric Motors (%) ..... 5-113~~5-92~~
Table 27 – Fan Curve Default Values ..... 5-114~~5-93~~
Table 28 – Cooling Source for Baseline Building System ..... 5-128~~5-104~~
Table 29 –Cooling Capacity Curve Coefficients ..... 5-131~~5-107~~
Table 30 – Default Coil Bypass Factors ..... 5-131~~5-107~~
Table 31 – Coil Bypass Factor Airflow Adjustment Factor ..... 5-133~~5-109~~
Table 32 – Coil Bypass Factor Temperature Adjustment Factor ..... 5-133~~5-109~~
Table 33 – Coil Bypass Factor Part Load Adjustment Factor ..... 5-133~~5-109~~
Table 34 – Cooling System Coefficients for EIR-FT ..... 5-136~~5-111~~
Table 35 – Cooling System Coefficients for EIR-FPLR ..... 5-139~~5-114~~
Table 36 – Cooling System Coefficients for Part-Load Factor (PLF) Correlation (EnergyPlus) ..... 5-139~~5-114~~
Table 37 – Duct Leakage Factors ..... 5-143~~5-118~~
Table 38 – Baseline Building Condenser Type ..... 5-146~~5-121~~
Table 39 – Part Load Curve Coefficients – Evaporative Cooler Effectiveness ..... 5-148~~5-123~~
Table 40 – Heating Source for Baseline Building ..... 5-156~~5-128~~
Table 41 – Furnace Efficiency Curve Coefficients ..... 5-158~~5-131~~
Table 42 – Heat Pump Capacity Adjustment Curves (CAP-FT) ..... 5-161~~5-133~~
Table 43 – Heat Pump Heating Efficiency Adjustment Curves ..... 5-162~~5-135~~
Table 44 – Liquid Desiccant Unit Performance Curves ..... 5-168~~5-141~~
Table 45 – Default Minimum Unloading Ratios ..... 5-173~~5-145~~
Table 46 – Type and Number of Chillers ..... 5-175~~5-147~~
Table 47 – Default Minimum Unloading Ratios ..... 5-177~~5-148~~
Table 48 – Default Capacity Coefficients – Electric Air-Cooled Chillers ..... 5-178~~5-150~~
Table 49 – Default Capacity Coefficients – Electric Water-Cooled Chillers ..... 5-178~~5-150~~
Table 50 – Default Capacity Coefficients – Fuel- & Steam-Source Water-Cooled Chillers ..... 5-178~~5-150~~
Table 51 – Default Efficiency EIR-FT Coefficients – Air-Cooled Chillers ..... 5-180~~5-152~~

Table 52 – Default Efficiency EIR-FT Coefficients – Water-Cooled Chillers 5-1805-152
Table 53 – Default Efficiency EIR-FPLR Coefficients – Air-Cooled Chillers..... 5-1805-152
Table 54 – Default Efficiency EIR-FPLR Coefficients – Water-Cooled Chillers..... 5-1805-152
Table 55 – Default FIR-FPLR coefficients – Fuel- & Steam-Source Water-Cooled Absorption Chillers.... 5-1825-154
Table 56 – Default FIR-FPLR coefficients – Engine Driven Chillers 5-1825-154
Table 57 – Default FIR-FT coefficients – Fuel- & Steam-Source Water-Cooled Absorption Chillers .. 5-1825-154
Table 58 – Default FIR-FT coefficients – Engine Driven Chillers..... 5-1825-154
Table 59 – Default Capacity Coefficients – Cooling Towers..... 5-1875-159
Table 60 – Default Efficiency TWR-FAN-FPLR Coefficients – VSD on Cooling Tower Fan 5-1895-161
Table 61 – Default Part-Load CIRC-PUMP-FPLR Coefficients – VSD on Circulation Pump 5-1975-168

1. Overview

1.1 Purpose

This document is the California Nonresidential ACM Reference Manual. It explains the requirements for approval of nonresidential compliance and Compliance Software in California. Approved software is used for two purposes: to demonstrate minimum Compliance with the California energy efficiency standards and to achieve beyond-code energy performance needed to qualify for Reach standards. The procedures and processes described in this manual are designed to provide consistency and accuracy while preserving the integrity of the process of Compliance and Reach. This manual addresses software for nonresidential buildings, hotels & motels, and high-rise residential buildings as outlined in Title 24, Part 6, Subchapter 5, § 140.1. A separate ACM Reference Manual applies to low-rise residential buildings. The approval process for nonresidential software programs is specified in Title 24, Part 1, § 10-101 through § 10-110 of the California Code of Regulations.

1.2 Modeling Assumptions

When calculating annual energy use, it is necessary to make assumptions about how the proposed building is operated. Operating assumptions include thermostat settings, number of occupants, receptacle loads, process loads, hot water loads as well as schedules of operation for HVAC systems, lighting systems and other systems. Sometimes these data are known with some certainty and other times (for instance for speculative buildings), it is necessary to make estimates. Some of these inputs are prescribed (they are fixed for both the proposed design and for the baseline building and can't be changed), while others are defaults for California Compliance and for California Reach.

1.3 Scope

This manual is intended to be used for nonresidential buildings that are seeking a building permit for new construction or are seeking recognition under California's Reach program.

The long-term goal of this manual is to define modeling rules and procedures for all conceivable design features that may be incorporated in buildings. The authors recognize, however, that this goal cannot be fully achieved due to limitations in the development energy simulation algorithms, and due to the natural lag time between the introduction of an advanced energy efficiency measure or device and the development of algorithms to simulate its performance.

The goal of the manual is to provide methods that are as consistent and accurate as possible. This goal can best be achieved if the manual is a 'living document,' changing and growing as increasing amounts of information and better modeling methods become available.

1.4 Organization

This document is organized in five chapters and several appendices, as described below:

Chapter	Description

1. Overview	The purpose, organization, content, and intent of the manual (this chapter).
2. General Modeling Procedures	An overview of the modeling process, outlining the modeling rules and assumptions that are implemented in the same way for both the standard design and the proposed design, and procedures for determining system types and equipment sizes.
3. Software Requirements	Requirements for the simulation engines and software shells that are used to make calculations, and special reporting requirements for non-standard building features.
4. Content and Format of Standard Reports	The content and organization of the standard reports that need to be produced by qualifying software.
5. Building Descriptors Reference	The acceptable range of inputs for the proposed design and a specification for the standard design.

In addition, a number of appendices are provided that contain reference material that support definition of the standard design. The numbering for these appendices generally aligns with the section numbers in the main manual that reference the appendices.

1.5 California ACM

The reference procedures and method described in this manual establish the basis of comparison for all software. The approval process ensures that a minimum level of energy efficiency is achieved regardless of the software used. This is accomplished

- by having candidate software pass a series of Reference Method comparison tests,
- by specifying input which may be varied in the compliance process for credit and which inputs are fixed or restricted,
- by defining standard reports output requirements, and
- by software vendor-certification to the requirements in this manual.

The Nonresidential ACM Reference Manual is an approved document, separate from the formally adopted ACM regulations. This gives the Commission the flexibility to incorporate new modeling procedures or features, or fix any errata, within the code cycle. The document is said to be in continuous maintenance. Software may be certified with the capability of modeling specific building systems or features.

The Commission's purpose in approving additional capabilities is to accommodate new technologies which have only begun to penetrate the market and new modeling algorithms. Newly added capabilities which evaluate measures already in relatively common use shall have their standard design for the measure based on the common construction practice (or the typical base situation) for that measure since common practice is the inherent basis of the standards for all measures not explicitly regulated. For example, the Commission has no interest in an optional capability that evaluates the energy impacts of dirt on windows unless a new technology produces substantial changes in this aspect of a building relative to buildings without this technology. The burden of proof that an additional capability should be approved lies with the applicant.

Companion documents which are helpful to prepare software for certification include the latest editions of the following Commission publications:

- Energy Efficiency Standards
- Appliance Efficiency Regulations
- Nonresidential Compliance Manual
- Nonresidential Alternative Calculation Method (ACM) Manual
- Reference Nonresidential Appendices
- Reference Joint Appendices

In this manual the term "Standards" means the Building Energy Efficiency Standards, Title 24, Part 6 of the California Code of Regulations. The term "compliance" means that a building design in an application for a building permit complies with the "Standards" and meets the requirements described for building designs therein.

There are a few special terms that are used in this Manual. The Commission approves the use of software for compliance. Commission approval means that the Commission accepts the applicant's certification that software meets the requirements of this Manual. The proponent of candidate software is referred to as a vendor. The vendor shall follow the procedure described in this document to publicly certify to the Commission that the software meets the criteria in this document for:

- Accuracy and reliability when compared to the Reference Method; and
- Suitability in terms of the accurate calculation of the correct energy budget, the printing of standardized forms, and the documentation on how the program demonstrates compliance.

In addition to explicit and technical criteria, Commission approval will also depend upon the Commission's evaluation of:

- Enforceability in terms of reasonably simple, reliable, and rapid methods of verifying compliance and application of energy efficiency features modeled by the software and the inputs used to characterize those features by the software users.
- Dependability of the installation and energy savings of features modeled by the software. The Commission will evaluate the probability of the measure actually being installed and remaining functional. The Commission shall also determine that the energy impacts of the features that the software is capable of modeling will be reasonably accurately reflected in real building applications of those features. In particular, it is important that the software does not encourage the replacement of actual energy savings with theoretical energy savings due to tradeoffs allowed by the software.

For the vendor, the process of receiving approval of software includes preparing an application, working with the Commission staff to answer questions from either Commission staff or the public, and providing any necessary additional information regarding the application. The application includes the four basic elements outlined below. The Commission staff evaluates the software based on the completeness of the application and its overall responsiveness to staff and public comment.

The four basic requirements for approval include:

1. Required capabilities:

   Software shall have all the required input capabilities explained in Chapter 2.

   Software may be meet software requirements and documentation requirements described in Chapter 3.

2. Accuracy of simulation:

   The software shall demonstrate acceptable levels of accuracy by performing and passing the required certification tests discussed in Chapter 6.

   The software vendor performs the certification tests in Chapter 6. The vendor conducts the specified tests, evaluates the results and certifies in writing that the software passes the tests. The

Commission will perform spot checks and may require additional tests to verify that the proposed software is appropriate for compliance purposes.

When energy analysis techniques are compared, two potential sources of discrepancies are the differences in user interpretation when entering the building specifications, and the differences in the software's algorithms (mathematical models) for estimating energy use. The approval tests minimize differences in interpretation by providing explicit detailed descriptions of the test buildings that must be analyzed. For differences in the software's algorithms, the Commission allows algorithms that yield equivalent results.

3.. Program support:

The vendor shall provide ongoing user and enforcement agency support as described in the Nonresidential ACM Approval Manual.

The Commission may hold one or more workshops with public review and vendor participation to allow for public review of the vendor's application. Such workshops may identify problems or discrepancies that may necessitate revisions to the application.

Commission approval of software programs is intended to provide flexibility in complying with the Standards. However, in achieving this flexibility, the software shall not degrade the standards or evade the intent of the Standards to achieve a particular level of energy efficiency. The vendor has the burden of proof to demonstrate the accuracy and reliability of the software relative to the reference method and to demonstrate the conformance of the software to the requirements of this manual.

1.6 Compliance

1.6.1 Type of Project Submittal

Software shall require the user to identify the type of project; either Compliance or Reach. The software shall require the user to choose one of the following options:

- New Building or Addition Alone. Software may do this by treating an addition alone as a new building, but an addition modeled in this way shall be reported on all output forms as an Addition (modeled alone).
- Addition Plus Alteration of Existing Building. (if software is approved for this optional capability)
- Alteration of Existing Building (if software is approved for this optional capability)

1.6.2 Scope of Compliance Calculations

For each building or separately permitted space, software shall also require the user to identify the scope of the compliance submittal from the following list:

- Envelope only
- Mechanical only
- Envelope and Lighting
- Envelope and Mechanical
- Lighting and Mechanical
- Envelope, Lighting and Mechanical

Each of these situations requires specific assumptions, input procedures and reporting requirements. Modeling assumptions are documented in Chapter 5. Reporting requirements are documented in Chapter

4. Software shall only produce compliance reports specific to the scope of the submittal determined for the run. For example, an Envelope Only scope run is only allowed to produce ENV forms and PERF forms that are designated Envelope Only.

The information about installed service water heating system(s) is included in the mechanical compliance submittal forms. Software shall calculate the energy use for both the proposed system(s) and the reference system(s) [TDV energy budget] and provide the results on the PERF forms. The energy budget is calculated in accordance with Section 5.9 (Service Water Heating--Required capabilities) of this manual. If the energy used by the proposed water heating system(s) is less than the energy budget, the credit may be traded off for other building features. Alternatively, for high-rise residential buildings, users may show service water heating compliance by meeting the prescriptive requirements of § 150.1(f)(8). When the compliance for the service water heating is shown prescriptively, tradeoff between the service water heating and other building components is not allowed.

When a building has a mixed scope of compliance, such as a speculative building where all the envelope is being permitted but the core includes lighting as well as portions of the envelope, two (or more) compliance runs shall be performed and forms from different runs shall be submitted for the appropriate spaces. The scope of submittal for the building core compliance run will be Envelope & Lighting and the scope of submittal for the compliance run for the remainder of the building will be Envelope Only.

The following modeling rules apply for when the scope of the compliance calculations do not include one of the following: the building envelope, the lighting system or the mechanical system.

Table 1: Compliance Options

Cases	Modeling Rules for Proposed Design	Modeling Rules for Standard Design (All):
No Envelope Compliance Mechanical Only Lighting and Mechanical	The envelope shall be modeled according to the as-built drawings and specifications of the building or as it occurs in the previously-approved compliance documentation of the building. All envelope features and inputs required for software by this manual shall be entered.	The envelope shall be identical to the proposed design.
	Note: A partial permit application involving no envelope compliance creates an exceptional condition. This requires either a copy of the previous envelope compliance approval or an equivalent demonstration by the applicant (to the satisfaction of the local enforcement agency) that the building is conditioned and an occupancy permit has previously been issued by the local enforcement agency. The exceptional condition list shall indicate the presence of an existing or previously-approved envelope documentation and a form shall be produced to document the existing envelope. Software shall not produce envelope (ENV) compliance forms when the user selects this option.	
No Mechanical Compliance Envelope Only Envelope and Lighting	Software shall model the baseline building HVAC system according to the rules in Chapter 5.	The mechanical systems shall be identical to the proposed design.
No Lighting Compliance Envelope Only Mechanical Only	Previously-approved lighting plans with approved lighting compliance forms may be entered. The exceptional conditions list on the PERF-1 form shall indicate that previously-approved lighting plans	The baseline building lighting system shall be identical to the proposed design.

Envelope and Mechanical	and compliance forms shall be resubmitted with the application.	
	In the absence of approved lighting plans and lighting compliance forms, the software shall model the baseline building lighting system.	The baseline building lighting system shall be identical to the proposed design.

1.6.3 Climate Zones

The program shall account for variations in energy use due to the effects of the sixteen (16) California climate zones and local weather data. Climate information for compliance simulations shall use one of sixteen (16) data sets described in Reference Joint Appendix JA2.

1.6.4 Time Dependent Valuation

The candidate software shall calculate the hourly energy use for both the standard design and the proposed design by applying a TDV factor for each hour of the reference year. TDV factors have been established by the CEC for residential and nonresidential occupancies, for each of the climate zones, and for each fuel (electricity, natural gas, and propane). The procedures for Time Dependent Valuation of energy are documented in Reference Appendix JA3.

1.7 Approval Process

1.7.1 Application Checklist

The following items shall be included in an application package submitted to the Commission for software approval:

- Compliance Software Vendor Certification Statement. A copy of the statement contained in Appendix A, signed by the software vendor, certifying that the software meets all Commission requirements, including accuracy and reliability when used to demonstrate compliance with the energy standards.
- Computer Runs. Copies of the computer runs specified in Chapter 3 of this manual on machine readable form as specified in Chapter 3 to enable verification of the runs.
- Help System and/or User's Manual. The vendor shall submit a complete copy of the help system and/or software user's manual, including material on the use of the software for compliance purposes.
- Copy of the Compliance Software and Weather Data. A machine readable copy of the software for random verification of compliance analyses. The vendor shall provide weather data for all 16 climate zones.
- TDV Factor Documentation. The software shall be able to apply the TDV multipliers described in Reference Appendix JA3.
- Application Fee. The vendor shall provide an application fee of $2,000.00 (two thousand dollars) as authorized by § 25402.1(b) of the Public Resources Code, made out to the "State of California" to cover costs of evaluating the application and to defray reproduction costs.

A cover letter acknowledging the shipment of the completed application package should be sent to:

Executive Director
California Energy Commission

1516 Ninth Street, MS-39
Sacramento, CA 95814-5512

Two copies of the full application package should be sent to:

Compliance Software Nonresidential Certification
California Energy Commission
1516 Ninth Street, MS-26
Sacramento, CA 95814-5512

Following submittal of the application package, the Commission may request additional information pursuant to Title 24, Part 1, § 10-110. This additional information is often necessary due to complexity of software. Failure to provide such information in a timely manner may be considered cause for rejection or disapproval of the application. A resubmittal of a rejected or disapproved application will be considered a new application, including a new application fee.

1.7.2 Types of Approval

This Manual addresses two types of software approval: full program approval (including amendments to programs that require approval), and approval of new program features and updates.

If software vendors make a change to their programs as described below, the Commission shall again approve the program. Additionally, any software change that affects the energy use calculations for compliance, the modeling capabilities for compliance, the format and/or content of compliance forms, or any other change which would affect Compliance or Reach requires another approval.

Changes that do not affect Compliance or Reach, such as changes to the user interface, may follow a simplified or streamlined procedure for approval. To comply with this simpler process, the software vendor shall certify to the Commission that the new program features do not affect the results of any calculations performed by the program, shall notify the Commission of all changes and shall provide the Commission with one updated copy of the program and Help System/User's Manual. Examples of such changes include fixing logical errors in computer program code that do not affect the numerical results (bug fixes) and new interfaces.

1.7.2.1 Full Approval & Re-Approval of Compliance Software

The Commission requires program approval when candidate software has never been previously approved by the Commission, when the software vendor makes changes to the program algorithms, or when any other change occurs that in any way affects the compliance results. The Commission may also require that all currently approved software be approved again whenever substantial revisions are made to the Standards or to the Commission's approval process.

The Commission may change the approval process and require that all software be approved again for several reasons including:

- If the standards undergo a major revision that alters the basic compliance process, then software would have to be updated and re-approved for the new process.
- If new analytic capabilities come into widespread use, then the Commission may declare them to be required software capabilities, and may require all software vendors to update their programs and submit them for re-approval.

When re-approval is necessary, the Commission will notify all software vendors of the timetable for renewal. A new version of this manual will be published and the Commission will provide instructions for re-approval.

Re-approval shall be accompanied by a cover letter explaining the type of amendment(s) requested and copies of other documents as necessary. The timetable for re-approval of amendments is the same as for full program approval.

1.7.2.2 Approval of New Features & Updates

Certain types of changes may be made to previously approved nonresidential software through a streamlined procedure, including implementing a computer program on a new machine and changing executable program code that does not affect the results.

Modifications to previously approved software including new features and program updates are subject to the following procedure:

- The software vendor shall prepare an addendum to the Compliance Supplement or software user's manual, when new features or updates affect the outcome or energy efficiency measure choices, describing the change to the software. If the change is a new modeling capability, the addendum shall include instructions for using the new modeling capability for compliance.
- The software vendor shall notify the Commission by letter of the change that has been made to the software. The letter shall describe in detail the nature of the change and why it is being made. The notification letter shall be included in the revised Compliance Supplement or software user's manual.
- The software vendor shall provide the Commission with an updated copy of the software and include any new forms created by the software (or modifications in the standard reports).

The Commission will respond within 45 days. The Commission may approve the change, request additional information, refuse to approve the change, or require that the software vendor make specific changes to either the Compliance Supplement addendum or the software program itself.

With Commission approval, the vendor may issue new copies of the software with the Compliance Supplement addendum and notify software users and building officials.

1.7.3 Challenges

Building officials, program users, program vendors, Commission staff or other interested parties may challenge any nonresidential software approval. If any interested party believes that a compliance program, an algorithm or method of calculation used in a compliance program, a particular capability or other aspect of a program provides inaccurate results or results which do not conform to the criteria described in his manual, the party may initiate the challenge of the program.

1.7.4 Decertification of Compliance Software Programs

The Commission may decertify (rescind approval of) an alternative calculation method through the following means:

- All software programs are decertified when the Standards undergo substantial changes which occur about every three years.
- Any software can be decertified by a letter from the software vendor requesting that a particular version (or versions) of the software be decertified. The decertification request shall briefly describe the nature of the program errors or "bugs" which justify the need for decertification.
- Any "initiating party" may commence a procedure to decertify an software according to the steps outlined below. The intent is to include a means whereby unfavorable software tests, serious program errors, flawed numeric results, improper forms and/or incorrect program documentation not discovered in the certification process can be verified, and use of the particular software version discontinued. In this process, there is ample opportunity for the Commission, the software vendor and all interested parties to evaluate any alleged problems with the software program.

NOTE 1: The primary rationale for a challenge is unfavorable software tests, which means that for some particular building design with its set of energy efficiency measures, the software fails to meet the criteria used for testing software programs described in Chapter 3.

NOTE 2: Flawed numeric results where the software meets the test criteria in Chapter 3, in particular when software fails to properly create the baseline building.

Following is a description of the process for challenging software or initiating a decertification procedure:

1. Any party may initiate a review of software's approval by sending a written communication to the Commission's Executive Director. (The Commission may be the initiating party for this type of review by noticing the availability of the same information listed here.)

   The initiating party shall:

   - State the name of the software and the program version number(s) which contain the alleged errors;
   - Identify concisely the nature of the alleged errors in the software which require review;
   - Explain why the alleged errors are serious enough in their effect on analyzing buildings for compliance to justify a decertification procedure; and,
   - Include appropriate data on any media compatible with Windows XP or above and/or information sufficient to evaluate the alleged errors.
2. The Executive Director shall make a copy or copies of the initial written communication available to the software vendor and interested parties within 30 days.
3. Within 75 days of receipt of the written communication, the Executive Director may request any additional information needed to evaluate the alleged software errors from the party who initiated the decertification review process. If the additional information is incomplete, this procedure will be delayed until the initiating party submits complete information.
4. Within 75 days of receipt of the initial written communication, the Executive Director may convene a workshop to gather additional information from the initiating party, the software vendor and interested parties. All parties will have 15 days after the workshop to submit additional information regarding the alleged program errors.
5. Within 90 days after the Executive Director receives the application or within 30 days after receipt of complete additional information requested of the initiating party, whichever is later, the Executive Director shall either:

   - Determine that the software need not be decertified; or,
   - Submit to the Commission a written recommendation that the software be decertified.
6. The initial written communication, all other relevant written materials, and the Executive Director's recommendation shall be placed on the calendar and considered at the next business meeting after submission of the recommendation. The matter may be removed from the consent calendar at the request of one of the Commissioners.
7. If the Commission approves the software decertification, it shall take effect 60 days later. During the first 30 days of the 60-day period, the Executive Director shall send out a Notice to Building Officials and Interested Parties announcing the decertification.

All initiating parties have the burden of proof to establish that the review of alleged software errors should be granted. The decertification process may be terminated at any time by mutual written consent of the initiating party and the Executive Director.

As a practical matter, the software vendor may use the 180- to 210-day period outlined here to update the software program, get it re-approved by the Commission, and release a revised version that does not have the problems initially brought to the attention of the Commission. Sometimes the software vendor may wish to be the initiating party to ensure that a faulty program version is taken off the market

1.8 Vendor Requirements

Each vendor shall meet all of the following requirements as part of the software approval process and as part of an ongoing commitment to users of their particular program.

1.8.1 Availability to Commission

All software vendors are required to submit at least one fully working program version of the software to the California Energy Commission. An updated copy or access to the approved version of the software shall be kept by the Commission to maintain approval for compliance use of the software.

The Commission agrees not to duplicate the software except for the purpose of analyzing it, for verifying building compliance with the compliance software, or to verify that only approved versions of the software are used for compliance.

1.8.2 Enforcement Agency Support

Software vendors shall provide a copy of the software User's Manual / Help System to all enforcement agencies who request one in writing.

1.8.3 User Support

Software vendors shall offer support to their users with regard to the use of the software for Compliance or Reach purposes. Vendors may charge a fee for user support.

1.8.4 Compliance Software Vendor Demonstration

The Commission may request software vendors to offer a live demonstration of their software's capabilities. One or more demonstration may be requested before approval is granted.

2. General Modeling Procedures

2.1 General Requirements for Data from the User

2.1.1 General

This document lists the building descriptors that are used in the compliance simulation. Users must provide valid data for all descriptors that that do not have defaults specified and that apply to parts of the building that must be modeled.

2.1.2 Building Envelope Descriptions

The user shall provide accurate descriptions for all building envelope assemblies including exterior walls, windows, doors, roofs, exterior floors, slab-on-grade floors, below grade walls and below grade floors. The user shall provide data for all of the required descriptors listed in section 5.5 that correspond with these assemblies. However, the following exceptions apply:

- Exterior surfaces whose azimuth orientation and tilt differ by no more than 45° and are otherwise the same may be described as a single surface or described using multipliers. This specification would permit a circular form to be described as an octagon.

2.1.3 Space Use Classification

The user must designate space use classifications that best match the uses for which the building or individual spaces within the building are being designed. Space use classifications determine the default or prescribed occupant density, occupant activity level, receptacle power, service water heating, lighting load, area-based minimum outdoor ventilation air, daylighting setpoints, and operating schedules used in the analysis. Process loads and refrigeration loads are also provided for applicable space types.

The user must specify the space use classifications using either the complete *building* or *area category* methods but may not combine the two types of categories within a single analysis. The building area method assigns assumptions based on average values that occur within typical buildings of the designated type. The complete building method is recommended for use when detailed space planning information is unavailable. More than one building area category may be used in a building if it is a mixed-use facility.

The area category method uses the area category categories in the standard design, which were developed for lighting requirements. The area category method requires area category entry of floor area and space use designations. The area category method can be used whenever design information is available with the necessary detail.

The user may override the default assumptions for some building descriptors dependent on the space use classification with supporting documentation. Details are provided in section 5.4 of this manual.

2.1.4 Treatment of Descriptors Not Fully Addressed By This Document

The goal for this document is to provide input and rating rules covering a full range of energy-related features encountered in commercial buildings. However, this goal is unlikely to ever be achieved due to the large number of features that must be covered and the continuous evolution of building materials and

technologies. For compliance and for Reach code, building features or systems not covered in this manual must apply for approval via the Exceptional Calculation method to the Commission. However, this manual may be amended with provisions to model additional features or HVAC systems during the code cycle. When this occurs, it is the responsibility of the software vendor to pass the necessary acceptance tests and apply for approval for the new building feature(s).

2.2 Thermal Zones, HVAC Zones and Space Functions

2.2.1 Definitions

A *thermal zone* is a space or collection of spaces within a building having sufficiently similar space conditioning requirements so that those conditions could be maintained with a single thermal controlling device. A thermal zone is a thermal and not a geometric concept: spaces need not be contiguous to be combined within a single thermal zone. However, daylighting requirements may prevent combining non-contiguous spaces into a single thermal zone.

An *HVAC zone* is a physical space within the building that has its own thermostat and zonal system for maintaining thermal comfort. HVAC zones are identified on the HVAC plans. HVAC zones should not be split between thermal zones, but a thermal zone may include more than one HVAC zone.

A *space function* is a sub-component of a thermal zone that has specific standard design lighting requirements and for which there are associated defaults for outside air ventilation, occupancy, receptacle loads, and hot water consumption. An *HVAC zone* may contain more than one *space function*. Appendix 5.4A has a list of the space functions that may be used with the software. Daylighted areas should generally be defined as separate space functions, even if they have the same classification from Appendix 5.4A, so that lighting reductions due to daylighting can be determined at the appropriate resolution.

Figure 1 shows the hierarchy of *space functions, HVAC zones* and *thermal zones*.

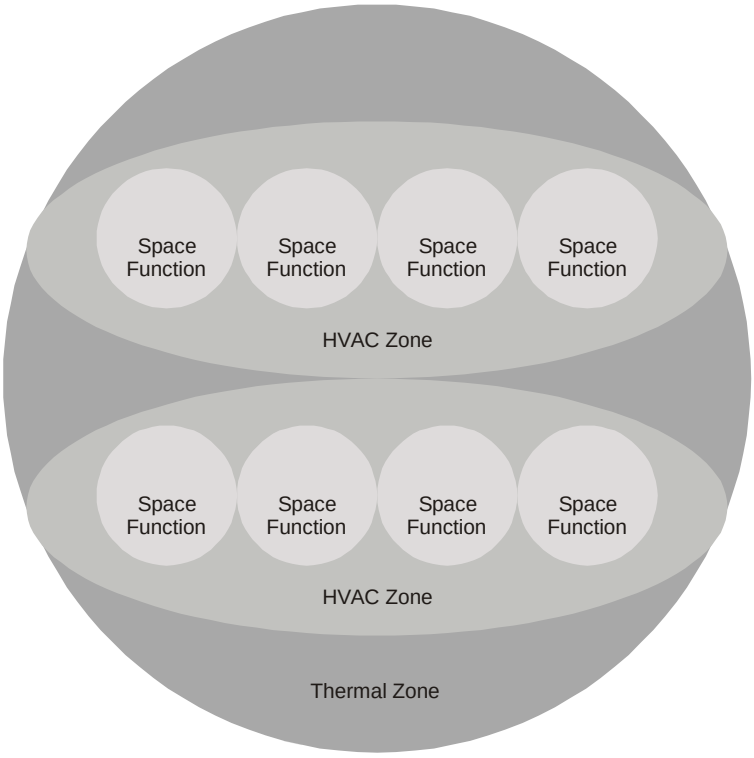

Figure 1 – Hierarchy of Space Functions, HVAC Zones and Thermal Zones

2.3 Software Modeling Requirements for Zones

2.3.1 Required Zone Modeling Capabilities

For California compliance, software shall accept input for and be capable of modeling a minimum of fifty (50) thermal zones, each with its own control. Software shall also be capable of reporting the number of control points at the building level. When the number of control points is not greater than twenty (20) the compliance software shall have one HVAC zone per control point. Compliance software may use zone multipliers for identical zones. When the number of zones exceeds twenty (20), then (and only then) thermal zones may be combined subject to a variety of rules and restrictions.

2.3.2 Modeling Requirements for Unconditioned Spaces

Unconditioned space is enclosed space that is neither directly nor indirectly conditioned. Examples include stairways, warehouses, unoccupied adjacent tenant spaces, attached sunspaces, attics and crawl spaces.

Unconditioned spaces shall be modeled if they are part of the permitted space. All applicable envelope information shall be specified in a similar manner to conditioned space.

If unconditioned space is not a part of the permitted space, the space may be either explicitly modeled or its impact on the permitted space may be approximated by modeling the space as outdoor space and turning off solar gains to the demising wall that separates the permitted space from the adjacent unconditioned space. For unconditioned spaces that are explicitly modeled, all internal gains and operational loads (occupants, water heating, receptacle, lighting and process loads) shall be modeled as specified in Appendix 5.4A.

Return air plenums are considered indirectly conditioned spaces and shall be modeled as part of the adjacent conditioned space with equipment, lighting and occupant loads at zero.

Indirectly conditioned spaces can either be occupied or unoccupied. For spaces that are unoccupied, such as plenums, attics or crawlspaces, lighting, receptacle and occupant loads shall be zero. For spaces that can be occupied, such as stairwells or storage rooms, modeling assumptions shall be taken from Appendix 5.4A.

Unconditioned spaces may not be located in the same zone as conditioned spaces. Conditioned spaces and indirectly conditioned spaces may be located in the same zone; when this occurs, the indirectly conditioned spaces will assume the space temperature schedule of the conditioned space.

2.3.3 Space Use Classification Considerations

~~Thermal zones shall contain no more than ten different space use classifications, provided the spaces have similar space conditioning requirements. If the building area method is used, each thermal zone must be assigned to one and only one building area category. For space classifications that are combined in a single thermal zone, the spaces must meet all of the following conditions:~~

- ~~Use the same HVAC operation schedule. Spaces that have a difference in full-load equivalent operating hours (FLEOH) of 40 or more shall not be combined.~~
- ~~Use the same space temperature schedule.~~
- ~~Have similar internal load power densities. Combined lighting, receptacle, and process equipment power densities that differ by no more than 2.0 W/ft² or a factor of two shall be considered similar.~~
- ~~Have similar occupant densities. Occupant densities (i.e., densities represented in floor area per occupant [under peak design conditions]) that differ by no more than a factor of three shall be considered similar.~~

~~A separate category shall exist for each change in efficiency standard level in the Appliance Efficiency Regulations and in §110.2.~~

Thermal zones shall contain no more than ten different space functions, which shall only be combined if the spaces have similar space conditioning requirements. If the complete building method is used, each thermal zone must be assigned to one and only one complete building type. For California compliance, space function inputs, as how they translate to thermal zone and HVAC system analysis assumptions are defined by the following rules:

Schedule Group: 13 different *schedule groups* are defined in Appendix 5.4B for California compliance. Each schedule group defines building specific hourly profiles for thermostat setpoints, HVAC system availability, occupancy, lighting, etc.

Formatte
numbering

Commen
the "Air Ha
system tha
handler. F
"Availabilit

Space Functions: Each building space is assigned one *space function*. Design internal loads and other space function input assumptions, including the assigned schedule group described above, are defined in Appendix 5.4A. The schedule group and the schedule values for each space function are prescribed for compliance analysis, with the exception of the following space functions:

- Corridors, Restrooms, Stairs, and Support Areas
- Electrical, Mechanical, Telephone Rooms
- Laundry
- Lobby, Main Entry
- Locker/Dressing Room
- Waiting Area

These space functions are common to many different building types, and therefore, the user can assign any of the available schedule groups defined in Appendix 5.4B. This mitigates the issue of conflicting schedule profiles if these common functions are combined into a single thermal zone or served by the same HVAC system as surrounding zones. In the event the user does not assign a schedule group to these common space types, default assumptions are defined in the Appendix 5.4B.

Thermal Zones: Spaces can be combined into thermal zones. In this situation, peak internal loads and other design inputs for the thermal zone are determined by weight-averaging the space function design inputs by floor area. However, if the peak lighting, receptacle, and process load of the individual space functions differs by more than 2 Watts/sf or a factor of 2, the space functions cannot be combined into a single thermal zone. If spaces combined into thermal zones meet these criteria, the thermal zone schedules are based on the schedule group of the predominant space function (by floor area) included in the thermal zone.

HVAC Systems: In many cases, more than one conditioned thermal zone is served by single HVAC system, which is has scheduled availability (ON or OFF) to address the occupancy and internal load patterns of the thermal zones it serves. For systems that serve more than one thermal zone, the HVAC availability schedule is determined by the most predominant schedule group (by floor area) represented in the thermal zones served. In this case, if peak lighting, receptacle, and process loads of the individual thermal zones differs by more than 2 Watts/sf or a factor of 2, the compliance software will identify this HVAC system and the range of peak thermal zone internal loads for the given system in the final compliance report, however, compliance analysis will still be performed.

In the rare case that the predominant schedule group for the thermal zones/HVAC system cannot be determined by floor area (i.e. two or more different schedule groups are represented by equal floor areas), the schedule group corresponding to the combined space functions or thermal zones with the highest combined peak lighting and receptacle load shall be used at each respective step described above.

2.4 Unmet Load Hours

This manual uses the term “Unmet Load Hours” (UMLH) as a criterion for sizing equipment, for qualifying natural ventilation systems, and for other purposes. The concept of unmet load hours applies to individual thermal zones but is summed for hours whenever any thermal zone in the building has unmet loads. For a thermal zone, it represents the number of hours during a year when the HVAC system serving the thermal zone is unable to maintain the set point temperatures for heating and/or cooling. During periods

of unmet loads, the space temperature drifts above the cooling setpoint or below the heating setpoint. A thermal zone is considered to have an unmet load hour if the space is outside the throttling range for heating or cooling. The throttling range is defined in Chapter 5 as the space temperature difference between no cooling and full cooling or between no heating and full heating. The throttling range is fixed at 2°F for simulating both the standard design and proposed design.

An unmet load hour ~~occurs~~ can occur only during periods when the HVAC system is scheduled to operate. ~~One hour with unmet loads in one or more thermal zones counts as a single unmet load hour for the building~~Unmet load hours are accounted for in each zone of the building. No zone in the building can exceed the maximum allowed unmet load hours. ~~If unmet load hours for more than one thermal zone coincide (occur at the same hour), they count as only one unmet load hour for the building. Therefore, the unmet load hours for the building will never be less than the worst thermal zone.~~

Unmet load hours can occur because fans, air flows, coils, furnaces, air conditioners or other equipment is undersized. Unmet load hours can also occur due to user errors including mismatches between the thermostat setpoint schedules and HVAC operating schedules or from other input errors, for instance, high internal gains or occupant loads. The term, as used in this manual, only addresses equipment that is undersized. It is the responsibility of the user to address other causes of unmet load hours in the proposed design.

2.5 Calculation Procedures

The general calculation procedure is illustrated in Figure 2. *The* proposed design *TDV energy use* is compared *to the* standard design.

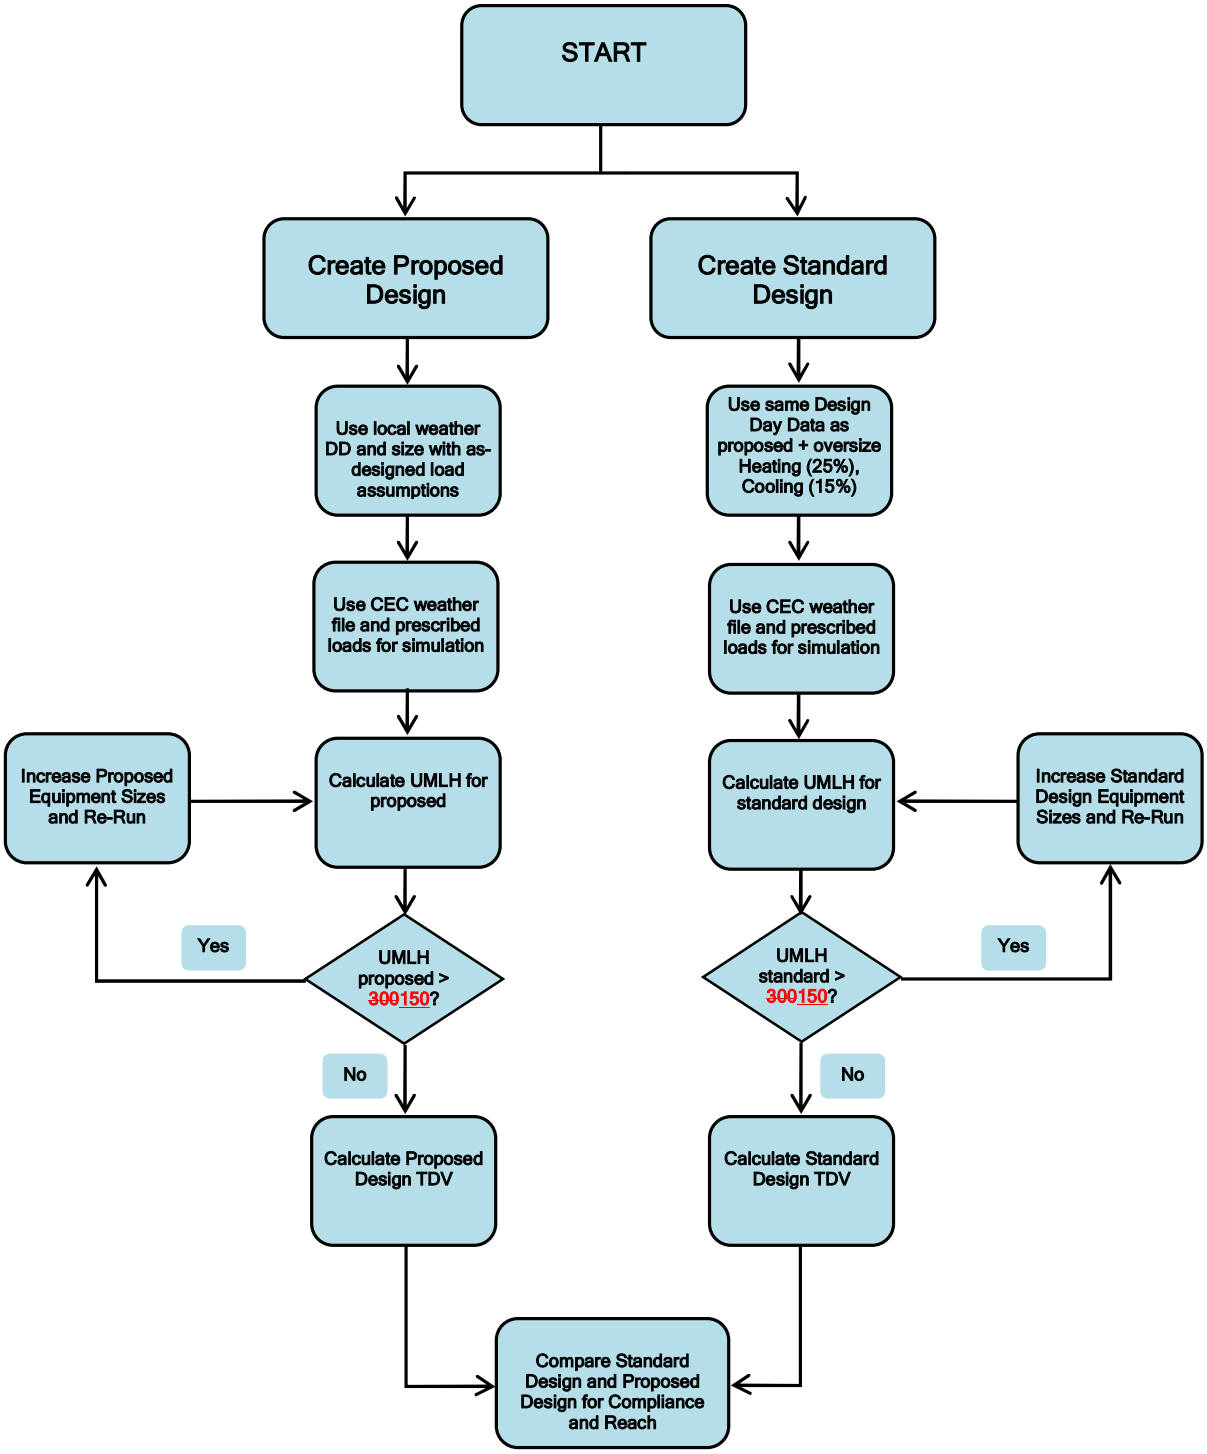

Figure 2 – Calculation Process for Title 24 Compliance and Reach

1. The process begins with a detailed description of the proposed design. Information is provided in enough detail to enable an estimate of annual energy use for a typical weather year. This information includes the building envelope, the lighting systems, the HVAC systems, the water heating systems and other important energy-using systems. This collection of information is referred to in this manual as *building descriptors*. Details on the building descriptors are provided in Chapter 5.

2. Before the calculations are performed, some of the building descriptors are modified for the proposed design to incorporate *prescribed* modeling assumptions. Prescribed modeling assumptions include occupant density, equipment power density, ventilation rates and water heating loads.

3. The next step is to make a simulation of the *proposed design* to determine how well the heating and cooling loads are being satisfied. The indicator is *unmet load hours*, the number of occupied hours during the year when the space temperature in one or more zones is below the heating set point temperature or greater than the cooling set point temperature. A large number of hours indicates that the equipment is undersized.

4. Test the number of unmet load hours and proceed only if the hours for each zone in the building are less than or equal to ~~300~~ 150 for the year of the proposed design simulation.

5. If the unmet load hours are greater than ~~300~~ 150 for the year, then the proposed building simulation model is adjusted by the user to reduce the unmet load hours to less than or equal to ~~300~~150. No zone may exceed 150 unmet load hours. If the problem is heating, then the size of the boiler or furnace may need to be increased. If the problem is cooling, then the size of the coils or chillers may need to be increased. It is up to the designer to adjust equipment sizes as necessary; in some cases adjusting the zone airflows may solve the unmet load issue.

6. If the unmet load hours are less than or equal to ~~300~~150, then the final simulation is performed. If no changes are made in the model, this may be the same simulation in step 3. These calculations produce the results that are compared to the standard design, which is calculated in steps 7 through 16.

7. Create the standard design following the rules in this manual. The standard design has the same floor area, number of floors and spatial configuration as the proposed design; however, systems and components are modified to be in minimum compliance with the *standard design*. The HVAC systems for the standard design are established according to rules in this manual and depend on the primary building activity (residential or non-residential), the floor area, and the number of stories. See Section 5.1.

8. Sizing calculations are performed for the standard design and heating equipment is oversized by 25% and cooling equipment by 15%.

9. The standard design is simulated to determine the number of unmet load hours. This process is the same as performed for the proposed design in step 3.

10. The number of unmet load hours for the standard design is then tested to see if they are greater than ~~300~~150 for any zone(s). This is not likely to occur since the heating and cooling equipment is oversized by 15% for cooling and 25% for heating in step 8.

11. If the unmet load hours are greater than ~~300~~150, then equipment capacity in the standard design is increased so that the unmet hours are less than or equal to ~~300~~150. See the discussion below on how equipment sizes are increased.

12. Once the tests on unmet load hours are satisfied, then the energy consumption of the standard design is calculated. If the tests on unmet hours are satisfied the first time through, this step is the same as step 9.

13. Finally, the proposed design TDV energy use and standard design TDV energy use are compared for compliance or Reach.

2.6 HVAC Capacity Requirements and Sizing

To ensure that the simulated space-conditioning loads are adequately met, adequate capacity must be available in each of the components of the HVAC system; e.g., supply-air flow rates, cooling coils, chillers, and cooling towers. If any component of the system is incapable of adequate performance, the simulation may understate the required energy inputs for space conditioning and report unmet load hours. Adequate capacities are required in the simulations of both the proposed design and standard design. The subsections below describe the procedures that shall be followed to ensure that both versions of the design are simulated with adequate space-conditioning capacities.

2.6.1 Specifying HVAC Capacities for the Proposed Design

As shown in

Figure 2

~~Figure 2~~, the proposed design shall have no more than ~~300~~ 150 unmet load hours. If this requirement is violated, the software shall require the user to make changes to the proposed design building description to bring the unmet load hours equal to or below ~~300~~150. This process is not automated by the software. There are two tests that must be met:

- Space loads must be satisfied: Space temperatures in all zones must be maintained within one half of the throttling range (1°F with a 2°F throttling range) of the scheduled heating or cooling thermostat setpoints. This criterion may be exceeded for no more than ~~300~~ 150 hours for a typical year.
- System loads must be satisfied: Plant equipment must have adequate capacity to satisfy the HVAC system loads. This criterion may be exceeded for no more than ~~300~~ 150 hours for a typical year.

If either the space or system loads do not meet the above criteria, the equipment in the proposed design shall be resized by the user such that the criteria are met. If the space conditioning criteria are not met because the HVAC equipment in the proposed design lacks the capability to provide either heating or cooling, equipment capable of providing the needed space conditioning must be modified by the user. The type of equipment added or modified will depend on the type of HVAC system in the proposed design and the judgment of the energy analyst.

Equipment sizes for the proposed design shall be entered into the model by the energy analyst and shall agree with the equipment sizes specified in the construction documents. When the simulations of these actual systems indicate that specified space conditions are not being adequately maintained in one or more thermal zone(s), the user shall be prompted to make changes to equipment sizes or zones as necessary. This occurs when the unmet load hours exceed ~~300~~ 150 for the year. The use of equipment sizes that do not match the actual equipment sizes as indicated on construction documents triggers an Exceptional Condition that is noted on the compliance forms.

2.6.2 Sizing Equipment in the Standard Design

For sizing heating and cooling equipment capacities, the compliance software shall use design day schedules as specified in Section 5.3. For cooling capacity sizing, compliance software shall use the OnDay schedule from Appendix 5.4B for occupant, lighting and equipment schedules, respectively. For heating capacity sizing, compliance software shall use the OffDay schedule from Appendix 5.4B for occupant, lighting and equipment schedules, respectively.

Equipment in the standard design is automatically oversized by the program (25% for heating and 15% for cooling). If the automatic oversizing percentage is not sufficient to meet demands, then Unmet load hours are evaluated at the building level by looking at the unmet load hours for each of the thermal zones being modeled. ~~One hour with unmet loads in one or more thermal zones counts as a single unmet load hour for the building. Therefore, the unmet load hours for the building will never be less than the worst thermal zone.~~ The zone with the greatest number of unmet load hours shall not exceed 150.

If the number of total unmet load hours for cooling and/or heating exceeds ~~300~~150, then equipment capacities of cooling and/or heating equipment must be increased by the software incrementally.

1. The first step is to determine whether heating or cooling unmet load hours are the bigger problem. If heating unmet load hours are the bigger problem, upsize the heating equipment capacity. If cooling UMLH is the problem, upsize the cooling equipment capacity.
2. If the cooling is undersized, the equipment is resized by first increasing the design airflow of all zones with significant unmet load hours (greater than 150 for an individual zone) by 10%, i~~ncreasing the design airflow of all zones with some unmet load hours (between 50 and 150) by 5%~~. Then the equipment capacity for the system(s) serving the affected zones is increased to handle the increased zone loads. For central plant the chiller(s) are towers are resized proportionally to handle the increased system loads.

If heating is undersized, the same procedure is followed, with zones resized first, then heating secondary equipment and then boilers as necessary.

The capacity of the boiler or furnace shall be increased in ~~2~~5% increments and the simulation re-run until the loads are met. For heat pumps the capacity of the coil is increased so that the additional load is not met by auxiliary heat.

2.7 Ventilation Requirements

Design decisions regarding outside air ventilation shall be based on Section 120.1 of the Standards. If local codes do not apply, minimum values from Appendix 5.4A shall be used. Chapter 5.6 of the ACM has additional information on the ventilation requirements used in the building descriptors for the proposed and standard design. While no compliance credit can be claimed for reducing ventilation rates in the proposed design below the required levels, the user can specify higher ventilation rates in the proposed design.

3. Compliance Software Test Requirements

This chapter contains the procedures used to test and certify vendor's compliance software as acceptable for compliance with Title 24 Part 6. Compliance software must also follow all modeling rules specified in Chapter 5. The tests used to verify software functionality and accuracy of simulation results are referred to as the Reference Method. The tests fall into the following categories:

- Tests to verify that the software is evaluating thermal loads and the response of the HVAC systems to these loads in a manner that is acceptable. These tests reference *ASHRAE Standard 140-2007, Standard Method of Test for Evaluation of Building Energy Analysis Computer Programs*.
- Tests that verify that compliance software is capable of modeling envelope, lighting, HVAC and water heating efficiency features and provides precise estimates of energy tradeoffs and reasonably accurate predictions of building energy consumption.
- Tests to verify that the Standard Design (baseline building) is created correctly, e.g. that the baseline HVAC system is properly specified, that other components of the baseline are correctly defined and that rules that fix and restrict inputs (such as schedules and plug loads) are properly applied. These tests do not verify simulation outputs, but may require simulations to be run to specify inputs that are dependent on system sizing.
- The Reference Method is designed to cover representative software functionality for building envelope, space uses, lighting, daylighting, HVAC and water heating, both for simulation performance and for proper implementation of ACM rules specified in Chapter 5. The California Energy Commission reserves the right to add Ruleset Implementation Tests or Software Sensitivity Tests to verify existing or future compliance software requirements. Moreover, the California Energy Commission reserves the right to adjust the passing criteria for the Software Sensitivity Tests to reflect the capabilities of commonly available energy simulation programs.

3.1 General Requirements

3.1.1 Scope

The *Compliance Software* must satisfy the requirements contained in this section.

The *Compliance Software* shall be capable of modeling at least 50 *thermal zones*.

The *Compliance Software* shall be capable of modeling at least 15 separate HVAC systems.

3.1.2 Calculation Methods

The *Compliance Software* shall calculate the annual consumption of all end uses in buildings, including fuel and electricity for:

- HVAC (heating, cooling, fans, and ventilation);
- Lighting (both interior and exterior);
- Receptacles and miscellaneous electric;
- Service water heating;
- Process energy uses;
- Commercial refrigeration systems; and

- All other energy end uses that typically pass through the building meter.

The *Compliance Software* shall perform a simulation on an hourly time interval (at a minimum) over a one year period (8760 hours) with the ability to model changes in weather parameters, schedules, and other parameters for each hour of the year. This is achieved by specifying a 24-hour schedule for each day of the week plus holidays.

3.1.2.1 Calculating Design Loads

The software shall be capable of performing design load calculations for determining required HVAC equipment capacities and air and water flow rates using accepted industry calculation methods for the standard design.

3.1.2.2 Checking Simulation Output for Unmet Loads

The software shall be capable of checking the output of the energy analysis module for the proposed design to ensure that space conditions are maintained within the tolerances specified (maximum of 150 zone unmet load hours per year).

3.1.2.3 Adjusting Capacities

For the baseline building, the software shall be capable of modifying capacities, temperatures or flow rates for baseline building HVAC system components causing excessive unmet loads hours according to the procedures in Chapter 2.

3.1.2.4 Error Handling

The software shall identify error conditions when unmet loads exceed 150 hours, prevent completion of the compliance analysis, and provide information to the user describing the error that has occurred and what steps the user should take to remedy the situation.

3.1.3 Climate Data

The *Compliance Software* shall perform simulations using the official California Energy Commission weather files and design conditions documented in Joint Appendix 2.

The *Compliance Software* shall calculate solar radiation on exterior surfaces on an hourly basis from the values of direct normal irradiance and diffuse horizontal irradiance contained in the climate data, taking ground reflectance into account.

3.1.5 Time Dependent Valued (TDV) Energy

The Compliance Software shall be capable of applying the Energy Commission TDV multipliers for each hour of the simulation. See California Joint Appendix 3.

3.1.6 Thermal Mass

The calculation procedures used in the *Compliance Software* shall account for the effect of thermal mass on: loads due to occupants, lights, solar radiation, and transmission through building envelope; amount of heating and cooling required to maintain the specified space temperature schedules; and variation in space temperature.

3.1.7 Modeling Space Temperature

The *Compliance Software* shall incorporate a dynamic simulation of space temperature which accounts for:

- Dynamics in change in heating and cooling setpoint temperatures;
- Deadband between heating and cooling thermostat settings;
- Temperature drift in transition to setback or setup thermostat schedules;
- Temperature drift in periods when heating or cooling capability are scheduled off;
- Temperature drift when heating or cooling capability of the system is limited by heating or cooling capacity, air flow rate, or scheduled supply air temperature; and
- Indirectly conditioned *thermal zones*, where the temperature is determined by internal loads, heat transfer through building envelope, and heat transfer between *thermal zones*.

3.1.8 Heat Transfer between Thermal zones

The *Compliance Software* shall be capable of modeling heat transfer between a *thermal zone* and adjacent *thermal zones*.

The *Compliance Software* shall account for the effect of this heat transfer on the space temperature, space conditioning loads, and resulting energy use in the *thermal zone* and in the adjacent *thermal zones*.

3.1.9 Control and Operating Schedules

The *Compliance Software* shall be capable of modeling control and operating schedules which can vary by:

- The hour of the day;
- The day of the week; and
- Holidays treated as a special day of the week.

The *Compliance Software* shall be capable of explicitly modeling all of the schedules specified in Appendix 5.4B of this manual.

3.1.10 Loads Calculation

The loads calculations described in this section relate to the simulation engine and not to the procedure used the design engineer to size and select equipment.

3.1.10.1 Internal Loads

The *Compliance Software* shall be capable of calculating the hourly cooling loads due to occupants, lights, receptacles, and process loads.

The calculation of internal loads shall account for the dynamic effects of thermal mass.

The *Compliance Software* shall be capable of simulating schedules for internal loads in the form given in Appendix 5.4B.

The simulation of cooling load due to lights shall account for:

- The effect of the proportion radiant and convective heat, which depends on the type of light, on the dynamic response characteristic; and
- A portion of heat from lights going directly to return air, the amount depending on the type and location of fixture.

3.1.10.2 Building Envelope Loads

The *Compliance Software* shall calculate heat transfer through walls, roofs and floors for each *thermal zone*, accounting for the dynamic response due to thermal characteristics of the particular construction as defined in the *Building Descriptors* in Chapter 5.

The calculation of heat transfer through walls and roofs shall account for the effect of solar radiation absorbed on the exterior surface, which depends on orientation and absorptance of the surface.

The *Compliance Software* shall calculate heat transfer through windows and skylights, accounting for both temperature difference and transmission of solar radiation through the glazing.

Calculation of cooling load due to transmission of solar radiation through windows and skylights shall account for:

- The angular incidence of the direct beam sunlight and the angular and spectral dependence of the solar properties.
- The variation of thermal properties of the fenestration system with ambient temperature.
- Orientation (azimuth and tilt of surface).
- The effect of shading from overhangs side fins, louvers or neighboring buildings or terrain.

3.1.10.3 Infiltration

The *Compliance Software* shall be capable of simulating infiltration that varies by the time of day and day of the week. Schedules are provided in Appendix 5.4B.

3.1.10.4 Natural Ventilation

The *Compliance Software* shall be capable of simulating natural ventilation.

3.1.11 Systems Simulation

3.1.11.1 General

The *Compliance Software* shall be capable of modeling:

- The baseline building systems defined in Chapter 5,
- The lighting, water heating, HVAC and miscellaneous equipment detailed in Chapter 5
- All compulsory and required features as detailed in Chapter 5

The capability to model multiple zone systems shall allow at least 15 *thermal zones* to be served by one multiple zone system.

The *Compliance Software* shall be capable of modeling plenum air return.

3.1.11.2 HVAC Zone Level Systems

The *Compliance Software* shall be capable of simulating the effect on space temperature and energy use of:

- Limited capacity of terminal heating devices;
- Limited capacity of terminal cooling devices; and
- Limited rate of air flow to *thermal zone*s.

3.1.11.3 HVAC Secondary Systems and Equipment

The *Compliance Software* shall be capable of simulating the effect on energy use and space temperature in *thermal zones* served by the HVAC system of:

- Limited heating capacity of an HVAC system; and
- Limited cooling capacity of an HVAC system.

The simulation of HVAC systems shall account for:

- Temperature rise of supply air due to heat from supply fan, depending on the location of the fan;
- Temperature rise of return air due to heat from return fan;
- Temperature rise of return air due to heat from lights to return air stream; and
- Fan power as a function of supply air flow in variable air volume systems.

3.1.11.4 HVAC Primary Systems and Equipment

The *Compliance Software* shall be capable of simulating the effect on energy use of limited heating or cooling capacity of the central plant system.

If the *Compliance Software* is not capable of simulating the effect of limited heating or cooling capacity of the central plant system on space temperature in *thermal zones* dependent on the central plant system for heating and cooling, then it shall issue a warning message when loads on the central plant system are not met.

3.1.11.5 Equipment Performance Curves

The *Compliance Software* shall be capable of modeling the part load efficiency and variation in capacity of equipment as follows:

- Furnaces as a function of part load;
- Boilers as a function of part load, supply hot water temperature, and return hot water temperature;
- Water-cooled compressors including heat pumps and chillers as a function of part load, evaporator fluid, or air temperature and condensing fluid temperature;
- Air-cooled compressors including heat pumps, direct expansion cooling and chillers as a function of part load, ambient dry-bulb temperature, and wet-bulb temperature returning to the cooling coil;
- Evaporative cooling systems as a function of ambient wet-bulb temperature; and
- Cooling towers as a function of range and ambient wet-bulb temperature.

3.1.11.6 Economizer Control

The *Compliance Software* shall be capable of modeling integrated air- and water-side economizers.

3.1.11.7 Heat-Recovery Water Heating

The Compliance Software shall be capable of modeling heat recovery water heating from the following sources:

- Double bundled chiller;
- Refrigerant desuperheater as part of a packaged HVAC unit;
- Heat exchanger on the condenser water loop; and
- Heat-recovery water-to-water heat pumps operating off of the condenser or chilled water loop.

3.2 Special Documentation and Reporting Requirements

3.2.1 Building Envelope

3.2.1.1 Roof Radiative Properties

The user shall enter three-year aged roof reflectance and emittance for roofs that have been certified by the Cool Roof Rating Council.

3.2.1.2 Ground Reflectance

When specific design features are incorporated to increase or reduce reflectance for the purpose of enhancing daylighting, there can be variation between the proposed design and the standard design, when appropriately documented. In cases where the default value is overridden, the user is required to submit documentation identifying the test procedure that was used to establish the non-default values.

3.2.1.3 Exterior Wall Surface Properties

The default value for emittance is 0.90. The default value for reflectance is 0.30. There is no default for roughness. The default values may be overridden only in cases when the lower reflectance can be documented by manufacturers' literature or tests.

3.2.2 Interior Lighting

3.2.2.1 Regulated Interior Lighting Power

Complete lighting plans and space plans are required for the tailored method. Prescriptive compliance forms for the tailored method shall be developed and these shall be verified by the plans examiner.

Whenever any of the special allowance exceptions (footnotes in Standards Table 140.6-C) are claimed, the compliance software shall make an entry on the compliance forms to indicate that verification is required.

With the tailored lighting method, the software shall make an entry in the special features section on the California compliance forms that the tailored lighting method has been used to determine the lighting power for this space and that all necessary prescriptive tailored lighting forms and worksheets documenting the lighting and its justification shall be provided as part of the compliance documentation and be approved independently.

3.2.2.2 Indoor Lighting Power (see 5.4.4)

Compliance software shall print all applicable lighting forms and report the lighting energy use and the lighting level (Watts/ft^2) for the entire project. Compliance software shall report "No Lighting Installed" for nonresidential spaces with no installed lighting. Compliance software shall report "Default Residential Lighting" for residential units of high rise residential buildings and hotel/motel guest rooms.

If the modeled Lighting Power Density (LPD) is different than the actual LPD calculated from the fixture schedule for the building, Compliance software shall model the larger of the two values for sizing the mechanical systems and for the compliance run. Compliance software shall report the larger value on PERF-1. Lighting levels schedules shall be adjusted by any lighting Control Credit Watts, if input by the user.

Lighting power is not modeled in unconditioned spaces that are modeled, but lighting in those spaces is required to meet the prescriptive requirements for regulated unconditioned spaces such as commercial and industrial storage spaces and parking garages. When these types of spaces are entered the compliance software must report in the Special Features section that these spaces must comply with the prescriptive requirements for such spaces.

3.2.2.3 Complete Building Method

The Complete Building method triggers special reporting requirements. The compliance software shall report the following on the compliance form:

"The Complete Building method requires that at least 90% of the building contain conditioned space, and that at least 90% of the building conform to the building type classification. This condition must be verified by the building official."

3.2.2.4 Design Illumination Setpoint

Spaces that have low design illuminance levels, below the ranges specified in Appendix 5.4A, shall provide documentation that show the design illuminance to be used as the daylight illumination setpoint.

3.2.2.5 Primary and Secondary Daylighted Area

The default primary daylight area for sidelighting is a band near the window with a depth equal to the distance from the floor to the top of the window. The default secondary daylight area for sidelighting is a band beyond the primary daylighted area that extends a distance double the distance from the floor to the top of the window. Other daylight areas may be defined with appropriate documentation.

3.2.2.6 Light Heat Gain Distribution

Values within the ranges of Table 9 may be used when following the rules in the 2009 ASHRAE HOF. Other values may be used when manufacturers' literature and/or testing data is available, and adequate documentation is provided to the California Energy Commission.

Formatte

3.2.3 Exterior Lighting

If the lighted façade area exceeds exterior wall area or if door linear footage exceeds 25% of building perimeter, the software shall produce a warning.

3.2.4 Infiltration Data

When credit is taken for reductions in infiltration (see above), test results or research reports shall be provided that document and support the inputs used for the baseline building and the proposed design.

3.2.5 HVAC Exceptional Conditions

3.2.5.1 Equipment Sizing

When the any proposed equipment size for secondary equipment or central plant equipment does not match the equipment size listed on construction documents, an exceptional condition shall be reported on compliance forms.

3.2.5.2 Custom Occupant, Fan, Heating or Cooling Schedules

Custom hourly schedules may be used with appropriate documentation from project schedules. The default schedules from Appendix 5.4B apply unless they are overridden. The user must ensure that the HVAC schedule operating hours serve all of the occupied spaces, and spaces should not be combined when their weekly occupancy varies by more than 40 full load equivalent operating hours (FLEOH).

3.2.5.3 Equipment Performance Curves

(Is documentation required if non-default HVAC equipment performance curves are used? For example, COOL-CAP-FT, COOL-EIR-FT, etc.)

(Note documentation required if credits for fault detection and diagnostics and/or airflow testing are taken.)

For equipment with a capacity less than or equal to 135,000 Btu/h, but larger than 65,000 Btu/h, the user may not enter data on the temperature dependent equipment performance. However, the compliance software vendor may work with manufacturers to collect such data and build this data into the compliance software. The user may either select equipment for which the compliance software vendor has collected or use the defaults.

3.2.5.4 Natural Ventilation

The air flow rate for the proposed design shall be determined using sound engineering methods and supporting documentation shall be provided.

3.2.5.5 Condenser Flow Type

The default is fixed condenser flow for water-cooled condensers. If the variable-flow is selected, the software must indicate that supporting documentation is required on the output forms.

3.2.5.6 Evaporative Cooling Performance Curves

User may input curves or use default curves. If defaults are overridden, the software must indicate that supporting documentation is required on the output forms.

3.2.5.7 Condenser Heat Recovery Effectiveness

As designed. The software must indicate that supporting documentation is required on the output forms if heat recovery is specified.

3.2.5.8 Boiler Heat Loss

Default is 2% for electric boilers and heat-exchangers and 0% for fuel-fired boilers. If the user overrides the default, supporting documentation is required.

3.2.5.9 Boiler Minimum Unloading Ratio

If the user does not use the default value the software must indicate that supporting documentation is required on the output forms.

3.2.5.10 Chiller Minimum Unloading Ratio

. If the user does not employ the default values, supporting documentation is required.

3.2.5.11 Cooling Tower Setpoint Control

If the user does not use the default control, supporting documentation is required.

3.2.5.12 Exterior Lighting Control

Documentation should be provided for lighting controls other than standard and evidence should be provided to support the reduction in lighting power (PAF).

3.3 ASHRAE Standard 140-2007 Tests

This method of testing is provided for analyzing and diagnosing building energy simulation software using software-to-software and software-to-quasi-analytical-solution comparisons. The methodology allows different building energy simulation programs, representing different degrees of modeling complexity, to be tested by comparing the predictions from other building energy programs to the simulation results provided by the Compliance Software in question.

Compliance software must pass ASHRAE 140-2007 tests, but these tests are not part of the Reference Method.

3.4 Ruleset Implementation Tests

3.4.1 Introduction

The Building Energy Sensitivity Tests in the Reference Method suite of tests verifies that the simulation engine produces results that are within an acceptable range. The tests in this section are intended to verify that the software correctly constructs the Standard Design model and applies rules of the 2013 Nonresidential ACM appropriately to the proposed and Standard Design models. The rule set implementation tests cover representative portions of the rules for building envelope, lighting, daylighting, space use data and HVAC. For each test there is a set of three models defined:

- User Model – the user model contains the user inputs for the as-designed building. In most cases, the values for the Proposed Design will be taken from user inputs with no modification. However, there are some cases where the building input is prescribed for the Proposed Design, or constrained by mandatory minimums or other rules.

- Proposed Design Model – the proposed model is defined by the rules in the ACM Reference Manual and created by the vendor software and is the building modeled for compliance. This model takes user inputs for building geometry, building envelope, lighting and HVAC and is used in the compliance simulation.
- Standard Design Model – this is the baseline model defined by the ACM Reference Manual modeling rules, and is the basis for comparison that determines whether a building passes compliance using the performance method.

These tests do not require that simulation outputs be verified, but they do require that simulation input files for the Proposed Design and Standard Design are properly constructed according to the rules in the ACM Reference Manual. Some tests require that sizing runs be performed, for HVAC inputs whose values are dependent on autosized Standard Design systems.

3.4.2 Overview

The test runs described in this section represent the Title-24 2013 Non-Residential ACM code compliance calculation and use the following Prototype Models- Small Office Building, Medium Office Building, Large Office Building, Warehouse Building and Small Hotel. For further details on the Prototype Models, refer to Section III of the Software Compliance Specification document. Each of the Standard Design test cases shall be created by modifying the Prototype Model as described in Section IV of this document. The modified Prototype Model shall form the proposed case for each test run. The Standard Design model shall be generated by compliance software as per the rules in the 2013 Nonresidential ACM. The Standard Design and proposed model files for each of test cases shall then be evaluated to verify that:

- The Standard Design building envelope constructions are correctly substituted for exterior opaque surfaces and fenestrations.
- Fenestration area in the Standard Design building is reduced in accordance with the 2013 Nonresidential ACM Manual, when the Proposed Design fenestration area is greater than 40% of the exterior wall.
- Skylight area in the Standard Design building is adjusted in accordance with the 2013 Nonresidential ACM Manual, when applicable.
- Default schedules of operation are applied for both the Standard Design building and the Proposed Design.
- The proposed and Standard Design cases use the same defaults or tailored inputs for internal loads as required by the 2013 Nonresidential ACM Manual.
- The Standard Design building lighting system is correctly specified and that exterior lighting is modeled.
- Receptacle loads, process loads is modeled according to the rules in the 2013 Nonresidential ACM Manual.
- The Standard Design building use the correct system types as prescribed in Table 5 of the 2013 Nonresidential ACM Manual.
- An economizer (of the right type) is included in the Standard Design building if required.
- The primary and secondary Standard Design building systems are properly specified and sized.
- Fan brake horsepower is correctly specified for the Standard Design building.
- Prescribed modeling assumptions are applied for both the Standard Design building and the Proposed Design.
- Overhangs are modeled in the Proposed Design for Test Case 7 but not the Standard Design building.
- Unconditioned spaces are modeled.

- Other Standard Design building specifications and/or modeling assumptions are correctly applied. As the software developer verifies the various test conditions, the input and output files should be annotated with comments or other methods to demonstrate that the modeling rules specified in the 2013 Nonresidential ACM Manual are correctly applied. Software developers should use the output format spreadsheets, included in Appendix B, to report the results of these tests. These annotated files shall then be submitted to the Commission for further evaluation. Any errors discovered shall be corrected by making modifications to the software; the runs shall be repeated; and the new results shall be annotated for submittal to the Commission.

The Standard Design Tests are labeled using the format:

Standard Design Fenestration Test/Medium Office -CZ-15, Exterior Envelope Run 01

Run name number

Climate Zone

Prototype Model Type

Test Type

3.4.3 Ruleset Implementation Tests

The following tests shall be performed to verify that the compliance software correctly creates the Standard Design model and applies modeling rules as per the requirements of the Nonresidential ACM 2013. The proposed model shall be created by modifying the appropriate Prototype Model type. The Standard Design Model for each test case shall be generated automatically by the complaince software.

The intent of each test run, characteristics of the proposed model and inputs to be verified in the Standard Design model are described below.

1. Standard Design Exterior Envelope Test/Small Office-CZ-6, Run01– This test will verify that the applicant software models the wall, floor and roof construction correctly in the Standard Design model and that the envelope and fenestration performance requirements for the Standard Design are modelled as per the requirements of 2013 Nonresidential ACM.

   The user model is a small office building in climate zone 6 with the following envelope characteristics:
   - Low sloped concrete roof with assembly U-value of 0.065, Aged Solar Reflectance of 0.75 and Thermal emittance of 0.78
   - Wood-framed wall with assembly U-value of 0.095
   - Mass floor with asssembly U-value of 0.052
   - Fixed window with U-factor of 0.25, SHGC of 0.20 and VT of 0.45

   The following inputs in the Proposed Design and Standard Design model file shall be verified and reported in the output form provided in Appendix 3C:
   - Standard Design roof, wall and floor construction assembly type

- Standard Design roof, wall and floor overall U-value
- Standard Design roof, wall and floor construction assembly layer inputs
- Standard Design roof aged solar reflectance and thermal emittance
- Window U-factor, SHGC and VT

2. Standard Design Exterior Envelope Test/Small Office-CZ-15, Run02 – This test will verify that the applicant software models the wall, floor, roof construction and fenestrations correctly and that the envelope performance requirements for the Standard Design are modelled as per the 2013 Nonresidential ACM.

   The user model is a small office building in climate zone 15 with the following envelope characteristics:
   - Steep sloped metal building roof with assembly U-factor of 0.055, Aged Solar Reflectance of 0.60 and Thermal emittance of 0.70
   - Metal-framed wall with assembly U-factor of 0.056
   - Slab on grade floor with floor F-factor of 0.70
   - Horizontal overhang of 2 feet on south facing windows and vertical fins of 2 feet on right and left of west facing windows

   The following inputs in the Proposed Design and Standard Design model file shall be verified and reported in the output form:
   - Standard Design roof, wall and floor construction assembly type
   - Standard Design roof, wall and floor construction assembly layer inputs
   - Standard Design roof, wall overall U-value
   - Standard Design floor slab F-factor
   - Standard Design roof aged solar reflectance and thermal emittance.
   - Window overhangs for south and west windows

3. Standard Design Exterior Envelope Test/Small Hotel-CZ-15, Run03 – This test will verify that the applicant software models the wall, floor and roof construction correctly in the Standard Design model and that the envelope and fenestration performance requirements for the Standard Design are modelled as per the requirements of 2013 Nonresidential ACM.

   The proposed model is a small hotel building in climate zone 15 with the following characteristics:
   - Low sloped Metal building Roof with assembly U-value of 0.055, Aged Solar Reflectance of 0.60 and Thermal emittance of 0.70
   - Metal-framed wall with assembly U-value of 0.8
   - Mass Floor with asssembly U-value of 0.052
   - Fixed windows in the first floor with U-factor of 0.25, RSHGC of 0.20 and V.T of 0.47
   - Operable windows in guest room windows with U-factor of 0.42, SHGC of 0.18 and V.T of 0.35

   The following inputs in the Standard Design model file shall be verified and reported in the output form:
   - Standard Design roof, wall and floor construction assembly type
   - Standard Design roof, wall and floor construction assembly layer inputs

- Standard Design roof, wall and floor U-value
- Standard Design roof aged solar reflectance and thermal emittance.
- Window U-value, SHGC and VT

4. Standard Design Exterior Envelope Test/Medium Office-CZ6, Run04 – This test will verify that mandatory minimum opaque envelope insulation requirements are applied. The user model is a small office building in climate zone 6, with a metal-framed wall containing R-5 continuous insulation on the exterior and a U-factor of 0.138.
   a. For this test, the proposed model should be ***undefined***, and the compliance simulation should not run.

5. Standard Design Fenestration Test/Large Office-CZ-6, WWR Run05 - Run 05 tests whether the applicant software determines the window area of the Standard Design model as per the rules in 2013 Nonresidential ACM.

   The user model is the Large office building in climate zone 6 with an overall window-to-wall ratio (WWR) of 52% made of a continuous band of glass distributed evenly across all facades. For this run, the building is rotated 15 degrees to the east in azimuth.

   The following inputs in the Proposed Design and Standard Design model file shall be verified and reported in the output form:
   - WWR

6. Standard Design Fenestration Test/Large Office-CZ-6, WWR Run06 - Run 06 tests whether the applicant software determines the window area of the Standard Design model as per the rules in 2013 Nonresidential ACM.

   The user model is the Large office building in climate zone 6 with overall building WWR-46% and 50% WWR in the west, 40% in South, 45% in East and 50% in the North façade.

   The following inputs in the Proposed Design and Standard Design model file shall be verified and reported in the output form:
   - Window Area (and WWR) for each orientation
   - Window Area (and Overall WWR) for the building

7. Standard Design Skylight Test/Warehouse-CZ-6, Run07 – This tests verifies whether the applicant software models the Standard Design skylight as per the performance requirements for skylights in 2013 Nonresidential ACM. This test checks whether the applicant software determines the skylight area of the Standard Design model correctly.

   The user model is a Warehouse building in climate zone 6 with an overall skylight-to-roof ratio (SRR) of 7%. Curb mounted glass Skylight with U-value 0.55, SHGC 0.20 and VT 0.40. The building has ceiling heights of 10 feet and a LPD of 0.8 W/ft2.

   The following inputs in the Standard Design model file shall be verified and reported in the output form:
   - Skylight U-factor, SHGC and VT, and SRR

8. Standard Design Skylight Test/Warehouse-CZ-6, SRR Run08 – This test checks whether the applicant software determines the skylight area of the Standard Design model correctly.

   The proposed model is a Warehouse building in climate zone 6 with ceiling heights of 20 feet and a lighting power density of 0.8 W/ft2. The SRR of the proposed building is 15% and 80% of the building area gets daylighting from skylights or sidelights.

   The following Standard Design inputs shall be verified:
   - Standard Design SRR, Standard Design total daylit area as a fraction of gross building area

9. Standard Design Skylight Test/Warehouse-CZ-6, SRR Run09 – This test checks whether the applicant software determines the skylight area of the Standard Design model correctly.

   The proposed model is a Warehouse building in climate zone 6 with ceiling heights of 20 feet and a lighting power density of 0.8 W/ft2. The SRR of the proposed building is 5% and 55% of the building area gets daylighting from skylights or sidelights.

   The following Standard Design inputs shall be verified:
   - Standard Design SRR, Standard Design total daylit area as a fraction of gross building area

10. Standard Design Occupancy Test/Medium Office-CZ-6, Whole Building Method Run10 – This test verifies whether the applicant software inserts the correct Standard Design inputs for schedules, occupant density, equipment power density, lighting power density, hot water load and ventilation rates using the Complete Building lighting method and in accordance with 2013 Nonresidential ACM. The user model is an office occupancy with:
    - Occupant Density- 50 ft^2/person
    - Equipment Power Density- 3 W/ft^2
    - Lighting Power Density- 1.2 W/ft^2
    - Hot Water Load- 106 Btu/person
    - Ventilation Rate- 0.15 cfm/ft^2

    The Proposed Design and Standard Design Standard Design model inputs shall be verified for:
    - Schedules (verified shall include occupancy schedule, lighting schedule, receptacle schedule, hot water schedule, infiltration schedule and elevator schedule)
    - Occupant Density
    - Equipment Power Density
    - Lighting Power Density
    - Hot Water Load
    - Ventilation Rate

11. Standard Design Occupancy Test/Large Office- CZ-6, Area Category Run11 – This test verifies whether the applicant software inserts the correct Proposed Design and Standard Design inputs for schedules, occupant density, equipment power density, lighting power density, hot water load and ventilation rates in accordance with 2013 Nonresidential ACM. This run tests the capability

of the applicant software to model Standard Design inputs for multiple space types using the Area Category lighting method.

The user model is the Large office building in climate zone six with the following characteristics:

- First Floor- Retail space occupancy- Occupant Density 33 ft2/person, EPD-2W/ft^2, LPD-1W/ft^2, Ventilation rate- 0.75 cfm/ft^2, Hot Water Load- 120 Btuh/person
- Second Floor- Medical occupancy- Occupant Density 100 ft2/person, EPD-1.5 W/ft^2, LPD-1W/ft^2, Ventilation rate- 0.15 cfm/ft^2, Hot Water Load- 160 Btuh/person
- Third to 12th Floor North, South, West and East zones -Offices occupancy- Occupant Density 150 ft2/person, EPD-1.5 W/ft^2, LPD-0.75 W/ft^2, Ventilation rate- 0.15 cfm/ft^2, Hot Water Load- 120 Btuh/person
- Third and Fifth Floor Core zones- Lobby occupancy- Occupant Density 100 ft2/person, EPD-0.5 W/ft^2, LPD-1.5 W/ft^2, Ventilation rate- 0.15 cfm/ft^2
- Fourth, Seventh, 10th and 12th Floor Core Zones- Conference occupancy- Occupant Density 100 ft2/person, EPD-1.0 W/ft^2, LPD-1.2 W/ft^2, Ventilation rate- 1 cfm/ft^2, Hot Water Load- 60 Btuh/person
- Sixth, Eighth Floor Core Zone- Restroom occupancy- Occupant Density 100 ft2/person, EPD-0.2 W/ft^2, LPD-0.5 W/ft^2, Ventilation rate- 0.15 cfm/ft^2
- Ninth and 11th Floor Core Zones- Corridor occupancy- Occupant Density 100 ft2/person, EPD-0.2 W/ft^2, LPD-0.5 W/ft^2, Ventilation rate- 0.15 cfm/ft^2

For each space type, the Proposed Design and Standard Design model inputs shall be verified for:

- Schedules (verified shall include occupancy schedule, lighting schedule, receptacle schedule, hot water schedule, infiltration schedule and elevator schedule)
- Occupant Density
- Equipment Power Density
- Lighting Power Density
- Hot Water Load
- Ventilation Rate

12. Standard Design Tailored Lighting Method/Medium Office-CZ-6, Run12 – This test verifies if the applicant software applies the requirements of the Tailored Lighting Method appropriately.

The User Model is a medium office building in climate Zone 6 with the following chracteristics:

- Perimeter zones on all floors are modelled as main entry spaces using the Tailored Lighting Method. The space has a general lighting of 0.5 W/ft2
- Core zones on all floors are modelled as waiting spaces using the Tailored Lighting Method. The space has a general lighting of 0.75 W/ft2 and decorative lighting of 0.2 W/ft2

For each space type, the Proposed Design and Standard Design model inputs shall be verified for:

- Lighting Power Density for main entry area
- Lighting Power Density General Lighting Power for waiting area
- Lighting Power Density Custom Lighting Power for waiting area

- Lighting Schedules

13. Standard Design Tailored Lighting Method/Medium Office-CZ-6, Run13 – This test verifies if the applicant software applies the requirements of the Tailored Lighting Method appropriately.

    Proposed Model is a medium office building in climate Zone 6 with the following chracteristics:
    - Perimeter zones on all floors are modelled as main entry spaces using the Tailored Lighting Method. The space has a general lighting of 0.8 W/ft2 and task lighting of 0.1 W/ft2
    - Core zones on all floors are modelled as waiting spaces using the Tailored Lighting Method. The space has a general lighting of 0.6 W/ft2, floor display lighting of 0.1 W/ft2, and decorative lighting of 1.2 W/ft2

    For each space type, the Proposed Design and Standard Design model inputs shall be verified for:
    - Lighting Power Density for main entry area
    - Lighting Power Density General Lighting Power for waiting area
    - Lighting Power Density Custom Lighting Power for waiting area
    - Lighting Schedules

14. Standard Design Lighting Control Test/Small Office-CZ-6, PAF Run14 – This test verifies if the applicant software models lighting power density and schedules for eligible Califonia Power adjustment factors as required by the 2013 Nonresidential ACM.

    The proposed model is a small office building (area=5500 sq ft) with demand responsive lighting controls. The model files shall be examined to verify whether adjustment factors are applied as per the requirements in the 2013 Nonresidential ACM.

    For this test, the lighting power density of the proposed model and Standard Design are verified.

15. Standard Design Lighting Control Test/Warehouse-CZ-6, Daylightcontrol Run15 – This test verifies the ability of the applicant software to model daylighting controls as per the requirements of the 2013 Nonresidential ACM.

    The user model is a warehouse building in CZ-6 with the following characteristics:
    - The building has three spaces – Office, Fine Storage and Bulk Storage. The office space gets daylighting from four windows. Fine Storage gets daylighting from skylights and bulk storage gets both sidelighting from windows and skylighting.
    - Daylighting controls are installed in primary and skylit daylit areas in all spaces and in the secondary daylit area of the Bulk Storage.
    - The installed general lighting power controlled by daylight controls in the office space is 150 Watts. The installed lighting power in the primary daylit zone is 150 Watts and the installed lighting power in the secondary daylit zone is 150 Watts.
    - The illuminance setpoint for the office spaces is set at 400 lux and the illuminance setpoint in the fine storage and bulk storage are each set at 250 lux.
    - The reference position for the office space is 5 feet from the exterior wall, at the midpoint between the two interior walls, for the primary daylit zone, and 12 feet from the exterior wall, at the midpoint between the two interior walls, for the secondary daylit zone

The Proposed Design and Standard Design model inputs shall be verified for:

For the office space primary daylit zone and secondary daylit zone:

- Lighting Power in Daylit Zone – for this input, the lighting power for general lighting is assumed to be uniform throughout the space for the Standard Design, so the fraction of lighting power in the space in the primary daylit zone and secondary daylit zone is equal to the fraction of space floor area that is in the primary daylit zone
- Secondary Daylit Zone Adjustment Factor – by space type, from Appendix 5.4A
- Daylight control type
- Reference position and illuminance setpoint

For the bulk storage space:

- Lighting Power in the Daylit Zone
- Daylight control type
- Reference position and illuminance setpoint
- For the fine storage space:
- Lighting Power in the Daylit Zone
- Daylight control type
- Reference position and illuminance setpoint

16. Standard Design Lighting Control Test/Retail-CZ-6, Daylightcontrol Run16 – This test verifies the ability of the applicant software to model daylighting controls as per the requirements of the 2013 Nonresidential ACM.

The user model is a retail building in CZ-6 with the following characteristics:

- The building has five spaces – Front Entry, Point of Sale, Front Retail, Core Retail and Back Space. The front retail space has daylighting from 5 feet high glass on the exterior with a sill height of 3.74 ft. This test only tests the daylighting control in the front retail space.
- Daylighting controls are installed in primary and skylit daylit areas in all spaces and in the secondary daylit area of the Bulk Storage.
- The front retail space has a general lighting power of 1.6 W/ft2 and task and floor display accent lighting in the space of 0.75 W/ft2 in the front half of the space closest to the exterior window.
- The illuminance setpoint is set at 950 lux in all spaces.
- The reference position for the front retail space is 5 feet from the exterior wall, at the midpoint between the two interior walls, for the primary daylit zone, and 12 feet from the exterior wall, at the midpoint between the two interior walls, for the secondary daylit zone.

The Proposed Design and Standard Design model inputs shall be verified for:

For the front retail space, primary daylit zone and secondary daylit zone:

- Lighting Power Density, General Lighting – this is calculated from the room cavity ratio and illuminance level
- Lighting Power in Daylit Zone – this input defines the lighting power that is controlled by daylight dimming controls
- Secondary Daylit Zone Adjustment Factor – by space type, from Appendix 5.4A
- Daylight control type
- Reference position and illuminance setpoint

17. Standard Design Ext. Light, SHW Test/Large Office-CZ-6, Run17 – This test verifies if the 2013 Nonresidential ACM rules for exterior lighting are applied accurately for exterior lighting power, exterior lighting control and schedules. This test also verifies if the Service Hot Water systems are modelled correctly.

    The user model is a large office building in climate zone 6, with the following characteristics:
    a. Hot water load of 106 Btu/h-person
    b. Thermal efficiency of 0.78
    c. An exterior hardscape comprising of:
        i. Driveway of dimensions 20x30 feet with lighting load of 1115 Watts
        ii. Parking lot of dimensions 180x56 feet with lighting load of 6566 Watts
        iii. 2 sidewalks of dimensions 6x30 feet with total lighting load of 977 Watts
        iv. A building entrance door light of 90 Watts.
        v. 50 square feet of hardscape ornamental light of 2 Watts
        vi. Lighting load of 6566 Watts on the building façade.
        vii. Signage of 40 square feet with lighting load of 80 Watts

    This test verifies that the Proposed Design and standard design are specified correctly for:
    d. Service Water Heating: thermal efficiency, hot water load
    e. Exterior Lighting Power

18. Standard Design HVAC Test/Small Office-CZ-6, System Type Run18 – This test checks if the applicant software models the Standard Design HVAC system in accordance with the requirements of the 2013 Nonresidential ACM.

    The proposed model is a small office building in climate zone 6 with the following characteristics:
    - DX cooling
    - Cooling COP-3.84
    - Gas Furnace Heating
    - Thermal Efficiency – 80%
    - Constant Volume Fan

    The following Standard Design model inputs shall be verified:
    - HVAC System Type
    - Heating and Cooling Type
    - Heating and Cooling Efficiency
    - System Sizing
    - Maximum and minimum supply air temperature
    - Fan Control Method
    - Cooling and heating efficiency curve
    - Cooling, Heating and Fan Schedule

19. Standard Design HVAC Test/Medium Office-CZ-6, System Type Run19 – This test checks if the applicant software models the Standard Design HVAC system in accordance with the requirements of the 2013 Nonresidential ACM.

The proposed model is a medium office building in climate zone 6 with the following characteristics:

- Core, Mid and Top Bottom Zones are computer rooms with a zone Cooling load= 110,000 Btuh-Packaged Single Zone unit and constant volume fan
- All Perimeter zones- DX Cooling and Hot water Boiler with reheat and variable volume fan
- Cooling Efficiency- COP=4 for packaged single zone units; COP=3.8 for VAV units serving perimeter zones
- Heating Efficiency – 82% for VAV unit serving perimeter zones

The following Standard Design model inputs shall be verified:

- HVAC System Type
- Heating and Cooling Type
- Heating and Cooling Efficiency
- System Sizing
- Maximum and minimum supply air temperature
- SAT Reset Control
- Economizer Type and limits
- Fan Power
- Fan Control Method
- Cooling and heating capacity adjustment curve
- Cooling and heating efficiency curve
- Cooling, Heating and Fan Schedule
- Terminal heat type and capacity
- Terminal minimum stop
- Terminal heat control type
- Boiler type and Number of boilers
- Boiler Heat loss, boiler minimum unloading ratio
- Hot water supply and return temperature

20. Standard Design HVAC Test/Large Office-CZ-6, System Type Run20 – This test checks if the applicant software models the Standard Design HVAC system in accordance with the requirements of the 2013 Nonresidential ACM.

The proposed model is a Large office building in climate zone 6 with the following characteristics:

- Basement Zone is a computer room with cooling only dedicated packaged DX system.
- All other zones have a Built-up VAV system.
- Cooling Efficiency- COP 6.2 for chiller; EER 11, SEER 14 for packaged DX system
- Heating Efficiency – 82% for boiler; not applicable for packaged DX system

The following Standard Design model inputs shall be verified:

- HVAC System Type
- Heating and Cooling Type
- Heating and Cooling Efficiency
- System Sizing
- Sizing Factor (zone, system)
- Maximum and minimum supply air temperature

- Sat Reset Control
- Economizer Type and limits
- Fan Power
- Fan Control Method
- Cooling, Heating and Fan Schedule
- Terminal heat type and capacity
- Boiler type and Number of boilers
- Boiler Heat loss, boiler minimum unloading ratio
- Boiler Performance Curve
- Hot water supply and return temperature
- Boiler pump type
- Pump motor power and efficiency
- Pump part load curve.
- Chiller Type and Number of chillers
- Chiller fuel, capacity and efficiency
- Chiller Minimum Unloading ratio
- Chiller cooling capacity and adjustment curves
- Chilled water supply and return air temperature
- Condenser Type
- Cooling Tower Fan control type and horse power
- Cooling Tower Set Point Control
- Pump Control Type, Motor Power, Efficiency and design flow rate

21. Standard Design HVAC Test/Warehouse-CZ-6, System Type Run21 – This test checks if the applicant software models the Standard Design HVAC system in accordance with the requirements of the 2013 Nonresidential ACM.

    The proposed model is a Warehouse building in climate zone 6 with the following characteristics:
    - Zones are served by a gas furnace heat only system.
    - Heating Efficiency – 84%

    The following Standard Design model inputs shall be verified-
    - HVAC System Type
    - Heating and Cooling Type
    - Heating and Cooling Efficiency
    - System Sizing
    - Maximum and minimum supply air temperature
    - Sat Reset Control
    - Economizer Type and limits
    - Fan Power
    - Fan Control Method
    - Cooling, Heating and Fan Schedule

22. Standard Design HVAC Test/Hotel-CZ-6, System Type Run22 – This test checks if the applicant software models the Standard Design HVAC system in accordance with the requirements of the 2013 Nonresidential ACM.

The proposed model is a ten-story Hotel in climate zone 6 with a full-service restaurant, and an assembly area that uses demand control ventilation.

- Guestrooms are served by a four-pipe fan coil with water-cooled chiller and boiler
- Building has a water-side economizer

The following Standard Design inputs shall be verified:

- System Type is four-pipe fan coil for the hotel, and kitchen is served by a dedicated kitchen system with exhaust meeting ACM requirements
- Assembly area contains demand control ventilation in Standard Design
- Standard Design building does not contain a water-side economizer

23. Standard Design HVAC Test/MediumOffice-CZ-6, System Type Run23 – This test checks the Standard Design building for an existing, altered building that has the roof replaced with a metal building roof, R-15 continuous insulation, and that has the windows replaced on the South façade with low-e, double glazed windows with U=0.40, SHGC=0.33 and VT=0.50. The windows on the North, East and West facades are existing, unchanged single-paned windows with U=0.55, SHGC=0.56, VT=0.6.

3.4.4 Results Comparison

The applicant shall perform all tests specified in Section IV and report the outputs in the forms provided in Appendix 3C. Note that the Standard Design for some inputs, such as cooling efficiency and pump power, are dependent upon the autosizing of the HVAC equipment. The ruleset implementation tests do not check that the autosized capacity matches the Reference Method, but rather, that the Standard Design input is properly defined in relation to the autosized capacity.

3.5 Software Sensitivity Tests

This section details the eligibility requirements for an applicant simulation program for use as compliance software under the 2013 Title 24 ACM. A series of **quantitative** tests called the Software Sensitivity Tests shall be performed and results compared against predetermined Reference results to demonstrate that the applicant software is acceptable for use in code compliance. There are a total of 106 tests. All the test cases described here shall be performed and results summarized in the forms contained in Appendix 3B.

3.5.1.1 Overview

The applicant software shall perform a suite of Software Sensitivity Tests to demonstrate that their performance is acceptable for code compliance. The applicant software test results shall be compared against a base case called the Reference tests. The Reference Test case is the corresponding match of a particular test case simulated already on EnergyPlus (v.7.2) engine. The Reference Model results, as determined by the Commission, are tabulated in Appendix 3B.

The test cases will assess the applicant software's sensitivity to various inputs ranging from envelope thermal conductance to HVAC system performance. Each case tests the impact of the input component on building end use energy and annual TDV. The following six building components will be tested through a series of tests:

- Opaque envelope
- Glazing
- Lighting

- Daylighting
- Receptacle loads
- HVAC System Parameters

3.5.1.2 Prototype Models

The Software Sensitivity Tests are performed on four Prototype Models which are a subset of the DOE Prototype Building Models developed by PNNL for analysis of ASHRAE Standard 90.1. The Prototype Models are EnergyPlus model input files of the DOE prototype building models, modified to comply with the requirements of Title-24 2013. The Prototype Models will be the reference baseline runs for the test cases. The applicant software shall replicate the four building models using the same inputs as the Prototype Models. The models so replicated will be the applicant baseline models for the test cases.

A summary of the Prototype Models is provided in Appendix 3A. Detailed EnergyPlus input files of the Reference baseline models are available from the California Energy Commission's Building Energy Efficiency Software Consortium webpage http://bees.archenergy.com/

Prototype Models used for Software Sensitivity test cases are:

- Medium Office Building:

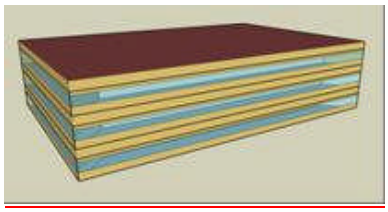

The Medium Office Building model is a three storied rectangular building with an overall area of 53600 square feet. It has a window to wall ratio of 33% with fenestration distributed evenly across all four facades. The zones are served by DX cooling and Gas furnace heating with hot water reheat. For more details refer Appendix 3A.

- Large Office Building:

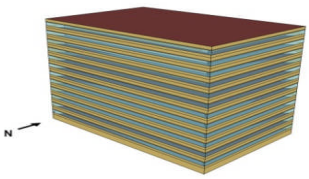

The large office building has twelve floors and a basement floor with glass windows with a window to wall ratio of 40% on the above-grade walls. The total area of the building is 498,600 square feet. The HVAC system type used VAV system. For more details refer Appendix 3A.

- Stand-Alone Retail:

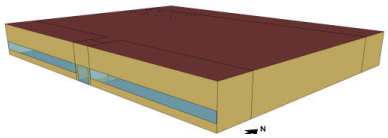

The stand-alone retail is a single story rectangular building measuring 178 ft by 139 ft. The total area is 24695 square feet. Windows are located only on the street facing façade and occupy 25.4% of that facade. The building is divided into five thermal zones which are served by various system types as described in Appendix 3A.

- Strip Mall Building:

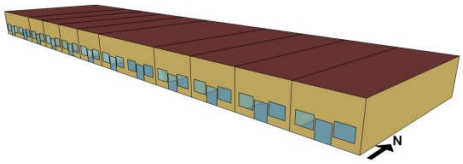

The strip mall building area of 22,500 square feet. It has ten zones each with rooftop units. The building has windows in the street facing façade and has an overall window to wall ratio of 10.5%. For more details refer to Appendix 3A.

3.5.1.3 Climate Zones

The Software Sensitivity Test cases use building models for five of the 16 California climate zones. Most tests are performed with two or three climate zones to capture the sensitivity of the input characteristics to extremes in weather conditions. The test cases are performed on climate zones 6, 15 and 16, which represent mild, hot and cold climates respectively. Daylighting tests are performed on climate zone 7, which has a high annual daylighting potential and climate zone 1, representative of the climate with least annual daylighting potential.

Table 2-Climate Zones Tested

Climate Zone	Example City
1	Arcata
6	Torrence
7	San Diego Lindbergh
15	Palm Springs-Intl
16	Blue Canyon

3.5.1.4 Labeling Test Runs

Each test case in the Software Sensitivity test is labeled uniquely to make it easier to keep track of the runs and to facilitate analysis. The following scheme is used:

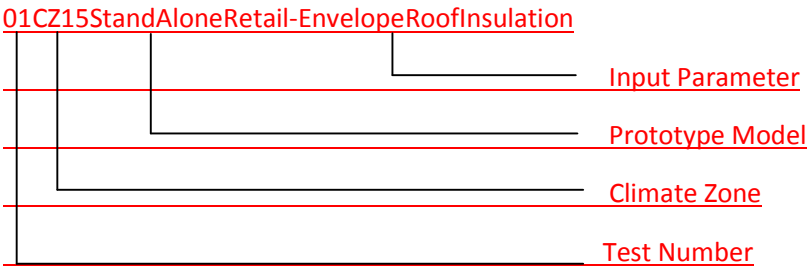

3.5.1.5 Test Criteria

Applicant software vendors shall perform a series of computer runs. Each of these runs shall be a systematic variation of the applicant base case model as described in 3.5.1.7. The applicant test case results will be compared to the reference results to verify that applicant software meets the requirements of the ACM. Simulation results for each test case will be compiled in forms provided in Appendix 3B. Compiled results will include annual site energy consumption for each end-use, overall site energy consumption, total unmet load hours and annual TDV and % variation of annual TDV and total end use site energy.

The annual TDV % variation shall be calculated using the formula:

$TDV_{\%} = (TDV_b - TDV_n)/TDV_b$

Where, $TDV_{\%}$ is the TDV % variation,

TDV_n is the annual TDV for test case number n and

TDV_b is the annual TDV for the base case run.

In order to be accepted, the applicant software should fulfill the passing criteria as determined by the Commission:

For each test case,

The change in energy for the test case must be in the same direction as the Reference Method test case result, and must be equal to the Reference Method test case percentage change in TDV energy, plus or minus 0.5% of baseline TDV energy.

If any of the tests required for the Title 24 compliance feature set fails to meet these criteria, the applicant software will not be accepted for compliance use.

3.5.1.6 Reporting Test Results

For each test case, the TDV energy use of the modeled building is reported (kBtu/ft2), along with the TDV energy use attributed to the major fuel types (electricity, gas), site energy use, and energy end use intensity for the regulated end uses (cooling, heating, lighting, etc.). The following energy totals are reported:

1. Annual TDV EUI (kBtu/ft2)
2. Annual Site EUI – Electricity (kWh/ft2)
3. Annual SiteEUI – Natural Gas (therm/ft2)

4. Annual Total End Use Site Energy EUI – kBtu/ft2

   Site Energy End Uses
5. Site Energy: Heating (kBtu/ft2)
6. Site Energy: Cooling (kBtu/ft2)
7. Site Energy: Interior Lighting (kBtu/ft2)
8. Site Energy: Interior Equipment (kBtu/ft2)
9. Site Energy: Fans (kBtu/ft2) (Airside Fans, does not include tower fans)
10. Site Energy: Pumps (kBtu/ft2)
11. Site Energy: Towers (kBtu/ft2)Water heating (kBtu/ft2)
12. **TDV % Variation** – this field is used for the compliance test
13. Total End Use Site Energy % - percentage change in site energy use
14. Pass/Fail – test fails if it does not meet passing criteria
15. Unmet load hours – these are defined as the zone with the most unmet load hours
    a. Reference Model Occupied Unmet Load Hours
    b. Applicant Model Occupied Unmet Load Hours

AK8

B	C	Y	Z	AA	AB	AC	AD	AE	AG
TEST RESULTS			11		12		13		14
					Variation from Baseline				
	Test Case	Btu/sqft)	Water Heating (kBtu/sqft)		TDV % variation		Total End Use Site Energy % Variation		Pass/Fail
		Applicant Model	Reference Model	Applicant Model	Reference Model	Applicant Model	Reference Model	Applicant Model	
	CZ15StandAloneRetailBaseline		**7.58**						
1	01CZ15StandAloneRetail Envelope RoofInsulation		7.57		2.52%		2.37%		Fail
2	02CZ15StandAloneRetail Envelope WallInsulation		7.58		0.74%		0.64%		Fail
3	03CZ15StandAloneRetail Envelope Heavy		7.57		-5.16%		-3.69%		Fail
	CZ16StandAloneRetailBaseline		**9.73**						
4	04CZ16StandAloneRetail Envelope RoofInsulation		9.73		2.01%		2.04%		Fail
5	05CZ16StandAloneRetail Envelope WallInsulation		9.73		0.55%		0.79%		Fail
6	06CZ16StandAloneRetail Envelope Heavy		9.72		-2.84%		-0.32%		Fail
	CZ06StandAloneRetailBaseline		**8.65**						
7	07CZ06StandAloneRetail Envelope RoofInsulation		8.65		0.81%		0.57%		Fail
8	08CZ06StandAloneRetail Envelope WallInsulation		8.65		0.49%		0.48%		Fail
9	09CZ06StandAloneRetail Envelope Heavy		8.64		-1.25%		0.72%		Fail
	CZ15MediumOfficeBaseline		**2.03**						
10	10CZ15MediumOffice Envelope FloorslabInsulation		2.03		-0.77%		-0.53%		Fail
11	11CZ15MediumOffice Envelope Infiltration		2.03		-0.26%		-0.29%		Fail
	CZ15MediumOfficeBaseline		**2.03**						

Results HVAC Results Sheet3

Ready

Figure 3 – Results Spreadsheet Excerpt from Appendix 3B

The results spreadsheet provides the results of the Reference Method for each test, and provides a column (in orange) for the vendor to report the results from their candidate compliance software.

The variation from baseline section of the spreadsheet shows the percent change in TDV energy use (kBtu/ft2) from the base case for testing. The percentage must be within the passing criteria for the candidate software to pass this test.

Also reported is the number of unmet load hours during occupied hours for the building. An unmet load hour for Title 24 compliance is defined as any hour when any of the zones served by the system has an unmet cooling or heating load. This is typically reported by the software for each zone in the building.

The spreadsheet where the results are documented indicates whether the candidate software passes or fails a test. The result in column AH of the spreadsheet indicates whether or not the candidate software passes the test.

3.5.1.7 Software Sensitivity Test Cases

Test cases assess the energy impact of one or more of the building or system input characteristics on the baseline model. Each test suite consists of a series of unique test cases aimed to test the impact of a specific characteristic on building energy performance. Simulations are grouped according to test criteria and sub-grouped based on the reference model type to allow for direct comparison of results. For each test case, the applicant software will modify the applicant baseline model with specific inputs as described in the Test Case description section.

The test cases are simulated on multiple California weather files to evaluate the sensitivity of the building or system input to extremes in climate. Results of the test case runs and the TDV percent variation over the baseline run shall be compiled and compared against the reference results.

A total of 106 test cases shall be performed. The baseline runs for each of the test cases are provided in . Detailed descriptions of the Standard Design models are provided in Appendix 3A. EnergyPlus input files, Results output in html format and HVAC line diagram in svg format for all baseline and test case models are available from the California Energy Commission's, Building Energy Efficiency Software Consortium webpage http://bees.archenergy.com

Field Coc

Table 3 – Baseline Runs for Test Cases

Test Run Name	**Baseline**	**Test Description**
01CZ15StandAloneRetail-EnvelopeRoofInsulation	CZ15StandAloneRetail	Decrease overall U value of Roof by 20% compared to baseline case
02CZ15StandAloneRetail Envelope WallInsulation	CZ15StandAloneRetail	Decrease overall U value of Exterior Wall by 20% compared to baseline case
03CZ15StandAloneRetail Envelope Heavy	CZ15StandAloneRetail	Change Roof and Wall construction assembly to Wood Framed Roof and Heavy Mass wall. Roof and Wall assembly overall U value of test case= Baseline construction assembly U value
04CZ16StandAloneRetail Envelope RoofInsulation	CZ16StandAloneRetail	Decrease overall U value of Roof by 20% compared to baseline case
05CZ16StandAloneRetail Envelope WallInsulation	CZ16StandAloneRetail	Decrease overall U value of Exterior Wall by 20% compared to baseline case
06CZ16StandAloneRetail Envelope Heavy	CZ16StandAloneRetail	Change Roof and Wall construction assembly to Wood Framed Roof and Heavy Mass wall. Roof and Wall assembly overall U value of test case= Baseline construction assembly U value
07CZ06StandAloneRetail Envelope RoofInsulation	CZ06StandAloneRetail	Decrease overall U value of Roof by 20% compared to baseline case
08CZ06StandAloneRetail Envelope WallInsulation	CZ06StandAloneRetail	Decrease overall U value of Exterior Wall by 20% compared to baseline case
09CZ06StandAloneRetail Envelope Heavy	CZ06StandAloneRetail	Change Roof and Wall construction assembly to Wood Framed Roof and Heavy Mass wall. Roof and Wall assembly overall U value of test case= Baseline construction assembly U value

10CZ15MediumOffice Envelope FloorslabInsulation	CZ15MediumOffice	Change Floor slab F factor to 0.45
11CZ15MediumOffice Envelope Infiltration	CZ15MediumOffice	Increase Exterior Wall Infiltration by 10% compared to baseline case
12CZ15MediumOffice Glazing WindowU	CZ15MediumOfficeBaseline	Decrease U value of windows by 20% compared to baseline case
13CZ15MediumOffice Glazing WindowSHGC	CZ15MediumOfficeBaseline	Decrease SHGC of windows by 20% compared to baseline case
14CZ15MediumOffice Glazing WindowUSHGC	CZ15MediumOfficeBaseline	Decrease U value & SHGC of windows by 20% compared to baseline case
15CZ16MediumOffice Envelope FloorslabInsulation	CZ16MediumOffice	Change Floor slab F factor to 0.45
16CZ16MediumOffice Envelope Infiltration	CZ16MediumOffice	Increase Exterior Wall Infiltration by 10% compared to baseline case
17CZ16MediumOffice Glazing WindowU	CZ16MediumOfficeBaseline	Decrease U value of windows by 20% compared to baseline case
18CZ16MediumOffice Glazing WindowSHGC	CZ16MediumOfficeBaseline	Decrease SHGC of windows by 20% compared to baseline case
19CZ16MediumOffice Glazing WindowUSHGC	CZ16MediumOfficeBaseline	Decrease U value & SHGC of windows by 20% compared to baseline case
20CZ06MediumOffice Envelope FloorslabInsulation	CZ06MediumOffice	Change Floor slab F factor to 0.45
21CZ06MediumOffice Envelope Infiltration	CZ06MediumOffice	Increase Exterior Wall Infiltration by 10% compared to baseline case
22CZ06MediumOffice Glazing WindowU	CZ06MediumOffice	Decrease U value of windows by 20% compared to baseline case
23CZ06MediumOffice Glazing WindowSHGC	CZ06MediumOffice	Decrease SHGC of windows by 20% compared to baseline case
24CZ06MediumOffice Glazing WindowUSHGC	CZ06MediumOffice	Decrease U value & SHGC of windows by 20% compared to baseline case
25CZ07LargeOffice WWR20%	CZ07LargeOffice	Reduce window area such that overall window to wall ratio is 20%
26CZ07LargeOffice WWR60%	CZ07LargeOffice	Increase window area such that overall window to wall ratio is 60%
27CZ07LargeOffice Glazing WWR60%SouthOverhang	CZ07LargeOffice	Increase window area such that overall window to wall ratio is 60%. Include horizontal overhang of two feet for all south facing windows
28CZ01LargeOffice_WWR20%	CZ01LargeOffice	Reduce window area such that overall window to wall ratio is 20%
29CZ01LargeOffice_WWR60%	CZ01LargeOffice	Increase window area such that overall window to wall ratio is 60%
30CZ15MediumOffice Lighting LowLPD	CZ15MediumOffice	Decrease LPD by 20% compared to baseline case
31CZ15MediumOffice Lighting HIghLPD	CZ15MediumOffice	Increase LPD by 20% compared to baseline case
32CZ16MediumOffice Lighting LowLPD	CZ16MediumOffice	Decrease LPD by 20% compared to baseline case
33CZ16MediumOffice Lighting HIghLPD	CZ16MediumOffice	Increase LPD by 20% compared to baseline case
34CZ06MediumOffice Lighting LowLPD	CZ06MediumOffice	Decrease LPD by 20% compared to baseline case
35CZ06MediumOffice Lighting	CZ06MediumOffice	Increase LPD by 20% compared to baseline case

HIghLPD		
36CZ15MediumOffice Int.Eqpt LowEPD	CZ15MediumOffice	Decrease EPD by 20% compared to baseline case
37CZ15MediumOffice Int.Eqpt HighEPD	CZ15MediumOffice	Increase EPD by 20% compared to baseline case
38CZ16MediumOffice Int.Eqpt LowEPD	CZ16MediumOffice	Decrease EPD by 20% compared to baseline case
39CZ16MediumOffice Int.Eqpt HighEPD	CZ16MediumOffice	Increase EPD by 20% compared to baseline case
40CZ06MediumOffice Int.Eqpt LowEPD	CZ06MediumOffice	Decrease EPD by 20% compared to baseline case
41CZ06MediumOffice Int.Eqpt HighEPD	CZ06MediumOffice	Increase EPD by 20% compared to baseline case
42CZ07LargeOffice Daylighting Cont.DimHighVT	CZ07LargeOffice	Increase Visible Transmittance of windows by 20% compared to baseline case
43CZ07LargeOffice Daylighting StepDim	CZ07LargeOffice	Change daylighting controls in Primary and Secondary daylit areas to Stepped dimming with 4 control steps
44CZ07LargeOffice Daylighting StepDimHighVT	CZ07LargeOffice	Change daylighting controls in Primary and Secondary daylit areas to Stepped dimming with 4 control steps and increase visible transmittance of windows by 20%
45CZ07LargeOffice Daylighting WWR20%Cont.DimHighVT	25CZ07LargeOffice WWR20%	Increase Visible Transmittance of windows by 20% compared to baseline case. Reduce window area such that overall window to wall ratio is 20% Note for this test, Run 25CZ07LargeOfficeWWR20% is the baseline
46CZ07LargeOffice Daylighting WWR20%StepDim	25CZ07LargeOffice WWR20%	Change daylighting controls in Primary and Secondary daylit areas to Stepped dimming with 4 control steps.Reduce window area such that overall window to wall ratio is 20% Note for this test, Run 25CZ07LargeOfficeWWR20% is the baseline
47CZ07LargeOffice Daylighting WWR20%StepDimHighVT	25CZ07LargeOffice WWR20%	Change daylighting controls in Primary and Secondary daylit areas to Stepped dimming with 4 control steps and increase visible transmittance of windows by 20%. Reduce window area such that overall window to wall ratio is 0.2 Note for this test, Run 25CZ07LargeOfficeWWR0.2 is the baseline
48CZ07LargeOffice Daylighting WWR60%Cont.DimHighVT	26CZ07LargeOffice WWR60%	Increase Visible Transmittance of windows by 20% compared to baseline case. Reduce window area such that overall window to wall ratio is 60% Note for this test, Run 26CZ07LargeOfficeWWR60% is the baseline
49CZ07LargeOffice Daylighting WWR60%StepDim	26CZ07LargeOffice WWR60%	Change daylighting controls in Primary and Secondary daylit areas to Stepped dimming with 4 control steps.Reduce window area such that overall window to wall ratio is 60% Note for this test, Run 26CZ07LargeOffice WWR60% is the baseline
50CZ07LargeOffice Daylighting WWR60%StepDimHighVT	26CZ07LargeOffice WWR60%	Change daylighting controls in Primary and Secondary daylit areas to Stepped dimming with 4 control steps and increase visible transmittance of windows by 20%. Reduce window area such that overall window to wall ratio is 60% Note for this test, Run 26CZ07LargeOffice WWR60% is the baseline
51CZ01LargeOffice Daylighting Cont.DimHighVT	CZ01LargeOffice	Increase Visible Transmittance of windows by 20% compared to baseline case

52CZ01LargeOffice Daylighting StepDim	CZ01LargeOffice	Change daylighting controls in Primary and Secondary daylit areas to Stepped dimming with 4 control steps
53CZ01LargeOffice Daylighting StepDimHighVT	CZ01LargeOffice	Change daylighting controls in Primary and Secondary daylit areas to Stepped dimming with 4 control steps and increase visible transmittance of windows by 20%
54CZ01LargeOffice Daylighting WWR20%Cont.DimHighVT	28CZ07LargeOffice WWR20%	Increase Visible Transmittance of windows by 20% compared to baseline case. Reduce window area such that overall window to wall ratio is 20% Note for this test, Run 28CZ07LargeOffice Glazing WWR20% is the baseline
55CZ01LargeOffice Daylighting WWR20%StepDim	28CZ07LargeOffice WWR20%	Change daylighting controls in Primary and Secondary daylit areas to Stepped dimming with 4 control steps. Reduce window area such that overall window to wall ratio is 20% Note for this test, Run 28CZ07LargeOfficeWWR20% is the baseline
56CZ01LargeOffice Daylighting WWR20%StepDimHighVT	28CZ07LargeOffice WWR20%	Change daylighting controls in Primary and Secondary daylit areas to Stepped dimming with 4 control steps and increase visible transmittance of windows by 20%. Reduce window area such that overall window to wall ratio is 20% Note for this test, Run 28CZ07LargeOffice WWR20% is the baseline
57CZ01LargeOffice Daylighting WWR60%Cont.DimHighVT	29CZ07LargeOffice WWR60%	Increase Visible Transmittance of windows by 20% compared to baseline case. Reduce window area such that overall window to wall ratio is 60% Note for this test, Run 29CZ07LargeOffice WWR60% is the baseline
58CZ01LargeOffice Daylighting WWR60%StepDim	29CZ07LargeOffice WWR60%	Change daylighting controls in Primary and Secondary daylit areas to Stepped dimming with 4 control steps. Reduce window area such that overall window to wall ratio is 60% Note for this test, Run 29CZ07LargeOffice WWR60% is the baseline
59CZ01LargeOffice Daylighting WWR60%StepDimHighVT	29CZ07LargeOffice WWR60%	Change daylighting controls in Primary and Secondary daylit areas to Stepped dimming with 4 control steps and increase visible transmittance of windows by 20%. Reduce window area such that overall window to wall ratio is 60% Note for this test, Run 29CZ07LargeOffice WWR60% is the baseline
60CZ07StandAloneRetail Daylighting SRRBaseHighVT	CZ07StandAloneRetail	Increase Visible Transmittance of skylights by 20% compared to baseline case
61CZ07StandAloneRetail Daylighting SRR3.04	CZ07StandAloneRetail	Increase skylight area such that overall skylight to roof ratio is 3.04.
62CZ07StandAloneRetail Daylighting SRR3.04HighVT	CZ07StandAloneRetail	Increase skylight area such that overall skylight to roof ratio is 3.04 and visible transmittance of skylights by 20% compared to baseline case.
63CZ01StandAloneRetail Daylighting SRRBaseHighVT	CZ01StandAloneRetail	Increase Visible Transmittance of skylights by 20% compared to baseline case
64CZ01StandAloneRetail Daylighting SRR3.04	CZ01StandAloneRetail	Increase skylight area such that overall skylight to roof ratio is 3.04.

65CZ01StandAloneRetail Daylighting SRR3.04HighVT	CZ01StandAloneRetail	Increase skylight area such that overall skylight to roof ratio is 3.04 and visible transmittance of skylights by 20% compared to baseline case
66CZ16StandAloneRetail HVAC DuctLoss	CZ16StandAloneRetailDuctlossBaseline	Increase duct loss in the zones served by Packaged Single Zone systems to 14%. The baseline for this test is a modified version of Stand-Alone Retail prototype. See details below
67CZ06StandAloneRetail HVAC DuctLoss	CZ06StandAloneRetailDuctlossBaseline	Increase duct loss in the zones served by Packaged Single Zone systems to 14%. The baseline for this test is a modified version of Stand-Alone Retail prototype. See details below
68CZ15MediumOffice HVACPVAV Design	CZ15MediumOffice	Change static pressure and motor efficiency of all VAV fans. See details below
69CZ15MediumOffice HVACPVAV SATControl	CZ15MediumOffice	Change supply air temperature reset based on Outside air. See details below
70CZ15MediumOffice HVACPVAV VAVControl	CZ15MediumOffice	Change VAV damper control to dual maximum.
71CZ15MediumOffice HVACPVAV EconomizerType	CZ15MediumOffice	Change Economizer Type to Fixed Dry bulb with 70 F high limit
72CZ16MediumOffice HVACPVAV Design	CZ16MediumOffice	Change static pressure and motor efficiency of all VAV fans. See details below
73CZ16MediumOffice HVACPVAV SATControl	CZ16MediumOffice	Change supply air temperature reset based on Outside air. See details below
74CZ16MediumOffice HVACPVAV VAVControl	CZ16MediumOffice	Change VAV damper control to dual maximum.
75CZ16MediumOffice HVACPVAV EconomizerType	CZ16MediumOffice	Change Economizer Type to Fixed Dry bulb with 70 F high limit
76CZ06MediumOffice HVACPVAV Design	CZ06MediumOffice	Change static pressure and motor efficiency of all VAV fans. See details below
77CZ06MediumOffice HVACPVAV SATControl	CZ06MediumOffice	Change supply air temperature reset based on Outside air. See details below
78CZ06MediumOffice HVACPVAV VAVControl	CZ06MediumOffice	Change VAV damper control to dual maximum.
79CZ06MediumOffice HVACPVAV EconomizerType	CZ06MediumOffice	Change Economizer Type to Fixed Dry bulb with 70 F high limit
80CZ15LargeOffice HVACVAV ChillerCOP	CZ15LargeOffice	Increase Chiller COP by 11% compared to baseline case
81CZ15LargeOffice HVACVAV CHWdeltaT	CZ15LargeOffice	Change the Chilled water loop design temperature difference to 12F. See below for details
82CZ15LargeOffice HVACVAV CWSetpoint	CZ15LargeOffice	Change condenser water setpoint reset (50F to 95F) based on Outdoor air wet bulb temperature
83CZ15LargeOffice HVACVAV TowerEff	CZ15LargeOffice	

84CZ16LargeOffice HVACVAV ChillerCOP	CZ16LargeOffice	Increase Chiller COP by 11% compared to baseline case
85CZ16LargeOffice HVACVAV CHWdeltaT	CZ16LargeOffice	Change the Chilled water loop design temperature difference to 12F. See below for details
86CZ16LargeOffice HVACVAV CWSetpoint	CZ16LargeOffice	Change condenser water setpoint reset (50F to 95F) based on Outdoor air wet bulb temperature
87CZ16LargeOffice HVACVAV TowerEff	CZ16LargeOffice	
88CZ06LargeOffice HVACVAV ChillerCOP	CZ06LargeOffice	Increase Chiller COP by 11% compared to baseline case
89CZ06LargeOffice HVACVAV CHWdeltaT	CZ06LargeOffice	Change the Chilled water loop design temperature difference to 12F. See below for details
90CZ06LargeOffice HVACVAV CWSetpoint	CZ06LargeOffice	Change condenser water setpoint reset (50F to 95F) based on Outdoor air wet bulb temperature
91CZ06LargeOffice HVACVAV TowerEff	CZ06LargeOffice	
92CZ15StripMall HVACPSZ DXCOP	CZ15StripMall PSZ	Increase COP of DX coil to 3.8
93CZ15StripMall HVACPSZ HeatEff	CZ15StripMall PSZ	Increase efficiency of the Heating coil to 90%
94CZ15StripMall HVACPSZ EconomizerControl	CZ15StripMall PSZ	Change Economizer from Integrated as in baseline to Non-Integrated. See below for details
95CZ16StripMall HVACPSZ DXCOP	CZ16StripMall PSZ	Increase COP of DX coil to 3.8
96CZ16StripMall HVACPSZ HeatEff	CZ16StripMall PSZ	Increase efficiency of the Heating coil to 90%
97CZ16StripMall HVACPSZ EconomizerControl	CZ16StripMall PSZ	Change Economizer from Integrated as in baseline to Non-Integrated. See below for details
98CZ06StripMall HVACPSZ DXCOP	CZ06StripMall PSZ	Increase COP of DX coil to 3.8
99CZ06StripMall HVACPSZ HeatEff	CZ06StripMall PSZ	Increase efficiency of the Heating coil to 90%
100CZ06StripMall HVACPSZ EconomizerControl	CZ06StripMall PSZ	Change Economizer from Integrated as in baseline to Non-Integrated. See below for details
101CZ15StripMall HVACPTAC DXCOP	CZ15StripMall PTAC	Increase COP of DX coil to 3.8
102CZ16StripMall HVACPTAC DXCOP	CZ16StripMall PTAC	Increase COP of DX coil to 3.8
103CZ06StripMall HVACPTAC DXCOP	CZ06StripMall PTAC	Increase COP of DX coil to 3.8
104CZ15StripMall HVACPTAC vsFanCoil	CZ15StripMall PTAC	Comparison of PTAC system with Fan Coil System. For details on Fan Coil system, refer StripMall FanCoil
105CZ16StripMall HVACPTAC vsFanCoil	CZ16StripMall PTAC	Comparison of PTAC system with Fan Coil System. For details on Fan Coil system, refer StripMall FanCoil
106CZ06StripMall HVACPTAC vsFanCoil	CZ06StripMall PTAC	Comparison of PTAC system with Fan Coil System. For details on Fan Coil system, refer StripMall FanCoil

3.5.1.8 Results Documentation

The applicant shall perform simulations for all tests specified above. Detailed description of each test case is provided in Appendix 3A and report results in the forms provided in Appendix 3B. Some of the prototype models have some variants of the baseline model. These include 1) Stand Alone Duct Loss baseline- a variant of the Stand-Alone Retail model 2) StripMall-PTAC model- a variant of StripMall- PSZ model and 3) StripMall- Fan Coil model- a variant of StripMall PSZ model. For details please refer Appendix 3A.

A set of three test cases are presented here as examples: one for building envelope, one for lighting and daylighting, and one for HVAC. The development of the other required test cases follows the same process.

Example Test Case: #23 Envelope Glazing Test Medium OfficeCZ-6 Window SHGC

For this test case the SHGC of all vertical fenestration is decreased by 20%. The prototype used for this test case is a medium office building.

Before the test cases are run, the first step is to generate the prototype models for the four reference buildings, which are required for all of the tests. The seven prototype models are defined in the PrototypeModel spreadsheet of Appendix 3A. (Note: while many of the prototype model inputs are based on Title 24 prescriptive requirements, the prototype models do not exactly conform to minimum Title 24 requirements, but rather, are intended to test the sensitivity of the candidate software simulation results to common variations in building inputs

Step 1. Generate prototype models. The first step is to generate the prototype building for the medium office building. The detailed specification of the medium office building is listed in Appendix A. A portion of the inputs are shown in the Figure below. The prototypes are defined for the reference models on the Prototype Model tab of Appendix 3A.

Prototype Description	**Small Office Building**	**Medium Office Building**
Vintage	New Construction	New Construction
Location	CZ-6/15/16	CZ-3/6/15/16
Fuel Type	gas, electricity	gas, electricity
Total Floor Area (sq feet)	5500 (90.8 ft x 60.5ft)	53600 (163.8 ft x 109.2 ft)
Building shape		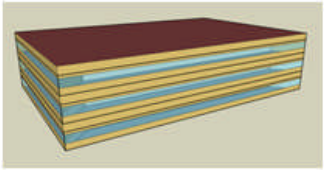
Aspect Ratio	1.5	1.5
Number of Floors	1	3
Window Fraction (Window-to-Wall Ratio)	24.4% for South and 19.8% for the other three orientations (Window Dimensions: 6.0 ft x 5.0 ft punch windows for all façades)	33% (Window Dimensions: 163.8 ft x 4.29 ft on the long side of facade 109.2 ft x 4.29 ft on the short side of the façade)
Window Locations	evenly distributed along four façades	evenly distributed along four façades
Shading Geometry	none	none
Azimuth	non-directional	non-directional
Thermal Zoning	Perimeter zone depth: 16.4 ft. Four perimeter zones, one core zone and an attic zone. Percentages of floor area: Perimeter 70%, Core 30%	Perimeter zone depth: 15 ft. Each floor has four perimeter zones and one core zone. Percentages of floor area: Perimeter 40%, Core 60%
		
Floor to floor height (feet)	10	13

Figure 4 – Prototype Model Definition from Appendix 3A

The prototype model definition in the spreadsheet contains links to other input definitions:

Row 19, 26,45: Links to layer-by-layer exterior construction assembly definitions in the *ConstructionAssembly* tab

Row 52: links to layer-by-layer interior construction assembly definitions in the *ConstructionAssembly* tab

Row 85, 105, 107, 109, 112: links to fan and equipment hourly schedules in the *Schedules* tab

Row 112, 116, 119: links to space use interior load schedules in the *Schedules* tab

Step 2. Define base case and variation for test run.

The base case is defined as the starting point for each test. In many tests, the base case will be one of the prototype models. However, in some cases, a variation of the prototype may serve as the base case for the test.

For this test, the base case is found by looking at the Test Criteria spreadsheet:

Y4 | Decrease U value & SHGC of windows by 20% compared to baseline case

	A	U	V	W	X
2	**Test Run Name**	**20CZ06MediumOffice Envelope FloorslabInsulation**	**21CZ06MediumOffice Envelope Infiltration**	**22CZ06MediumOffice Glazing WindowU**	**23CZ06MediumOffice Glazing WindowSHGC**
3	**Baseline**	CZ06MediumOffice	CZ06MediumOffice	CZ06MediumOffice	CZ06MediumOffice
4	**Test Description**	Change Floor slab F factor to 0.45	Increase Exterior Wall Infiltration by 10% compared to baseline case	Decrease U value of windows by 20% compared to baseline case	Decrease SHGC of windows by 20% compared to baseline case
5	Location	CZ06	CZ06	CZ06	CZ06

Figure 5 – Base Case Definition from Appendix 3A

For this test, the Baseline field in row 3 of the *TestCritieria* tab shows that the baseline is *CZ06MediumOffice*, the medium office prototype in climate zone 6.

This same TestCritieria tab shows the input(s) to be verified, which are highlighted in purple. For this test, the solar heat gain coefficient of all vertical fenestration is reduced by 20%, from 0.25 to 0.20.

A	U	V	W	X
Test Run Name	**20CZ06MediumOffice Envelope FloorslabInsulation**	**21CZ06MediumOffice Envelope Infiltration**	**22CZ06MediumOffice Glazing WindowU**	**23CZ06MediumOffice Glazing WindowSHGC**
Baseline	CZ06MediumOffice	CZ06MediumOffice	CZ06MediumOffice	CZ06MediumOffice
Test Description	Change Floor slab F factor to 0.45	Increase Exterior Wall Infiltration by 10% compared to baseline case	Decrease U value of windows by 20% compared to baseline case	Decrease SHGC of windows by 20% compared to baseline case
Location	CZ06	CZ06	CZ06	CZ06
Dimensions				
Tilts and orientations		Refer MediumOffice		
Window				
Dimensions				
Glass-Type and frame				
U-factor (Btu / h * ft^2 * °F)			0.29	
SHGC				0.2
Visible transmittance				
Operable area				

Figure 6 – Input Parameter Variation for Medium Office from Appendix 3A

Step 3. Run the base case model and generate test results.

Once the base case model is developed, the simulation is run and the results are recorded onto the spreadsheet of test cases, Appendix 3B.

The candidate software shall report electricity use by end use, gas use by end use, TDV energy and unmet load hours. For purposes of compliance, unmet load hours are defined at the zone level, and the zone with the greatest number of unmet load hours must pass the criteria specified in the sizing procedure.

For the Reference Tests, the following parameters can be found in the output summary (html) file:

Central Plant

	Type	Nominal Capacity [W]	Nominal Efficiency [W/W]
BOILER1	Boiler:HotWater	564505.93	0.80

Cooling Coils

	Type	Nominal Total Capacity [W]	Nominal Sensible Capacity [W]	Nominal Latent Capacity [W]	Nominal Sensible Heat Ratio	Nominal Efficiency [W/W]
BOTTOMVAV COOLING COIL	Coil:Cooling:DX:TwoSpeed	82908.42	61957.71	20950.71	0.75	2.78
MIDVAV COOLING COIL	Coil:Cooling:DX:TwoSpeed	94787.77	71965.02	22822.75	0.76	2.78
TOPVAV COOLING COIL	Coil:Cooling:DX:TwoSpeed	115684.88	89530.77	26154.11	0.77	2.78

DX Cooling Coils

	DX Cooling Coil Type	Standard Rating (Net) Cooling Capacity [W]	SEER in SI Units [W/W]	SEER in IP Units [Btu/W-h]	EER in SI Units [W/W]	EER in IP Units [Btu/W-h]
None						

Heating Coils

	Type	Nominal Total Capacity [W]	Nominal Efficiency [W/W]
CORE_BOTTOM REHEAT COIL	Coil:Heating:Water	68067.08	-
PERIMETER_BOT_ZN_1 REHEAT COIL	Coil:Heating:Water	21331.69	-
PERIMETER_BOT_ZN_2 REHEAT COIL	Coil:Heating:Water	17076.38	-
PERIMETER_BOT_ZN_3 REHEAT COIL	Coil:Heating:Water	18425.98	-

System Design Air Flow Rates

	Calculated cooling [m3/s]	User cooling [m3/s]	Calculated heating [m3/s]	User heating [m3/s]
BOTTOMVAV	4.31	4.31	2.03	2.03
MIDVAV	5.11	5.11	1.53	1.53
TOPVAV	6.52	6.52	1.41	1.41

Coil:Cooling:DX:TwoSpeed

	Rated High Speed Air Flow Rate [m3/s]	Rated High Speed Total Cooling Capacity (gross) [W]	Rated High Speed Sensible Heat Ratio	Rated Low Speed Air Flow Rate [m3/s]	Rated Low Speed Total Cooling Capacity (gross) [W]
BOTTOMVAV COOLING COIL	4.31	82908.42	0.747303	1.44	27633.38
MIDVAV COOLING COIL	5.11	94787.77	0.759223	1.70	31592.76
TOPVAV COOLING COIL	6.52	115684.88	0.773919	2.17	38557.77

Figure 7 – System Sizing Data for Test Runs

Step 4. Run the test case model (with the reduced solar heat gain coefficient) and report the results.

The model is re-run and the energy results and outputs are reported. The percentage change in energy use is reported.

Step 5. Report the change in TDV energy use from the base case as a percentage change.

The reported percentage change in energy use from the candidate compliance software must fall within the passing criteria for the Reference Method.

~~3.~~

Formatte

~~This chapter contains the software requirements for candidate Title 24 software that must be verified by acceptance testing. The tests fall into the following categories:~~

- ~~Tests to verify that the software is evaluating thermal loads and the response of the HVAC systems to these loads in a manner that is acceptable. These tests reference *ASHRAE Standard 140-2007, Standard Method of Test for Evaluation of Building Energy Analysis Computer Programs*.~~
- ~~Tests that verify that compliance software is capable of modeling envelope, lighting, HVAC and water heating efficiency features and provides precise estimates of energy tradeoffs and reasonably accurate predictions of building energy consumption.~~
- ~~Tests to verify that the baseline building is created correctly, e.g. that the baseline HVAC system is properly specified, that other components of the baseline are correctly defined and that rules that fix and restrict inputs (such as schedules and plug loads) are properly applied.~~

~~3.1 General Requirements~~

~~3.1.1 Scope~~

~~The *Compliance Software* must satisfy the requirements contained in this section.~~

~~The *Compliance Software* shall be capable of modeling at least 50 *thermal zones*.~~

~~The *Compliance Software* shall be capable of modeling at least 15 separate HVAC systems.~~

~~3.1.2 Calculation Methods~~

~~The *Compliance Software* shall calculate the annual consumption of all end uses in buildings, including fuel and electricity for:~~

- ~~HVAC (heating, cooling, fans, and ventilation);~~
- ~~Lighting (both interior and exterior);~~
- ~~Receptacles and miscellaneous electric;~~
- ~~Service water heating;~~
- ~~Process energy uses;~~
- ~~Commercial refrigeration systems; and~~
- ~~All other energy end uses that typically pass through the building meter.~~

~~The *Compliance Software* shall perform a simulation on an hourly time interval (at a minimum) over a one year period (8760 hours) with the ability to model changes in weather parameters, schedules, and other parameters for each hour of the year. This is achieved by specifying a 24-hour schedule for each day of the week plus holidays.~~

~~*3.1.2.1 Calculating Design Loads*~~

~~The software shall be capable of performing design load calculations for determining required HVAC equipment capacities and air and water flow rates using accepted industry calculation methods for the standard design.~~

~~*3.1.2.2 Checking Simulation Output for Unmet Loads*~~

~~The software shall be capable of checking the output of the energy analysis module for the proposed design to ensure that space conditions are maintained within the tolerances specified (maximum of 300 unmet load hours per year).~~

~~*3.1.2.3 Adjusting Capacities*~~

~~For the baseline building, the software shall be capable of modifying capacities, temperatures or flow rates for baseline building HVAC system components causing excessive unmet loads hours according to the procedures in Chapter 2.~~

~~*3.1.2.4 Error Handling*~~

~~The software shall identify error conditions when unmet loads exceed 300 hours, prevent completion of the compliance analysis, and provide information to the user describing the error that has occurred and what steps the user should take to remedy the situation.~~

~~3.1.3 Climate Data~~

~~The *Compliance Software* shall perform simulations using the official California Energy Commission weather files and design conditions documented in Joint Appendix 2.~~

~~The *Compliance Software* shall calculate solar radiation on exterior surfaces on an hourly basis from the values of direct normal irradiance and diffuse horizontal irradiance contained in the climate data, taking ground reflectance into account.~~

~~3.1.5 Time Dependent Valued (TDV) Energy~~

~~The Compliance Software shall be capable of applying the Energy Commission TDV multipliers for each hour of the simulation. See California Joint Appendix 3.~~

~~3.1.6 Thermal Mass~~

~~The calculation procedures used in the *Compliance Software* shall account for the effect of thermal mass on: loads due to occupants, lights, solar radiation, and transmission through building envelope; amount of heating and cooling required to maintain the specified space temperature schedules; and variation in space temperature.~~

~~3.1.7 Modeling Space Temperature~~

~~The *Compliance Software* shall incorporate a dynamic simulation of space temperature which accounts for:~~

- ~~Dynamics in change in heating and cooling setpoint temperatures;~~
- ~~Deadband between heating and cooling thermostat settings;~~
- ~~Temperature drift in transition to setback or setup thermostat schedules;~~
- ~~Temperature drift in periods when heating or cooling capability are scheduled off;~~
- ~~Temperature drift when heating or cooling capability of the system is limited by heating or cooling capacity, air flow rate, or scheduled supply air temperature; and~~
- ~~Indirectly conditioned *thermal zones*, where the temperature is determined by internal loads, heat transfer through building envelope, and heat transfer between *thermal zones*.~~

~~3.1.8 Heat Transfer between Thermal zones~~

~~The *Compliance Software* shall be capable of modeling heat transfer between a *thermal zone* and adjacent *thermal zones*.~~

~~The *Compliance Software* shall account for the effect of this heat transfer on the space temperature, space conditioning loads, and resulting energy use in the *thermal zone* and in the adjacent *thermal zones*.~~

~~3.1.9 Control and Operating Schedules~~

~~The *Compliance Software* shall be capable of modeling control and operating schedules which can vary by:~~

- ~~The hour of the day;~~
- ~~The day of the week; and~~
- ~~Holidays treated as a special day of the week.~~

~~The *Compliance Software* shall be capable of explicitly modeling all of the schedules specified in Appendix 5.4B of this manual.~~

~~3.1.10 Loads Calculation~~

~~The loads calculations described in this section relate to the simulation engine and not to the procedure used the design engineer to size and select equipment.~~

~~*3.1.10.1 Internal Loads*~~

~~The *Compliance Software* shall be capable of calculating the hourly cooling loads due to occupants, lights, receptacles, and process loads.~~

~~The calculation of internal loads shall account for the dynamic effects of thermal mass.~~

~~The *Compliance Software* shall be capable of simulating schedules for internal loads in the form given in Appendix 5.4B.~~

~~The simulation of cooling load due to lights shall account for:~~

- ~~The effect of the proportion radiant and convective heat, which depends on the type of light, on the dynamic response characteristic; and~~
- ~~A portion of heat from lights going directly to return air, the amount depending on the type and location of fixture.~~

~~*3.1.10.2 Building Envelope Loads*~~

~~The *Compliance Software* shall calculate heat transfer through walls, roofs and floors for each *thermal zone*, accounting for the dynamic response due to thermal characteristics of the particular construction as defined in the *Building Descriptors* in Chapter 5.~~

~~The calculation of heat transfer through walls and roofs shall account for the effect of solar radiation absorbed on the exterior surface, which depends on orientation and absorptance of the surface.~~

~~The *Compliance Software* shall calculate heat transfer through windows and skylights, accounting for both temperature difference and transmission of solar radiation through the glazing.~~

~~Calculation of cooling load due to transmission of solar radiation through windows and skylights shall account for:~~

- ~~The angular incidence of the direct beam sunlight and the angular and spectral dependence of the solar properties.~~
- ~~The variation of thermal properties of the fenestration system with ambient temperature.~~
- ~~Orientation (azimuth and tilt of surface).~~
- ~~The effect of shading from overhangs side fins, louvers or neighboring buildings or terrain.~~

~~*3.1.10.3 Infiltration*~~

~~The *Compliance Software* shall be capable of simulating infiltration that varies by the time of day and day of the week. Schedules are provided in Appendix 5.4B.~~

~~*3.1.10.4 Natural Ventilation*~~

~~The *Compliance Software* shall be capable of simulating natural ventilation.~~

~~3.1.11 Systems Simulation~~

~~*3.1.11.1 General*~~

~~The *Compliance Software* shall be capable of modeling:~~

- ~~The baseline building systems defined in Chapter 5,~~
- ~~The lighting, water heating, HVAC and miscellaneous equipment detailed in Chapter 5~~
- ~~All compulsory and required features as detailed in Chapter 5~~

~~The capability to model multiple zone systems shall allow at least 15 *thermal zones* to be served by one multiple zone system.~~

~~The *Compliance Software* shall be capable of modeling plenum air return.~~

~~*3.1.11.2 HVAC Zone Level Systems*~~

~~The *Compliance Software* shall be capable of simulating the effect on space temperature and energy use of:~~

- ~~Limited capacity of terminal heating devices;~~
- ~~Limited capacity of terminal cooling devices; and~~
- ~~Limited rate of air flow to *thermal zones*.~~

~~*3.1.11.3 HVAC Secondary Systems and Equipment*~~

~~The *Compliance Software* shall be capable of simulating the effect on energy use and space temperature in *thermal zones* served by the HVAC system of:~~

- ~~Limited heating capacity of an HVAC system; and~~
- ~~Limited cooling capacity of an HVAC system.~~

~~The simulation of HVAC systems shall account for:~~

- ~~Temperature rise of supply air due to heat from supply fan, depending on the location of the fan;~~
- ~~Temperature rise of return air due to heat from return fan;~~
- ~~Temperature rise of return air due to heat from lights to return air stream; and~~
- ~~Fan power as a function of supply air flow in variable air volume systems.~~

~~*3.1.11.4 HVAC Primary Systems and Equipment*~~

~~The *Compliance Software* shall be capable of simulating the effect on energy use of limited heating or cooling capacity of the central plant system.~~

~~If the *Compliance Software* is not capable of simulating the effect of limited heating or cooling capacity of the central plant system on space temperature in *thermal zones* dependent on the central plant system for heating and cooling, then it shall issue a warning message when loads on the central plant system are not met.~~

~~*3.1.11.5 Equipment Performance Curves*~~

~~The *Compliance Software* shall be capable of modeling the part load efficiency and variation in capacity of equipment as follows:~~

- ~~Furnaces as a function of part load;~~
- ~~Boilers as a function of part load, supply hot water temperature, and return hot water temperature;~~
- ~~Water-cooled compressors including heat pumps and chillers as a function of part load, evaporator fluid, or air temperature and condensing fluid temperature;~~
- ~~Air-cooled compressors including heat pumps, direct expansion cooling and chillers as a function of part load, ambient dry-bulb temperature, and wet-bulb temperature returning to the cooling coil;~~
- ~~Evaporative cooling systems as a function of ambient wet-bulb temperature; and~~
- ~~Cooling towers as a function of range and ambient wet-bulb temperature.~~

~~*3.1.11.6 Economizer Control*~~

~~The *Compliance Software* shall be capable of modeling integrated air- and water side economizers.~~

~~*3.1.11.7 Air Side Heat-Recovery*~~

~~The Compliance Software shall be capable of modeling heat recovery between the exhaust air stream and the outside air stream. The software shall account for auxiliary energy uses associated with heat recovery systems, including pumping energy, frost control, and system control.~~

~~*3.1.11.8 Heat-Recovery Water Heating*~~

~~The Compliance Software shall be capable of modeling heat recovery water heating from the following sources:~~

- ~~Double bundled chiller;~~
- ~~Refrigerant desuperheater as part of a packaged HVAC unit;~~
- ~~Heat exchanger on the condenser water loop; and~~
- ~~Heat recovery water-to-water heat pump operating off of the condenser or chilled water loop.~~

~~*3.1.11.9 Heat-Pump Water Heaters*~~

~~The Compliance Software shall be capable of modeling heat-pump water heaters. The algorithm must allow the evaporator coil to be located in:~~

- ~~Any thermal zone;~~
- ~~Any plenum; and~~
- ~~Outside air.~~

~~3.1.12 Managing User Input~~

~~This section addresses the processes of data entry and the validation of user input data that can be performed prior to and independent of the energy simulation.~~

~~*3.1.12.1 Building Descriptor Inputs and Restrictions*~~

~~Building descriptors are discussed in Chapter 5. There are three types of inputs as shown in Table 2: compulsory, required and unsanctioned. Compulsory inputs must always be specified by the user for any compliance run. Required inputs shall be supported by the Compliance Software but they may not be applicable for all compliance runs. Some software may still be certified for compliance if it doesn't support some of the inputs listed in this manual; however, the software will only be certified for a limited scope commensurate with its capabilities. Unsanctioned inputs are inputs that are not addressed in this manual; these are not discussed in Chapter 5.~~

~~All inputs shall conform to the input conditions and restrictions specified in Chapter 5. Four levels of restriction are specified for building descriptors. The most limiting restriction is a prescribed value. This is an input that must be used in all instances, with no variation. A critical default may be overridden, but when it is, the user must provide special documentation. A default is provided for convenience and may be overridden by the user with no special documentation. For many inputs there is no restriction. The relationship between input types and restrictions is shown in Table 2.~~

~~*Table 2 – Input Types and Restrictions*~~

~~Input Type~~	~~Prescribed~~	~~Critical Default~~	~~Default~~	~~No Restriction~~
~~Compulsory~~	~~n.a.~~	~~n.a.~~	~~n.a.~~	~~✓~~
~~Required~~	~~✓~~	~~✓~~	~~✓~~	~~✓~~
~~Unsanctioned~~	~~n.a.~~	~~n.a.~~	~~n.a.~~	~~✓~~

~~Restrictions apply to all required inputs. The software user interface shall: 1) clearly indicate when a building descriptor has an associated default, 2) indicate what the default value is, and 3) provide a convenient means for the user to over-ride the default. When critical default values are overridden, the software interface shall notify the user that documentation of the revised assumption is required.~~

~~No restrictions are specified for unsanctioned inputs. The use of unsanctioned inputs may require an Exceptional Calculation Procedure application be submitted for the building system or features.~~

~~Compliance Software may not provide default assumptions other than those specified in Chapter 5. However, the software may assist the user in describing the proposed design by displaying typical values for building descriptors, provided deliberate action by the user is necessary before a displayed value is used.~~

~~*3.1.12.2 Data Validation*~~

~~*Compulsory Input Checks*~~

~~The software shall check to ensure that valid entries have been made for all compulsory building descriptors before the user is permitted to proceed with the next step in the compliance process. Appendix 5.0 and Chapter 5 specify the compulsory building descriptors. Examples of compulsory inputs are climate zone, floor area, and area category classification.~~

~~*Handling of Missing Inputs*~~

~~If a required input is missing or invalid, the software shall: 1) notify the user that the input is missing or invalid, 2) identify the input field(s) with missing or invalid data, and 3) prevent the user from moving to~~

~~the next step of the compliance process. The software may provide additional information designed to help the user correct the deficiency.~~

~~*Validity Checks*~~

~~The software shall check all user inputs to ensure that the following conditions are met:~~

- ~~*Simulation Tool Limits* Inputs do not exceed the minimums or maximums for the parameters permitted by the simulation engine.~~
- ~~*Compliance Rule Limits* Inputs do not exceed minimums or maximums for the descriptors specified in Chapter 5 of this document.~~
- ~~*Simulation Tool Discrete Options* Inputs correspond with valid discrete or list options for parameters available in the simulation engine.~~
- ~~*Compliance Rule Discrete Options* Inputs correspond with valid discrete options provided for in Chapter 5.~~

~~*Handling Invalid Input*~~

~~When invalid data is entered, the software shall: 1) notify the user of the invalid input, 2) identify the nonconforming input field, and 3) prevent execution of the next step of the compliance run; i.e., generating the input description for the proposed design. The software may provide additional information designed to help the user correct the deficiency.~~

~~*Consistency Checks*~~

~~The consistency checks described above are intended to identify errors and oversights in user input and thereby help ensure that the building description is complete and interpretable by the energy analysis program. Examples of consistency checks include that window should not exceed the areas of wall in which they are contained and that the necessary plant equipment has actually been connected to the secondary HVAC systems. The software may include additional consistency checks as needed.~~

~~*Handling Inconsistent Input*~~

~~If the proposed design fails a consistency check, the software shall: 1) notify the user that an inconsistency exists, 2) identify the specific consistency check that has been failed, 3) identify the inconsistent input fields, if feasible, and 4) prevent execution of the next step of the compliance process; i.e., generating the input description for the proposed design. The software may provide additional information designed to help the user correct the deficiency.~~

~~3.2 Special Documentation and Reporting Requirements~~

~~**(THIS INFORMATION COULD PROBABLY BE SUMMARIZED IN A TABLE – ALL BUILDING DESCRIPTORS OF TYPE "CRITICAL DEFAULT" REQUIRE DOCUMENTATION IF THE DEFAULT VALUE IS OVERRIDDEN. THE REPORTING REQUIREMENTS SHOWN HERE HAVE NOT BEEN FINALIZED, BUT ARE REPRESENTATIVE OF THE TYPE OF EXCEPTIONAL FEATURES THAT REQUIRE DOCUMENTATION.)**~~

~~3.2.1 Building Envelope~~

~~*3.2.1.1 Roof Radiative Properties*~~

~~The user shall enter three-year aged roof reflectance and emittance for roofs that have been certified by the Cool Roof Rating Council.~~

~~*3.2.1.2 Ground Reflectance*~~

~~When specific design features are incorporated to increase or reduce reflectance for the purpose of enhancing daylighting, there can be variation between the proposed design and the standard design, when appropriately documented. In cases where the default value is overridden, the user is required to submit documentation identifying the test procedure that was used to establish the non-default values.~~

~~*3.2.1.3 Exterior Wall Surface Properties*~~

~~The default value for emittance is 0.90. The default value for reflectance is 0.30. There is no default for roughness. The default values may be overridden only in cases when the lower reflectance can be documented by manufacturers' literature or tests.~~

~~3.2.2 Interior Lighting~~

~~*3.2.2.1 Regulated Interior Lighting Power*~~

~~Complete lighting plans and space plans are required for the tailored method. Prescriptive compliance forms for the tailored method shall be developed and these shall be verified by the plans examiner.~~

~~With the tailored lighting method, the software shall make an entry in the special features section on the California compliance forms that the tailored lighting method has been used to determine the lighting power for this space and that all necessary prescriptive tailored lighting forms and worksheets documenting the lighting and its justification shall be provided as part of the compliance documentation and be approved independently.~~

~~*3.2.2.2 Indoor Lighting Power (see 5.4.4)*~~

~~Compliance software shall print all applicable lighting forms and report the lighting energy use and the lighting level (Watts/ft^2) for the entire project. Compliance software shall report "No Lighting Installed" for nonresidential spaces with no installed lighting. Compliance software shall report "Default Residential Lighting" for residential units of high rise residential buildings and hotel/motel guest rooms.~~

~~If the modeled Lighting Power Density (LPD) is different than the actual LPD calculated from the fixture schedule for the building, Compliance software shall model the larger of the two values for sizing the mechanical systems and for the compliance run. Compliance software shall report the larger value on PERF-1. Lighting levels schedules shall be adjusted by any lighting Control Credit Watts, if input by the user.~~

~~Lighting power is not modeled in unconditioned spaces that are modeled, but lighting in those spaces is required to meet the prescriptive requirements for regulated unconditioned spaces such as commercial and industrial storage spaces and parking garages. When these types of spaces are entered the compliance software must report in the Special Features section that these spaces must comply with the prescriptive requirements for such spaces.~~

~~*3.2.2.3 Complete Building Method*~~

~~The Complete Building method triggers special reporting requirements. The compliance software shall report the following on the compliance form:~~

~~"The Complete Building method requires that at least 90% of the building contain conditioned space, and that at least 90% of the building conform to the building type classification. This condition must be verified by the building official."~~

~~3.2.2.4 Design Illumination Setpoint~~

~~Spaces that have low design illuminance levels, below the ranges specified in Appendix 5.4A, shall provide documentation that show the design illuminance to be used as the daylight illumination setpoint.~~

~~3.2.2.5 Primary and Secondary Daylighted Area~~

~~The default primary daylight area for sidelighting is a band near the window with a depth equal to the distance from the floor to the top of the window. The default secondary daylight area for sidelighting is a band beyond the primary daylighted area that extends a distance double the distance from the floor to the top of the window. Other daylight areas may be defined with appropriate documentation.~~

~~3.2.2.6 Light Heat Gain Distribution~~

~~Values within the ranges of Table 8 may be used when following the rules in the 2009 ASHRAE HOF. Other values may be used when manufacturers' literature and/or testing data is available, and adequate documentation is provided to the California Energy Commission.~~

~~3.2.3 Exterior Lighting~~

~~If the lighted façade area exceeds exterior wall area or if door linear footage exceeds 25% of building perimeter, the software shall produce a warning.~~

~~3.2.4 Infiltration Data~~

~~When credit is taken for reductions in infiltration (see above), test results or research reports shall be provided that document and support the inputs used for the baseline building and the proposed design.~~

~~3.2.5 HVAC Exceptional Conditions~~

~~3.2.5.1 Equipment Sizing~~

~~When the any proposed equipment size for secondary equipment or central plant equipment does not match the equipment size listed on construction documents, an exceptional condition shall be reported on compliance forms.~~

~~3.2.5.2 Custom Occupant, Fan, Heating or Cooling Schedules~~

~~Custom hourly schedules may be used with appropriate documentation from project schedules. The default schedules from Appendix 5.4B apply unless they are overridden. The user must ensure that the HVAC schedule operating hours serve all of the occupied spaces, and spaces should not be combined when their weekly occupancy varies by more than 40 full load equivalent operating hours (FLEOH).~~

~~3.2.5.3 Equipment Performance Curves~~

~~(Is documentation required if non-default HVAC equipment performance curves are used? For example, COOL-CAP-FT, COOL-EIR-FT, etc.)~~

~~(Note documentation required if credits for fault detection and diagnostics and/or airflow testing are taken.)~~

~~For equipment with a capacity less than or equal to 135,000 Btu/h, but larger than 65,000 Btu/h, the user may not enter data on the temperature dependent equipment performance. However, the compliance software vendor may work with manufacturers to collect such data and build this data into the compliance software. The user may either select equipment for which the compliance software vendor has collected or use the defaults.~~

~~*3.2.5.4 Natural Ventilation*~~

~~The air flow rate for the proposed design shall be determined using sound engineering methods and supporting documentation shall be provided.~~

~~*3.2.5.5 Condenser Flow Type*~~

~~The default is fixed condenser flow for water-cooled condensers. If the variable-flow is selected, the software must indicate that supporting documentation is required on the output forms.~~

~~*3.2.5.6 Evaporative Cooling Performance Curves*~~

~~User may input curves or use default curves. If defaults are overridden, the software must indicate that supporting documentation is required on the output forms.~~

~~*3.2.5.7 Condenser Heat Recovery Effectiveness*~~

~~As designed. The software must indicate that supporting documentation is required on the output forms if heat recovery is specified.~~

~~*3.2.5.8 Boiler Heat Loss*~~

~~Default is 2% for electric boilers and heat-exchangers and 0% for fuel-fired boilers. If the user overrides the default, supporting documentation is required.~~

~~*3.2.5.9 Boiler Minimum Unloading Ratio*~~

~~If the user does not use the default value the software must indicate that supporting documentation is required on the output forms.~~

~~*3.2.5.10 Chiller Minimum Unloading Ratio*~~

~~. If the user does not employ the default values, supporting documentation is required.~~

~~*3.2.5.11 Cooling Tower Setpoint Control*~~

~~If the user does not use the default control, supporting documentation is required.~~

~~*3.2.5.12 Exterior Lighting Control*~~

~~Documentation should be provided for lighting controls other than standard and evidence should be provided to support the reduction in lighting power (PAF).~~

~~3.3 ASHRAE Standard 140-2007 Tests~~

~~This method of testing is provided for analyzing and diagnosing building energy simulation software using software-to-software and software-to-quasi-analytical-solution comparisons. The methodology allows different building energy simulation programs, representing different degrees of modeling complexity, to be tested by comparing the predictions from other building energy programs to the simulation results provided by the Compliance Software in question.~~

~~Compliance software must pass ASHRAE 140-2007 tests, but these tests are not part of the Reference Method.~~

~~3.4 Reference Method Tests~~

~~The previous suite of tests, based on ASHRAE Standard 140-2007, verifies that the simulation engine produces appropriate models of fundamental building physics and predicts interactions between system components. Each test requires a simulation to be run. The tests in this section are intended to verify that the software correctly constructs the proposed design and baseline buildings and correctly applies the proposed design input restrictions specified in Chapter 5 and Appendix 5.0. A set of quantitiative tests verifies that the candidate compliance software can accurately predict energy tradeoffs bre~~

~~3.4.1 Compliance Margin Tests~~

~~This document details the eligibility requirements for an applicant simulation program for use as compliance software under the 2013 ACM. A series of **quantitative** tests called the Compliance Margin Tests shall be performed and results compared against predetermined Reference results to demonstrate that the applicant software is acceptable for use in code compliance. There are a total of 168 tests. All the test cases described in Section VII shall be performed and results summarized in the forms contained in Appendix A.~~

~~*3.4.1.1 Overview*~~

~~The applicant software shall perform a suite of Compliance Margin Test Cases to demonstrate that their performance is acceptable for code compliance. The applicant software test results shall be compared against a base case called the Reference tests. The Reference Test case is the corresponding match of a particular test case simulated already on EnergyPlus (v.7.0) engine. The Reference Model results, as determined by the Commission, are tabulated in Appendix A.~~

~~The test cases will assess the applicant software's sensitivity to various inputs ranging from envelope thermal conductance to HVAC system performance. Each case tests the impact of the input component on building end use energy and annual TDV. The following seven input components will be tested through a series of _ tests:~~

- ~~Opaque envelope~~
- ~~Glazing~~
- ~~Lighting~~
- ~~Daylighting~~
- ~~Receptacle loads~~
- ~~HVAC System Parameters~~

~~3.4.1.2 Reference Model~~

~~The Reference Method tests are performed on seven Prototype Models which are a subset of the DOE Prototype Building Models developed by PNNL for analysis of ASHRAE Standard 90.1. The Reference Models are EnergyPlus model input files of the DOE prototype models, modified to comply with the requirements of Title-24 2013. The Reference Models will be the reference baseline runs for the test cases. The applicant software shall replicate the seven building models using the same inputs as the Reference Models. The models so replicated will be the applicant baseline models for the test cases.~~

~~A summary of the Reference Models is provided in Appendix A. Detailed EnergyPlus input files of the Reference models are available from the California Energy Commission's Building Energy Efficiency Software Consortium webpage http://www.energydataweb.com/consortium/PACdocsNR.aspx.~~

~~Reference Models used for the test cases are:~~

- ~~Small Office Building:~~

~~This is a single story building of area 5500 square feet with punched windows distributed evenly across all facades. There are five thermal zones in this building served by packaged air conditioning units. For further details refer Appendix A.~~

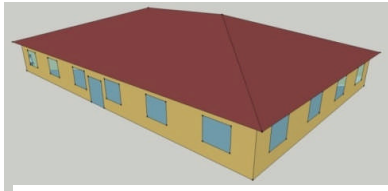

fig 1- Small Office

- ~~Medium Office Building:~~

~~This Reference model is a three storied rectangular building with an overall area of 53600 square feet. It has a window to wall ratio of 33% with fenestration distributed evenly across all four facades. The zones are served by DX cooling and Gas furnace heating with electric reheat. For further details refer Appendix A.~~

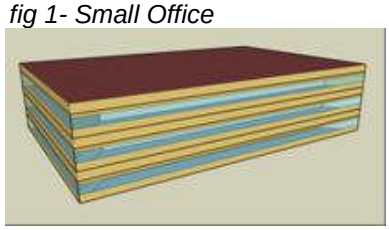

fig.2- Medium Office

- ~~Large Office Building:~~

~~The large office building has twelve floors and a basement floor with glas windows with a window to wall ratio of 40% on the above grade walls. Th total area of the building is 498,600 square feet. The HVAC system type used is centrifugal chillers and gas boiler. For further details refer Appendix A.~~

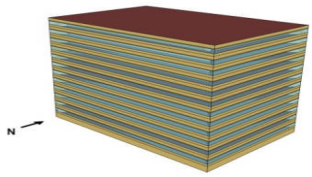

fig.3- Large Office

- ~~Stand-Alone Retail:~~

~~The stand-alone retail is a single story rectangular building measuring 178 ft by 139 ft. The total area is 24695 square feet. Windows are located only on the street facing façade and occupy 25.4% of that facade. The building is divided into five thermal zones which are served by various system types as described in Appendix A.~~

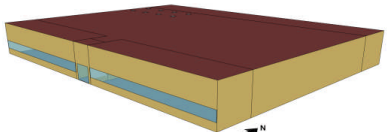

fig.4- Stand-Alone Retail

- ~~Primary School:~~

~~The primary school building is a single story building with a total floor area of 73, 960 square feet. It has a window to wall ratio of 35% with ribbon windows across all facades. Thermal zoning is as per exposure and space function. The zones are served by various system types. For further details refer Appendix A.~~

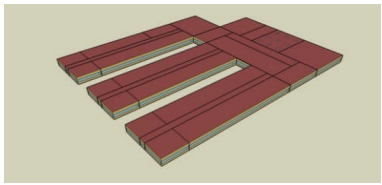

fi

- ~~Fast food Restaurant:~~

~~The fast food restaurant Model has one floor of area 2500 square feet. Windows are located on the east, south and west sides of the dining zone façade. Window to wall ratio varies for each façade. The building is served by packaged air conditioning unit. For further details refer Appendix A.~~

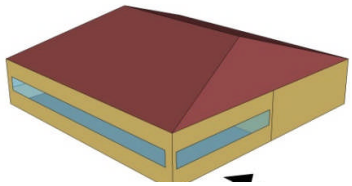

fig.6- Fast food Restaurant

- ~~Warehouse Building:~~

~~The warehouse building has a total area of 49,495 square feet. It has three zones with office and storage spaces. The office spaces have punched windows. For further details refer Appendix A.~~

- ~~Strip Mall Building:~~

~~The strip mall building has a total area of 22,500 square feet. It has ten zones each with rooftop units. The building has windows in the street facing façade and has an overall window to wall ratio of 10.5% . For further details refer Appendix A.~~

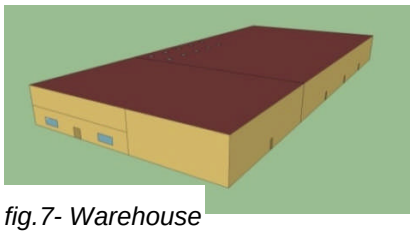

fig.7- Warehouse

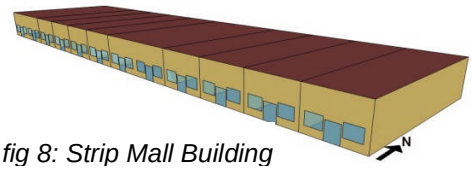

fig 8: Strip Mall Building

~~3.4.1.3 Climate Zones~~

~~The Reference Method Test cases use five of the 16 California climate zones. Most tests are performed on two or three climate zones to capture the sensitivity of the input characteristic to extremes in weather conditions. The test cases are performed on climate zones 6, 15 and 16 which represent mild, hot and cold climates respectively. Daylighting tests are performed on climate zone 7 which has a high annual daylighting potential and climate zone 1, representative of climate with least annual daylighting potential.~~

~~*Table 3-Climate Zones Tested*~~

~~Climate Zone~~	~~Example City~~
~~1~~	~~Arcata~~
~~6~~	~~Long Beach~~
~~7~~	~~San Diego Lindbergh~~
~~15~~	~~Palm Springs Intl~~
~~16~~	~~Blue Canyon~~

~~3.4.1.4 Labeling Computer Runs~~

~~Each test case used for the compliance test is labeled uniquely to make it easier to keep track of the runs and to facilitate analysis. The following scheme is used:~~

~~Envelope Test/Medium Office-CZ 15, Roof Insulation~~

~~Input Characteristic~~

~~Climate Zone~~

~~Prototype Model Type~~

~~Test Component~~

~~*3.4.1.5 Test Criteria*~~

~~Applicant software vendors shall perform a series of computer runs. Each of these runs shall be a systematic variation of the applicant base case model as described in Section VII. The applicant test case results will be compared to the reference results to verify that applicant software meets the requirements of the ACM. Simulation results for each test case will be compiled in forms provided in Appendix A. Compiled results will include annual site energy consumption for each end-use, overall site energy consumption, total unmet load hours and annual TDV and % variation of annual TDV and total end use site energy.~~

~~The annual TDV % variation shall be calculated using the formula:~~

$\cancel{TDV_{\%} = (TDV_b - TDV_n)/TDV_b}$

~~Where, $TDV_{\%}$ is the TDV % variation,~~

~~TDV_n is the annual TDV for test case number n and~~

~~TDV_b is the annual TDV for the base case run.~~

~~In order to be accepted, the applicant software should fulfill the passing criteria as determined by the Commission:~~

~~For each test case,~~

~~When Reference Model $TDV_{\%r}$ ≤ 1%, Allowed Maximum Applicant Model $TDV_{\%a}$ =1%~~

~~When Reference Model $TDV_{\%r}$ > 1%, Allowed Applicant Model $TDV_{\%a}$ shall be within ± 10% of Reference Model $TDV_{\%r}$~~

~~Where, the subscript "a" represents the applicant results and "r" represents the reference results.~~

~~If any of the tests fail to meet these criteria, the applicant software will not be accepted for compliance use.~~

~~*3.4.1.6 Compliance Margin Test Cases*~~

~~Test cases assess the energy impact of one or more of the building or system input characteristics on the baseline model. Each test suite consists of a series of unique test cases aimed to test the impact of a specific characteristic on building energy performance. Simulations are grouped according to test criteria and sub-grouped based on the reference model type to allow for direct comparison of results. For each test case, the applicant software will modify the applicant baseline model with specific inputs as described in the Test Case description section.~~

~~The test cases are simulated on multiple California weather files to evaluate the sensitivity of the building or system input to extremes in climate. Results of the test case runs and the TDV percent variation over the baseline run shall be compiled and compared against the reference results.~~

~~Each test case described in this section shall be compared against a baseline run. The baseline runs for each of the test cases are provided in Table 4 – Baseline Runs for Test *Cases*. A summary of the baseline reference Models is provided in Appendix A. Detailed EnergyPlus input files of the Reference baseline and test case models are available from the California Energy Commission's, Building Energy Efficiency Software Consortium webpage http://www.energydataweb.com/consortium/PACdocsNR.aspx.~~

~~**Test cases:**~~

- ~~**Envelope Test**~~

1. ~~**Envelope Test/Medium Office-CZ-15, Roof Insulation-** This case tests the impact of modifying Roof assembly overall U value in climate zone 15. Roof assembly U value is increased 20% more than the baseline case.~~
2. ~~**Envelope Test/Medium Office-CZ-15, Wall Insulation-** This case tests the impact of modifying Wall assembly overall U value in climate zone 15. Wall assembly U value is modeled 20% more than the baseline case.~~
3. ~~**Envelope Test/Medium Office-CZ-15, Floor Slab Insulation-** This case tests the impact of a slab on grade floor with vertical perimeter insulation in climate zone 15. The baseline case has floor slab with no insulation.~~
4. ~~**Envelope Test/Medium Office-CZ-15, Infiltration-** This case tests the impact of increasing the envelope infiltration by 5% compared to baseline case in climate zone 15.~~
5. ~~**Envelope Test/Medium Office-CZ-16, Roof Insulation-** This case tests the impact of modifying Roof assembly overall U value in climate zone 16. Roof assembly U value is increased 20% more than the baseline case.~~
6. ~~**Envelope Test/Medium Office-CZ-16, Wall Insulation-** This case tests the impact of modifying Wall assembly overall U value in climate zone 15. Wall assembly U value is modeled 20% more than the baseline case.~~
7. ~~**Envelope Test/Medium Office-CZ-16, Floor Slab Insulation-** This case tests the impact of a slab on grade floor with vertical perimeter insulation in climate zone 15. The baseline case has floor slab with no insulation.~~
8. ~~**Envelope Test/Medium Office-CZ-16, Infiltration-** This case tests the impact of increasing the envelope infiltration by 5% compared to baseline case in climate zone 16.~~
9. ~~**Envelope Test/Medium Office-CZ-6, Roof Insulation-** This case tests the impact of modifying Roof assembly overall U value in climate zone 6. Roof assembly U value is increased 20% more than the baseline case.~~
10. ~~**Envelope Test/Medium Office-CZ-6, Wall Insulation-** This case tests the impact of modifying Wall assembly overall U value in climate zone 6. Wall assembly U value is modeled 20% more than the baseline case.~~
11. ~~**Envelope Test/Medium Office-CZ-6, Floor Slab Insulation-** This case tests the impact of a slab on grade floor with vertical perimeter insulation in climate zone 6. The baseline case has floor slab with no insulation.~~
12. ~~**Envelope Test/Medium Office-CZ-6, Infiltration-** This case tests the impact of increasing the envelope infiltration by 5% compared to baseline case in climate zone 6.~~
13. ~~**Envelope Test/Small Office-CZ-15, Low Sloped Roof, Solar Reflectance-** This case tests the impact of modifying the reflectivity of the roof in climate zone -15. Here, aged solar reflectance of the roofing product is increased by 20% compared to a low sloped base case roof.~~
14. ~~**Envelope Test/Small Office-CZ-16, Low Sloped Roof, Solar Reflectance-** This case tests the impact of modifying the reflectivity of the roof in climate zone -16. Here, aged solar reflectance of the roofing product is increased by 20% compared to a low sloped base case roof.~~
15. ~~**Envelope Test/Small Office-CZ-6, Low Sloped Roof, Solar Reflectance-** This case tests the impact of modifying the reflectivity of the roof in climate zone -6. Here, aged solar reflectance of the roofing product is increased by 20% compared to a low sloped base case roof.~~
16. ~~**Envelope Test/Small Office-CZ-15, Steep Sloped Roof, Solar Reflectance-** This case tests the impact of modifying the reflectivity of the roof in climate zone -15. Here, aged solar reflectance of the roofing product is increased by 20% compared to a steep sloped base case roof.~~

17. ~~**Envelope Test/Small Office-CZ-16, Steep Sloped Roof, Solar Reflectance**- This case tests the impact of modifying the reflectivity of the roof in climate zone -16. Here, aged solar reflectance of the roofing product is increased by 20% compared to a steep sloped base case roof.~~

18. ~~**Envelope Test/Small Office-CZ-6, Steep Sloped Roof, Solar Reflectance**- This case tests the impact of modifying the reflectivity of the roof in climate zone -6. Here, aged solar reflectance of the roofing product is increased by 20% compared to a low sloped base case roof.~~

19. ~~**Envelope Test/Primary School-CZ-15-Heavy Construction**- In this case, the impact of envelope mass on energy consumption in climate zone 15 is tested. The test case is modeled with a Solid concrete wall and compared against the light weight construction baseline.~~

20. ~~**Envelope Test/Primary School-CZ-16-Heavy Construction**- In this case, the impact of envelope mass on energy consumption in climate zone 16 is tested. The test case is modeled with a Solid concrete wall and compared against the light weight construction baseline.~~

21. ~~**Envelope Test/Primary School-CZ-6-Heavy Construction**- In this case, the impact of envelope mass on energy consumption in climate zone 6 is tested. The test case is modeled with a Solid concrete wall and compared against the light weight construction baseline.~~

- ~~**Envelope Glazing Test**~~

22. ~~**Envelope Glazing Test/Medium Office-CZ-15, Window U value**- This case tests the impact of reducing the window U value by 20% compared to baseline window U value on climate zone 15. The intent is to test the sensitivity of the software to modifications in heat transmitted into the space through fenestration.~~

23. ~~**Envelope Glazing Test/Medium Office-CZ-15, Window SHGC value**- This case tests the impact of reducing the window SHGC value by 20% compared to baseline SHGC on climate zone 15. The intent is to test the sensitivity of the software to modifications in heat transmitted into the space through fenestration.~~

24. ~~**Envelope Glazing Test/Medium Office-CZ-15, Window U & SHGC value**- This case tests the impact of reducing the window U and SHGC values by 20% compared to baseline on climate zone 15. The intent is to test the sensitivity of the software to modifications in heat transmitted into the space through fenestration.~~

25. ~~**Envelope Glazing Test/Medium Office-CZ-16, Window U value**- This case tests the impact of reducing the window U value by 20% compared to baseline window U value on climate zone 16. The intent is to test the sensitivity of the software to modifications in heat transmitted into the space through fenestration.~~

26. ~~**Envelope Glazing Test/Medium Office-CZ-16, Window SHGC value**- This case tests the impact of reducing the window SHGC value by 20% compared to baseline SHGC on climate zone 16. The intent is to test the sensitivity of the software to modifications in heat transmitted into the space through fenestration.~~

27. ~~**Envelope Glazing Test/Medium Office-CZ-16, Window U & SHGC value**- This case tests the impact of reducing the window U and SHGC values by 20% compared to baseline on climate zone 16. The intent is to test the sensitivity of the software to modifications in heat transmitted into the space through fenestration.~~

28. ~~**Envelope Glazing Test/Medium Office-CZ-6, Window U value**- This case tests the impact of reducing the window U value by 20% compared to baseline window U value on climate zone 6. The intent is to test the sensitivity of the software to modifications in heat transmitted into the space through fenestration.~~

29. ~~**Envelope Glazing Test/Medium Office-CZ-6, Window SHGC value**- This case tests the impact of reducing the window U value by 20% compared to baseline window U value on climate zone 6. The intent is to test the sensitivity of the software to modifications in heat transmitted into the space through fenestration.~~

30. **Envelope Glazing Test/Medium Office-CZ-6, Window U & SHGC value**- This case tests the impact of reducing the window U and SHGC values by 20% compared to baseline on climate zone 6. The intent is to test the sensitivity of the software to modifications in heat transmitted into the space through fenestration.

31. **Envelope Glazing Test/Large Office-CZ-7, WWR of 20%**- In this case, the impact of reducing the window to wall ratio is tested. The test case is compared against the baseline which has a WWR of 40%. This case is tested for climate zone 7.

32. **Envelope Glazing Test/Large Office-CZ-7, WWR of 60%**- In this case, the impact of increasing the window to wall ratio is tested. The test case is compared against the baseline which has a WWR of 40%. This case is tested for climate zone 7.

33. **Envelope Glazing Test/Large Office-CZ-7, WWR of 60% with overhang on South Façade**- In this case, the impact of shading the south facing windows by a two feet deep overhang is tested. This case is tested for climate zone 7.

34. **Envelope Glazing Test/Large Office-CZ-1, WWR of 20%**- In this case, the impact of reducing the window to wall ratio is tested. The test case is compared against the baseline which has a WWR of 40%. This case is tested for climate zone 1.

35. **Envelope Glazing Test/Large Office-CZ-1, WWR of 60%**- In this case, the impact of increasing the window to wall ratio is tested. The test case is compared against the baseline which has a WWR of 40%. This case is tested for climate zone 1.

- **Lighting Test**

36. **Lighting Test/Medium Office-CZ-15, low lighting power density**- This case tests the impact of reducing the lighting power density of interior lights by 20% compared to baseline. This case is tested on climate zone 15.

37. **Lighting Test/Medium Office-CZ-15, high lighting power density**- This case tests the impact of increasing the lighting power density of interior lights by 20% compared to baseline. This case is tested on climate zone 15.

38. **Lighting Test/Medium Office-CZ-16, low lighting power density**- This case tests the impact of reducing the lighting power density of interior lights by 20% compared to baseline. This case is tested on climate zone 16.

39. **Lighting Test/Medium Office-CZ-16, high lighting power density**- This case tests the impact of increasing the lighting power density of interior lights by 20% compared to baseline. This case is tested on climate zone 16.

40. **Lighting Test/Medium Office-CZ-6, low lighting power density**- This case tests the impact of reducing the lighting power density of interior lights by 20% compared to baseline. This case is tested on climate zone 6.

41. **Lighting Test/Medium Office-CZ-6, high lighting power density**- This case tests the impact of increasing the lighting power density of interior lights by 20% compared to baseline. This case is tested on climate zone 6.

- **Daylighting Test**

42. **Daylighting Test/Large Office-CZ-7, Daylight sensors with Continuous Dimming**- This case tests the impact of daylighting. Daylight sensors with continuous dimming is modeled in a large office building type with a WWR of 40% and results compared against Large office Prototype model , both modeled for climate zone 7.

43. **Daylighting Test/Large Office-CZ-7, Daylight sensors with Continuous Dimming and windows with high VT**- This case tests the impact of daylighting. Daylight sensors with continuous dimming are modeled in a large office building type with a WWR of 40%. The visible transmittance of windows is increased to improve the daylighting potential. This case is tested on large office Prototype model, both modeled for climate zone 7.

44. ~~**Daylighting Test/Large Office-CZ-7, Daylight sensors with Stepped Dimming-** This case tests the impact of daylighting. Daylight sensors with stepped dimming is modeled in a large office building type with a WWR of 40% and results compared against Large office Prototype model, both modeled for climate zone 7.~~

45. ~~**Daylighting Test/Large Office-CZ-7, Daylight sensors with Stepped Dimming and windows with high VT-** This case tests the impact of daylighting. Daylight sensors with stepped dimming are modeled in a large office building type with a WWR of 40%. The visible transmittance of windows is increased to improve the daylighting potential. This case is tested on large office Prototype model, both modeled for climate zone 7.~~

46. ~~**Daylighting Test/Large Office-CZ-7,WWR of 20%, Daylight sensors with Continuous Dimming-** This case tests the impact of daylighting. Daylight sensors with continuous dimming is modeled in a large office building type with a WWR of 20% and results compared against Large office Prototype model , both modeled for climate zone 7.~~

47. ~~**Daylighting Test/Large Office-CZ-7, WWR of 20%, Daylight sensors with Continuous Dimming and windows with high VT-** This case tests the impact of daylighting. Daylight sensors with continuous dimming are modeled in a large office building type with a WWR of 20%. The visible transmittance of windows is increased to improve the daylighting potential. This case is tested on large office Prototype model in climate zone 7.~~

48. ~~**Daylighting Test/Large Office-CZ-7, WWR of 20%, Daylight sensors with Stepped Dimming-** This case tests the impact of daylighting. Daylight sensors with stepped dimming is modeled in a large office building type with a WWR of 20% and results compared against Large office Prototype model in climate zone 7.~~

49. ~~**Daylighting Test/Large Office-CZ-7, WWR of 20%, Daylight sensors with Stepped Dimming and windows with high VT-** This case tests the impact of daylighting. Daylight sensors with stepped dimming are modeled in a large office building type with a WWR of 20%. The visible transmittance of windows is increased to improve the daylighting potential. This case is tested on large office Prototype model in climate zone 7.~~

50. ~~**Daylighting Test/Large Office-CZ-7,WWR of 60%, Daylight sensors with Continuous Dimming-** This case tests the impact of daylighting. Daylight sensors with continuous dimming is modeled in a large office building type with a WWR of 60% and results compared against Large office Prototype model in climate zone 7.~~

51. ~~**Daylighting Test/Large Office-CZ-7, WWR of 60%, Daylight sensors with Continuous Dimming and windows with high VT-** This case tests the impact of daylighting. Daylight sensors with continuous dimming are modeled in a large office building type with a WWR of 60%. The visible transmittance of windows is increased to improve the daylighting potential. This case is tested on large office Prototype model in climate zone 7.~~

52. ~~**Daylighting Test/Large Office-CZ-7, WWR of 60%, Daylight sensors with Stepped Dimming-** This case tests the impact of daylighting. Daylight sensors with stepped dimming is modeled in a large office building type with a WWR of 60% and results compared against Large office Prototype model in climate zone 7.~~

53. ~~**Daylighting Test/Large Office-CZ-7, WWR of 60%, Daylight sensors with Stepped Dimming and windows with high VT-** This case tests the impact of daylighting. Daylight sensors with stepped dimming are modeled in a large office building type with a WWR of 60%. The visible transmittance of windows is increased to improve the daylighting potential. This case is tested on large office Prototype model in climate zone 7.~~

54. ~~**Daylighting Test/Large Office-CZ-1, Daylight sensors with Continuous Dimming-** This case tests the impact of daylighting. Daylight sensors with continuous dimming is modeled in a large office building type with a WWR of 40% and results compared against Large office Prototype model , both modeled for climate zone 1.~~

55. **~~Daylighting Test/Large Office-CZ-1, Daylight sensors with Continuous Dimming and windows with high VT-~~** ~~This case tests the impact of daylighting. Daylight sensors with continuous dimming are modeled in a large office building type with a WWR of 40%. The visible transmittance of windows is increased to improve the daylighting potential. This case is tested on large office Prototype model, both modeled for climate zone 1.~~

56. **~~Daylighting Test/Large Office-CZ-1, Daylight sensors with Stepped Dimming-~~** ~~This case tests the impact of daylighting. Daylight sensors with stepped dimming is modeled in a large office building type with a WWR of 40% and results compared against Large office Prototype model , both modeled for climate zone 1.~~

57. **~~Daylighting Test/Large Office-CZ-1, Daylight sensors with Stepped Dimming and windows with high VT-~~** ~~This case tests the impact of daylighting. Daylight sensors with stepped dimming are modeled in a large office building type with a WWR of 40%. The visible transmittance of windows is increased to improve the daylighting potential. This case is tested on large office Prototype model, both modeled for climate zone 1.~~

58. **~~Daylighting Test/Large Office-CZ-1,WWR of 20%, Daylight sensors with Continuous Dimming-~~** ~~This case tests the impact of daylighting. Daylight sensors with continuous dimming is modeled in a large office building type with a WWR of 20% and results compared against Large office Prototype model , both modeled for climate zone 1.~~

59. **~~Daylighting Test/Large Office-CZ-1, WWR of 20%, Daylight sensors with Continuous Dimming and windows with high VT-~~** ~~This case tests the impact of daylighting. Daylight sensors with continuous dimming are modeled in a large office building type with a WWR of 20%. The visible transmittance of windows is increased to improve the daylighting potential. This case is tested on large office Prototype model in climate zone 1.~~

60. **~~Daylighting Test/Large Office-CZ-1, WWR of 20%, Daylight sensors with Stepped Dimming-~~** ~~This case tests the impact of daylighting. Daylight sensors with stepped dimming is modeled in a large office building type with a WWR of 20% and results compared against Large office Prototype model in climate zone 1.~~

61. **~~Daylighting Test/Large Office-CZ-1, WWR of 20%, Daylight sensors with Stepped Dimming and windows with high VT-~~** ~~This case tests the impact of daylighting. Daylight sensors with stepped dimming are modeled in a large office building type with a WWR of 20%. The visible transmittance of windows is increased to improve the daylighting potential. This case is tested on large office Prototype model in climate zone 1.~~

62. **~~Daylighting Test/Large Office-CZ-1 ,WWR of 60%, Daylight sensors with Continuous Dimming-~~** ~~This case tests the impact of daylighting. Daylight sensors with continuous dimming is modeled in a large office building type with a WWR of 60% and results compared against Large office Prototype model in climate zone 1.~~

63. **~~Daylighting Test/Large Office-CZ-1, WWR of 60%, Daylight sensors with Continuous Dimming and windows with high VT-~~** ~~This case tests the impact of daylighting. Daylight sensors with continuous dimming are modeled in a large office building type with a WWR of 60%. The visible transmittance of windows is increased to improve the daylighting potential. This case is tested on large office Prototype model in climate zone 1.~~

64. **~~Daylighting Test/Large Office-CZ-1, WWR of 60%, Daylight sensors with Stepped Dimming-~~** ~~This case tests the impact of daylighting. Daylight sensors with stepped dimming is modeled in a large office building type with a WWR of 60% and results compared against Large office Prototype model in climate zone 1.~~

65. **~~Daylighting Test/Large Office-CZ-1, WWR of 60%, Daylight sensors with Stepped Dimming and windows with high VT-~~** ~~This case tests the impact of daylighting. Daylight sensors with stepped dimming are modeled in a large office building type with a WWR of 60%. The visible transmittance of windows is increased to improve the daylighting potential. This case is tested on large office Prototype model in climate zone 1.~~

66. ~~**Daylighting Test/Stand Alone Retail-CZ-7, with skylights with high VT-** In this case the impact of daylighting with skylights is tested. Daylight potential is improved by increasing the visible transmittance of the skylight glass. Standalone retail building in climate zone 7 is tested in this case.~~

67. ~~**Daylighting Test/Stand Alone Retail-CZ-7, with SRR of 5%-** In this case the impact of daylighting with skylights is tested. Daylight potential is improved by increasing the SRR to 5% compared to baseline SRR of 1.3%. Standalone retail building in climate zone 7 is tested in this case.~~

68. ~~**Daylighting Test/Stand Alone Retail-CZ-7, with SRR of 5% and skylights with high VT -** In this case the impact of daylighting with skylights is tested. Daylight potential is improved by increasing the SRR to 5% compared to baseline SRR of 1.3%, and visible transmittance of skylight glass. Standalone retail building in climate zone 7 is tested in this case.~~

69. ~~**Daylighting Test/Stand Alone Retail-CZ-1, with skylights with high VT-** In this case the impact of daylighting with skylights is tested. Daylight potential is improved by increasing the visible transmittance of the skylight glass. Standalone retail building in climate zone 1 is tested in this case.~~

70. ~~**Daylighting Test/Stand Alone Retail-CZ-1, with SRR of 5% %-** In this case the impact of daylighting with skylights is tested. Daylight potential is improved by increasing the SRR to 5% compared to baseline SRR of 1.3%. Standalone retail building in climate zone 1 is tested in this case.~~

71. ~~**Daylighting Test/Stand Alone Retail-CZ-1, with SRR of 5% and skylights with high VT -** In this case the impact of daylighting with skylights is tested. Daylight potential is improved by increasing the SRR to 5% compared to baseline SRR of 1.3%, and visible transmittance of skylight glass. Standalone retail building in climate zone 1 is tested in this case.~~

- ~~**Equipment Test**~~

72. ~~**Equipment Test/Medium Office-CZ-15, with low Equipment Power Density-** This case tests the impact of reducing the equipment power density by 20% compared to baseline. This case is tested on climate zone 15.~~

73. ~~**Equipment Test/Medium Office-CZ-15, with high Equipment Power Density-** This case tests the impact of increasing the equipment power density by 20% compared to baseline. This case is tested on climate zone 15.~~

74. ~~**Equipment Test/Medium Office-CZ-16, with low Equipment Power Density-** This case tests the impact of reducing the equipment power density by 20% compared to baseline. This case is tested on climate zone 16.~~

75. ~~**Equipment Test/Medium Office-CZ-16, with high Equipment Power Density-** This case tests the impact of increasing the equipment power density by 20% compared to baseline. This case is tested on climate zone 16.~~

76. ~~**Equipment Test/Medium Office-CZ-6, with low Equipment Power Density-** This case tests the impact of reducing the equipment power density by 20% compared to baseline. This case is tested on climate zone 6.~~

77. ~~**Equipment Test/Medium Office-CZ-6, with high Equipment Power Density-** This case tests the impact of increasing the equipment power density by 20% compared to baseline. This case is tested on climate zone 6.~~

78. ~~**Equipment Test/Fast food Restaurant-CZ-6, with high Process Load-** This case tests the impact of increasing the electric process load by 5% compared to baseline. This case is tested on climate zone 6.~~

~~The System test suit comprises of test cases for 12 different HVAC system types like:~~

- ~~Packaged Terminal Air Conditioner~~

- ~~Packaged Terminal Heat Pump~~
- ~~Packaged Single Zone System~~
- ~~Packaged VAV System~~
- ~~Single duct built-up VAV system~~
- ~~Fan coil units~~
- ~~Water loop heat pump~~
- ~~Evaporative cooling system~~
- ~~Natural ventilation~~
- ~~Hydronic radiant system~~
- ~~Under-floor air distribution system~~
- ~~Variable refrigerant flow (VRF) system~~

- ~~**HVAC Test Cases**~~

79. ~~**HVAC Test /PTAC, Stripmall-CZ-6, Low Efficiency-** This case tests the impact of modifying a set of parameters with efficiencies and requirements lower than the 2008 Title 24 baseline.~~
80. ~~**HVAC Test /PTAC, Stripmall-CZ-6, High Efficiency-** This case tests the impact of modifying a set of parameters with efficiencies and requirements higher than the 2008 Title 24 baseline.~~
81. ~~**HVAC Test /PTAC, Stripmall-CZ-15, Low Efficiency-** This case tests the impact of modifying a set of parameters with efficiencies and requirements lower than the 2008 Title 24 baseline.~~
82. ~~**HVAC Test /PTAC, Stripmall-CZ-15, High Efficiency-** This case tests the impact of modifying a set of parameters with efficiencies and requirements higher than the 2008 Title 24 baseline.~~
83. ~~**HVAC Test /PTAC, Stripmall-CZ-16, Low Efficiency-** This case tests the impact of modifying a set of parameters with efficiencies and requirements lower than the 2008 Title 24 baseline.~~
84. ~~**HVAC Test /PTAC, Stripmall-CZ-16, High Efficiency-** This case tests the impact of modifying a set of parameters with efficiencies and requirements higher than the 2008 Title 24 baseline.~~
85. ~~**HVAC Test /PTHP, Stripmall-CZ-6, Low Efficiency-** This case tests the impact of modifying a set of parameters with efficiencies and requirements lower than the 2008 Title 24 baseline.~~
86. ~~**HVAC Test /PTHP, Stripmall-CZ-6, High Efficiency-** This case tests the impact of modifying a set of parameters with efficiencies and requirements higher than the 2008 Title 24 baseline.~~
87. ~~**HVAC Test /PTHP, Stripmall-CZ-15, Low Efficiency-** This case tests the impact of modifying a set of parameters with efficiencies and requirements lower than the 2008 Title 24 baseline.~~
88. ~~**HVAC Test /PTHP, Stripmall-CZ-15, High Efficiency-** This case tests the impact of modifying a set of parameters with efficiencies and requirements higher than the 2008 Title 24 baseline.~~
89. ~~**HVAC Test /PTHP, Stripmall-CZ-16, Low Efficiency-** This case tests the impact of modifying a set of parameters with efficiencies and requirements lower than the 2008 Title 24 baseline.~~
90. ~~**HVAC Test /PTHP, Stripmall-CZ-16, High Efficiency-** This case tests the impact of modifying a set of parameters with efficiencies and requirements higher than the 2008 Title 24 baseline.~~
91. ~~**HVAC Test/ PSZ, Stripmall-CZ-6, Low Efficiency-** This case tests the impact of modifying a set of parameters with efficiencies and requirements lower than the 2008 Title 24 baseline.~~
92. ~~**HVAC Test/ PSZ, Stripmall-CZ-6, High Efficiency-** This case tests the impact of modifying a set of parameters with efficiencies and requirements higher than the 2008 Title 24 baseline.~~
93. ~~**HVAC Test/ PSZ, Stripmall-CZ-15, Low Efficiency-** This case tests the impact of modifying a set of parameters with efficiencies and requirements lower than the 2008 Title 24 baseline.~~

~~**94. HVAC Test/ PSZ, Stripmall-CZ-15, High Efficiency-** This case tests the impact of modifying a set of parameters with efficiencies and requirements higher than the 2008 Title 24 baseline.~~

~~**95. HVAC Test/ PSZ, Stripmall-CZ-16, Low Efficiency-** This case tests the impact of modifying a set of parameters with efficiencies and requirements lower than the 2008 Title 24 baseline.~~

~~**96. HVAC Test/ PSZ, Stripmall-CZ-16, High Efficiency-** This case tests the impact of modifying a set of parameters with efficiencies and requirements higher than the 2008 Title 24 baseline.~~

~~**97. HVAC Test/PVAV, Medium Office-CZ-6, Low Efficiency-** This case tests the impact of modifying a set of parameters with efficiencies and requirements lower than the 2008 Title 24 baseline.~~

~~**98. HVAC Test/PVAV, Medium Office-CZ-6, High Efficiency-** This case tests the impact of modifying a set of parameters with efficiencies and requirements higher than the 2008 Title 24 baseline.~~

~~**99. HVAC Test/PVAV, Medium Office-CZ-15, Low Efficiency-** This case tests the impact of modifying a set of parameters with efficiencies and requirements lower than the 2008 Title 24 baseline.~~

~~**100. HVAC Test/PVAV, Medium Office-CZ-15, High Efficiency-** This case tests the impact of modifying a set of parameters with efficiencies and requirements higher than the 2008 Title 24 baseline.~~

~~**101. HVAC Test/PVAV, Medium Office-CZ-16, Low Efficiency-** This case tests the impact of modifying a set of parameters with efficiencies and requirements lower than the 2008 Title 24 baseline.~~

~~**102. HVAC Test/PVAV, Medium Office-CZ-16, High Efficiency-** This case tests the impact of modifying a set of parameters with efficiencies and requirements higher than the 2008 Title 24 baseline.~~

~~**103. HVAC Test /VAV, Large Office-CZ-6, Low Efficiency-** This case tests the impact of modifying a set of parameters with efficiencies and requirements lower than the 2008 Title 24 baseline.~~

~~**104. HVAC Test /VAV, Large Office-CZ-6, High Efficiency-** This case tests the impact of modifying a set of parameters with efficiencies and requirements higher than the 2008 Title 24 baseline.~~

~~**105. HVAC Test /VAV, Large Office-CZ-15, Low Efficiency-** This case tests the impact of modifying a set of parameters with efficiencies and requirements lower than the 2008 Title 24 baseline.~~

~~**106. HVAC Test /VAV, Large Office-CZ-15, High Efficiency-** This case tests the impact of modifying a set of parameters with efficiencies and requirements higher than the 2008 Title 24 baseline.~~

~~**107. HVAC Test /VAV, Large Office-CZ-16, Low Efficiency-** This case tests the impact of modifying a set of parameters with efficiencies and requirements lower than the 2008 Title 24 baseline.~~

~~**108. HVAC Test /VAV, Large Office-CZ-16, High Efficiency-** This case tests the impact of modifying a set of parameters with efficiencies and requirements higher than the 2008 Title 24 baseline.~~

~~**109. HVAC Test/FanCoil, Stripmall-CZ-6, Low Efficiency-** This case tests the impact of modifying a set of parameters with efficiencies and requirements lower than the 2008 Title 24 baseline.~~

~~**110. HVAC Test/FanCoil, Stripmall-CZ-6, High Efficiency**- This case tests the impact of modifying a set of parameters with efficiencies and requirements higher than the 2008 Title 24 baseline.~~

~~**111. HVAC Test/FanCoil, Stripmall-CZ-15, Low Efficiency**- This case tests the impact of modifying a set of parameters with efficiencies and requirements lower than the 2008 Title 24 baseline.~~

~~**112. HVAC Test/FanCoil, Stripmall-CZ-15, High Efficiency**- This case tests the impact of modifying a set of parameters with efficiencies and requirements higher than the 2008 Title 24 baseline.~~

~~**113. HVAC Test/FanCoil, Stripmall-CZ-16, Low Efficiency**- This case tests the impact of modifying a set of parameters with efficiencies and requirements lower than the 2008 Title 24 baseline.~~

~~**114. HVAC Test/FanCoil, Stripmall-CZ-16, High Efficiency**- This case tests the impact of modifying a set of parameters with efficiencies and requirements higher than the 2008 Title 24 baseline.~~

~~**115. HVAC Test/VRF , Stripmall-CZ-6, Low Efficiency**- This case tests the impact of modifying a set of parameters with efficiencies and requirements lower than the 2008 Title 24 baseline.~~

~~**116. HVAC Test/VRF, Stripmall-CZ-6, High Efficiency**- This case tests the impact of modifying a set of parameters with efficiencies and requirements higher than the 2008 Title 24 baseline.~~

~~**117. HVAC Test/VRF , Stripmall-CZ-15, Low Efficiency**- This case tests the impact of modifying a set of parameters with efficiencies and requirements lower than the 2008 Title 24 baseline.~~

~~**118. HVAC Test/VRF, Stripmall-CZ-15, High Efficiency**- This case tests the impact of modifying a set of parameters with efficiencies and requirements higher than the 2008 Title 24 baseline.~~

~~**119. HVAC Test/VRF , Stripmall-CZ-16, Low Efficiency**- This case tests the impact of modifying a set of parameters with efficiencies and requirements lower than the 2008 Title 24 baseline.~~

~~**120. HVAC Test/VRF, Stripmall-CZ-16, High Efficiency**- This case tests the impact of modifying a set of parameters with efficiencies and requirements higher than the 2008 Title 24 baseline.~~

~~*Table 4 – Baseline Runs for Test Cases*~~

~~**Test Case No.**~~	~~**Test Case**~~	~~**Baseline Model**~~
~~1~~	~~Envelope Test Medium OfficeCZ-15 Roof Insulation~~	~~**Medium Office CZ-15 Baseline**~~
~~2~~	~~Envelope Test Medium OfficeCZ-15 Wall Insulation~~	
~~3~~	~~Envelope Test Medium OfficeCZ-15 Floor Slab Insulation~~	
~~4~~	~~Envelope Test Medium OfficeCZ-15 Infiltration~~	
~~5~~	~~Envelope Test Medium OfficeCZ-16 Roof Insulation~~	~~**Medium Office CZ-16 Baseline**~~
~~6~~	~~Envelope Test Medium OfficeCZ-16 Wall Insulation~~	
~~7~~	~~Envelope Test Medium OfficeCZ-16 Floor Slab Insulation~~	

~~8~~	~~Envelope Test Medium OfficeCZ-16 Infiltration~~	
~~9~~	~~Envelope Test Medium OfficeCZ-6 Roof Insulation~~	~~**Medium Office CZ-6 Baseline**~~
~~10~~	~~Envelope Test Medium OfficeCZ-6 Wall Insulation~~	
~~11~~	~~Envelope Test Medium OfficeCZ-6 Floor Slab Insulation~~	
~~12~~	~~Envelope Test Medium OfficeCZ-6 Infiltration~~	
~~13~~	~~Envelope Test Small OfficeCZ-15 SolarReflectance-Low Slope~~	~~**Small Office CZ-15 SolarReflectance-Low Slope Baseline**~~
~~14~~	~~Envelope Test Small OfficeCZ-16 SolarReflectance-Low Slope~~	~~**Small Office CZ-16 SolarReflectance-Low Slope Baseline**~~
~~15~~	~~Envelope Test Small OfficeCZ-6 SolarReflectance-Low Slope~~	~~**Small Office CZ-6 SolarReflectance-Low Slope Baseline**~~
~~16~~	~~Envelope Test Small OfficeCZ-15 SolarReflectance-Steep Slope~~	~~**Small Office CZ-15 SolarReflectance-Steep Slope Baseline**~~
~~17~~	~~Envelope Test Small OfficeCZ-16 SolarReflectance-Steep Slope~~	~~**Small Office CZ-16 SolarReflectance-Steep Slope Baseline**~~
~~18~~	~~Envelope Test Small OfficeCZ-6 SolarReflectance-Steep Slope~~	~~**Small Office CZ-6 SolarReflectance-Steep Slope Baseline**~~
~~19~~	~~Envelope Test Primary SchoolCZ-15 Heavy~~	~~**Envelope Test Primary SchoolCZ-15 Light**~~
~~20~~	~~Envelope Test Primary SchoolCZ-16 Heavy~~	~~**Envelope Test Primary SchoolCZ-16 Light**~~
~~21~~	~~Envelope Test Primary SchoolCZ-6 Heavy~~	~~**Envelope Test Primary SchoolCZ-6 Light**~~
~~-~~	~~-~~	~~-~~
~~22~~	~~Envelope Glazing Test Medium OfficeCZ-15 Window U~~	~~**Medium Office CZ-15 Baseline**~~
~~23~~	~~Envelope Glazing Test Medium OfficeCZ-15 Window SHGC~~	
~~24~~	~~Envelope Glazing Test Medium OfficeCZ-15 Window U&SHGC~~	
~~25~~	~~Envelope Glazing Test Medium OfficeCZ-16 Window U~~	~~**Medium Office CZ-16 Baseline**~~
~~26~~	~~Envelope Glazing Test Medium OfficeCZ-16 Window SHGC~~	
~~27~~	~~Envelope Glazing Test Medium OfficeCZ-16 Window U&SHGC~~	
~~28~~	~~Envelope Glazing Test Medium OfficeCZ-6 Window U~~	~~**Medium Office CZ-6 Baseline**~~
~~29~~	~~Envelope Glazing Test Medium OfficeCZ-6 Window SHGC~~	
~~30~~	~~Envelope Glazing Test Medium OfficeCZ-6 Window U&SHGC~~	
~~31~~	~~Envelope Glazing Test Large OfficeCZ-7 WWR 20%~~	~~**Large Office CZ-7 Baseline**~~
~~32~~	~~Envelope Glazing Test Large OfficeCZ-7 WWR 60%~~	
~~33~~	~~Envelope Glazing Test Large OfficeCZ-7 WWR 60% with South overhang~~	
~~34~~	~~Envelope Glazing Test Large OfficeCZ-1 WWR 20%~~	
~~35~~	~~Envelope Glazing Test Large OfficeCZ-1 WWR 60%~~	
~~-~~		~~-~~

~~36~~	~~Lighting Tests Medium OfficeCZ-15 low LPD~~	~~**Medium Office CZ-15 Baseline**~~
~~37~~	~~Lighting Tests Medium OfficeCZ-15 high LPD~~	
~~38~~	~~Lighting Tests Medium OfficeCZ-16 low LPD~~	~~**Medium Office CZ-16 Baseline**~~
~~39~~	~~Lighting Tests Medium OfficeCZ-16 high LPD~~	
~~40~~	~~Lighting Tests Medium OfficeCZ-6 low LPD~~	~~**Medium Office CZ-6 Baseline**~~
~~41~~	~~Lighting Tests Medium OfficeCZ-6 high LPD~~	
-		-
~~42~~	~~Daylighting Tests Large OfficeCZ-7 Continuous Dimming~~	~~**Large Office CZ-7 Baseline**~~
~~43~~	~~Daylighting Tests Large OfficeCZ-7 Continuous Dimming and high VT~~	
~~44~~	~~Daylighting Tests Large OfficeCZ-7 Stepped Dimming~~	
~~45~~	~~Daylighting Tests Large OfficeCZ-7 Stepped Dimming and high VT~~	
~~46~~	~~Daylighting Tests Large OfficeCZ-7 WWR-20%,Continuous Dimming~~	~~**Large Office CZ-7 WWR-20% Baseline**~~
~~47~~	~~Daylighting Tests Large OfficeCZ-7 WWR-20%,Continuous Dimming and high VT~~	
~~48~~	~~Daylighting Tests Large OfficeCZ-7 WWR-20%,Stepped Dimming~~	
~~49~~	~~Daylighting Tests Large OfficeCZ-7 WWR-20%,Stepped Dimming and high VT~~	
~~50~~	~~Daylighting Tests Large OfficeCZ-7WWR-60%,Continuous Dimming~~	~~**Large Office CZ-7 WWR-60% Baseline**~~
~~51~~	~~Daylighting Tests Large OfficeCZ-7 WWR-60%,Continuous Dimming and high VT~~	
~~52~~	~~Daylighting Tests Large OfficeCZ-7 WWR-60%,Stepped Dimming~~	
~~53~~	~~Daylighting Tests Large OfficeCZ-7 WWR-60%,Stepped Dimming and high VT~~	
~~54~~	~~Daylighting Tests Large OfficeCZ-1 Continuous Dimming~~	~~**Large Office CZ-1 Baseline**~~
~~55~~	~~Daylighting Tests Large OfficeCZ-1 Continuous Dimming and high VT~~	
~~56~~	~~Daylighting Tests Large OfficeCZ-1 Stepped Dimming~~	
~~57~~	~~Daylighting Tests Large OfficeCZ-1 Stepped Dimming and high VT~~	
~~58~~	~~Daylighting Tests Large OfficeCZ-1 WWR-20%,Continuous Dimming~~	~~**Large Office CZ-1 WWR-20% Baseline**~~
~~59~~	~~Daylighting Tests Large OfficeCZ-1 WWR-20%,Continuous Dimming and high VT~~	
~~60~~	~~Daylighting Tests Large OfficeCZ-1 WWR-20%,Stepped Dimming~~	
~~61~~	~~Daylighting Tests Large OfficeCZ-1 WWR-20%,Stepped Dimming and high VT~~	

~~62~~	~~Daylighting Tests Large OfficeCZ-1WWR-60%,Continuous Dimming~~	~~**Large Office CZ-1 WWR-60% Baseline**~~
~~63~~	~~Daylighting Tests Large OfficeCZ-1 WWR-60%,Continuous Dimming and high VT~~	
~~64~~	~~Daylighting Tests Large OfficeCZ-1 WWR-60%,Stepped Dimming~~	
~~65~~	~~Daylighting Tests Large OfficeCZ-1 WWR-60%,Stepped Dimming and high VT~~	
~~66~~	~~Daylighting Tests Stand Alone Retail CZ-7 Skylight VT~~	~~**Stand Alone Retail CZ-7 Baseline**~~
~~67~~	~~Daylighting Tests Stand Alone Retail CZ-7 SRR-5%~~	
~~68~~	~~Daylighting Tests Stand Alone Retail CZ-7 SRR-5% and high VT~~	
~~69~~	~~Daylighting Tests Stand Alone Retail CZ-1 Skylight VT~~	~~**Stand Alone Retail CZ-1 Baseline**~~
~~70~~	~~Daylighting Tests Stand Alone Retail CZ-1 SRR-5%~~	
~~71~~	~~Daylighting Tests Stand Alone Retail CZ-1 SRR-5% and high VT~~	
~~-~~	~~-~~	~~-~~
~~72~~	~~Equipment test Medium OfficeCZ-15 low EPD~~	~~**Medium Office CZ-15 Baseline**~~
~~73~~	~~Equipment test Medium OfficeCZ-15 high EPD~~	
~~74~~	~~Equipment test Medium OfficeCZ-16 low EPD~~	~~**Medium Office CZ-16 Baseline**~~
~~75~~	~~Equipment test Medium OfficeCZ-16 high EPD~~	
~~76~~	~~Equipment test Medium OfficeCZ-6 low EPD~~	~~**Medium Office CZ-6 Baseline**~~
~~77~~	~~Equipment test Medium OfficeCZ-6 high EPD~~	
~~78~~	~~Equipment test Fast food RestaurantCZ-6 high Process load~~	~~**Fast food Restaurant CZ-6 Baseline**~~
~~79~~	~~PTAC Test Strip Mall CZ-6 Low Eff~~	~~**PTAC Strip Mall CZ-6 Baseline**~~
~~80~~	~~PTAC Test Strip Mall CZ-6 High Eff~~	
~~81~~	~~PTAC Test Strip Mall CZ-15 Low Eff~~	~~**PTAC Strip Mall CZ-15 Baseline**~~
~~82~~	~~PTAC Test Strip Mall CZ-15 High Eff~~	
~~83~~	~~PTAC Test Strip Mall CZ-16 Low Eff~~	~~**PTAC Strip Mall CZ-16 Baseline**~~
~~84~~	~~PTAC Test Strip Mall CZ-16 High Eff~~	
~~85~~	~~PTHP Test Strip Mall CZ-6 Low Eff~~	~~**PTHP Strip Mall CZ-6 Baseline**~~
~~86~~	~~PTHP Test Strip Mall CZ-6 High Eff~~	
~~87~~	~~PTHP Test Strip Mall CZ-15 Low Eff~~	~~**PTHP Strip Mall CZ-15 Baseline**~~
~~88~~	~~PTHP Test Strip Mall CZ-15 High Eff~~	
~~89~~	~~PTHP Test Strip Mall CZ-16 Low Eff~~	~~**PTHP Strip Mall CZ-16 Baseline**~~
~~90~~	~~PTHP Test Strip Mall CZ-16 High Eff~~	
~~91~~	~~PSZ Test Strip Mall CZ-6 Low Eff~~	~~**PSZ Strip Mall CZ-6 Baseline**~~
~~92~~	~~PSZ Test Strip Mall CZ-6 High Eff~~	

~~93~~	~~PSZ Test Strip Mall CZ-15 Low Eff~~	~~**PSZ Strip Mall CZ-15 Baseline**~~
~~94~~	~~PSZ Test Strip Mall CZ-15 High Eff~~	
~~95~~	~~PSZ Test Strip Mall CZ-16 Low Eff~~	~~**PSZ Strip Mall CZ-16 Baseline**~~
~~96~~	~~PSZ Test Strip Mall CZ-16 High Eff~~	
~~97~~	~~PVAV Test Medium Office CZ-6 Low Eff~~	~~**PVAV Medium Office CZ-6 Baseline**~~
~~98~~	~~PVAV Test Medium Office CZ-6 High Eff~~	
~~99~~	~~PVAV Test Medium Office CZ-15 Low Eff~~	~~**PVAV Medium Office CZ-15 Baseline**~~
~~100~~	~~PVAV Test Medium Office CZ-15 High Eff~~	
~~101~~	~~PVAV Test Medium Office CZ-16 Low Eff~~	~~**PVAV Medium Office CZ-16 Baseline**~~
~~102~~	~~PVAV Test Medium Office CZ-16 High Eff~~	
~~103~~	~~VAV Test Large Office CZ-6 Low Eff~~	~~**VAV Large Office CZ-6 Baseline**~~
~~104~~	~~VAV Test Large Office CZ-6 Low Eff~~	
~~105~~	~~VAV Test Large Office CZ-15 Low Eff~~	~~**VAV Large Office CZ-15 Baseline**~~
~~106~~	~~VAV Test LargeOffice CZ-15 Low Eff~~	
~~107~~	~~VAV Test LargeOffice CZ-16 Low Eff~~	~~**VAV Large Office CZ-16 Baseline**~~
~~108~~	~~VAV Test LargeOffice CZ-16 Low Eff~~	
~~109~~	~~FanCoil Test Strip Mall CZ-6 Low Eff~~	~~**FanCoil Strip Mall CZ-6 Baseline**~~
~~110~~	~~FanCoil Test Strip Mall CZ-6 High Eff~~	
~~111~~	~~FanCoil Test Strip Mall CZ-15 Low Eff~~	~~**FanCoil Strip Mall CZ-15 Baseline**~~
~~112~~	~~FanCoil Test Strip Mall CZ-15 High Eff~~	
~~113~~	~~FanCoil Test Strip Mall CZ-16 Low Eff~~	~~**FanCoil Strip Mall CZ-16 Baseline**~~
~~114~~	~~FanCoil Test Strip Mall CZ-16 High Eff~~	
~~115~~	~~VRF Test Strip Mall CZ-6 Low Eff~~	~~**PSZ Strip Mall CZ-6 Baseline**~~
~~116~~	~~VRF Test Strip Mall CZ-6 High Eff~~	
~~117~~	~~VRF Test Strip Mall CZ-15 Low Eff~~	~~**PSZ Strip Mall CZ-15 Baseline**~~
~~118~~	~~VRF Test Strip Mall CZ-15 High Eff~~	
~~119~~	~~VRF Test Strip Mall CZ-16 Low Eff~~	~~**PSZ Strip Mall CZ-16 Baseline**~~
~~120~~	~~VRF Test Strip Mall CZ-16 High Eff~~	

~~*3.4.1.7 Results Documentation*~~

~~The applicant shall perform simulations for all tests specified in Section VII and report results in the forms provided in Appendix A.~~

~~3.4.2 Ruleset Implementation Tests~~

~~The Compliance Margin Tests in the Reference Method suite of tests verifies that the simulation engine produces results that are within an acceptable range. The tests in this section are intended to verify that the software correctly constructs the baseline model and applies rules of the 2013 Nonresidential ACM~~

~~appropriately to the proposed and baseline models. Evaluation of the modeling assumptions and baseline building tests is **qualitative**.~~

~~*3.4.2.1 Overview*~~

~~The test runs described in this section represent the Title-24 2013 Non-Residential ACM code compliance calculation and use the following Prototype Models- Small Office Building, Medium Office Building, Large Office Building, Warehouse Building and Small Hotel. For further details on the Prototype Models, refer to Section III of the Software Compliance Specification document. Each of the baseline test cases shall be created by modifying the Prototype Model as described in Section IV of this document. The modified Prototype Model shall form the proposed case for each test run. The baseline model shall be generated by compliance software as per the rules in the 2013 Nonresidential ACM. The baseline and proposed model files for each of test cases shall then be evaluated to verify that:~~

- ~~The baseline building envelope constructions are correctly substituted for exterior opaque surfaces and fenestrations.~~
- ~~Fenestration area in the baseline building is reduced in accordance with the 2013 Nonresidential ACM Manual, when the proposed design fenestration area is greater than 40% of the exterior wall.~~
- ~~Skylight area in the baseline building is adjusted in accordance with the 2013 Nonresidential ACM Manual, when applicable.~~
- ~~Default schedules of operation are applied for both the baseline building and the proposed design.~~
- ~~The proposed and baseline cases use the same defaults or tailored inputs for internal loads as required by the 2013 Nonresidential ACM Manual.~~
- ~~The baseline building lighting system is correctly specified and that exterior lighting is modeled.~~
- ~~Receptacle loads, process loads is modeled according to the rules in the 2013 Nonresidential ACM Manual.~~
- ~~The baseline building use the correct system types as prescribed in Table_ of the 2013 Nonresidential ACM Manual.~~
- ~~An economizer (of the right type) is included in the baseline building if required.~~
- ~~The primary and secondary baseline building systems are properly specified and sized.~~
- ~~Fan brake horsepower is correctly specified for the baseline building.~~
- ~~Prescribed modeling assumptions are applied for both the baseline building and the proposed design.~~
- ~~Overhangs are modeled in the proposed design for Run 7 but not the baseline building.~~
- ~~Unconditioned spaces are modeled.~~
- ~~Other baseline building specifications and/or modeling assumptions are correctly applied.~~

~~As the software developer verifies the above and other conditions, the input and output files should be annotated with comments or other methods to demonstrate that the modeling rules specified in the 2013 Nonresidential ACM Manual are correctly applied. Software developers should use the output format spreadsheets, included in Appendix B, to report the results of these tests. These annotated files shall then be submitted to the Commission for further evaluation. Any errors discovered shall be corrected by making modifications to the software; the runs shall be repeated; and the new results shall be annotated for submittal to the Commission.~~

~~*3.4.2.2 Labeling of Baseline Tests*~~

~~The Baseline Tests are labeled using the format:~~

~~Baseline Fenestration Test/Medium Office -CZ-15, Exterior Envelope Run 01~~

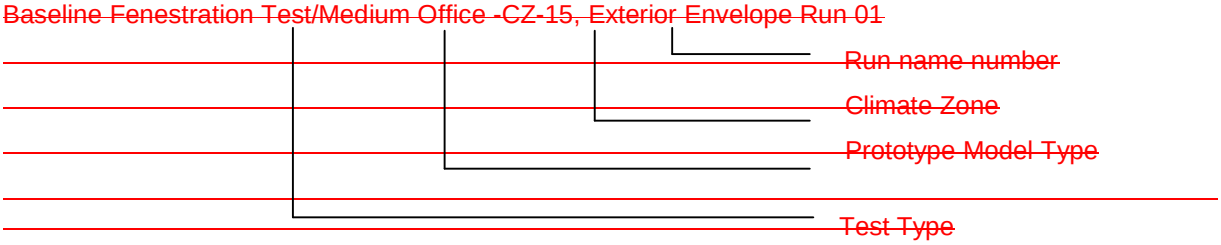

~~*3.4.2.3 Rule set Implementation Tests*~~

~~The following tests shall be performed to verify that the compliance software correctly creates the baseline model and applies modeling rules as per the requirements of the Nonresidential ACM 2013. The proposed model shall be created by modifying the appropriate Prototype Model type. The Baseline Model for each test case shall be generated automatically by the complaince software.~~

~~The intent of each test run, characteristics of the proposed model and inputs to be verified in the baseline model are described below.~~

1. ~~Baseline Exterior Envelope Test/Small Office-CZ-6, Run01 – This test will verify that the applicant software models the wall, floor and roof construction correctly in the baseline model and the envelope and fenestration performance requirements for the baseline are modelled as per the requirements of NACM 2013.~~

   ~~The proposed model is a small office building in climate zone 6 with the following envelope characteristics-~~

   - ~~Low sloped concrete roof with assembly U value of 0.065, Aged Solar Reflectance of 0.75 and Thermal emittance of 0.78.~~
   - ~~Wood-framed wall with assembly U value of 0.090~~
   - ~~Mass floor with asssembly U value of 0.15.~~
   - ~~Fixed window with U factor of 0.25, RSHGC of 0.20 and V.T of 0.45.~~

   ~~The following inputs in the baseline model file shall be verified and reported in the output form provided in Appendix B-~~

   - ~~Baseline roof, wall and floor construction assembly type~~
   - ~~Baseline roof, wall and floor overall U-value~~
   - ~~Baseline roof, wall and floor construction assembly layer inputs~~
   - ~~Baseline roof aged solar reflectance and thermal emittance.~~
   - ~~Window U value, SHGC and V.T~~

2. ~~Baseline Exterior Envelope Test/Small Office-CZ-15, Run02 – This test will verify that the applicant software models the wall, floor, roof construction and fenestrations correctly and the envelope performance requirements for the baseline are modelled as per the NACM 2013.~~

   ~~The proposed model is a small office building in climate zone 15 with the following envelope characteristics-~~

   - ~~Steep sloped metal building roof with assembly U value of 0.055, Aged Solar Reflectance of 0.60 and Thermal emittance of 0.70.~~
   - ~~Metal- framed wall with assembly U value of 0.056~~
   - ~~Slab on grade floor with florr F factor of 0.70.~~
   - ~~Horizontal overhang of 2 feet on south facing windows and vertical fins of 2 feet on right and left of west facing windows.~~

   ~~The following inputs in the baseline model file shall be verified and reported in the output form-~~

   - ~~Baseline roof, wall and floor construction assembly type~~
   - ~~Baseline roof, wall and floor construction assembly layer inputs~~
   - ~~Baseline roof, wall overall U-value~~

- ~~Baseline floor slab F-factor.~~
- ~~Baseline roof aged solar reflectance and thermal emittance.~~
- ~~Window overhangs for south and west windows.~~

3. ~~Baseline Exterior Envelope Test/Small Hotel CZ 15, Run03 – This test will verify that the applicant software models the wall, floor and roof construction correctly in the baseline model and the envelope and fenestration performance requirements for the baseline are modelled as per the requirements of NACM 2013.~~

   ~~The proposed model is a small hotel building in climate zone 15 with the following characteristics-~~
   - ~~Low sloped Metal building Roof with assembly U value of 0.055, Aged Solar Reflectance of 0.60 and Thermal emittance of 0.70~~
   - ~~Metal- framed wall with assembly U value of 0.8~~
   - ~~Mass Floor with asssembly U value of 0.052.~~
   - ~~Fixed windows in the first floor with U factor of 0.25, RSHGC of 0.20 and V.T of 0.47.~~
   - ~~Opearble windows in guest room windows with U factor of 0.42, RSHGC of 0.18 and V.T of 0.35.~~

   ~~The following inputs in the baseline model file shall be verified and reported in the output form-~~
   - ~~Baseline roof, wall and floor construction assembly type~~
   - ~~Baseline roof, wall and floor construction assembly layer inputs~~
   - ~~Baseline roof, wall and floor U-value~~
   - ~~Baseline roof aged solar reflectance and thermal emittance.~~
   - ~~Window U value, SHGC and V.T~~

4. ~~Baseline Fenestration Test/Large Office-CZ-6, WWR Run04 - Run 04 tests whether the applicant software determines the window area of the baseline model as per the rules in NACM 2013.~~

   ~~The proposed model is the Large office building in climate zone six with an overall window to wall ratio (WWR) of 60% made of a continuous band of glass distributed evenly across all facades. For this run, the building is rotated 15 degrees to the east in azimuth.~~

   ~~The following inputs in the baseline model file shall be verified and reported in the output form-~~
   - ~~Baseline WWR~~

5. ~~Baseline Fenestration Test/Large Office-CZ-6, WWR Run05 - Run 05 tests whether the applicant software determines the window area of the baseline model as per the rules in NACM 2013.~~

   ~~The proposed model is the Large office building in climate zone six with overall building WWR 30% and 45% WWR in the western façade.~~

   ~~The following inputs in the baseline model file shall be verified and reported in the output form-~~
   - ~~Baseline WWR~~

6. ~~Baseline Fenestration Test/Large Office-CZ-6, WWR Run06 - Run 06 tests whether the applicant software determines the window area of the baseline model as per the rules in NACM 2013.~~

   ~~The proposed model is the Large office building in climate zone six with overall building WWR 46% and 50% WWR in the west, 40% in South, 45% in East and 50% in the North façade.~~

   ~~The following inputs in the baseline model file shall be verified and reported in the output form-~~
   - ~~Baseline WWR~~

7. ~~Baseline Skylight Test/Warehouse-CZ-6, Run07 – This tests verifies whether the applicant software models the baseline skylight as per the performance requirements for skylights in NACM 2013.~~

   ~~The proposed model is a Warehouse building in climate zone six with the following characteristics-~~
   - ~~Curb mounted glass Skylight with U value 0.55 ,SHGC 0.20 and V.T 0.40.~~

   ~~The following inputs in the baseline model file shall be verified and reported in the output form-~~
   - ~~Skylight U value, SHGC and VT.~~

8. ~~Baseline Skylight Test/Warehouse-CZ-6, SRR Run08 – This test checks whether the applicant software determines the skylight area of the baseline model correctly. The proposed model is a Warehouse building in climate zone 6 with an overall Skylight to roof ratio (SRR) of 7%.~~
   ~~The following inputs in the baseline model file shall be verified and reported in the output form-~~
   - ~~Baseline SRR.~~
9. ~~Baseline Skylight Test/Warehouse-CZ-6, SRR Run09- This test checks whether the applicant software determines the skylight area of the baseline model correctly. The proposed model is a Warehouse building in climate zone 6. The SRR of the proposed building is 15% and more than 75% of the building area gets daylighting from skylights or sidelights .~~
   ~~The following baseline inputs shall be verified:~~
   - ~~Baseline SRR, baseline total daylit area as a fraction of gross building area.~~
10. ~~Baseline Skylight Test/Warehouse-CZ-6, SRR Run10- This test checks whether the applicant software determines the skylight area of the baseline model correctly. The proposed model is a Warehouse building in climate zone 6. The SRR of the proposed building is 5% and 55% of the building area gets daylighting from skylights or sidelights .~~
    ~~The following baseline inputs shall be verified:~~
    - ~~Baseline SRR, baseline total daylit area as a fraction of gross building area.~~
11. ~~Baseline Occupancy Test/Medium Office-CZ-6, Whole Building Method Run11- This test verifies whether the applicant software inserts the correct baseline inputs for schedules, occupant density, equipment power density, lighting power density, hot water load and ventilation rates using the whole building method and in accordance with NACM 2013. The proposed model is an office occupancy with:~~
    - ~~Occupant Density- 100 ft^2/person~~
    - ~~Equipment Power Density- 1.34 W/ft^2~~
    - ~~Lighting Power Density- 1.2 W/ft^2~~
    - ~~Hot Water Load- 106 Btu/person~~
    - ~~Ventilation Rate- 0.15 cfm/ft^2~~

    ~~The baseline model inputs shall be verified for-~~
    - ~~Schedules (verified shall include occupancy schedule, lighting schedule, receptacle schedule, hot water schedule, infiltration schedule and elevator schedule)~~
    - ~~Occupant Density~~
    - ~~Equipment Power Density~~
    - ~~Lighting Power Density~~
    - ~~Hot Water Load~~
    - ~~Ventilation Rate~~
12. ~~Baseline Occupancy Test/Large Office- CZ-6, Space by Space Method Run12- This test verifies whether the applicant software inserts the correct baseline inputs for schedules, occupant density, equipment power density, lighting power density, hot water load and ventilation rates in accordance with NACM 2013. This run tests the capability of the applicant software to model baseline inputs for multiple space types using the Space by Space method. The proposed model is the Large office building in climate zone six with the following characteristics-~~
    - ~~First Floor- Retail space occupancy- Occupant Density 30 ft2/person, EPD-1W/ft^2, LPD-1W/ft^2, Ventilation rate- 0.25 cfm/ft^2, Hot Water Load- 120 Btuh/person.~~
    - ~~Second Floor- Medical occupancy- Occupant Density 100 ft2/person, EPD 1.5 W/ft^2, LPD-1W/ft^2, Ventilation rate- 0.15 cfm/ft^2, Hot Water Load- 160 Btuh/person.~~
    - ~~Third to 12th Floor North, South, West and East zones -Offices occupancy- Occupant Density 150 ft2/person, EPD 1.5 W/ft^2, LPD 0.75 W/ft^2, Ventilation rate- 0.15 cfm/ft^2, Hot Water Load- 120 Btuh/person.~~

- ~~Third and Fifth Floor Core zones- Lobby occupancy- Occupant Density 100 ft2/person, EPD-0.5 W/ft^2, LPD-1.5 W/ft^2, Ventilation rate- 0.15 cfm/ft^2.~~
- ~~Fourth, Seventh, 10th and 12th Floor Core Zones- Conference occupancy- Occupant Density 100 ft2/person, EPD-1.0 W/ft^2, LPD-1.2 W/ft^2, Ventilation rate- 0.15 cfm/ft^2, Hot Water Load- 60 Btuh/person.~~
- ~~Sixth, Eighth Floor Core Zone- Restroom occupancy- Occupant Density 100 ft2/person, EPD-0.2 W/ft^2, LPD-0.5 W/ft^2, Ventilation rate- 0.15 cfm/ft^2.~~
- ~~Ninth and 11th Floor Core Zones- Corridor occupancy- Occupant Density 100 ft2/person, EPD-0.2 W/ft^2, LPD-0.5 W/ft^2, Ventilation rate- 0.15 cfm/ft^2.~~

13. ~~Baseline Tailored Lighting Method/Medium Office-CZ-6, Run13- This test verifies if the applicant software applies the trade-off requirements of the Tailored Lighting Method appropriately. Proposed Model is a medium office building in climate Zone 6 with the following chracteristics-~~
    - ~~Perimeter zones on all floors are modelled as main entry spaces- using the Tailored Lighting Method. The space has a general lighting of 0.5 W/ft2.~~
    - ~~Core zones- on all floors are modelled as waiting spaces- using the Tailored Lighting Method. The space has a general lighting of 0.75 W/ft2- and decorative lighting of 0.2 W/ft2.~~
14. ~~Baseline Tailored Lighting Method/Medium Office-CZ-6, Run14- This test verifies if the applicant software applies the trade-off requirements of the Tailored Lighting Method appropriately. Proposed Model is a medium office building in climate Zone 6 with the following chracteristics-~~
    - ~~Perimeter zones on all floors are modelled as main entry spaces- using the Tailored Lighting Method. The space has a general lighting of 0.8 W/ft2 and task lighting of 0.1 W/ft2.~~
    - ~~Core zones- on all floors are modelled as waiting spaces- using the Tailored Lighting Method. The space has a general lighting of 0.6 W/ft2- and decorative lighting of 0.2 W/ft2.~~
15. ~~Baseline Tailored Lighting Method/Medium Office-CZ-6, Run15- This test verifies if the applicant software applies the trade-off requirements of the Tailored Lighting Method appropriately. Proposed Model is a medium office building in climate Zone 6 with the following chracteristics-~~
    - ~~Perimeter zones on all floors are modelled as main entry spaces- using the Tailored Lighting Method. The space has a general lighting of 1.1 W/ft2 and task lighting of 0.2 W/ft2.~~
    - ~~Core zones- on all floors are modelled as waiting spaces- using the Tailored Lighting Method. The space has a general lighting of 0.5 W/ft2.~~
16. ~~Baseline Lighting Control Test/Small Office-CZ-6, PAF-Run16- This test verifies if the applicant software models lighting power density and schedules for eligible Califonia Power adjustment factors as required by the NACM2013. The proposed model is a small office building (area=5500 sq ft) with demand responsive lighting controls.The model files shall be examined to verify whether adjustment factors are applied as per the requirements in NACM 2013.~~
17. ~~Baseline Lighting Control Test/Warehouse-CZ-6, Daylightcontrol Run17- This test verifies the ability of the applicant software to model daylighting controls as per the requirements of the 2013 ACM. The proposed model is a warehouse building in CZ-6 with the following characteristics-~~
    - ~~The building has three spaces – Office, Fine Storage and Bulk Storage. The office space gets daylighting from four windows. Fine Storage gets daylighting from skylights and bulk storage gets both sidelighting from windows and skylighting.~~
    - ~~Daylighting controls are installed in primary and skylit daylit areas in all spaces and in the secondary daylit area of the Bulk Storage.~~
    - ~~The installed general lighting power controlled by daylight controls is X Watts.~~

- ~~The illuminance setpoint at Reference positions are-~~

~~The baseline model inputs shall be verified for-~~

- ~~Daylight control type~~
- ~~Reference position and illuminance setpoint .~~

18. ~~Baseline Ext. Light, SHW Test/Large Office-CZ-6, Run18- This test verifies if the NACM rules for exterior lighting is applied accurately for Exterior lighting power, exterior lighting control and schedules. This test also verifies if the Service hot Water systems are modelled correctly. The proposed building is a large office building in climate zone 6, with the following characteristics-~~
    a. ~~Hot water load of 106 Btuh/person.~~
    b. ~~Thermal efficiency of 0.78~~
    c. ~~An exterior hardscape comprising of –~~
        i. ~~Driveway of dimensions 20x30 feet with lighting load of 1115 Watts~~
        ii. ~~Parking lot of dimensions 180x56 feet with lighting load of 6566 Watts~~
        iii. ~~2 sidewalks of dimensions 6x30 feet with total lighting load of 977 Watts~~
        iv. ~~A building entrance door light of 90 Watts.~~
        v. ~~50 square feet of hardscape ornamental light of 2 Watts.~~
        vi. ~~Lighting load of 6566 Watts on the building façade.~~
        vii. ~~Signage of 40 square feet with lighting load of 80 Watts.~~
19. ~~Baseline HVAC Test/Small Office-CZ-6, System Type Run19- This test checks if the applicant software models the baseline HVAC system in accordance with the requirements of NACM 2013. The proposed model is a small office building in climate zone 6 with the following characteristics-~~
    - ~~DX cooling~~
    - ~~Cooling COP-3.84~~
    - ~~Gas Furnace Heating~~
    - ~~Thermal Efficiency – 80%~~
    - ~~Constant Volume Fan~~

    ~~The following baseline model inputs shall be verified-~~
    - ~~HVAC System Type~~
    - ~~Heating and Cooling Type~~
    - ~~Heating and Cooling Efficiency~~
    - ~~System Sizing~~
    - ~~Maximum and minimum supply air temperature~~
    - ~~Fan Control Method~~
    - ~~Cooling and heating efficiency curve~~
    - ~~Cooling, Heating and Fan Schedule~~
20. ~~Baseline HVAC Test/Medium Office-CZ-6, System Type Run20- This test checks if the applicant software models the baseline HVAC system in accordance with the requirements of NACM 2013. The proposed model is a medium office building in climate zone 6 with the following characteristics-~~
    - ~~Core, Mid and Top Bottom Zones (Cooling load= 110,000 Btuh) Electric Heat pump and constant volume fan.~~
    - ~~All Perimeter zones DX Cooling and Hot water Boiler with reheat and variable volume fan.~~
    - ~~Cooling Efficiency-~~
    - ~~Heating Efficiency –~~

    ~~The following baseline model inputs shall be verified-~~
    - ~~HVAC System Type~~
    - ~~Heating and Cooling Type~~

- ~~Heating and Cooling Efficiency~~
- ~~System Sizing~~
- ~~Maximum and minimum supply air temperature~~
- ~~Sat Reset Control~~
- ~~Economizer Type and limits~~
- ~~Fan Power~~
- ~~Fan Control Method~~
- ~~Cooling and heating capacity adjustment curve~~
- ~~Cooling and heating efficiency curve~~
- ~~Cooling, Heating and Fan Schedule~~
- ~~Terminal heat type and capacity.~~
- ~~Boiler type and Number of boilers~~
- ~~Boiler Heat loss, boiler minimum unloading ratio~~
- ~~Boiler Performance Curve~~
- ~~Hot water supply and return temperature~~
- ~~Boiler pump type~~
- ~~Pump motor power and efficiency.~~
- ~~Pump part load curve.~~

~~21. Baseline HVAC Test/Large Office-CZ-6, System Type Run 21- This test checks if the applicant software models the baseline HVAC system in accordance with the requirements of NACM 2013. The proposed model is a Large office building in climate zone 6 with the following characteristics-~~

- ~~Basement Zone is a computer room with cooling only variable air volume system.~~
- ~~All other zones have a Built-up VAV system.~~
- ~~Cooling Efficiency-~~
- ~~Heating Efficiency –~~

~~The following baseline model inputs shall be verified-~~

- ~~HVAC System Type~~
- ~~Heating and Cooling Type~~
- ~~Heating and Cooling Efficiency~~
- ~~System Sizing~~
- ~~Maximum and minimum supply air temperature~~
- ~~Sat Reset Control~~
- ~~Economizer Type and limits~~
- ~~Fan Power~~
- ~~Fan Control Method~~
- ~~Cooling, Heating and Fan Schedule~~
- ~~Terminal heat type and capacity.~~
- ~~Boiler type and Number of boilers~~
- ~~Boiler Heat loss, boiler minimum unloading ratio~~
- ~~Boiler Performance Curve~~
- ~~Hot water supply and return temperature~~
- ~~Boiler pump type~~
- ~~Pump motor power and efficiency.~~
- ~~Pump part load curve.~~
- ~~Chiller Type and Number of chillers~~
- ~~Chiller fuel, capacity and efficiency~~
- ~~Chiller Minimum Unloading ratio~~

- ~~Chiller cooling capacity and adjustment curves~~
- ~~Chilled water supply and return air temperature~~
- ~~Condenser Type~~
- ~~Cooling Tower Fan control type and horse power~~
- ~~Cooling Tower Set Point Control~~
- ~~Pump Control Type, Motor Power, Efficiency and design flow rate~~

~~22. Baseline HVAC Test/Warehouse-CZ-6, System Type Run22- This test checks if the applicant software models the baseline HVAC system in accordance with the requirements of NACM 2013. The proposed model is a Warehouse building in climate zone 6 with the following characteristics-~~

- ~~Zones are served by a gas furnace heat only system.~~
- ~~Heating Efficiency –~~

~~The following baseline model inputs shall be verified-~~

- ~~HVAC System Type~~
- ~~Heating and Cooling Type~~
- ~~Heating and Cooling Efficiency~~
- ~~System Sizing~~
- ~~Maximum and minimum supply air temperature~~
- ~~Sat Reset Control~~
- ~~Economizer Type and limits~~
- ~~Fan Power~~
- ~~Fan Control Method~~
- ~~Cooling, Heating and Fan Schedule~~

~~*3.4.2.4 Results Comparison*~~

~~The applicant shall perform all tests specified in Section IV and report the outputs in the forms provided in Appendix B.~~

~~3.5 California Calculation Procedures~~

~~California recognizes that there are multiple options for calculating energy impacts of certain building features, including:~~

- ~~Duct efficiency~~
- ~~Water heating for multi-family~~
- ~~Heat transfer from slab-on-grade~~
- ~~Daylighting~~

~~The approach taken for these building features is to specify the required inputs to the compliance software, but allow the software to use its own algorithms or external procedures as appropriate. These building features will be accompanied by a compliance test to verify that the software produces results in reasonable agreement with the Reference Method.~~

~~**DETAILS TBD.**~~

4. Content and Format of Standard Reports

NOTE! THIS CHAPTER WILL NEED REVISION FOR TITLE 24. THE CONTENT OF THE REPORTS MAY CHANGE BASED ON THE NEEDS FOR COMPLIANCE ENFORCEMENT.

4.1 Overview

THE NUMBER, STRUCTURE AND CONTENT OF THE REPORTS WILL BE DETERMINED.

This chapter provides a summary of the requisite content and format of the Title 24 standard reports. These reports standardize the way energy modeling output data is delivered to the California Energy Commission, either in electronic or printed format. Electronically formatted output reports may be uploaded to the CEC registry according to procedures TBD.

4.1.1 Content

CONTENT TBD.

4.1.2 Format

FORMAT TBD.

4.2 Electronic Format: XML

A POSSIBLE OPTION IS FOR THE COMPLIANCE SOFTWARE TO GENERATE REPORTS IN AN ELECTRONIC FORMAT, SO THAT THEY MAY BE READILY UPLOADED TO THE COMMISSION OR OTHER APPROPRIATE AHJ. THIS FEATURE HAS NOT YET BEEN INCLUDED IN THE SCOPE OF THE COMPLIANCE REPORTS. THE DETAILS OF THE COMPLIANCE FORMS AND REPORTS NEED TO BE SPECIFIED.

4.3 Hard Copy Format: PDF

The compliance software will produce required compliance reports for new construction or alterations projects. The following section provides examples of the automatically generated standard reports. These examples are representative of a typical report output; however, they are not exhaustive.

CONTENTS TBD

5. Building Descriptors Reference

5.1 Overview

This chapter specifies for each building descriptor the rules that apply to the proposed design and to the standard design.

5.1.1 Definition of Building Descriptors

Building descriptors provide information about the proposed design and the standard design. In this chapter, the building descriptors are discussed in the generic terms of engineering drawings and specifications. By using generic building descriptors, this manual avoids bias toward one particular energy simulation engine. The building descriptors in this chapter are compatible with commonly used simulation software.

Each energy simulation program has its own way of accepting building information. EnergyPlus, for instance, uses a comma delimited data file called an IDF file. DOE-2 uses BDL (building design language) to accept information. It is the responsibility of the compliance software to translate the generic terms used in this chapter into the "native language" of the simulation program. Figure 8~~Figure 3~~ illustrates the flow of information.

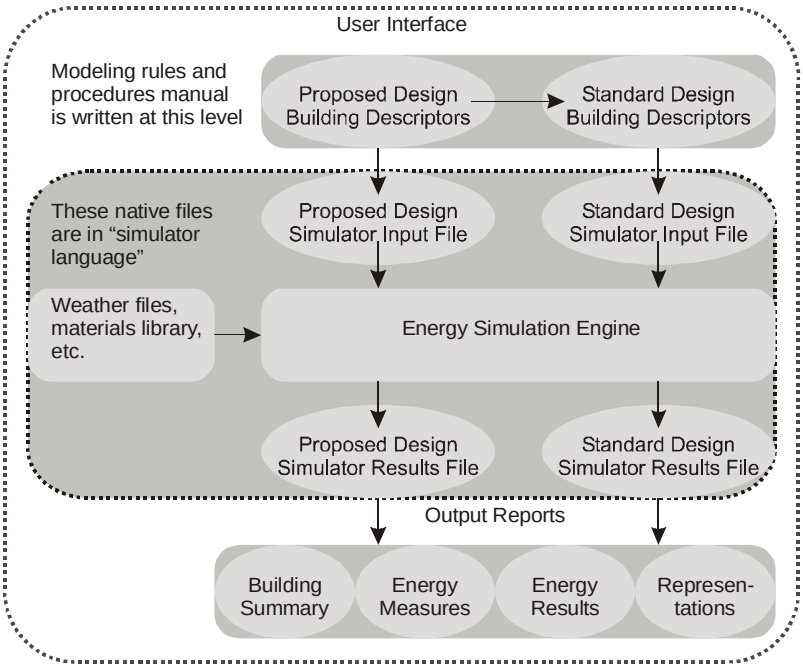

Figure 8~~3~~ – Information Flow

5.1.2 HVAC System Map

The HVAC system in the standard design depends on the primary building activity, the size of the building and the energy source used for heating in the proposed design. Details about these systems are provided in subsequent sections.

Many of the building descriptors have a one-to-one relationship between the proposed design and the standard design, for example, every wall in the proposed design has a corresponding wall in the standard design. However, for HVAC systems, this one-to-one relationship generally does not hold. The HVAC system serving the proposed design and the standard design may be completely different, each with different components, etc.

HVAC system in the *standard design* shall be selected from Table 1 – HVAC System Map, and be based on building type, number of floors, conditioned floor area, and heating source. Additionally, the selected system shall conform to the descriptions in Table 2 – HVAC System Descriptions.

For systems 1, 3, 7, 10 and 11 each thermal zone shall be modeled with its own HVAC system. For systems 5, 6, and 9, each floor shall be modeled with a separate HVAC system. Floors with identical thermal zones and occupancies can be grouped for modeling purposes. The standard design heating source is natural gas. ~~where gas is available at the site. Where gas is not available the heating source is propane.~~

~~*Table 5 – HVAC System Map*~~

~~**Building Type**~~	~~**Standard Design System**~~
~~Residential~~	~~System 1 – PTAC~~
~~High-rise Residential and Hotel Guestrooms~~	~~System 2 – Four-pipe fan coil (FPFC)~~
~~Nonresidential and 3 Floors or Less than <25,000 ft2~~	~~System 3 – PSZ AC~~
~~Nonresidential and 4 or 5 Floors and <25,000 ft2 or 5 Floors or Less and 25,000 ft2 to 150,000 ft2~~	~~System 5 – PVAV with Reheat**~~
~~Nonresidential and More than 5 Floors or >150,000 ft2~~	~~System 6 – VAV with reheat**~~
~~Nonresidential and 3 Floors or Less and less than 25,000 ft2 and zone cooling load >= 110,000 Btu/h*~~	~~System 7 – Single Zone VAV~~
~~Heated Only Storage~~	~~System 9 – Heating and Ventilation~~
~~Total computer room design cooling load is over 3,000,000 Btu/h or the non-computer loads are served by System Types 5 or 6 (Packaged VAV or Built-up VAV)~~	~~System 10 – CRAH Units~~
~~Computer rooms that do not meet the conditions for System 10, CRAH~~	~~System 11 – CRAC Units~~

~~* The single zone VAV system 7 applies to thermal zones with design cooling loads greater than 110,000 Btu/h (and in 1/1/2014, 75,000 Btu/h, and 1/1/2016, 65,000 Btu/h). Thermal zones with smaller design cooling loads shall use the package single zone system 3.~~

~~** For laboratory spaces in a building having a total laboratory exhaust rate greater than 5000 cfm, use a single system of type 5 or 6 with a design supply air to room air temperature difference of 17F.~~

~~Note: A "Floor" is considered a "Habitable Story", defined in the Standards as a story that is at least 50 percent above grade.~~

~~*Table 6 – HVAC System Descriptions*~~

~~System No.~~	~~System Type~~	~~Fan Control~~	~~Cooling Type~~	~~Heating Type~~
~~1 – PTAC~~	~~Package terminal air~~	~~Constant volume~~	~~DX~~	~~Hot water fossil fuel boiler~~

	~~conditioner~~			
~~2 – FPFC~~	~~Four-pipe fan coil~~	~~Constant volume~~	~~Chilled Water~~	~~Hot water fossil fuel boiler~~
~~3 – PSZ AC~~	~~Package single zone~~	~~Constant volume~~	~~DX~~	~~Fossil fuel furnace~~
~~5 – PVAV reheat~~	~~Package VAV reheat~~	~~Variable volume~~	~~DX~~	~~Hot water fossil fuel boiler~~
~~6 – VAV reheat~~	~~VAV reheat~~	~~Variable volume~~	~~Chilled water~~	~~Hot water fossil fuel boiler~~
~~7 – SZVAV~~	~~Single Zone VAV~~	~~Two-Speed*~~	~~DX~~	~~Fossil fuel furnace~~
~~9 – Heating ventilation~~	~~Heating only~~	~~Constant volume~~	~~None~~	~~Gas furnace~~
~~10 – CRAH Units~~	~~CR Air Handler~~	~~Variable volume~~	~~Chilled water~~	~~N/A~~
~~11 – CRAC Units~~	~~CR Air Conditioner~~	~~Variable volume~~	~~DX~~	~~N/A~~

~~* The supply fan controls shall modulate down to a minimum of 2/3 of the full fan speed or lower at low cooling demand, with a maximum part-load fan power of 40% at 2/3 fan speed.~~

Table 4~~5~~ – HVAC System Map

Building Type	Conditioning	Standard Design	Description
Low-Rise Residential	Heating and Cooling	PTAC	Packaged Terminal Air Conditioner
High-Rise Residential and Hotel Guestrooms	Heating and Cooling	FPFC	Four-Pipe Fan Coil
Nonresidential	Heating Only	Heating and Ventilation	Heating and Ventilation Only
Nonresidential	Heating and Cooling	*See Table 5-2*	
Nonresidential	Covered Process	*See Table 5-3*	

Table 5 – Non-Residential, Non-Process Spaces

Building Area	Floors	Standard Design	Description
≤ 10,000 ft^2	1 floor	PSZ	Packaged Single Zone
	>1 floor	PVAV	Packaged VAV Unit
10,000 ft2 – 150,000 ft2	1 floor	SZVAV	Single-zone VAV Unit
	2-5 floors	PVAV	Packaged VAV Unit
	>5 floors	VAVS	Built-Up VAV Unit
>150,000 ft2	1 floor	SZVAV	Single-zone VAV Unit
	>1 floor	VAVS	Built-up VAV Unit

Table 6~~5~~ – System Map for Covered Processes

Building Type or Space Type	Floors	Baseline System
Total computer room design cooling load is over 3,000,000 Btu/h or the non-computer loads are served by System Types 5 or 6 (Packaged VAV or Built-up VAV)	Any	System 10 – CRAH Unit
Computer rooms that do not meet the conditions for System 10, CRAH	Any	System 11 – CRAC Unit

Laboratory Space with total exhaust rate exceeding 5000 cfm	Any	System 12 – Laboratory HVAC System with 100%OA
Kitchen	Any	System 13 – Kitchen HVAC System with kitchen exhaust

Table 7~~5~~ – System Descriptions

System Type	Description	Detail
System 1 – PTAC	Packaged Terminal Air Conditioner	Ductless single-zone DX unit with hot water natural gas boiler
System 2 – FPFC	Four-Pipe Fan Coil	Central plant with terminal units with hot water and chilled water coils, with separate ventilation source
System 3 – PSZ	Packaged Single Zone	Single-zone constant volume DX unit with gas heating
System 4 – RESERVED		
System 5 – PVAV	Packaged VAV Unit	VAV reheat system; packaged variable volume DX unit with gas heating and with hot water reheat terminal units
System 6 – VAVS	Built-up VAV Unit	Variable volume system with chilled water and hot water coils, water-cooled chiller, tower and central boiler
System 7 – SZVAV	Packaged Single-Zone VAV Unit	Single-zone variable volume DX unit with variable-speed drive and gas heating
System 8 – RESERVED		
System 9 – HEATVENT	Heating and Ventilation Only	Gas heating and ventilation
System 10 – CRAH	Computer Room Air Handler	Built-up variable volume unit with chilled water, no heating
System 11 – CRAC	Computer Room Air Conditioner	Packaged variable volume DX unit with no heating
System 12 – LAB	Laboratory HVAC System	Packaged variable volume system with 100% OA and minimum ventilation rate of 6 ACH
System 13 – KITCH	Kitchen HVAC System	Dedicated makeup air unit (MAU) – CHW if building is VAVS, DX otherwise. Dedicated exhaust fan.

There are several important exceptions to the HVAC mapping rules that apply to spaces with unusual internal heat gains, different schedules, special pressurization requirements, or unique outside air needs. These exceptions will typically apply to laboratories, data centers, and many spaces in healthcare facilities. See Chapter 5 for the special requirements for these building types. The exceptions are described below:

- Separate occupancies in mixed use buildings are served by separate standard design systems. Examples include residential spaces located over retail and other similar conditions. See Chapter 2, Space Use Classification Considerations, for a detailed description of when spaces with different occupancies may be served by a single system. However, when the equivalent weekly full-load hours between occupancies in mixed use buildings varies by more than 40 hours~~;~~, occupancies shall be served by separate HVAC systems.

- A separate standard design system shall serve laboratories or a group of laboratories with an exhaust system designed for 5,000 cfm or more of air movement. The standard design system serving the laboratory spaces shall be system 5 (PVAV with hot water reheat) or 6 (VAV with hot water reheat). The PVAV or VAV system must be capable of reducing the exhaust and makeup air volume to 50% of design values during unoccupied periods. This exception essentially requires VAV for both the supply fan and the exhaust system.
- ~~Spaces that do not trigger the laboratory exception above may still have a separate standard design system. System 3 (PSZ-AC) shall serve spaces in the standard design (depending on the heating source for the building) when one of the following conditions apply:~~
  - ~~Spaces on a floor have significantly different schedules or internal heat loads. Heat gain differences of more than 10 Btu/h-ft^2 or operation schedule differences of more than 40 hours/week trigger this exception.~~
  - ~~Spaces on a floor have "special pressurization relationships, cross-contamination requirements, or code-required minimum circulation rates". Many laboratory spaces with fume hoods would likely trigger this exception.~~

These special systems serve just the spaces that trigger the exceptions. The rest of the building/floor is served by the standard design HVAC system as indicated in Table 1.

5.1.3 Organization of Information

Building descriptors are grouped under objects or building components. A wall or exterior surface (an object) would have multiple building descriptors dealing with its geometry, thermal performance, etc. Each building descriptor contains the following pieces of information.

Building Descriptor Title	
Applicability	Information on when the building descriptor applies to the proposed design
Definition	A definition for the building descriptor
Units	The units that are used to prescribe the building descriptor. A “List” indicates that a fixed set of choices applies and the user shall only be allowed to enter one of the values in the list.
Input Restrictions	Any restrictions on information that may be entered for the proposed design
Standard Design	This defines the value for the “Standard Design” or baseline building is applied for this building descriptor. A value of “Same as proposed” indicates that the building descriptor is neutral; that is, the value is set to match the proposed design value. In many cases, the value may be fixed, or may be determined from a table lookup. In some cases the input may not be applicable: for example, heat recovery effectiveness is not applicable because the standard design (baseline building) does not have heat recovery.

5.2 Project Data

5.2.1 General Information

Project Name	
Applicability	All projects
Definition	Name used for the project, if one is applicable
Units	Up to 50 alphanumeric characters
Input Restrictions	Input is optional for the proposed design.
Standard Design	Not applicable

Project Address	
Applicability	All projects
Definition	Street address, city, state, and zip code
Units	Up to 50 alphanumeric characters on each of two lines
Input Restrictions	Input is mandatory for the proposed design.
Standard Design	Not applicable

Project Owner	
Applicability	All projects
Definition	Owner(s) of the project or individual or organization for whom the building permit is sought. Information should include name, title, organization, email, and phone number.
Units	Up to 50 alphanumeric characters
Input Restrictions	Input is optional for the proposed design.
Standard Design	Not applicable

Architect	
Applicability	All projects
Definition	Architect responsible for the building design. Information should include name, title, organization, email, and phone number.
Units	Up to 50 alphanumeric characters
Input Restrictions	Input is mandatory for the proposed design.
Standard Design	Not applicable

HVAC Engineer	
Applicability	All projects
Definition	HVAC Engineer responsible for the building design. Information should include name, title, organization, email, and phone number.
Units	

	Up to 50 alphanumeric characters
Input Restrictions	Input is mandatory for the proposed design. Information should include name, title, organization, email, and phone number.
Standard Design	Not applicable

Lighting Engineer/Designer

Applicability	All projects
Definition	Lighting Engineer/Designer responsible for the building design. Information should include name, title, organization, email, and phone number.
Units	Up to 50 alphanumeric characters
Input Restrictions	Input is mandatory for the proposed design.
Standard Design	Not applicable

Energy Modeler

Applicability	All projects
Definition	Individual responsible for performing the compliance analysis. Information should include name, title, organization, email, and phone number.
Units	Up to 50 alphanumeric characters
Input Restrictions	Input is mandatory for the proposed design.
Standard Design	Not applicable

Date

Applicability	All projects
Definition	Date of completion of the compliance analysis or the date of its most-recent revision
Units	Date format
Input Restrictions	Input is mandatory for the proposed design.
Standard Design	Not applicable

5.2.2 Building Model Classification

The structure of this manual supports multiple purposes and multiple baselines. For example, a baseline used for Title 24 compliance might be separate from a baseline used for green building ratings or ASHRAE 90.1 energy cost budget method. A building descriptor “Purpose” could be used to identify different baselines, but is not within the current scope of this manual.

Space Classification Type

Applicability	All projects
Definition	One of two available classification methods for identifying the function of the building or the functions of spaces within the building, which in turn determine energy-related requirements for the standard design. Appendix 5.4A lists the building classifications that are available under the complete building method and area category method.

	The Complete Building method uses the same space definitions for all spaces within a building, and the building type must match one of the types in the list in the Appendix. The Area Category method uses a separate space classification for each space in the building according to its function.
Units	List: Complete Building, Area Category
Input Restrictions	For multi-use buildings, the building may be divided and a different building classification may be assigned to each part. Either the complete building method or the area category method must be used, but the two classification methods may not be mixed within a single compliance run.
Standard Design	Same as proposed

Building Classification	
Applicability	When the complete building method is used instead of the area category method of classifying activity in the building
Definition	The building type or principal activity. One of two available classification methods for identifying the function of the building or the functions of spaces within the building, which in turn determine energy-related requirements for the standard design. Appendix 5.4A lists the building classifications that are available under the complete building method.
Units	List: Choose a building activity from Appendix 5.4A
Input Restrictions	For multi-use buildings, the building may be divided and a different building classification may be assigned to each part. Either the complete building method or the area category method must be used, but the two classification methods may not be mixed within a single compliance run.
Standard Design	Same as proposed

5.2.3 Geographic and Climate Data

The following data needs to be specified or derived in some manner. Software developers may use any acceptable method to determine the data. For California, city, state and county are required to determine climate data from the available data in Reference Appendix JA2

Zip Code	
Applicability	All projects
Definition	California postal designation
Units	List
Input Restrictions	None
Standard Design	Not applicable

Latitude	
Applicability	All projects
Definition	The latitude of the project site

Units	Degrees (°)
Input Restrictions	None
Standard Design	Latitude of representative city from Reference Appendix JA2

Longitude

Applicability	All projects
Definition	The longitude of the project site
Units	Degrees (°)
Input Restrictions	None
Standard Design	Longitude of representative city from Reference Appendix JA2

Elevation

Applicability	All projects
Definition	The height of the building site above sea level
Units	Feet (ft)
Input Restrictions	None
Standard Design	Elevation of representative city from Reference Appendix JA2

California Climate Zone

Applicability	All projects
Definition	One of the 16 California climate zones
Units	List
Input Restrictions	None
Standard Design	Same as proposed

Daylight Savings Time Observed

Applicability	All projects
Definition	An indication that daylight savings time is observed. The schedules of operation are shifted by an hour twice a year and this affects solar gains, temperature and other factors.
Units	Boolean (True/False)
Input Restrictions	True
Standard Design	True

County

Applicability	All projects
Definition	The county where the project is located
Units	List
Input Restrictions	None
Standard Design	

County of representative city from Reference Appendix JA2

City	
Applicability	All projects
Definition	The city where the project is located
Units	List
Input Restrictions	None
Standard Design	Representative city from Reference Appendix JA2

Design Day Data	
Applicability	All projects
Definition	A data structure indicating design day information used for the sizing of the proposed system. Note that this information may not necessarily match the information used in the annual compliance simulation.
Units	Data Structure: contains the following: Design DB (0.5%), Mean Coincident Wet-Bulb, Daily Range, Day of Year
Input Restrictions	Must match climate data in Reference Appendix JA2
Standard Design	Not applicable

Weather File	
Applicability	All projects
Definition	The hourly (i.e., 8,760 hour per year) weather data to be used in performing the building energy simulations. Weather data must include outside dry-bulb temperature, outside wet-bulb temperature, atmospheric pressure, wind speed, wind direction, cloud amount, cloud type (or total horizontal solar and total direct normal solar), clearness number, ground temperature, humidity ratio, density of air, and specific enthalpy.
Units	Data file
Input Restrictions	The weather file selected shall be in the same climate zone as the proposed design. If multiple weather files exist for one climate zone then the weather file closest in distance to the proposed design and in the same climate zone shall be used.
Standard Design	Weather data shall be the same for both the proposed design and standard design.

Ground Reflectance	
Applicability	All projects
Definition	Ground reflectance affects daylighting calculations and solar gain. The reflectance can be specified as a constant for the entire period of the energy simulation or it may be scheduled, which ~~might be appropriate to~~can account for snow cover in the winter.
Units	Data structure: schedule, fraction
Input Restrictions	~~None~~ Prescribed. The weather file determines the ground reflectance. The ground reflectance shall be set to 0.2 when the snow depth is 0 or undefined, and set to 0.6 when the snow depth is greater than 0.
Standard Design	~~Ground reflectance shall be the same for both the proposed design and the standard design when it is specified to capture snow cover.~~ Same as proposed

Local Terrain

Applicability All projects

Definition An indication of how the local terrain shields the building from the prevailing wind. Estimates of this effect are provided in the ASHRAE Handbook of Fundamentals.

Units List: the list shall contain only the following choices:

Description	Exponent (α)	Boundary layer thickness, δ (m)
Flat, open country	0.14	270
Rough, wooded country, Suburbs	0.22	370
Towns and cities	0.33	460
Ocean	0.10	210
Urban, industrial, forest	0.22	370

The exponent and boundary layer are used in the following equation to adjust the local wind speed:

$$V_z = V_{met}\left(\frac{\delta_{met}}{z_{met}}\right)^{\alpha_{met}}\left(\frac{z}{\delta}\right)^{\alpha}$$

where

z = altitude, height above ground (m)

V_z = wind speed at altitude z *(m/s)*

α = wind speed profile exponent at the site

δ = wind speed profile boundary layer thickness at the site (m)

z_{met} = height above ground of the wind speed sensor at the meteorological station (m)

V_{met} = wind speed measured at the meteorological station (m/s)

α_{met} = wind speed profile exponent at the meteorological station

δ_{met} = wind speed profile boundary layer thickness at the meteorological station. (m)

The wind speed profile coefficients α, δ, α_{met}, and δ_{met}, are variables that depend on the roughness characteristics of the surrounding terrain. Typical values for α and δ are shown in the table above:

Input Restrictions Weather data should be representative of the long term conditions at the site

Standard Design The standard design terrain should be equal to the proposed design

5.2.4 Site Characteristics

Shading of Building Site

Applicability	All projects
Definition	Shading of building fenestration, roofs, or walls by other structures, surrounding terrain, vegetation, and the building itself
Units	Data structure
Input Restrictions	The default and fixed value is for the site to be unshaded. External shading from other buildings or other objects is not modeled for Title 24 compliance in the ACM.
Standard Design	The proposed design and standard design are modeled with identical assumptions regarding shading of the building site.

5.2.5 Calendar

Year for Analysis

Applicability	All projects
Definition	The calendar year to be used for the annual energy simulations. This input determines the correspondence between days of the week and the days on which weather events on the weather tape occur and has no other impact.
Units	List: choose a year (other than a leap year).
Input Restrictions	Use year 1991.
Standard Design	Same calendar year as the proposed design

Schedule of Holidays

Applicability	All projects
Definition	A list of dates on which holidays are observed and on which holiday schedules are used in the simulations
Units	Data structure
Input Restrictions	The following ten holidays represent the prescribed set. When a holiday falls on a Saturday, the holiday is observed on the Friday proceeding the Saturday. If the holiday falls on a Sunday, the holiday is observed on the following Monday.

New Year's Day	January 1
Martin Luther King Day	Third Monday in January
Presidents Day	Third Monday in February
Memorial Day	Last Monday in May
Independence Day	July 4
Labor Day	First Monday in September
Columbus Day	Second Monday in October
Veterans Day	November 11
Thanksgiving Day	Fourth Thursday in November
Christmas Day	December 25

Standard Design	The standard design shall observe the same holidays specified for the proposed

design.

5.3 Thermal Zones

A thermal zone is a space or collection of spaces having similar space-conditioning requirements, the same heating and cooling setpoint, and is the basic thermal unit (or zone) used in modeling the building. A thermal zone will include one or more spaces. ~~A thermal zone can include more than one HVAC zone, but HVAC zones may not split between thermal zones.~~Thermal zones may be grouped together, but systems serving combined zones shall be subject to efficiency and control requirements of the combined zones. High-rise residiential and non-residential buildings with identical floors served by like systems may be modeled with floor multipliers.

5.3.1 General Information

Thermal Zone Name	
Applicability	All projects
Definition	A unique identifier for the thermal zone made up of 50 or fewer alphanumeric characters.
Units	Text
Input Restrictions	None
Standard Design	Not applicable

Thermal Zone Description	
Applicability	All projects
Definition	A brief description of the thermal zone that identifies the spaces which make up the thermal zone or other descriptive information. The description should tie the thermal zone to the building plans.
Units	Text
Input Restrictions	None
Standard Design	Not applicable

Thermal Zone Type	
Applicability	All projects
Definition	Designation of the thermal zone as directly conditioned space, indirectly conditioned space (i.e., conditioned only by passive heating or cooling from an adjacent thermal zone), or plenum (i.e., unoccupied but partially conditioned as a consequence of its role as a path for returning air).
Units	List: directly conditioned, , unconditioned or plenum
Input Restrictions	The default thermal zone type is “directly conditioned.”
Standard Design	

The descriptor is identical for the proposed design and standard design.

System Name	
Applicability	All projects
Definition	The name of the HVAC system that serves this thermal zone. The purpose of this building descriptor is to link the thermal zone to a system (child points to parent). Software can make this link in other ways.
Units	Text, unique
Input Restrictions	None
Standard Design	The standard design may have a different system mapping if the standard design has a different HVAC type than the proposed design.

Floor Area	
Applicability	All projects
Definition	The gross floor area of a thermal zone; including walls and minor spaces for mechanical or electrical services such as chases that are not assigned to other thermal zones. ~~Larger mechanical spaces and electrical rooms should not be combined.~~
Units	Square feet (ft^2)
Input Restrictions	The floor area of the thermal zone is derived from the floor area of the individual spaces that make up the thermal zone.
Standard Design	Same as proposed design

5.3.2 Interior Lighting

Inputs for interior lighting are specified at the space level (see specification below). In those instances when thermal zones contain just one space, the inputs here will be identical to the inputs for the single space that is contained within the thermal zone.

For those instances when a thermal zone contains more than one space, the software shall either model the lighting separate for each space and sum energy consumption and heat gain for each time step of the analysis or it must incorporate some procedure to sum inputs or calculate weighted averages such that the lighting power used at the thermal zone level is equal to the combination of lighting power for each of the spaces contained in the thermal zone.

In some cases, combining lighting power at the space level into lighting power for the thermal zone may be challenging and would have to be done at the level of each time step in the simulation. These cases include:

- A thermal zone that contains some spaces that have daylighting and others that do not.
- A thermal zone that contains spaces with different schedules of operation.
- A thermal zone that contains some spaces that have a schedule adjusted in some way for lighting controls and other spaces that do not.
- Combinations of the above.

5.3.3 Receptacle Loads

Inputs for receptacle and process loads are specified at the space level (see specification below). In those instances when thermal zones contain just one space, the inputs here will be identical to the inputs for the single space that is contained within the thermal zone.

For those instances when a thermal zone contains more than one space, the software shall either model the receptacle and process loads separate for each space and sum energy consumption and heat gain for each time step of the analysis or it must incorporate some procedure to sum inputs or calculate weighted averages such that the receptacle and process loads used at the thermal zone level are equal to the combination of receptacle and process loads for each of the spaces contained in the thermal zone.

When the spaces contained in a thermal zone have different schedules, combining receptacle and process loads from the space level may be challenging and would have to be done at the level of each time step in the simulation. See discussion above on lighting.

5.3.4 Occupants

Inputs for occupant loads are specified at the space level (see specification below). In those instances when thermal zones contain just one space, the inputs here will be identical to the inputs for the single space that is contained within the thermal zone.

For those instances when a thermal zone contains more than one space, the software shall either model the occupant loads separate for each space and the heat gain for each time step of the analysis or it must incorporate some procedure to sum inputs or calculate weighted averages such that the occupant loads used at the thermal zone level are equal to the combination of occupant loads for each of the spaces contained in the thermal zone.

When the spaces contained in a thermal zone have different occupant schedules, rolling up occupant loads from the space level may be challenging and would have to be done at the level of each time step in the simulation. Spaces with differences in full-load equivalent operating hours of more than 40 hours per week shall not be combined in a single zone. See discussion above on lighting.

~~5.3.5 Infiltration~~

~~*Infiltration Method*~~	
~~*Applicability*~~	~~All projects~~
~~*Definition*~~	~~Energy simulation programs have a variety of methods for modeling uncontrolled air leakage or infiltration. Some procedures use the effective leakage area which is generally applicable for small residential scale buildings. The component leakage method requires the user to specify the average leakage through the building envelope per unit area (ft²). Other methods require the specification of a maximum rate, which is modified by a schedule.~~
~~*Units*~~	~~List: effective leakage area, component leakage, air changes per hour, or other method supported by the energy analysis software.~~
~~*Input Restrictions*~~	~~For California Compliance and Reach, the component leakage area is prescribed; a fixed infiltration rate shall be specified and calculated as a leakage per area of exterior envelope, including the *gross area* of exterior walls, roofs, and exposed floors, but excluding slabs on grade and interior partitions.~~
~~*Standard Design*~~	~~The infiltration method used for the standard design shall be the same as the~~

~~proposed design.~~

~~*Infiltration Data*~~

~~*Applicability*~~ ~~All projects~~

~~*Definition*~~ ~~Information needed to characterize the infiltration rate in buildings. The required information will depend on the infiltration method selected above. For the effective leakage area method, typical inputs are leakage per exterior wall area in ft² or other suitable units and information to indicate the height of the building and how shielded the site is from wind pressures. Only zones with exterior wall area are assumed to be subject to infiltration.~~

~~*Units*~~ ~~A *data structure* is required to define the effective leakage area model.~~

~~*Input Restrictions*~~ ~~For the California Compliance and Reach, infiltration shall be calculated each hour using Equation 1:~~

$$\cancel{Infiltration = I_{design} \cdot F_{schedule} \cdot \left(A + B \cdot \left|t_{zone} - t_{odb}\right| + C \cdot ws + D \cdot ws^2\right) \quad (1)}$$

~~where:~~

~~*Infiltration* = zone infiltration airflow (m³/s-m²)~~
~~I_{design} = design zone infiltration airflow (m³/s-m²)~~
~~$F_{schedule}$ = fractional adjustment from a user input schedule (unitless)~~
~~t_{zone} = zone air temperature (°C)~~
~~t_{odb} = outdoor dry bulb temperature (°C)~~
~~*ws* = the windspeed (m/s)~~
~~*A* = overall coefficient (unitless)~~
~~*B* = temperature coefficient (1/°C)~~
~~*C* = windspeed coefficient (s/m)~~
~~*D* = windspeed squared coefficient (s²/m²)~~

~~For the proposed design, I_{design} shall have a default of 0.0448 cfm/ft² (0.000228 m³/s-m²) times the gross wall area exposed to ambient outdoor air. A, B and D shall be zero. C shall be 0.10016 hr/mile (0.224 s/m).~~

~~*Standard Design*~~ ~~The infiltration data for the standard design shall be the same as the proposed design unless the proposed design employs specific measures that go beyond the mandatory measures..~~

~~*Infiltration Schedule*~~

~~*Applicability*~~ ~~When an infiltration method is used that requires the specification of a schedule~~

~~*Definition*~~ ~~With the ACH method and other methods (see above), it may be necessary to specify a schedule that modifies the infiltration rate for each hour or time step of the simulation. Typically the schedule is either on or off, but can also be fractional.~~

~~*Units*~~ ~~Data structure: schedule, fractional~~

~~*Input Restrictions*~~ ~~For the purpose of California Compliance and Reach, the infiltration schedule shall be prescribed based on the HVAC System operating schedules from Appendix 5.4B. The infiltration schedule shall be set equal to 1 when the HVAC system is off, and 0.25 when the HVAC system is on. This is based on the assumption that when the HVAC system is on it brings the pressure of the interior space above the pressure of the exterior, and decreasing the infiltration of outside air. When the HVAC system is off, interior pressure drops below exterior pressure and infiltration increases.~~

~~*Standard Design*~~

~~The infiltration schedule for the standard design shall be the same as the proposed design.~~

~~5.3.6~~5.3.5 Natural Ventilation

Natural ventilation may be modeled for a thermal zone in the proposed design If zone temperature setpoints are maintained using only natural ventilation, the heating, cooling and ventilation systems may be shut off.

If the proposed design does not include a cooling system for the naturally ventilated zone, then the proposed design model will include a standard design single zone VAV system (System 7 SZVAV) to serve the zone. If the proposed design does not include a heating system for the zone, then heating will be provided by the same standard design SZVAV system.

The standard design model will not include natural ventilation. ~~when the following conditions are met:~~

~~The thermal zone does not have an air conditioning system.~~

~~The temperature of the thermal zone does not exceed the cooling setpoint temperature for more than 300 hours for the year of the simulation with just the natural ventilation system operating.~~

~~Under these circumstances, the thermal zone in the proposed design is modeled with no air conditioning when the natural ventilation system maintains temperature. For periods when the space temperature is greater than the cooling setpoint, an air conditioner like the one for the standard design is assumed to operate to maintain temperature. The fans in this simulated system cycle with loads. The corresponding thermal zone in the standard design is modeled with air conditioning and the fans operate continuously.~~

~~For California Compliance, natural ventilation shall not be modeled. Thermal zones in the proposed design that have no cooling system are modeled with the same standard design cooling system.~~

Natural Ventilation Method	
Applicability	All thermal zones with natural ventilation
Definition	The method used to model natural ventilation. The choices will depend ~~to some extent~~ on the capabilities of the energy simulation program. ~~One procedure that could be used with most energy simulation programs would be to approximate the effect of natural ventilation by scheduling a high rate of infiltration when conditions are right. The schedule would typically be developed through computational fluid dynamic software or with other software that is capable of estimating the cooling benefit of natural ventilation and relating it to climate so that the schedule can be developed.~~
Units	List: choices depend on the capabilities of the energy simulation program.
Input Restrictions	None
Standard Design	The standard design is not modeled with natural ventilation.

Air Flow Rate	
Applicability	All projects with natural ventilation that use a method that require the specification of an air flow rate
Definition	The rate of air flow through the thermal zone when the natural ventilation system is operating
Units	Air changes per hour or cfm
Input Restrictions	Documentation shall be provided supporting ~~The~~ the air flow rate for the proposed design ~~shall be determined using sound engineering methods and supporting documentation shall be provided~~.

Standard Design	The standard design is not modeled with natural ventilation.

	~~***Natural Ventilation Schedule***~~
~~*Applicability*~~	~~All projects with natural ventilation that use a method that requires a schedule~~
~~*Definition*~~	~~A schedule that modifies the airflow rate through the thermal zone dictates when windows can be opened to provide natural ventilation.~~
~~*Units*~~	~~Data structure: schedule, fractional~~
~~*Input Restrictions*~~	~~The schedule for the proposed design shall be determined using sound engineering methods and keyed to outdoor temperature and perhaps other conditions on the weather file used for the simulation.~~
~~*Standard Design*~~	~~The standard design is not modeled with natural ventilation.~~

~~5.3.7~~5.3.6 Thermal Mass

This set of building descriptors characterize the thermal mass that is not explicitly captured by the definition of exterior surfaces and interior partitions.

Thermal Response Characteristics	
Applicability	All projects
Definition	This building descriptor only addresses the building contents. The thermal mass associated with floors, interior walls, and other building envelope components is derived from the thermal properties and materials that make up these components. However, if interior partitions are not explicitly entered (see below) their effect may be captured with this input. The thermal capacitance of the building contents are typically specified in terms of the composite weight of the building contents in lb/ft² or absolute lb. In this instance, the software assumes an average specific heat for the contents. This input can also be specified as the mass of the contents multiplied times the specific heat of the contents. The latter method would be a summation, since each item may have a different specific heat.
Units	lb/ft² or lb
Input Restrictions	As designed
Standard Design	The interior thermal mass in the standard design shall be the same as the proposed design.

Furniture and Contents	
Applicability	All projects
Definition	A specification of the mass and heat capacity of furniture and other elements in the interior of the building. This includes information about the coverage and weight of furniture in the space as well as how much of the floor is covered by furniture. The latter affects how much of the solar gains that enters the space is directed to the floor with delayed heat gain and how much becomes a more instantaneous load.
Units	Data structure
Input Restrictions	As designed
Standard Design	The interior thermal mass and modeling assumptions in the standard design shall be

the same as the proposed design.

5.4 Space Uses

Each thermal zone discussed above may be subdivided into ~~HVAC zones and the HVAC zones may be further subdivided into space uses~~spaces. This section presents the building descriptors that relate to the space uses. Space uses and the defaults associated with them are listed in Appendix 5.4A. Every thermal zone shall have at least one space, as defined in this section. Daylit spaces should generally be separately defined.

5.4.1 General Information

Commen
building d
user input

Space Type

Applicability	All projects
Definition	For identifying space type, either the complete building method or area category method may be used. If lighting compliance is not performed, use either approach, but actual LPDs cannot be entered for the spaces – the LPDs of the building match the standard design. The allowed building types in complete building category or space types in area category is available from Nonresidential Appendix 5.4A. The building or space type determines the following baseline inputs: Number of occupants (occupant density) Equipment Power Density Lighting Power Density Hot Water Load Ventilation Rate Schedules (from Appendix 5.4B)
Units	List
Input Restrictions	Only selections shown in the Appendix 5.4A may be used. For unconditioned spaces, the user must enter “Unconditioned” as the occupancy and ventilation, internal loads and uses are set to zero. Compliance software shall require the user to identify if lighting compliance is performed (lighting plans are included or have already been submitted).
Standard Design	Same as proposed.
Standard Design, Existing Buildings	Same as proposed

Floor Area

Applicability:	All projects that use the area category classification method (see above)
Definition:	The floor area of the space. The area of the spaces that make up a thermal zone shall sum to the floor area of the thermal zone.

Units	Square feet (ft²)
Input Restrictions:	Area shall be measured to the outside of exterior walls and to the center line of partitions.
Standard Design	Area shall be identical to the proposed design.
Standard Design, Existing Buildings	Same as proposed

5.4.2 Infiltration

Infiltration Method	
Applicability	All projects
Definition	Energy simulation programs have a variety of methods for modeling uncontrolled air leakage or infiltration. Some procedures use the effective leakage area which is generally applicable for small residential scale buildings. The component leakage method requires the user to specify the average leakage through the building envelope per unit area (ft²). Other methods require the specification of a maximum rate, which is modified by a schedule.
Units	List: effective leakage area, component leakage, air changes per hour, or other method supported by the energy analysis software.
Input Restrictions	For California Compliance and Reach, the component leakage area is prescribed; a fixed infiltration rate shall be specified and calculated as a leakage per area of exterior envelope, including the *gross area* of exterior walls, roofs, and exposed floors, but excluding slabs on grade and interior partitions.
Standard Design	The infiltration method used for the standard design shall be the same as the proposed design.

Infiltration Data	
Applicability	All projects
Definition	Information needed to characterize the infiltration rate in buildings. The required information will depend on the infiltration method selected above. For the effective leakage area method, typical inputs are leakage per exterior wall area in ft² or other suitable units and information to indicate the height of the building and how shielded the site is from wind pressures. Only zones with exterior wall area are assumed to be subject to infiltration.
Units	A *data structure* is required to define the effective leakage area model,
Input Restrictions	For the California Compliance and Reach, infiltration shall be calculated each hour using Equation 1:

$$Infiltration = I_{design} \cdot F_{schedule} \cdot \left(A + B \cdot \left|t_{zone} - t_{odb}\right| + C \cdot ws + D \cdot ws^2\right) \qquad (1)$$

where:

- $Infiltration$ = zone infiltration airflow (m³/s-m²)
- I_{design} = design zone infiltration airflow (m³/s-m²)
- $F_{schedule}$ = fractional adjustment from a user input schedule (unitless)
- t_{zone} = zone air temperature (°C)

t_{odb}	= outdoor dry bulb temperature (°C)
ws	= the windspeed (m/s)
A	= overall coefficient (unitless)
B	= temperature coefficient (1/°C)
C	= windspeed coefficient (s/m)
D	= windspeed squared coefficient (s²/m²)

For the proposed design, I_{design} shall have a default of 0.0448 cfm/ft^2 (0.000228 m³/s-m²) times the gross wall area exposed to ambient outdoor air. A, B and D shall be zero. C shall be 0.10016 hr/mile (0.224 s/m).

Standard Design The infiltration data for the standard design shall be the same as the proposed design unless the proposed design employs specific measures that go beyond the mandatory measures..

Infiltration Schedule

Applicability When an infiltration method is used that requires the specification of a schedule

Definition With the ACH method and other methods (see above), it may be necessary to specify a schedule that modifies the infiltration rate for each hour or time step of the simulation. Typically the schedule is either on or off, but can also be fractional.

Units Data structure: schedule, fractional

Input Restrictions For the purpose of California Compliance and Reach, the infiltration schedule shall be prescribed based on the HVAC System operating schedules from Appendix 5.4B. The infiltration schedule shall be set equal to 1 when the HVAC system is off, and 0.25 when the HVAC system is on. This is based on the assumption that when the HVAC system is on it brings the pressure of the interior space above the pressure of the exterior, and decreasing the infiltration of outside air. When the HVAC system is off, interior pressure drops below exterior pressure and infiltration increases.

Standard Design The infiltration schedule for the standard design shall be the same as the proposed design.

~~5.4.2~~5.4.3 Occupants

For space level information on occupancy, lighting and plug load schedules, as well as occupant density, allowed lighting power density, Appendix 5.4A provides a table of allowed space types.

Commen
concept.

Number of Occupants

Applicability All projects

Definition The number of persons in a space. The number of persons is modified by an hourly schedule (see below), which approaches but does not exceed 1.0. Therefore, the number of persons specified by the building descriptor is similar to design conditions as opposed to average occupancy.

Units The number of persons may be specified in an absolute number, ft²/person, or persons/1000 ft².

Input Restrictions The number of occupants is prescribed ~~for Compliance and Reach~~, and the values are given by Space Type in Appendix 5.4A,.

Standard Design

	The number of occupants must be identical for both the proposed and baseline design cases.
Standard Design, Existing Buildings	The number of occupants must be identical for both the proposed and baseline design cases.

Occupant Heat Rate

Applicability	All projects
Definition	The sensible and latent heat produced by each occupant in an hour. This depends on the activity level of the occupants and other factors. Heat produced by occupants must be removed by the air conditioning system as well as the outside air ventilation rate and can have a significant impact on energy consumption.
Units	Btu/h specified separately for sensible and latent gains
Input Restrictions	The occupant heat rate is prescribed for California Compliance and Reach.
Standard Design	The occupant heat rate for the baseline building shall be the same as the proposed design.
Standard Design, Existing Buildings	Same as proposed

Occupancy Schedule

Applicability	All projects
Definition	The occupancy schedule modifies the number of occupants to account for expected operational patterns in the building. The schedule adjusts the heat contribution from occupants to the space on an hourly basis to reflect time-dependent usage patterns. The occupancy schedule can also affect other factors such as outside air ventilation, depending on the control mechanisms specified.
Units	Data structure: schedule, fractional.
Input Restrictions	The occupant schedule is a default for California Compliance and Reach. For California Compliance and Reach, an appropriate schedule from Appendix 5.4B shall be used as a default. If values other than those shown in Appendix 5.4A are used, this will be reported as a condition requiring an Exceptional Condition Review by a third party reviewer.
Standard Design	Occupancy schedules are identical for proposed and baseline building designs.
Standard Design, Existing Buildings	Same as proposed

Commen
type deter

~~5.4.3~~5.4.4 Interior Lighting

The building descriptors in this section are provided for each lighting system. Typically a space will have only one lighting system, but in some cases, it could have two or more. Examples include a general and task lighting system in offices or hotel multi-purpose rooms that have lighting systems for different functions. It may also be desirable to define different lighting systems for spaces that are daylit and those that are not.

Lighting Classification Method

Applicability Each space in the building

Definition Indoor lighting power can be specified using the complete building method, area category method or the tailored method.

Complete building method can be used for building types listed in Appendix 5.4A. Parking garage portion of the building shall be considered as a separate space. This method cannot be combined with other lighting classification methods described in this section.

Area category method can be used for all areas of the building with space types listed in Appendix 5.4A. This method can be used by itself or with the tailored lighting method.

Tailored lighting method can be used for spaces with primary function listed in Table 140.6D of the Standards and §140.6(c)3H. The tailored lighting method is intended to accommodate special lighting applications. The tailored lighting method can be used by itself for all areas of the building or with the area category method. For a given area only one classification type can be used.

Units List

Input Restrictions Only Complete Building, Area Category or Tailored Lighting are allowed.

The Complete Building method may only be used if at least 90% of the building is conditioned. Also, if there is a parking garage in the building, the parking garage must be modeled as a separate building if the Complete Building method is used.

Standard Design Same as proposed.

Standard Design, Existing Buildings Same as proposed.

Table 8~~7~~- Lighting Specification

Options:Lighting Classification Method	Complete Building Method	Area Category Method	Tailored Lighting Method
Allowed combinations with other lighting classification methods	None	May be combined with Tailored method	May be combined with Area Category Method
Allowed Regulated lighting power types	General Lighting Power	General Lighting Power Custom Lighting Power	General Lighting Power Custom Lighting Power
Allowed Trade-offs	None	General lighting between spaces using area category method General lighting between spaces using area category and tailored method.	General lighting between spaces using tailored method General lighting between spaces using tailored and area category method
Exception: With the Area Category method, custom lighting power can be used only if the tailored lighting method is not used in any area of the building.			

Regulated Interior Lighting Power

Applicability All projects when lighting compliance is performed

Definition

Total connected lighting power for all regulated interior lighting power. This includes the loads for lamps and ballasts. The total regulated interior lighting power is the sum of general lighting power and applicable custom lighting power. Calculation of lighting power for conditioned spaces is done separately from unconditioned spaces.

Units Watts

Input Restrictions Derived – not a user input. The proposed value is:

a) For the area category method, the sum of the proposed *General Lighting Power* and the proposed *General Lighting Exceptional Power*

b) For the tailored lighting method: the sum of the proposed *General Lighting Power* and the proposed *Custom Lighting Power*.

When lighting compliance is not performed, the lighting power may not be entered and is set equal to the lighting level of the baseline building, which is set to the levels for the selected occupancy from Appendix 5.4A.

Standard Design For spaces without special task lighting, wall display lighting or similar requirements, this input will be the same as the general lighting power. See the general lighting power building descriptor for details.

With the area category and tailored method regulated interior lighting power for each space will be the sum of general lighting power and allowed custom lighting power.

For alterations where less than 40 luminaires have been modified the standard design is the existing lighting condition before the alteration. If 40 or more luminaires have been modified, the prescriptive requirements for new construction apply.

General Lighting Power

Applicability All spaces or projects

Definition General lighting power is the power used by installed electric lighting that provides a uniform level of illumination throughout an area, exclusive of any provision for special visual tasks or decorative effect, exclusive of daylighting, and also known as ambient lighting.

Units Watts

Input Restrictions As designed. For spaces without special task lighting, wall display lighting or similar requirements, this input will be the same as the regulated lighting power.

Trade-offs in general lighting power is allowed between spaces all using the area category method, between spaces all using the tailored lighting method and between spaces that use area category and tailored methods. See Table Lighting Specification Options.

Standard Design With the complete building classification method, general lighting power is the product of the lighting power density for the building classification from Appendix 5.4A and the floor area of the space.

With the area category method, general lighting power is the product of the lighting power densities for the space type from Appendix 5.4A and the floor areas for the corresponding spaces.

With the tailored lighting method, general lighting power is the product of the lighting power density for the primary function type in Table 140.6-D of the Standards and floor area of the space. The lighting power density is given as a function of room cavity ratio (RCR) and interior illumination level in Table 140.6-G. *No interpolation is allowed for this table.*

The general lighting power in the tailored method is calculated by the following steps:

Step 1. Determine illumination level from Table 140.6-D by matching the Primary Function Area in Table 140.6-D with the space type in Appendix 5.4A.

Step 2. Calculate the room cavity ratio (RCR) by using the applicable equation in Table 140.6-F.

Rectangular Rooms: RCR = 5 x H x (L+W) / (L x W)

Irregular Rooms: RCR = 2.5 x H x P / A

Where: L =Length of room; W = Width of room; H =Vertical distance from the work plane to the centerline of the lighting fixture; P = Perimeter of room, and A = Area of room

Step 3. Determine the general lighting in the space(s) using the tailored method by a look-up in Table 140.6-G, where the general lighting LPD is a function of illuminance level and RCR. No interpolation is allowed for this table. A space between two illuminance levels (for example, 150 lux) uses the applicable LPD from the next lower illuminance level (100 lux).

Standard Design, Existing Buildings

For alterations where less than 40 luminaires have been modified, the baseline is the existing lighting condition before the alteration. If 40 or more luminaires have been modified, the general lighting power for the baseline is defined for each space type in Appendix 5.4B.

General Lighting Exceptional Power

Applicability

Spaces that use the area category method; note that some exceptional allowances are only applicable to certain space types – see Table 140.6-C of the Standards

Definition

The Standards provide an additional lighting power allowance for special cases. Each of these lighting system cases is treated separately as "use-it-or-lose-it" lighting: the user receives no credit (standard design matches proposed), but there is a maximum power allowance for each item). There are eight lighting power allowances, as defined in the Standards Table 140.6-C footnotes:

Formatte
Relative to
Paragraph

Units

Data structure: this input has 8 data elements:

1) Specialized task work, laboratory (W/ft2)

2) Specialized task work, other approved areas (W/ft2)

3) Ornamental lighting (W/ft2)

4) Precision commercial and industrial work (W/ft2)

5) White board or chalk board lighting (W/linear foot)

6) Accent, display and feature lighting (W/ft2)

7) Decorative Lighting (W/ft2)

8) Videoconferencing studio lighting (W/ft2)

Input Restrictions

As designed.

Standard Design

The standard design General Lighting Exceptional Power is given by the following equation:

$$GLEP_{std} = \sum_{i=1}^{8} \min(GLEP_{prop,i} \times GLETA\ , GLEA_i \times GLETA_i)$$

Where

GLEPstd = the General Lighting Exceptional Power of the standard design,

GLEPprop,i = the proposed General Lighting Exception Power of the footnote allowance i in the data structure above, or in the footnotes to Table 140.6-C of the Standards,

GLEAi = the General Lighting Exceptional Allowance, which is the maximum allowed added lighting power in the rightmost column in Table 140.6-C of the Standards. These allowances are, for GLEA1 through GLEA8, 0.2 W/ft^2, 0.5 W/ft^2, 0.5 W/ft^2, 1.0 W/ft^2, 5.5 W/linear foot, 0.3 W/ft^2, 0.2 W/ft^2 and 1.5 W/ft^2, respectively.

GLETAi = the General Lighting Exceptional Task Area for the ith exception, where the exception number corresponds to the area category exception number in the footnotes to Table 140.-C of the Standards.

General Lighting Exceptional Task Area

Applicability	Spaces that use area category method
Definition	The area associated each of the exceptional lighting allowances in the General Lighting Exceptional Power building descriptor.
Units	ft^2
Input Restrictions	As designed, but cannot exceed the floor area of the space
Standard Design	Same as proposed
Standard Design, Existing Buildings	Same as proposed

Formatte

White Board Length

Applicability	Spaces that use area category method and take General Lighting Exceptional Power allowance #5
Definition	The linear length of the white board or chalk board in feet
Units	ft
Input Restrictions	As designed.
Standard Design	Same as proposed
Standard Design, Existing Buildings	Same as proposed

Custom Lighting Power

Applicability	All spaces or projects that use the ~~area category or~~ tailored lighting method
Definition	Custom lighting power covers lighting sources that are not included as general lighting. These include task lighting, display lighting and other specialized lighting designated in the footnotes to Table 140.6-C and lighting systems in Table 140.6-D of the Standards This lighting must be entered separately from the general lighting because it is not subject to tradeoffs. Software shall allow the user to input a custom lighting input for the allowed lighting system. Custom lighting power cannot be used with the complete building method. If area category method is used, custom lighting power cannot be used if the tailored method is used for any area of the building. See Table Lighting Specification Options

for details.

Units Watts

Input Restrictions As designed.

Standard Design Same as proposed, but subject to the maximum limits specified in the footnotes to Table 140.6-C and Table 140.6-D of the Standards. For spaces using the tailored method, the maximum allowed custom power is defined by the following procedure:

~~Step 1. Find the Primary Function Area that matches the space type from Appendix A in Table 140.6-D.~~

~~Step 2. Multiply the proposed wall display length times the applicable power in Column 3 of Table 140.6-D.~~

~~Step 3. Multiply the applicable value in column 4 of Table 140.6-D times the floor area of the space.~~

~~Step 4. Multiply the applicable value in column 5 of Table 140.6-D times the floor area of the space.~~

~~Step 5. Add the lighting power (Watts) from steps 2, 3 and 4.~~

~~Step 6. If the proposed custom lighting power is greater than the custom lighting power limit, then the standard design custom lighting power is set to the custom lighting power limit. Otherwise, if the proposed Custom Lighting Power is less than the custom lighting power limit, then the standard design Custom Lighting Power equals the proposed design custom lighting power.~~

The Standard Design Custom Lighting Power is calculated by the sum of the following four terms:

1) The product of the standard design Wall Display Power and the standard design Wall Display Length,
2) The product of the standard design Floor and Task Lighting Power and the standard design Floor and Task Lighting Area,
3) The product of the standard design Ornamental and Special Effect Lighting Power and the standard design Ornamental and Special Effect Lighting Area,
4) The product of the standard design Very Valuable Display Case Power and the standard design Very Valuable Display Case Area,

Formatte
Numbering
Alignment
at: 1.42"

Standard Design, Existing Buildings For alterations where less than 40 luminaires have been modified, the baseline is the existing lighting condition before the alteration. If 40 or more luminaires have been modified, the custom lighting power for the baseline is the same as proposed, but subject to the limits specified in the footnotes to Table 140.6-C of the Standards.

Wall Display Power

Applicability All spaces that use the tailored lighting method

Definition The lighting power allowed for wall display, as specified in Standards Table 140.6-D, column 3

Units W/ft

Input Restrictions As designed.

Standard Design The standard design lighting power is the lesser of the proposed design wall display

	power or the limit specified in Table 140.6-D for the applicable space type.
Standard Design, Existing Buildings	Same as proposed

Formatte

Wall Display Length

Applicability	All spaces that use the tailored lighting method
Definition	The horizontal length of the wall display lighting area using the tailored method for the space.
Units	ft
Input Restrictions	As designed, but this value of this input cannot exceed the floor area of the space.
Standard Design	Same as proposed
Standard Design, Existing Buildings	Same as proposed

Floor and Task Lighting Power

Applicability	All spaces that use the tailored lighting method
Definition	The lighting power allowed for wall display, as specified in Standards Table 140.6-D, column 4
Units	W/ft2
Input Restrictions	As designed.
Standard Design	The standard design floor and task lighting power is the lesser of the proposed design floor and task lighting power or the limit specified in Table 140.6-D, column 4, for the applicable space type.
Standard Design, Existing Buildings	Same as proposed

Floor and Task Lighting Area

Applicability	All spaces that use the tailored lighting method
Definition	The lighting area that is served by the floor and task lighting defined using the tailored method for the space.
Units	ft2
Input Restrictions	As designed, but this value of this input cannot exceed the floor area of the space.
Standard Design	Same as proposed
Standard Design, Existing Buildings	Same as proposed

Ornamental and Special Effect Lighting Power

Applicability	All spaces that use the tailored lighting method
Definition	The lighting power allowed for ornamental and special effect lighting, as specified in

	Standards Table 140.6-D, column 5
Units	W/ft2
Input Restrictions	As designed.
Standard Design	The standard design floor and task lighting power is the lesser of the proposed design floor and task lighting power or the limit specified in Table 140.6-D, column 5, for the applicable space type.
Standard Design, Existing Buildings	Same as proposed

Ornamental and Special Effect Lighting Area

Applicability	All spaces that use the tailored lighting method
Definition	The lighting area that is served by the ornamental and special effect lighting defined using the tailored method for the space.
Units	ft2
Input Restrictions	As designed, but this value of this input cannot exceed the floor area of the space.
Standard Design	Same as proposed
Standard Design, Existing Buildings	Same as proposed

Very Valuable Display Case Lighting Power

Applicability	All spaces that use the tailored lighting method and that have very valuable display cases holding Very Valuable Merchandise as defined in the Standards.
Definition	The lighting power allowed for very valuable display case lighting, as specified in Standards section 140.6(c)3L.
Units	W/ft2
Input Restrictions	As designed.
Standard Design	The standard design Very Valuable Display Case Lighting Power is the lesser of the proposed design very valuable display case lighting power or the following limit: The lesser of: a) The product of the area of the primary function and 0.8 W/ft^2, and b) The product of the area of the display case and 12 W/ft^2.
Standard Design, Existing Buildings	Same as proposed

Very Valuable Display Case Lighting Area

Applicability	All spaces that use the tailored lighting method
Definition	The area of the very valuable display case(s) in plan view.
Units	ft2
Input Restrictions	As designed, but this value of this input cannot exceed the floor area of the space.
Standard Design	Same as proposed
Standard Design, Existing Buildings	Same as proposed

Formatte
Numbering
Alignment
at: 1.42"
Formatte
Formatte

Formatte

Non-Regulated Interior Lighting Power

Applicability	All projects
Definition	For California, §140.6(a)3 of the energy efficiency standards identifies non-regulated (exempted) lighting.
Units	W/ft² or Watts
Input Restrictions	As designed. The non-regulated lighting power should be cross-referenced to the type of exception and to the construction documents. The default for non-regulated lighting power is zero.
Standard Design	The non-regulated interior lighting in the baseline building shall be the same as the proposed design.
Standard Design, Existing Buildings	Same as proposed

Lighting Schedules

Applicability	All projects
Definition	Schedule of operation for interior lighting power used to adjust the energy use of lighting systems on an hourly basis to reflect time-dependent patterns of lighting usage. ~~Different schedules may be defined for different lighting circuits, depending on the capabilities of the software.~~
Units	Data structure: schedule, fractional
Input Restrictions	The lighting schedule is prescribed for California Compliance and California Reach. An appropriate schedule from Appendix 5.4B shall be used.
Standard Design	The baseline building shall use the same lighting schedules as the proposed design.
Standard Design, Existing Buildings	Same as proposed

Commen
deleting th
ACM.

Tailored Lighting Illumination Height

Applicability	Spaces that have special tailored lighting power allowances
Definition	The illumination height is the vertical distance from the workplane to the luminaire. This is used in the calculation of the Room Cavity Ratio.
Units	ft
Input Restrictions	As designed
Standard Design	Same as proposed. The baseline general lighting power for the space that uses the tailored lighting method is calculated by one of the following equations:

$$RCR = \frac{5 \times H \times (L + W)}{L \times W}$$ for rectangular rooms

$$RCR = \frac{2.5 \times H \times P}{A}$$ for irregular-shaped rooms

Where the illumination height defined for this input is H, the room length is L, width is W, perimeter is P and room area is A.

The allowed general lighting power for the tailored method is a function of the room cavity ratio and the space illumination level (in lux), and specified in Table 140.6-G of the Standards.

Standard Design, Existing Buildings Same as for new construction

Mounting Height Above Floor

Applicability Spaces that have wall display or floor display lighting and tailored lighting power allowances

Definition The mounting height of wall display lighting above the floor. To qualify for an additional lighting allowance, all luminaires must be located at or above the specified height.

Units List: one of three choices: <12 ft, 12 ft to 16 ft, > 16 ft

Input Restrictions As designed. The entered value maps to Table 140.6-E of the Standards, that provides an adjustment multiplier for the tailored lighting wall power allowance in Table 140.6-D. The multiplier is 1.15 if the mounting height is 12' to 16', and 1.30 if greater than 16'. The compliance software must perform input processing to perform the necessary requirements.

Standard Design Same as proposed.

Standard Design, Existing Buildings Same as for new construction

Formatte
to: Page,
Paragraph

Light Heat Gain Distribution

Applicability All projects

Definition The distribution of the heat generated by the lighting system that is directed to the space, the plenum, the HVAC return air, or to other locations. This input is a function of the luminaire type and location. Luminaires recessed into a return air plenum contribute more of their heat to the plenum or the return air stream if the plenum is used for return air; while pendant mounted fixtures hanging in the space contribute more of their heat to the space. Common luminaire type/space configurations are listed in Table 3, Chapter 18, 2009 ASHRAE Handbook of Fundamentals, summarized in Table 9~~Table 8~~ below. Typically the data will be linked to list of common luminaire configurations similar to Table 9~~Table 8~~ so that the user chooses a luminaire type category and heat gain is automatically distributed to the appropriate locations.

Formatte
Formatte

Units List (of luminaire types) or data structure consisting of a series of decimal fractions that assign heat gain to various locations.

Input Restrictions Default values listed in Table 9~~Table 8~~ shall be used as a default when the luminaire categories apply. Values within the ranges of Table 9~~Table 8~~ may be used when following the rules in the 2009 HOF.

Formatte
Formatte
Commen
from the E
things for

Where lighting fixtures having different heat venting characteristics are used within a single space, the wattage weighted average heat-to-return-air fraction shall be used.

Standard Design

The baseline building shall use the above referenced defaults.

Standard Design, Existing Buildings Same as for new construction

Table 98 – Light Heat Gain Parameters for Typical Operating Conditions

Based on Table 3, Chapter 18, 2009 ASHRAE Handbook – Fundamentals

Luminaire Type	Return Type	Space Fraction	Radiative Fraction
Recessed fluorescent luminaires without lens	Plenum	0.69	0.58
Recessed fluorescent luminaires without lens	Return	0.74	0.68
Recessed fluorescent luminaire with lens	Plenum	0.45	0.67
Recessed fluorescent luminaire with lens	Return	0.50	0.73
Downlight compact fluorescent	Plenum	0.20	0.97
Downlight compact fluorescent	Ducted	0.20	0.97
Downlight incandescent	Plenum	0.75	0.97
Downlight incandescent	Ducted	0.75	0.97
Non-in-ceiling fluorescent	Plenum	1.0	0.54
Non-in-ceiling fluorescent	Ducted	1.0	0.54

In this table, the Space Fraction is the fraction of the lighting heat gain that goes to the space; the radiative fraction is the fraction of the heat gain to the space that is due to radiation, with the remaining heat gain to the space due to convection.

Power Adjustment Factors (PAF)

Applicability All projects

Definition Automatic controls that are not already required by the baseline standard and which reduce lighting power more or less uniformly over the day can be modeled as power adjustment factors. Power adjustment factors represent the percent reduction in lighting power that will approximate the effect of the control. Models account for such controls by multiplying the controlled watts by by (1 – PAF).

Eligible California power adjustment factors are defined in Table 140.6-A. Reduction in lighting power using the PAF method can be used only for non-residential controlled general lights. Only one PAF can be used for a qualifying lighting system unless additions are allowed in Table 140.6.A of the standards. Controls for which PAFs are eligible are listed in Table 140.6-A of the California energy efficiency standards and include:

- Occupancy Sensing Controls for qualifying enclosed spaces and open offices
- Demand Control – Demand responsive lighting control that reduces lighting power consumption in response to a demand response signal for qualifying building types.
- Manual and multiscene programmable dimming for qualifying area types.
- Manual Dimming plus multi-level occupancy sensor for qualifying area types.

Units	List: eligible control types (see above) linked to PAFs
Input Restrictions	PAF shall be fixed for a given control and area type
Standard Design	PAF is zero
Standard Design, Existing Buildings	PAF is zero

~~5.4.4~~5.4.5 Daylighting Control

This group of building descriptors is applicable for spaces that have daylighting controls or daylighting control requirements. Spaces that have daylighting should be defined separately from spaces that do not.

California prescribes a modified version of the split flux daylighting methods to be used for Compliance and Reach. This is an *internal daylighting method* because the calculations are automatically performed by the simulation engine. For top-lighted or sidelit daylighted areas, California Compliance prescribes an internal daylighting model consistent with the split flux algorithms used in many simulation programs. With this method the simulation model has the capability to model the daylighting contribution for each hour of the simulation and make an adjustment to the lighting power for each hour, taking into account factors such as daylighting availability, geometry of the space, daylighting aperture, control type and the lighting system. The assumption is that the geometry of the space, the reflectance of surfaces, the size and configuration of the daylight apertures, and the light transmission of the glazing are taken from other building descriptors.

Daylight Control Requirements

Applicability	All spaces with daylighting controls
Definition	The conditions that determine if daylighting has to be modeled in a space
Units	List
Input Restrictions	Primary Only, Primary and Secondary
	As designed
Standard Design	If the calculated general lighting power in the Secondary Daylight Zone is greater than 120 Watts, then the Standard design has *Primary and Secondary* daylight controls. Otherwise the daylight control is *Primary Only*.
Standard Design, Existing Buildings	When alterations include skylight replacement or addition and recirculation of existing general lighting system, the standard design will be same as new construction.

Skylit, Primary and Secondary Daylighted Area

Applicability	All daylighted spaces
Definition	The floor area that is daylighted. The skylit area is the portion of the floor area that gets daylighting from a skylight. Two types of sidellit daylighted areas are recognized. The primary daylighted area is the portion that is closest to the daylighting source and receives the most illumination. The secondary daylighted area is an area farther from the daylighting source, but still receives useful daylight. The primary daylight area for sidelighting is a band near the window with a depth equal to the distance from the floor to the top of the window and width equal to window width plus 0.5 times window head height wide on each side of the window opening. The

secondary daylight area for sidelighting is a band beyond the primary daylighted area that extends a distance double the distance from the floor to the top of the window and width equal to window width plus 0.5 times window head height wide on each side of the window opening. Area beyond a permanent obstruction taller than 6 feet should not be included in the primary and secondary daylight area calculation.

The skylit area is a band around the skylight well that has a depth equal to the 70% of the ceiling height from the edge of the skylight well. The geometry of the skylit daylit area will be the same as the geometry of the skylight. Area beyond a permanent obstruction taller than 50% of the height of the skylight from the floor should not be included in the skylit area calculation.

Double counting due to overlaps is not permitted. If there is an overlap between Secondary and Primary or Skylit areas, the effective daylit area used for determining Reference position shall be the area minus the overlap.

Units ft^2

Input Restrictions The daylit areas in a space is derived using other modeling inputs like dimensions of the fenestration and ceiling height of the space.

Standard Design The daylit areas in the baseline building is derived from other modeling inputs like dimensions of the fenestration and ceiling height of the space. Daylit area calculation in the standard design is done after Window to wall ratio and Skylight to roof ratio rules in Section 5.5.7 of this manual are applied.

Standard Design, Existing Buildings Same as new construction, when skylights are added or replaced and general lighting altered.

Installed General Lighting Power in the Primary and Skylit Daylit Zone

Applicability Daylighted spaces

Definition The installed lighting power of general lighting in the primary and skylit daylit zone. The primary and skylit daylit zone shall be defined on the plans and be consistent with the definition of the primary and skylit daylit zone in the Standards. Note that a separate building descriptor, Fraction of Controlled Lighting, defines the fraction of the lighting power in the daylit zone that is controlled by daylighting.

Units Watts

Input Restrictions As designed.

Standard Design The Installed lighting power for the standard design is the product of the primary daylit area and the lighting power density (LPD) for general lighting in the space.

Standard Design, Existing Buildings Same as new construction when skylights are added, replaced and general lights are altered.

Installed General Lighting Power in the Secondary Daylit Zone

Applicability Daylighted spaces

Definition The installed lighting power of general lighting in the secondary daylit zone. The secondary daylit zone shall be defined on the plans and be consistent with the definition of the secondary daylit zone in the Standards. Note that a separate building descriptor, Fraction of Controlled Lighting, defines the fraction of the lighting power in the daylit zone that is controlled by daylighting.

Units	Watts
Input Restrictions	As designed.
Standard Design	The Installed lighting power for the standard design is the product of the secondary daylit area and the lighting power density (LPD) for general lighting in the space.
Standard Design, Existing Buildings	Same as new construction when skylights are added, replaced and general lights are altered.

Reference Position for Illuminance Calculations

Applicability	Daylighted spaces
Definition	The position of the daylight reference point within the daylighted space. Lighting controls are simulated so that the illuminance at the reference position is always equal to or above the illuminance setpoint. Thus for step switching controls, the combined daylight illuminance plus uncontrolled electric light illuminance at the reference position must be greater than the setpoint illuminance before the controlled stage of lighting can be tuned off. Similarly, dimming controls will be dimmed so that the combination of the daylight illuminance plus the controlled lighting illuminance is equal to the setpoint illuminance. Reference point for primary and secondary daylit areas is located at the farthest end of the daylit area at the center of the window. For skylit area, the reference point is located at the center of the edge of the skylit area. Up to two reference positions can be defined in a space.
Units	Data structure
Input Restrictions	The following steps shall be followed for determining the reference positions.

1. Determine all non-overlapping daylit areas in a space. Double counting due to overlaps is not permitted. If there is an overlap between Secondary and Primary or Skylit areas, the effective daylit area used for determining Reference position shall be the area minus the overlap.
2. Locate Reference position 1 in daylit space in following order of priority-
    a. Skylit area
    b. Primary daylit area in the South
    c. Primary daylit area in the West
    d. Primary daylit area in the East
    e. Primary daylit area in the North
3. Determine if the space has Secondary Daylit area and automatic controls are installed in the Secondary daylit area. If no, locate Reference position 2 in the next primary daylit space type in the order of priority described in the step 2. If yes, locate Reference point 2 in secondary daylit space in following order of priority:
    a. Secondary daylit area in the South
    b. Secondary daylit area in the West
    c. Secondary daylit area in the East
    d. Secondary daylit area in the North

For non-cardinal direction facing areas, the following orientation logic can be used:

a. Windows facing between 315 degrees and 45 degrees -North
b. Windows facing between 135 degrees and 45 degrees- East
c. Windows facing between 135 degrees and 225 degrees – South
d. Windows facing between 315 degrees and 225 degrees – West.

Standard Design The following steps shall be followed for determining the reference positions.

1. Determine all non-overlapping daylit areas in a space. Double counting due to overlaps is not permitted. If there is an overlap between Secondary and Primary or Skylit areas, the effective daylit area used for determining Reference position shall be the area minus the overlap.
2. Locate Reference position 1 in daylit space in following order of priority-
    a. Skylit area
    b. Primary daylit area in the South
    c. Primary daylit area in the West
    d. Primary daylit area in the East
    e. Primary daylit area in the North
3. Determine if the space has Secondary Daylit area. If no, locate Reference position 2 in the next primary daylit space type in the order of priority described in the step 2. If yes, locate Reference point 2 in secondary daylit space in following order of priority:
    a. Secondary daylit area in the South
    b. Secondary daylit area in the West
    c. Secondary daylit area in the East
    d. Secondary daylit area in the North

For non-cardinal direction facing areas, the following orientation logic can be used:

a. Windows facing between 315 degrees and 45 degrees -North
b. Windows facing between 135 degrees and 45 degrees- East
c. Windows facing between 135 degrees and 225 degrees – South
d. Windows facing between 315 degrees and 225 degrees – West.

Standard Design, Existing Buildings Same as new construction, when skylights are added or replaced and general lighting altered

Daylight Illuminance Setpoint

Applicability Daylit spaces

Definition The design illuminance for the daylit space for purposes of daylighting control.

Units lux

Input Restrictions As designed

Standard Design The standard design illuminance setpoint is defined for each space type in Appendix 5.4A (in lux). The baseline daylight illuminance setpoint is the same as proposed design, unless a range is specified for the space type in Appendix 5.4A.

Where a range is defined in the Appendix, the standard design setpoint is:

1. If the proposed design illuminance setpoint is higher than the high point of the range in Appendix 5.4A, then the standard design setpoint is the high point of the range.
2. If the proposed design illuminance setpoint is within the range of illuminance setpoints specified in Appendix 5.4A, then the standard design setpoint is the same as the proposed.
3. If the proposed design illuminance setpoint is below the range of setpoints specified in Appendix 5.4A for the given space type, then the standard

design setpoint shall be same as proposed. In this case an Exceptional Condition may be reported on the compliance documentation.

Standard Design, Existing Buildings	Same as for new construction, when skylights are added, replaced and general lighting altered.

Illumination Adjustment Factor

Applicability	All daylighted spaces
Definition	Recent studies have shown that the split flux interreflection component model used in many simulation programs overestimates the energy savings due to daylighting, particularly deep in the space. A set of two adjustment factors is provided, one for the primary daylit zone and one for the secondary daylit zone. For simulation purposes, the input daylight illuminance setpoint will be modified by the Illuminance Adjustment factor as follows: $\text{LIGHT-SET-PT}_{adj}$ = LIGHT-SET-PT x Adjustment Factor
Units	unitless
Input Restrictions	As per prescribed values for space type in Appendix 5.4A Spaces with no furniture ; Fixed at the following values: Primary Daylit Zone:1.5 Secondary Daylit Zone:2.0 Spaces with furniture ; Primary Daylit Zone: 1.0 Secondary Daylit Zone: 4.0
Standard Design	The baseline building adjustment factors shall match the proposed.
Standard Design, Existing and Altered	Same as for new construction, when skylights are added, replaced and general light altered.

Fraction of Controlled Lighting

Applicability	Daylighted spaces
Definition	The fraction of the general lighting power in the daylighted space that is controlled by daylighting controls.
Units	Numeric: fraction
Input Restrictions	As designed for secondary daylit areas. If the proposed design has no daylight controls in the secondary daylit area the value is set to 0 for the general lights in the secondary daylit area. Primary and skylit daylit area fraction of controlled general lighting shall be 1.
Standard Design	Daylighting controls are required for skylighted and primary and secondary daylight areas. The fraction of controlled general lighting shall be 1.

Standard Design, Existing Buildings Same as new construction when skylights are added, replaced and general lights are altered.

Daylighting Control Type

Applicability Daylighted spaces.

Definition The type of control that is used to control the electric lighting in response to daylight available at the reference point. The options are:

.

- Step Dimming controls have discrete steps of light output but typically the intermediate steps of light output are associated with higher levels of fraction of rated power. When the lights are fully off or fully on, the fraction of rated power matches the fraction of light output. Stepped Controls vary the electric input power and lighting output power in discrete equally spaced steps. See Figure 9 – Example Stepped Daylight Control~~Figure 4 – Example Stepped Daylight Control~~.
- Continuous Dimming controls have a fraction to rated power to fraction of rated output that is a linear interpolation of the *minimum power fraction* at the *minimum diming light fraction* to rated power (power fraction = 1.0) at full light output. See Figure 10~~Figure 5~~.
- Continuous Dimming + Off controls are the same as continuous dimming controls except that these controls can turn all the way off when none of the controlled light output is needed. See Figure 10~~Figure 5~~.

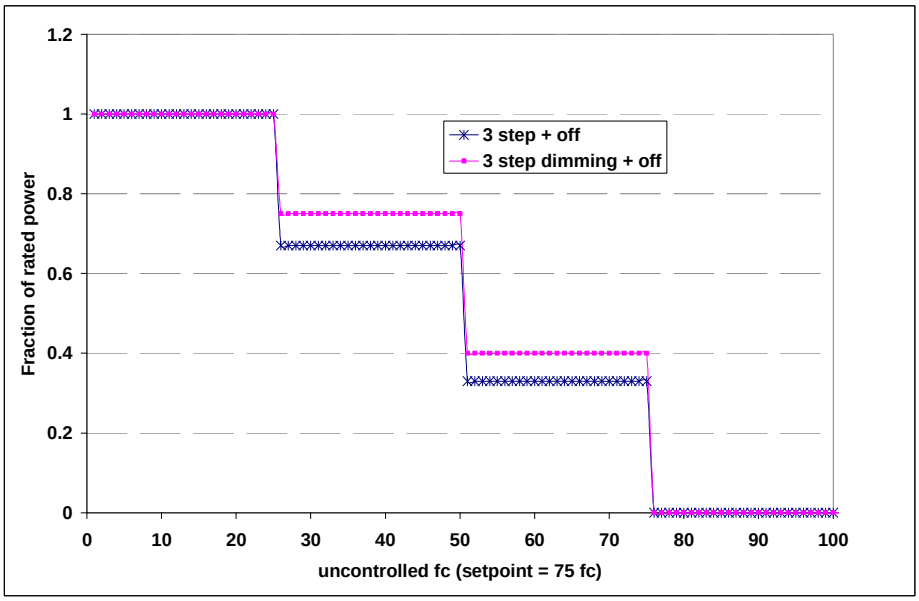

Figure 94 – Example Stepped Daylight Control

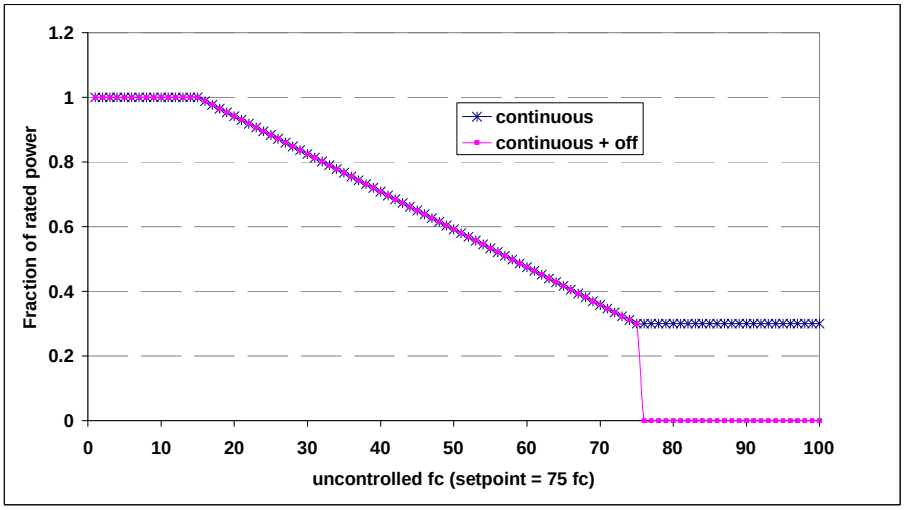

Figure 105 – Example Dimming Daylight Control

Units	List (see above)
Input Restrictions	As designed.
Standard Design	Continuous
Standard Design, Existing Buildings	Same as for new construction, when skylights are added, replaced and general lighting altered.

Minimum Dimming Power Fraction

Applicability	Daylit spaces
Definition	The minimum power fraction when controlled lighting is fully dimmed. Minimum power fraction = (Minimum power) / (Full rated power). See Figure 10~~Figure 5~~.
Units	Numeric: fraction
Input Restrictions	As designed
Standard Design	Baseline building uses continuous dimming control with a minimum dimming power fraction of : LED: 0.1 Linear Fluorescent: 0.2 CFL: 0.3 Metal Halide: TBD Where the Controlled Luminaire Type, input by the user, determines the Minimum Dimming Power Fraction .
Standard Design	

Same as for new construction, when skylights are added, replaced and general lighting altered
Existing Buildings

Minimum Dimming Light Fraction	
Applicability	Daylighted and dimming controls
Definition	Minimum light output of controlled lighting when fully dimmed. Minimum light fraction = (Minimum light output) / (Rated light output). See Figure 10~~Figure 5~~.
Units	Numeric: fraction
Input Restrictions	As designed
Standard Design	Baseline building uses continuous dimming control with a minimum dimming light fraction of : LED: TBD Linear Fluorescent: TBD CFL: TBD Metal Halide: TBD Where the Controlled Luminaire Type, input by the user, determines the Minimum Dimming Power Fraction
Standard Design, Existing Buildings	Same as for new construction, when skylights are added, replaced and general lighting altered

Number of Control Steps	
Applicability	Daylighted spaces that use stepped controls
Definition	Number of control steps~~.~~ For step dimming, identifies number of steps that require fraction of rated light output and rated power fraction.
Units	Numeric: integer
Input Restrictions	Integer 1 or 4 for primary and skylit daylit areas, as designed for secondary daylit areas .
Standard Design	Not applicable.
Standard Design, Existing Buildings	Same as for new construction, when skylights are added, replaced and general lighting altered

Controlled Luminaire Type	
Applicability	Daylit spaces
Definition	The predominant luminaire type in the daylit control zone. This is defined as the type of luminaire that has the most installed wattage in the daylit control zone. This input defines which dimming curve to use (from a lookup table)
Units	List (TBD) Metal halide Compact fluorescent Linear fluorescent LED

Input Restrictions	As designed
Standard Design	Same as proposed

~~5.4.5~~5.4.6 Receptacle Loads

Receptacle loads contribute to heat gains in spaces and directly use energy.

Receptacle Power	
Applicability	All building projects
Definition	Receptacle power is power for typical general service loads in the building. Receptacle power includes equipment loads normally served through electrical receptacles, such as office equipment and printers, but does not include either task lighting or equipment used for HVAC purposes. Receptacle power values are slightly higher than the largest hourly receptacle load that is actually modeled because the receptacle power values are modified by the receptacle schedule, which approaches but does not exceed 1.0. ~~Receptacle power is considered an unregulated load; no credit has been offered in the past for savings; identical conditions have been required for both the baseline building and the proposed design. Offering credit for receptacle loads is very difficult due to their temporal nature and because information is not always available on what equipment will go in the building. Tenants also have the ability to plug and unplug devices at their leisure or switch them out for different equipment, adding to the difficulty of assigning credit for promised energy efficiency.~~
Units	Total power (W) or the space or power density (W/ft²) Compliance software shall also use the following prescribed values to specify the latent heat gain fraction and the radiative/convective heat gain split. For software that specifies the fraction of the heat gain that is lost from the space, this fraction shall be prescribed at 0. Receptacle Power heat gain fractions: Radiative = 0.20, Latent = 0.00, Convective = 0.80 Gas Equipment Power Heat Gain Fractions: Radiative = 0.15, Latent = 0.20, Convective = 0.65
Input Restrictions	~~The receptacle power in the baseline building shall be the same as the proposed design.~~ ~~For California Compliance and California Reach,~~Prescribed to values from Appendix 5.4A ~~shall be used as a default value. If values other than those shown in Appendix 5.4A are used, this will be reported as a condition requiring an Exceptional Condition Review by a third party reviewer~~
Standard Design	Same as Proposed
Standard Design, Existing Buildings	Same as for new construction

Receptacle Schedule	
Applicability	All projects
Definition	Schedule for receptacle power loads used to adjust the intensity on an hourly basis to reflect time-dependent patterns of usage.
Units	Data structure: schedule, fraction
Input Restrictions	~~For compliance and Reach, t~~The schedule is prescribed in appendix 5.4A. ~~If values other than those shown in Appendix 5.4A are used, this will be reported as a condition requiring an Exceptional Condition Review by a third party reviewer.~~
Standard Design	Schedules for the baseline building shall be identical to the proposed design.
Standard Design, Existing Buildings	Same as for new construction

~~5.4.6~~5.4.7 Commercial Refrigeration Equipment

Commercial refrigeration equipment includes the following:

- Walk-in refrigerators
- Walk-in freezers
- Refrigerated casework

Walk-in refrigerators and freezers typically have remote condensers. Some refrigerated casework has remote condensers, while some have a self-contained condenser built into the unit. Refrigerated casework with built-in condensers rejects heat directly to the space while remote condensers reject heat in the remote location, typically on the roof or behind the building.

Refrigerated casework can be further classified by the purpose, the type of doors and, when there are no doors, the configuration: horizontal, vertical or semi-vertical. USDOE has developed standards for refrigerated casework. Table 10~~Table 9~~ shows these classifications along with the standard level of performance, expressed in kWh/d, which depends on the class of equipment, the total display area, and the volume of the casework.

Table 10~~9~~ – USDOE Requirements for Refrigerated Casework (kWh/d)

TABLE I–1—STANDARD LEVELS FOR COMMERCIAL REFRIGERATION EQUIPMENT

Equipment class[2]	Standard level*** (kWh/day)***	Equipment class	Standard level*** (kWh/day)
VOP.RC.M	0.82 × TDA + 4.07	VCT.RC.I	0.66 × TDA + 3.05
SVO.RC.M	0.83 × TDA + 3.18	HCT.RC.M	0.16 × TDA + 0.13
HZO.RC.M	0.35 × TDA + 2.88	HCT.RC.L	0.34 × TDA + 0.26
VOP.RC.L	2.27 × TDA + 6.85	HCT.RC.I	0.4 × TDA + 0.31
HZO.RC.L	0.57 × TDA + 6.88	VCS.RC.M	0.11 × V + 0.26
VCT.RC.M	0.22 × TDA + 1.95	VCS.RC.L	0.23 × V + 0.54
VCT.RC.L	0.56 × TDA + 2.61	VCS.RC.I	0.27 × V + 0.63
SOC.RC.M	0.51 × TDA + 0.11	HCS.RC.M	0.11 × V + 0.26
VOP.SC.M	1.74 × TDA + 4.71	HCS.RC.L	0.23 × V + 0.54
SVO.SC.M	1.73 × TDA + 4.59	HCS.RC.I	0.27 × V + 0.63
HZO.SC.M	0.77 × TDA + 5.55	SOC.RC.L	1.08 × TDA + 0.22
HZO.SC.L	1.92 × TDA + 7.08	SOC.RC.I	1.26 × TDA + 0.26
VCT.SC.I	0.67 × TDA + 3.29	VOP.SC.L	4.37 × TDA + 11.82
VCS.SC.I	0.38 × V + 0.88	VOP.SC.I	5.55 × TDA + 15.02
HCT.SC.I	0.56 × TDA + 0.43	SVO.SC.L	4.34 × TDA + 11.51
SVO.RC.L	2.27 × TDA + 6.85	SVO.SC.I	5.52 × TDA + 14.63
VOP.RC.I	2.89 × TDA + 8.7	HZO.SC.I	2.44 × TDA + 9.
SVO.RC.I	2.89 × TDA + 8.7	SOC.SC.I	1.76 × TDA + 0.36
HZO.RC.I	0.72 × TDA + 8.74	HCS.SC.I	0.38 × V + 0.88

*TDA is the total display area of the case, as measured in the Air-Conditioning and Refrigeration Institute (ARI) Standard 1200–2006, Appendix D.

**V is the volume of the case, as measured in ARI Standard 1200–2006, Appendix C.

***Kilowatt hours per day.

[2] For this rulemaking, equipment class designations consist of a combination (in sequential order separated by periods) of: (1) An equipment family code (VOP=vertical open, SVO=semivertical open, HZO=horizontal open, VCT=vertical transparent doors, VCS=vertical solid doors, HCT=horizontal transparent doors, HCS=horizontal solid doors, or SOC=service over counter); (2) an operating mode code (RC=remote condensing or SC=self contained); and (3) a rating temperature code (M=medium temperature (38 °F), L=low temperature (0 °F), or I=ice-cream temperature (– 15 °F)). For example, "VOP.RC.M" refers to the "vertical open, remote condensing, medium temperature" equipment class. See discussion in section V.A.2 and chapter 3 of the TSD, market and technology assessment, for a more detailed explanation of the equipment class terminology. See Table IV–2 for a list of the equipment classes by category.

Walk-in refrigerators and freezers are not covered by the USDOE standards and test procedures. Title-24 default values for these are given in Table 11~~Table 10~~. These values are expressed in W/ft² of refrigerator or freezer area. This power is assumed to occur continuously. Some walk-ins have glass display doors on one side so that products can be loaded from the back. Glass display doors increase the power requirements of walk-ins. Additional power is added when glass display doors are present. The total power for walk-in refrigerators and freezers is given in Equation (1).

$$P_{Walk-in} = \left(A_{Ref} \cdot PD_{Ref} + N_{Ref} \cdot D_{Ref}\right) + \left(A_{Frz} \cdot PD_{Frz} + N_{Frz} \cdot D_{Frz}\right) \quad (1)$$

Where

$P_{Walk-in}$ is the estimated power density for the walk-in refrigerator or freezer in (W)

A_{xxx} the area of the walk-in refrigerator or freezer (ft²)

N_{xxx} the number of glass display doors (unitless)

PD_{xxx} the power density of the walk-in refrigerator or freezer taken from Table 11~~Table 10~~ (W/ft²)

D_{xxx} the power associated with a glass display door for a walk-in refrigerator or freezer (W/door)

$_{xxx}$ subscript indicating a walk-in freezer or refrigerator (Ref or Frz)

Table 11~~10~~ – Default Power for Walk-In Refrigerators and Freezers (W/ft²)

Source: These values are determined using the procedures of the Heatcraft Engineering Manual, Commercial Refrigeration Cooling and Freezing Load Calculations and Reference Guide, August 2006. The EER is assumed to be 12.39 for refrigerators and 6.33 for Freezers. The specific efficiency is assumed to be 70 for refrigerators and 50 for freezers. Operating temperature is assumed to be 35 F for refrigerators and -10 F for freezers.

Floor Area	Refrigerator	Freezer
100 ft² or less	8.0	16.0
101 ft² to 250 ft²	6.0	12.0
251 ft² to 450 ft²	5.0	9.5
451 ft² to 650 ft²	4.5	8.0
651 ft² to 800 ft²	4.0	7.0
801 ft² to 1,000 ft²	3.5	6.5
More than 1,000 ft²	3.0	6.0
Additional Power for each Glass Display Door	105	325
Note:		

Refrigeration Modeling Method

Applicability All buildings that have commercial refrigeration for cold storage or display

Definition The method used to estimate refrigeration energy and to model the thermal interaction with the space where casework is located. Two methods are included in this manual:

- **Title 24 defaults**. With this method, the power density values provided in Appendix 5.4A[1] are used; schedules are assumed to be continuous operation.
- **USDOE performance ratings**. With this method, the energy modeler takes inventory of the refrigerated casework in the rated building and sums the rated energy use (typically in kWh/day). Walk-in refrigerators and freezers shall use the defaults from Equation (1) and the values from Table 11~~Table 10~~. All refrigeration equipment is then assumed to operate continuously.

The remaining building descriptors in this section apply to buildings that use either the Title-24 defaults or the USDOE performance ratings.

Units List (see above)

Input Restrictions For California Compliance, the *Title 24 defaults* shall be used. Otherwise, there are no input restrictions.

Standard Design Same as proposed

[1] See Table C-43, p. 146 of NREL/TP-550-41956, Methodology for Modeling Building Energy Performance across the Commercial Sector, Technical Report, Appendix C, March 2008. The values in this report were taken from Table 8-3 of the California Commercial End-Use Survey, Consultants Report, March 2006, CEC-400-2006-005

Standard Design, Existing Buildings	Same as for new construction

Refrigeration Power

Applicability	All buildings or spaces that have commercial refrigeration for cold storage or display.
Definition	Commercial refrigeration power is the average power for all commercial refrigeration equipment, assuming constant year-round operation. Equipment includes walk-in refrigerators and freezers, open refrigerated casework, and closed refrigerated casework. It does not include residential type refrigerators used in kitchenettes or refrigerated vending machines. These are covered under *receptacle power*.
Units	W/ft^2
Input Restrictions	With the *Title 24 defaults* method, the values in Appendix 5.4A are prescribed. These values are multiplied times the floor area of the rated building to estimate the refrigeration power. With the *USDOE performance ratings* method, refrigeration power is estimated by summing the kWh/day for all the refrigeration equipment in the space and dividing by 24 hours. The refrigeration power for walk-in refrigerators and freezers is added to this value.
Standard Design	Refrigeration power is the same as the proposed design when the Title 24 defaults are used. When the *USDOE performance ratings* method is used, refrigeration power for casework shall be determined from Table 10~~Table 9~~; the power for walk-in refrigerators and freezers shall be the same as the proposed design.
Standard Design, Existing Buildings	Same as for new construction

Remote Condenser Fraction

Applicability	All buildings that have commercial refrigeration for cold storage or display and use the *Title 24 defaults* or *USDOE performance ratings* methods
Definition	The fraction of condenser heat that is rejected to the outdoors. For self-contained refrigeration casework, this value will be zero. For remote condenser systems, this value is 1.0. For combination systems, the value should be weighted according refrigeration capacity. For refrigeration with self-contained condensers and compressors, the heat that is removed from the space is equal to the heat that is rejected to the space, since the evaporator and condenser are both located in the same space. There may be some latent cooling associated with operation of the equipment, but this may be ignored with the *Title 24 defaults* or *USDOE performance ratings* methods. The operation of self-contained refrigeration units may be approximated by adding a continuously operating electric load to the space that is equal to the energy consumption of the refrigeration units. Self-contained refrigeration units add heat to the space that must be removed by the HVAC system. When the condenser is remotely located, heat is removed from the space but rejected outdoors. In this case, the refrigeration equipment functions in a manner similar to a continuously running split system air conditioner. Some heat is added to the space for the evaporator fan, the anti-fog heaters and other auxiliary energy uses, but refrigeration systems with remote condensers remove more heat from the space where they are located than they add. The HVAC system must compensate for this imbalance.

For remotely located condensers using the *Title 24 defaults* or *USDOE performance ratings* methods, the heat that is removed from the space is determined as follows:

$$Q = \left[(1 - F) \times kW - (F \times kW \times COP)\right] \times 3.413 \quad (2)$$

Where

Q	The rate of heat removal from the space due to the continuous operation of the refrigeration system (kBtu/h). A negative number means that heat is being removed from the space; a positive number means that heat is being added.
kW	The power of the refrigeration system determined by using the *Title 24 defaults* or the *USDOE performance ratings* method (kW)
F	The remote condenser fraction (see building descriptor below) (unitless)
COP	The coefficient of performance of the refrigeration system (unitless)

The simple approach outlined above assumes that there is no latent cooling associated with the refrigeration system. The heat addition or removal resulting from the above equation can be modeled in a number of ways, to accommodate the variety of calculation engines available. It can be scheduled if the engine can accommodate a heat removal schedule. It can be modeled as a separate, constantly running air conditioner, if the engine can accommodate two cooling systems serving the same thermal zone. Other modeling techniques are acceptable as long as they are thermodynamically equivalent.

Units	Fraction
Input Restrictions	None
Standard Design	Same as the proposed design
Standard Design, Existing Buildings	Same as for new construction

Refrigeration COP

Applicability	All buildings that have commercial refrigeration for cold storage or display and use the *Title 24 defaults* or *USDOE performance ratings* methods
Definition	

	The coefficient of performance of the refrigeration system. This is used only to determine the heat removed or added to the space, not to determine the refrigeration power or energy.
Units	Fraction
Input Restrictions	This value is prescribed to be 3.6 for refrigerators and 1.8 for freezers.[2]
Standard Design	Same as the proposed design
Standard Design, Existing Buildings	Same as for new construction

Refrigeration Schedule	
Applicability	All buildings that have commercial refrigeration for cold storage or display
Definition	The schedule of operation for commercial refrigeration equipment. This is used to convert refrigeration power to energy use.
Units	Data structure: schedule, fractional
Input Restrictions	Continuous operation is prescribed.
Standard Design	Same as the proposed design
Standard Design, Existing Buildings	Same as for new construction

~~5.4.7~~5.4.8 Elevators, Escalators and Moving Walkways

Elevators, escalators and moving walkways account for 3% to 5% of electric energy use in buildings.[3] Buildings up to about five to seven stories typically use hydraulic elevators because of their lower initial cost. Mid-rise buildings commonly use traction elevators with geared motors, while high-rise buildings typically use gearless systems where the motor directly drives the sheave. The energy using components include the motors and controls as well as the lighting and ventilation systems for the cabs.

Elevators are custom designed for each building. In this respect they are less like products than they are engineered systems, e.g. they are more akin to chilled water plants where the engineer chooses a chiller, a tower, pumping and other components which are field engineered into a system. The main design criteria are safety and service. Some manufacturers have focused on energy efficiency of late and

[2] These values are consistent with the assumptions for the default values for walk-ins, which assume an EER of 12.39 for refrigerators and 6.33 for freezers.

[3] Sachs, Harvey M., Opportunities for Elevator Energy Efficiency Improvements, American Council for an Energy Efficiency Economy, April 2005

introduced technologies such as advanced controls that optimize the position of cars for minimum travel and regeneration motors that become generators when a loaded car descends or an empty car rises. These technologies can result in 35% to 40% savings.[4]

The motors and energy using equipment is typically located within the building envelope so it produces heat that must be removed by ventilation or by air conditioning systems. In energy models, a dedicated thermal zone (elevator shaft) will typically be created and this space can be indirectly cooled (from adjacent spaces) or positively cooled.

Little information is known on how to model elevators. As engineered systems, the model would need information on the number of starts per day, the number of floors, motor and drive characteristics, and other factors. Some work has been done to develop and categorize energy models for elevators;[5] however a simple procedure is recommended based on a count of the number of elevators, escalators and moving walkways in the building. This data is shown in Table 12~~Table 11~~.[6]

Table 12~~11~~ – Unit Energy Consumption Data for Elevators, Escalators and Moving Walkways[7]

	Elevators		Escalators and Moving Walkways	
Mode	Power (W)	Annual Hours	Power (W)	Annual Hours
Active	10,000	300	4,671	4,380
Ready	500	7,365	n.a.	0
Standby	250	1,095	n.a.	0
Off	0	0	0	4,380
Typical Annual Energy Use	7,000 kWh/y		20,500 kWh/y	

Elevator/Escalator Power

Applicability All buildings that have commercial elevators, escalator, or moving walkways

Definition The power for elevators, escalators and moving walkways for different modes of operation. Elevators typically operate in three modes: active (when the car is moving passengers), ready (when the lighting and ventilation systems are active but the car is not moving), and standby (when the lights and ventilation systems are off). Escalators and moving walkways are either active or turned off.

Units

[4] Ibid.

[5] Al-Sharif, Lutfi, Richard Peters and Rory Smith, Elevator Energy Simulation Model, Elevator World, November 2005, Volume LII, No11

[6] TIAX, Commercial and Residential Sector Miscellaneous Electricity consumption: Y20005 and Projections to 2030, Final Report to the U.S. Department of Energy's Energy Information Administration (EIA) and Decision Analysis Corporation (DAC), September 22, 2006, Reference Number D0366.

[7] The TIAX report does not give energy consumption data for moving walkways. For the purposes of this manual, it is assumed to be equal to escalators.

	W/unit
Input Restrictions	The power values from Table 12~~Table 11~~ for different modes of operation are prescribed for the proposed design.
Standard Design	Same as the proposed design
Standard Design, Existing Buildings	Not applicable

Elevator/Escalator Schedule	
Applicability	All buildings that have commercial elevators, escalator, or moving walkways
Definition	The schedule of operation for elevators, escalators, and moving walkways. This is used to convert elevator/escalator power to energy use.
Units	Data structure: schedule, state
Input Restrictions Standard Design	The operating schedule is prescribed for California Compliance and Reach. For California Compliance, an appropriate schedule from Appendix 5.4B shall be used. If values other than those shown in Appendix 5.4B are used, this will be reported as a condition requiring an Exceptional Condition Review by a third party reviewer
Standard Design	Same as the proposed design
Standard Design, Existing Buildings	Not applicable

~~5.4.8~~5.4.9 Process, Gas

Commercial gas equipment includes the following:

- Ovens
- Fryers
- Grills
- Other equipment

The majority of gas equipment is located in the space and may contribute both sensible and latent heat. Gas equipment is typically modeled by specifying the rate of peak gas consumption and modifying this with a fractional schedule. Energy consumption data for gas equipment is only beginning to emerge.

Because of these limits, the procedure for commercial gas is limited. The procedure consists of prescribed power and energy values for use with both the proposed design and the baseline building. No credit for commercial gas energy efficiency features is offered.

The prescribed values are provided in Appendix 5.4A. Schedules are defaulted to be continuous operation.

Gas Equipment Power	
Applicability	All buildings that have commercial gas equipment
Definition	Commercial gas power is the average power for all commercial gas equipment, assuming constant year-round operation.

Units	Btu/h-ft²
	Compliance software shall also use the following prescribed values to specify the latent heat gain fraction and the radiative/convective heat gain split.
	For software that specifies the fraction of the heat gain that is lost from the space, this fraction shall be prescribed at 0.
	Gas Equipment Power Heat Gain Fractions:
	Radiative = 0.15, Latent = 0.20, Convective = 0.65
Input Restrictions	The values in Appendix 5.4A are prescribed.
Standard Design	Same as the proposed design
Standard Design, Existing Buildings	Not applicable

Gas Equipment Schedule	
Applicability	All buildings that have commercial gas equipment
Definition	The schedule of operation for commercial gas equipment. This is used to convert gas power to energy use.
Units	Data structure: schedule, fractional
Input Restrictions	Continuous operation is prescribed.
Standard Design	Same as the proposed design
Standard Design, Existing Buildings	Not applicable

Gas Equipment Location	
Applicability	All buildings that have commercial gas equipment
Definition	The assumed location of the gas equipment for modeling purposes. Choices are in the space or external.
Units	List (see above)
Input Restrictions	As designed.
Standard Design	Same as the proposed design
Standard Design, Existing Buildings	Not applicable

Radiation Factor	
Applicability	Gas appliances located in the space
Definition	The fraction of heat gain to appliance energy use
Units	Fraction
Input Restrictions	Default value is 0.15. Other values can be used when a detailed inventory of equipment is known. The override value shall be based on data in Table 5C, Chapter 18, ASHRAE HOF, 2009, or similar tested information from the manufacturer.
Standard Design	Same as the proposed design

Standard Design, Existing Buildings	Not applicable

Usage Factor	
Applicability	Gas appliances located in the space
Definition	A duty cycle or usage factor to appliance energy use The radiation factor and usage factor are used together to determine the sensible heat gain to the space: Qsens = Qinput x F_U x F_R Where Qinput is the heat input of the equipment in Btu/h or Btu/h-ft2, F_U is the usage factor and F_R is the radiation factor
Units	Fraction
Input Restrictions	Default value is 0.70. Other values can be used when a detailed inventory of equipment is known. The override value shall be based on data in Table 5C, Chapter 18, ASHRAE HOF, 2009, or similar tested information from the manufacturer.
Standard Design	Same as the proposed design
Standard Design, Existing Buildings	Not applicable

Gas Process Loads	
Applicability	Spaces with process loads
Definition	Process load is the gas energy consumption in the conditioned space of a building resulting from an activity or treatment not related to the space conditioning, lighting, service water heating, or ventilating of a building as it relates to human occupancy. Process load may include sensible and/or latent components Compliance software shall model and simulate process loads only if the amount of the process energy and the location and type of process equipment are specified in the construction documents. This information shall correspond to specific special equipment shown on the building plans and detailed in the specifications. The compliance software Compliance Documentation shall inform the user that the compliance software will output process loads including the types of process equipment and locations on the compliance forms.
Units	Data structure: sensible (Btu/h), latent (Btu/h)
Input Restrictions	Compliance software shall receive input for Sensible and/or Latent Process Load for each zone in the proposed design. The process load input shall include the amount of the process load (Btu/h-ft^2) and the ~~HVAC~~ thermal zone where the process equipment is located. The modeled information shall be consistent with the plans and specifications of the building.
Standard Design	The standard design shall use the same gas process loads and sensible and latent contribution and radiative/convective split for each zone as the proposed design.
Standard Design, Existing Buildings	Same as for new construction

Electric Process Loads	
Applicability	Spaces with electric process loads
Definition	Process load is the electrical energy consumption in the conditioned space of a building resulting from an activity or treatment not related to the space conditioning, lighting, service water heating, or ventilating of a building as it relates to human occupancy. Data centers loads including transformers, UPS, PDU, server fans and power supplies are considered receptacle loads, not process loads, and the equipment schedules are given in Appendix 5.4B. Compliance software shall model and simulate process loads only if the amount of the process energy and the location and type of process equipment are specified in the construction documents. This information shall correspond to specific special equipment shown on the building plans and detailed in the specifications. The compliance software Compliance Documentation shall inform the user that the compliance software will output process loads including the types of process equipment and locations on the compliance forms.
Units	Data structure: load (kW) For electric process loads, the radiative fraction shall be defaulted to 0.2 and the convective fraction shall be defaulted to 0.8 by the compliance software. The user may enter other values for the radiative/convective split, but the compliance software shall verify that the values add to 1.
Input Restrictions	Compliance software shall receive input for Sensible and/or Latent Process Load for each zone in the proposed design. The process load input shall include the amount of the process load (Btu/h-ft^2) and the ~~HVAC~~ thermal zone where the process equipment is located. The modeled information shall be consistent with the plans and specifications of the building.
Standard Design	The standard design shall use the same process loads and radiative/convective split for each zone as the proposed design.
Standard Design, Existing Buildings	Same as for new construction

Gas Process Load Schedule	
Applicability	All buildings that have commercial gas equipment
Definition	The schedule of operation process load. This is used to convert gas power to energy use.
Units	Data structure: schedule, fractional
Input Restrictions	As designed.
Standard Design	Same as the proposed design
Standard Design, Existing Buildings	Not applicable

Electric Process Load Schedule	
Applicability	All buildings that have commercial gas equipment
Definition	The schedule of operation process load. This is used to convert gas power to energy use.
Units	Data structure: schedule, fractional
Input Restrictions	As designed.
Standard Design	Same as the proposed design
Standard Design, Existing Buildings	Not

5.5 Building Envelope Data

5.5.1 Materials

Energy simulation programs commonly define construction assemblies by listing a sequence of material layers that make up the construction assembly. Typical construction assemblies and their respective material layers are defined in Reference Appendix JA4. Additionally, the properties of the each material layer can be found in ACM Appendix 5.5A.

Material Name	
Applicability	When construction assemblies reference materials that are not standard
Definition	The name of a construction material used in the exterior envelope of the building
Units	Text: unique
Input Restrictions	Material name is a required input for materials not available from the standard list in ACM Appendix 5.5A. The user may not modify entries for predefined materials.
Standard Design	Not applicable

Density	
Applicability	All non-standard materials
Definition	The density (or mass per unit of volume) of the construction material as documented in an ASHRAE handbook, a comparably reliable reference, or manufacturers' literature.
Units	lb/ft^3
Input Restrictions	Density is a required input when non-standard materials are specified.
Standard Design	Not applicable

Specific Heat	
Applicability	All non-standard materials
Definition	The specific heat capacity of a material is numerically equal to the quantity of heat that must be supplied to a unit mass of the material to increase its temperature by 1 °F
Units	Btu/lb·°F

Input Restrictions	Specific heat is a required input when non-standard materials are specified. The specific heat capacity of the construction material as documented in an ASHRAE handbook, a comparably reliable reference, or manufacturers' literature.
Standard Design	Not applicable

Thermal Conductivity

Applicability	All non-standard materials
Definition	The thermal conductivity of a material of unit thickness is numerically equal to the quantity of heat that will flow through a unit area of the material when the temperature difference through the material is 1 °F.
Units	Btu/h·ft·°F
Input Restrictions	Thermal conductivity is a required input for non-standard materials.
Standard Design	Not applicable

Thickness

Applicability	All non-standard materials
Definition	The thickness of a material
Units	ft or in.
Input Restrictions	Thickness is a required input for non-standard materials. The user shall document the data source for thermal conductivity used for additional materials under the *material name* descriptor.
Standard Design	Not applicable

Solar Reflectance

Applicability	All opaque exterior surfaces exposed to ambient conditions
Definition	The solar reflectance of a material. For roofing materials, the 3-year aged reflectance value from CRRC testing should be used if available.
Units	Unitless fraction between 0 and 1
Input Restrictions	For walls and other non-roof surfaces: The value is prescribed to be 0.3. For roofs that are part of new construction, if asphalt shingles or composition shingles are not rated by the Cool Roof Rating Council (CRRC), the default aged solar reflectance shall be equal to 0.08 for asphalt roofs and 0.10 for all other roof types . The default value may be overridden when roof materials are used that have been tested by the (CRRC) and are called for in the construction documents. In cases where the default value is overridden, the user is required to submit documentation identifying the test procedure that was used to establish the non-default values. If the aged CRRC reflectance is not known, the aged CRRC reflectance may be calculated from the initial CRRC reflectance using the following equation: $\rho_{aged} = 0.2 + \beta \cdot (\rho_{init} - 0.2)$ Where, ρ_{aged} = the calculated aged reflectance

β = 0.65 for field-applied coatings, 0.7 for all other roof surfaces

ρ_{nit} = the initial CRRC reflectance

Standard Design For walls and other non-roof surfaces: Same as the proposed.

For new construction, the standard design reflectance shall meet the requirements stated in Section 140.3 of the Standards.

For alterations to more than 50% of the roof area or roof areas above 2,000 ft^2 the standard design shall be modeled as the more efficient of either the existing conditions or the values required for cool roofs under Section 141.0 of the Standards.

Thermal Emittance

Applicability All opaque exterior surfaces exposed to ambient conditions; this is prescribed for exterior walls at 0.85 and is the as-designed value entered for roofs, with some restrictions.

Definition The thermal emittance of a material. For roofing materials, the 3-year aged emittance value from CRRC testing should be used if available.

Units Unitless fraction between 0 and 1

Input Restrictions For walls and other non-roof surfaces: The value is prescribed to be 0.9.

For roofs, new construction: as designed, from CRRC values. If CRRC rating information is not available, the default thermal emittance shall be 0.75.

. In cases where the default value is overridden, the user is required to submit documentation identifying the test procedure that was used to establish the non-default values.

Standard Design For walls and other non-roof surfaces, the thermal emittance is 0.90.

For roofs, new construction, the standard design thermal emittance shall be 0.85.

For alterations to more than 50% of the roof area or roof areas above 2,000 ft^2 the standard design shall be modeled as the more efficient of either the existing conditions or a thermal emittance of 0.85.

SPECIAL NOTE: A SIMPLIFIED VERSION OF THE COMPLIANCE SOFTWARE WILL BE DEVELOPED TO BE USED FOR ENVELOPE TRADEOFFS, AND FOR ROOF ALTERATIONS IN PARTICULAR. THIS OPTION WILL CONSTRAIN ALMOST ALL INPUTS NOT RELATED TO ROOF PERFORMANCE AND WILL PROVIDE A WAY TO DETERMINE INSULATION TRADEOFFS ALLOWED WITH ROOF REFLECTANCE.

5.5.2 Construction Assemblies

For California Compliance and Reach, construction assemblies for the proposed design shall be created by selecting from a library of building construction layers in ACM Appendix 5.5A. The compliance software shall all specify composite layers that consist of both framing and insulation and shall use established methods defined in the ASHRAE Handbook of Fundamentals for calculating effective R-values of composite layers. **Geometry**

The geometry of roofs, walls, floors, doors and fenestration should match the construction documents or as-built drawings as accurately as possible. Unusual curved surfaces such as a dome or semi-circular wall may be approximated by a series of constructions.

Mass Walls

For mass walls, the user first chooses the mass layer from Appendix 5.5A. After that, the user may select an insulating layer from Appendix 5.5A for outside and/or inside the mass wall. **Ballasted Roofs, Vegetated Roofs, Concrete Pavers, and Other Mass Roofs**

An additional layer may be added to the roof construction assembly when thermal mass is used above the roof membrane. This exception is intended to allow ballasted roofs, concrete pavers and other massive elements to be explicitly modeled. To qualify, the weight of the stone ballast, the concrete pavers or other elements must exceed 15 lb/ft². The thickness, heat capacity, conductance and density of the additional mass layer shall be based on the measured physical properties of the material. If the surface properties of the additional mass material have been verified through the Cool Roof Rating Council (CRRC), the CRRC reported properties may be used for the proposed design; otherwise, the mass layer shall be modeled with an aged reflectance of 0.10 and an emittance of 0.85.

Assembly Name

Applicability	All projects
Definition	The name of a construction assembly that describes a roof, wall, or floor assembly. The name generally needs to be unique so it can be referenced precisely by surfaces.
Units	Text: unique
Input Restrictions	Construction name is a required input.
Standard Design	Not applicable

Specification Method

Applicability	All projects
Definition	The method of describing a construction assembly. The more simple method is to describe the U-factor of the construction assembly which can account for thermal bridging and other factors. However with this method, the time delay of heat transfer through the construction assembly is not accounted for. Generally, with the U-factor method, heat transfer is assumed to occur instantly. The more complex method is to describe the construction assembly as a series of layers, each layer representing a material. With this method, heat transfer is delayed in accord with the thermal mass and other properties of the assembly. For below-grade constructions, a C-factor can be specified; for slab-on-grade constructions, an F-factor is specified.
Units	List: layers, U-factor, C-factor, F-factor
Input Restrictions	The layers method shall be used for all constructions except for metal building or similar constructions with negligible thermal mass.
Standard Design	For each construction, the proposed design specification method shall be used.

Layers

Applicability	All construction assemblies that use the layers method of specification
Definition	A structured list of material names that describe a construction assembly, beginning with the exterior finish and progressing through the assembly to the interior finish. Material names must be from ACM Appendix 5.5A.

Units	List: layers of construction assembly
Input Restrictions	The user is required to describe all layers in the actual assembly and model the proposed design based the layer descriptions.
Standard Design	See building descriptors for Roofs, Exterior Walls, Exterior Floors, Doors, Fenestration and Below Grade Walls.

5.5.3 Roofs

Roof Name	
Applicability	All roof surfaces
Definition	A unique name or code that identifies the roof and ties it to the construction documents submitted for energy code review. It is not mandatory to name roofs.
Units	Text: unique
Input Restrictions	None
Standard Design	None

Roof Type	
Applicability	All roof surfaces
Definition	A roof classification defined in the Standards. This descriptor can be derived from other building descriptors and it may not be necessary for the software user to specify it directly.
Units	List: metal building, wood framed or other
Input Restrictions	Not applicable for new construction; as designed for existing buildings
Standard Design	~~m~~Metal building~~ (insulation entirely above deck)~~.
Standard Design, Existing Buildings	For existing buildings, the standard design roof type is the same as that for the proposed design.

Roof Geometry	
Applicability	All roofs, required input
Definition	Roof geometry defines the position, orientation, azimuth, tilt, and dimensions of the roof surface. The details of how the coordinate system is implemented may vary between software programs. The data structure for surfaces is described in the reference section of this chapter.
Units	Data structure: surface
Input Restrictions	There are no restrictions other than that the surfaces defined must agree with the building being modeled, as represented on the construction drawings or as-built drawings.
Standard Design	Roof geometry will be identical in the proposed and standard design building designs. For alterations, roof geometry will be fixed, based on one of the building prototypes (office, retail, etc.)

Roof Construction

Applicability All roofs, required input

Definition A specification containing a series of layers that result in a construction assembly for the proposed design. The first layer in the series represents the outside (or exterior) layer and the last layer represents the inside (or interior) layer. See the building descriptors above for roof construction type.

Units List: layers

Input Restrictions The construction assembly, defined by a series of layers, must be equal to or more efficient than the mandatory U-factor requirements of Section 120.7 of the Standards for new construction, and Section 141.0 of the Standards for alterations. Note that these U-Factor requirements assume an exterior air film of R-0.17 and an interior air film of R-0.61. Each layer specified must be listed in the materials database in the ACM Appendix 5.5A.

New Construction

Metal Building	U – 0.098
Wood Framed and Others	U – 0.075

Additions and Alterations

Roof / Ceiling Insulation	See 141.0(b)2Biii of the Standards

Appropriate R-values for insulation can be calculated using the formula below.

$R_{insulation}$ = (1/U-factor) – $R_{layer(1)}$ – $R_{layer(2)}$ – $R_{layer(3)}$ – $R_{layer(n)}$

$R_{insulation}$ = $R_{ins.continuous}$ + $R_{ins.framing}$

Standard Design For new construction, the standard design roof type is ***metal ~~framed~~building***. The U-factor required for roof construction is defined in Table 140.3-B, C or D of the Standards. Programs that model a U-factor shall ~~use~~ include an exterior~~outside~~ and ~~air film resistance and an~~ interior~~inside~~ air film resistance. The Standard Design construction is based on JA4-10 Table 4.2.7 and assumes an exterior air film of R-0.17 and an interior air film of R-0.~~62~~61~~, respectively~~.

For ***metal building*** roofs, the standard design construction shall include the following layers:

~~Outside Air Film~~		~~R - 0.17~~
~~Roof Gravel or Slag (1.0 in.)~~		~~R - 0.10~~
Layer 1	Metal Standing Seam 1/16 in.	R - 0.00
Layer 2	Continuous Insulation ~~Entirely Above Deck~~	R ~~ins~~ Based on Climate Zone ~~ulation~~
Layer 3	Open Framing + No Insulation	R – 0.00
~~Plywood (1/2 in.)~~		~~R - 0.63~~
~~Metal Deck~~		~~R - 0.00~~
~~Metal Framing~~		~~R - 0.00~~

~~Air Layer (4 in. or more) R - 0.92~~

~~Acoustic Tile (3/4 in.) R - 1.89~~

~~Inside Air Film R - 0.62~~

The ~~R-value of~~ value of the Continuous Insulation layer e~~E~~ntirely a~~A~~bove framing ~~Deck~~ shall be set to achieve the following R-values~~U-factors~~:

Nonresidential Buildings – Continuous Ins.

Climate Zones ~~2, 3, 4, 9~~1 - 16~~:~~ R – ~~U=~~14.60~~0.039~~

~~Climate Zones 1, 5: U=0.049~~

~~Climate Zones 7, 8: U=0.067~~

~~Climate Zones 6: U=0.075~~

High-Rise Residential Buildings and Hotel / Motel Guestrooms – Continuous Ins.

Climate Zones 1 ~~2,4,8~~- 16~~:~~ R – 14.60

For alterations, any approved roof type may be used. The U-factor in the standard design shall be modeled as the more efficient of either the existing conditions or the values stated in Section 141.0 of the Standards. Where applicable, selection shall be based on building type, assembly, and climate zone. A construction of layers shall be defined to yield an equivalent U-factor.~~U=0.028~~

~~Climate Zone 1: U=0.034~~

~~Climate Zone 3, 5-7: U=0.039~~

Standard Design, Existing Buildings

For existing buildings, if the roof component is not altered, the standard design roof construction shall match the proposed design roof construction of the existing building. If the roof is altered, the roof component shall meet the prescriptive requirements for new construction for the roof type of the existing building.

The roof type of the existing building is either a metal building roof or a wood-framed or other roof. The standard design roof assemblies for altered roofs are shown below for the appropriate climate zones.

The Reference Appendix JA4 reference and U-factor are provided for reference only. The U-factor does not need to exactly match the JA4 value, but the layer shall match the layer described below.

Alterations Roof Standard Design

Nonres	CZ 1,3-9	CZ 2,10-16
HRR	n/a	All Climate Zones
JA4 U-factor*	0.082	0.055
Roof Type	Wood-framed roof	Wood-framed roof
Layer 1	2x8, 24" o.c., No Insulation JA4 4.2.2-F25	2x8, 24" o.c., No Insulation JA4 4.2.2-H25

Layer 2	R-8 continuous insulation	R-14 continuous insulation

***U-factor and JA4 assembly table and cell reference is provided for reference only. The compliance software shall only require that the layers in the construction match those in this table.**

~~For alterations, any approved roof type may be used. The U-factor in the standard design shall be modeled as the more efficient of either the existing conditions or the values stated in Section 141.0 of the Standards. Where applicable, selection shall be based on building type, assembly, and climate zone. A construction of layers shall be defined to yield an equivalent U-factor.~~

.

5.5.4 Exterior Walls

Wall Name	
Applicability	All walls, optional input
Definition	A unique name or code that relates the exterior wall to the design documents. This is an optional input since there are other acceptable ways to key surfaces to the construction documents.
Units	Text: unique
Input Restrictions	None
Standard Design	None

Wall Type	
Applicability	All wall surfaces, optional
Definition	One of four categories of above-grade wall assemblies used to determine minimum insulation requirements for walls. The ~~four~~ five wall type categories are as follows: a) ~~Medium Mass walls~~Mass Light, b) ~~Heavy Mass Walls~~Mass Heavy c) Metal building ~~walls~~, c) Metal framing ~~walls~~, and Wood framing and other walls. A ~~medium mass~~Mass Light wall is defined as a wall with total heat capacity greater than 7 but less than 15 Btu/ft^2-F. A Mass Heavy wall is defined as a wall with a total heat capacity of 15 Btu/ft^2-F or greater. (Heat capacity is defined as the product of the specific heat in Btu/lb -F, the thickness in ft, and the density in lb/ft^3.)
Units	List: mass ~~walls~~light, mass heavy, metal building walls, metal framing walls, and wood framing and other walls
Input Restrictions	This input is required for existing buildings when any wall is altered. This input is not required for new construction.
Standard Design	All walls in the standard design building are modeled as “metal framed.”

Standard Design, Existing Buildings	The existing building standard design Wall Type shall be the same as the proposed.

Wall Geometry	
Applicability	All walls, required input
Definition	Wall geometry defines the position, orientation, azimuth, and tilt of the wall surface. The details of how the coordinate system is implemented may vary between simulation engines. The data structure for surfaces is described in the reference section of this chapter.
Units	Data structure: surface
Input Restrictions	As designed
Standard Design	Wall geometry in the standard design building is identical to the proposed design.

Wall Construction	
Applicability	All walls that use the Layers method
Definition	A specification containing a series of layers that result in a construction assembly for the proposed design. The first layer in the series represents the outside (or exterior) layer and the last layer represents the inside (or interior) layer. See the building descriptors above for wall construction type.
Units	List: Layers
Input Restrictions	The construction assembly, defined by a series of layers, must be equal to or more efficient than the mandatory U-factor requirements of Section 120.7 of the Standards for new construction. Note that these U-Factor requirements assume an exterior air film of R-0.17 and an interior air film of R-0.68. Each layer specified, with the exception of composite layers, must be listed in the materials database in the ACM Appendix 5.5A.

New Construction

Metal Building	U – 0.113
Metal Framed	U – 0.105
Light Mass Walls	U – 0.440
Heavy Mass Walls	U – 0.690
Wood Framed and Others	U – 0.110
Spandrel Panels / Glass Curtain Walls	U – 0.280

Additions and Alterations

Metal Building	U – 0.113
Metal Framed	U – 0.217
Wood Framed and Others	U – 0.110
Spandrel Panels / Glass Curtain Walls	U – 0.280

Formatte

Formatte

Appropriate R-values for insulation can be calculated using the formula below.

$R_{insulation} = (1/U\text{-factor}) - R_{layer(1)} - R_{layer(2)} - R_{layer(3)} - R_{layer(n)}$

$R_{insulation} = R_{ins.continuous} + R_{ins.framing}$

Standard Design

For new construction, the standard design wall type is ***metal -framed*** with continuous insulation. The U-factor required for wall construction of the standard design building is defined in Table 140.3-B, C or D of the Standards. Programs that model a U-factor shall use an exterior and interior air film resistance. The Standard Design construction is based on JA4-10 Table 4.3.3 and assumes an exterior air film of R-0.17 and an interior air film of R-0.68.

~~outside air film resistance and an inside air film resistance of R-0.17 and R-0.62, respectively.~~

For ***metal framed*** walls, the standard design construction shall include the following layers:

Layer 1	Stucco – 7/8 in.~~Outside Air Film~~	R - 0.~~17~~18
Layer 2	Building Paper	R – 0.06
Layer 3	Continuous Insulation	R - Based on Climate Zone
Layer 4	Closed Framing and No Ins.	R – 0.65
Layer 5	Gypsum Board – 1/2 in.	R – 0.45

The value of the Continuous Insulation layer entirely outside framing shall be set to achieve the following R-values:

Nonresidential Buildings – Continuous Ins.

Climate Zones 1, 6, and 7	R – 8.01
Climate Zones 2, 4, 5, and 8 – 16	R – 13.94
Climate Zones 3	R – 10.01

High-Rise Residential Buildings and Hotel / Motel Guestrooms – Continuous Ins.

Climate Zones 1 and 5	R – 7.33
Climate Zones 2 – 4, and 6 – 16	R – 9.52
~~Stucco, 7/8"~~	~~R - 0.18~~
~~Building Paper~~	~~R - 0.06~~
~~Insulation Continuous~~	~~$R_{insulation}$~~
~~Metal Framing, no Insulation~~	~~R - 0.00~~
~~Air Layer (4 in. or more)~~	~~R - 0.92~~
~~Gypsum board (5/8 in.)~~	~~R - 0.56~~
~~Inside Air Film~~	~~R - 0.62~~

~~The continuous insulation layer above ($R_{insulation}$) shall be R-8 for climate zones 1, 6 and 7, R-10 for climate zone 3 and R-14 for all other climate zones.~~

Formatte

Formatte

Formatte

Formatte

For alterations, any approved roof type may be used. The U-factor in the standard design shall be modeled as the more efficient of either the existing conditions or the values stated in Section 141.0 of the Standards. Where applicable, selection shall be based on building type, assembly, and climate zone. A construction of layers shall be defined to yield an equivalent U-factor.

For wall construction, the alteration standard design assembly shall include the appropriate existing layers.

Standard Design, Existing Buildings

For existing buildings, the standard design wall for unaltered components is the same as the proposed design. For altered exterior walls, the baseline assembly shall be as follows:

Step 1. Determine the existing wall type: metal building wall, metal framed wall, mass wall, medium; mass wall, heavy; wood-framed wall. The standard design wall type for alterations in existing building shall be the same as the proposed design wall type.

Step 2. Use the tables below to determine the standard design construction assembly, (The JA4 U-factors and cell references are provided as a reference only; the assembly U-factor need not match exactly the U-factor in Reference Appendix JA4, but the assembly shall include the layers defined below.)

Metal Framed Wall – same as new construction assembly above

Mass Wall, Light (Heat Capacity > 7 Btu/ft2-F and <15 Btu/ft2-F

	CZ2,10-16	CZ 1	CZ 4	CZ 3	CZ 5-9
JA4 U-factor	0.170	0.196	0.227	0.278	0.440
Layer 1	4 in MW CMU, 115 lb/sf 4.3.6-B5	4 in MW CMU, 115 lb/sf 4.3.6-B5	4 in MW CMU, 115 lb/sf 4.3.6-B5	4 in MW CMU, 115 lb/sf 4.3.6-B5	8 in NW CMU, 125 lb/ft2, partly grouted, reinforced with insulated cells 4.3.6-C10
Layer 2*	3” furring space with R-21 insulation and metal clips 4.3.14-V15 (equiv R-4.8 c.i.)	2.5” furring space with R-13 insulation and metal clips 4.3.14-R13 (equiv R-3.8 c.i.)	2” furring space with R-13 insulation and metal clips 4.3.14-N11 (equiv R-3.3 c.i.)	1.5” furring space with R-9 insulation and metal clips 4.3.14-J9 (equiv R-2.5 c.i.)	
Layer 3					
…					
Layer n					

Heavy Mass Wall (Heat Capacity >= 15 Btu/ft2-F):

	CZ2,10-16	CZ 1	CZ 4	CZ 3	CZ 5-9	

JA4 U-factor	0.160	0.184	0.211	0.253	0.650	0.690
Layer 1	8 in. NW CMU, 125 lb/ft2, solid grout, reinforced 4.3.5-A10	8 in. NW CMU, 125 lb/ft2, solid grout, reinforced 4.3.5-A10	8 in. NW CMU, 125 lb/ft2, solid grout, reinforced 4.3.5-A10	8 in. NW CMU, 125 lb/ft2, solid grout, reinforced 4.3.5-A10	8 in NW CMU, 125 lb/ft2, solid grout, reinforced 4.3.5-A9	8 in. NW CMU, 125 lb/ft2, solid grout, reinforced 4.3.5-A10
Layer 2*	3” furring space with R-21 insulation and metal clips 4.3.14-V15 (equiv R-4.8 c.i.)	2.5” furring space with R-13 insulation and metal clips 4.3.14-R13 (equiv R-3.8 c.i.)	2” furring space with R-13 insulation and metal clips 4.3.14-N11 (equiv R-3.3 c.i.)	1.5” furring space with R-9 insulation and metal clips 4.3.14-J9 (equiv R-2.5 c.i.)		
Layer 3						
…						
Layer n						

Metal Building Walls

	CZ15	CZ 2,4,5,8,9,10-14,16	CZ 1,3,6,7
JA4 U-factor	0.057	0.061	0.113
Layer 1	R-13 batt insulation draped over purlins and compressed	R-13 batt insulation draped over purlins and compressed	R-13 batt insulation draped over purlins and compressed Rlayer=8.85
Layer 2*	Second layer R-13 batt insulation	Second layer R-10 batt insulation	
Layer 3			
…			
Layer n			

Wood-Framed Walls

	CZ15	CZ 2,4,9-14,16	CZ 4	CZ 3
JA4 U-factor	0.042	0.059	0.102	0.110
Layer 1	2x4, 16” o.c, with R-13 batt ins	2x4, 16” o.c., with R-11 batt ins	2x4, 16” o.c. with R-13 batt ins	2x4, 16” o.c. with R-11 batt ins
Layer 2*	R-14 continuous insulation	R-8 continuous insulation		

Commen
section.

5.5.5 Exterior Floors

Floor Name	
Applicability	All floor surfaces
Definition	A unique name or code that relates the exposed floor to the design documents. Exposed floors include floors exposed to the outdoors and floors over unconditioned spaces, but do not include slab-on-grade floors, below grade floors, or interior floors.
Units	Text: unique
Input Restrictions	None
Standard Design	None

Floor Type	
Applicability	All exterior floor surfaces, optional
Definition	The category that defines the standard design prescriptive floor requirements.
Units	List: mass, other
Input Restrictions	Not applicable for new construction; either
Standard Design	The standard design building floors shall be of type “other”
Standard Design, Existing Buildings	The standard design building floor type for existing buildings shall be same as proposed.

Floor Geometry	
Applicability	All exterior floors, required input
Definition	Floor geometry defines the position, orientation, azimuth, and tilt of the floor surface. The details of how the coordinate system is implemented may vary between software programs. The data structure for surfaces is described in the reference section of this chapter.
Units	Data structure: surface
Input Restrictions	As designed
Standard Design	Standard design building floor geometry is identical to the proposed design.

Floor Construction	
Applicability	All floors, required input
Definition	A specification containing a series of layers that result in a construction assembly for the proposed design. The first layer in the series represents the outside (or exterior) layer and the last layer represents the inside (or interior) layer. See the building descriptors above for floor construction type.
Units	List: Layers
Input Restrictions	The construction assembly, defined by a series of layers, must be equal to or more

efficient than the mandatory U-factor requirements of Section 120.7 of the Standards for new construction, and Section 141.0 of the Standards for alterations. Note that these U-Factor requirements assume an exterior air film of R-0.17 and an interior air film of R-0.92. Each layer specified must be listed in the materials database in the ACM Appendix 5.5A.

New Construction

Raised Mass Floors	U – 0.269
Other Floors	U – 0.071
Heated Slab Floors	Climate Zone (see Section 120.7)

Additions and Alterations

Raised Framed Floors	U – 0.071
Raised Mass Floors in High-rise Res and Hotel Motel	U – 0.111
Raised Mass Floors in Other Occupancies	No Requirement

Appropriate R-values for insulation can be calculated using the formula below.

$R_{insulation} = (1/U\text{-factor}) - R_{layer(1)} - R_{layer(2)} - R_{layer(3)} - R_{layer(n)}$

$R_{insulation} = R_{ins.continuous} + R_{ins.framing}$

Standard Design

For new construction, the floor type for the standard design building is ***~~steel~~ metal framed***. The U-factor required for floor construction is defined in Table 140.3-B, C or D of the Standards. Programs that model a U-factor shall use an exterior and interior air film resistance. The Standard Design construction is based on JA4-10 Table 4.4.5 and assumes an exterior air film of R-0.17 and an interior air film of R-0.92. ~~outside air film resistance and an inside air film resistance of R-0.17 and R-0.62, respectively.~~

For ***~~steel~~ metal framed*** floors, the standard design construction shall include the following layers:

Layer 1	Open Framing + No Ins.	R – 0.00
Layer 2	Continuous Insulation	R – Based on Climate Zone
Layer 3	Plywood – 5/8 in.	R – 0.78
Layer 4	Carpet and Pad – 3/4 in.	R – 1.30

The value of the Continuous Insulation layer entirely above or below framing shall be set to achieve the following R-values:

Nonresidential Buildings – Continuous Ins.

Climate Zones 1	R – 17.66
Climate Zones 2, 11, and 14 -16	R – 22.47
Climate Zones 3 – 10, 12, and 13	R – 10.91~~Outside Air Film R – 0.17~~
~~Exterior Finish (metal or none)~~	~~R - 0.00~~
~~Insulation / Continuous~~	~~$R_{insulation}$~~
~~Steel joists~~	~~R – 0.00~~

~~Air Layer (4 in. or more) R - 0.92~~

~~Wood sheathing (5/8 in.) R - 0.78~~

~~Carpet with Fibrous Pad R - 2.08~~

~~Inside Air Film (down) R - 0.92~~

High-Rise Residential Buildings and Hotel / Motel Guestrooms – Continuous Ins.

Climate Zones 1, 2, 14, and 16 R – 26.24

Climate Zones 3 – 6, 8 – 13, and 15 R – 22.47

Climate Zones 7 R – 10.91

For alterations, any approved floor type may be used. The U-factor in the standard design shall be modeled as the more efficient of either the existing conditions or the values stated in Section 141.0 of the Standards. Where applicable, selection shall be based on building type, assembly, and climate zone. A construction of layers shall be defined to yield an equivalent U-factor.

Standard Design, Existing Buildings

The standard design floor construction for existing buildings depends on the floor type.

Raised Floors, Floor Type = Other (framed floors)

	All Climate Zones, Nonres
JA4 U-factor	0.071, JA4 4.4.2-A2
Layer 1	2x6 Wood-Framed, 16” o.c., R-11 batt
Layer 2	

Raised Floors, Floor Type= Mass

	All Climate Zones, Nonres	All Climate Zones, High-Rise Res.
JA4 U-factor	U=0.269	U=0.111, JA4 4.4.2-A2
Layer 1	Metal Deck, R-0	Metal Deck, R-0
Layer 2	4” Lightweight Concrete	4” Lightweight Concrete
Layer 3		R-6 continuous insulation

5.5.6 Doors

Door Name

Applicability All exterior doors, optional input

Definition A unique name or code that relates the door to the design documents submitted. Doors that are more than 50% glass are treated as windows and must be determined and entered by using the *Fenestration* building descriptors.

Units Text: unique

Input Restrictions None

Standard Design	None

	Door Type
Applicability	All exterior doors, required input
Definition	One of two door classifications of either: swinging or non-swinging. Non-swinging are generally roll-up doors. The prescriptive U-factor requirements depend on door type and climate. This building descriptor may be derived from other building descriptors, in which case a specific input is not necessary.
Units	List: swinging or non-swinging
Input Restrictions	The door type shall be consistent with the type of door represented on the construction documents or as-built drawings.
Standard Design	The standard design building door type shall be the same as the proposed design.

Door Geometry	
Applicability	All exterior doors
Definition	Door geometry defines the position and dimensions of the door surface relative to its parent wall surface. The azimuth and tilt (if any) of the door is inherited from the parent surface. The position of the door within the parent surface is specified through X,Y coordinates. The size is specified as a height and width (all doors are generally assumed to be rectangular in shape). The details of how the geometry of doors is specified may vary for each energy simulation program.
Units	Data structure: opening
Input Restrictions	As designed
Standard Design	Door geometry in the standard design building is identical to the proposed design.

Door Construction	
Applicability	All exterior doors
Definition	The thermal transmittance of the door, including the frame.
Units	Btu/h·ft^2·°F
Input Restrictions	The construction assembly must be equal to or more efficient than the mandatory U-factor requirements of Section 110.6 of the Standards for new construction. For alterations there are no restrictions.
Standard Design	For new construction, the U-factor required for door construction is defined in Table 140.3-B, C or D of the Standards. ~~For alterations, the U-factor in the standard design shall be modeled as the more efficient of either the existing conditions or the values stated in Table 140.3-B, C or D of the Standards. Where applicable, selection shall be based on building type, assembly, and climate zone.~~ **Nonresidential Buildings** – U Factor ~~Non-Swinging Doors, CZ1, 16: Wood Doors, 1-3/4 in. (including panel doors with minimum panel thickness of 1-1/8 in, and solid core flush doors, and hollow core flush doors (U=0.50)~~ Non-Swinging Doors Climate Zones 1, and 16 U – 0.50

Climate Zones 2 – 15 U – 1.45

Swinging Doors

Climate Zones 1 – 16 U – 0.70

High-Rise Residential Buildings and Hotel / Motel Guestrooms – U Factor ~~Non-Swinging Doors, CZ 2-15: Uninsulated single-layer metal swinging doors or non-swinging doors, including single-layer uninsulated access hatches and uninsulated smoke vents (U=1.45)~~

~~Swinging Doors, all climate zones: Uninsulated double-layer metal swinging doors~~

Non-Swinging Doors

Climate Zones 1, and 16 U – 0.50

Climate Zones 2 – 15 U – 1.45

Swinging Doors

Climate Zones 1 – 16 U – 0.70

For alterations, the U-factor in the standard design shall be modeled as the more efficient of either the existing conditions or the values stated in Table 140.3-B, C or D of the Standards. Where applicable, selection shall be based on building type, assembly, and climate zone.

5.5.7 Fenestration

Note that fenestration includes windows, doors that have more than 50% glazed area, and skylights. A skylight is fenestration that has a tilt of less than 60° from horizontal.

Fenestration Name	
Applicability	All fenestration, optional input
Definition	A unique name or code that relates the fenestration to the design documents and a parent surface.
Units	Text: unique
Input Restrictions	No restrictions
Standard Design	Not applicable

Fenestration Type (Vertical Fenestration)	
Applicability	All vertical fenestration
Definition	This is a classification of vertical fenestration that determines the thermal performance and solar performance requirement for vertical fenestration.
Units:	List: Fixed, Operable, Curtain Wall, or Glazed Doors
Input Restrictions	No restrictions, other than that the vertical fenestration type must agree with the type specified on the construction documents or the as-built drawings.
Standard Design	Same as the proposed design

Fenestration Type (Skylights)

Applicability	All skylights
Definition	This is a classification of skylights that determines the thermal performance and solar performance requirement for vertical fenestration.
Units:	List: Glass, curb-mounted, Glass, deck-mounted, or Plastic
Input Restrictions	No restrictions, other than the skylight types specified must agree with the construction documents or the as-built drawings.
Standard Design	Same as the proposed design

Default Fenestration Type

Applicability	All fenestration that uses default thermal performance factors
Definition	This is a classification of fenestration that determines the thermal performance for fenestration using defaults from Standards Section 110.6
Units:	List: Fixed, Operable, Greenhouse/garden, doors, or Skylight
Input Restrictions	As designed
Standard Design	Not applicable

Default Glazing Type

Applicability	All fenestration that uses default thermal performance factors
Definition	This is a classification of fenestration that determines the thermal performance for fenestration using defaults from Standards Section 110.6
Units:	List: Single Pane, Double Pane, Glass Block
Input Restrictions	As designed
Standard Design	Not applicable

Fenestration Geometry

Applicability All fenestration

Definition Fenestration geometry defines the position and dimensions of the fenestration surface within its parent surface and the identification of the parent surface. The orientation and tilt is inherited from the parent surface. The details of how the coordinate system is implemented may vary between Compliance Software programs.

Display Perimeter. Display perimeter is the length of an exterior wall in a B-2 occupancy that immediately abuts a public sidewalk, measured at the sidewalk level for each story that abuts a public sidewalk. The compliance software shall allow the user to specify a value for the length of display perimeter, in feet, for each floor or story of the building. The user entry for Display Perimeter shall have a default value of zero. Note: Any non-zero input for Display Perimeter is an exceptional condition that shall be reported on the PERF-1 exceptional condition list and shall be reported on the ENV forms. The value for Display Perimeter is used as an alternate means of establishing Maximum Wall Fenestration Area in the standard design (§140.3 of the Standards).

Commen
definitions

Floor Number. The compliance software shall also allow the user to specify the Display Perimeter associated with each floor (story) of the building.

Units Data structure: opening

Geometry is defined relative to the parent surface and can include setbacks.

Inputs include:

Geometry of opening (window or skylight), parent surface, display perimeter (optional), percent of roof area exempt from skylight requirements §140.3 of the Standards.

Input Restrictions As designed.

Specification of the fenestration position within its parent surface is required for the following conditions:

1) Exterior shading is modeled from buildings, vegetation, other objects; or

2) If daylighting is modeled within the adjacent space.

Standard Design

The standard design calculates the window wall ratio (WWR) for each orientation and the overall window wall ratio for the building. The window wall ratio is the total fenestration area (including framing) divided by the gross exterior wall area.

The geometry of the fenestration in the standard design shall be identical to the proposed design with the following exceptions:

Exception 1. Either the whole building window wall ratio or west window wall ratio exceeds 40%.

Exception 2. If display perimeter is entered, the fenestration area exceeds six times the display perimeter.

Exception 1. The fenestration is adjusted based on the following conditions:

Case 1. $WWR_o > 0.40$, $WWR_w <= 0.40$

In this case, the fenestration area of all windows is reduced by multiplying the fenestration area by the ratio $0.40/WWR_o$. The dimensions of each window is reduced by multiplying the proposed window dimension by $(0.40/WWR_o)1/2$, so that the same window aspect ratio is maintained.

Case 2: $WWR_o < 0.40$. $WWR_w > 0.40$

In this case, the fenestration area of all windows on the west orientation is reduced by multiplying the fenestration area by the ratio $0.40/WWR_o$. The dimensions of each window is reduced by multiplying the proposed window dimension by $(0.40/WWR_o)^{1/2}$, so that the same window aspect ratio is maintained.

Case 3: WWRo > 0.40. WWRw > 0.40

If both the west window wall ratio and the overall window wall ratio exceed the prescriptive limit of 0.40, the fenestration areas must be reduced by:

1) Adjust the West window area multiplying the west window area by the ratio 0.4/WWRw.

2) Calculate the WWR of the north, east and south facades:

   WWRnes = Window Area nes / Gross Wall Area nes

3) Adjust the window area of the windows on the north, east and south facades by the following ratio:

   $WindowArea_{N,std} = WindowArea_{N,prop} \times 0.4 / WWR_{nes}$

   $WindowArea_{E,std} = WindowArea_{E,prop} \times 0.4 / WWR_{nes}$

   $WindowArea_{S,std} = WindowArea_{S,prop} \times 0.4 / WWR_{nes}$

4) Adjust each window geometry for the west façade by multiplying each dimension by $(0.4/WWR_w)^{1/2}$

5) Adjust each window geometry for the north, east and south façade by multiplying each dimension by $(0.4/WWR_{nes})^{1/2}$

Exception 2. If the display perimeter is entered and the window area exceeds the prescriptive limit, the window area for the standard design is calculated by multiplying the proposed window area by the following ratio:

$WindowArea_{std}$ = 6 x DisplayPerimeter

The geometry of each window is modified by the following:

$WindowHeight_{std} = WindowHeight_{prop} \times (WindowArea_{std}/WindowArea_{prop})^{1/2}$

$WindowWidth_{std} = WindowWidth_{prop} \times (WindowArea_{std}/WindowArea_{prop})^{1/2}$

The following rules apply for calculating geometry of skylights:

The skylight area of the standard design is set to:

(1) For buildings without atria or with atria having a height less than 55 feet over conditioned space, the smaller of the proposed skylight area and ~~10~~5% of the gross roof area

(2) For buildings with atria at a height of 55ft or greater over conditioned spaces, the smaller of the proposed skylight area and ~~5~~10% of the gross roof area

(3) For buildings with atria ~~at a height of 55ft or greater~~ over unconditioned spaces, the smaller of the proposed skylight area or 5% of the roof area excluding the atria area. The skylight area of the atria is not included in the skylight area limit in this case.

~~(3)~~ The skylight area for atria over unconditioned space is not included in determining the skylight to roof ratio (SRR) for the building.

Formatte

Depending on the following condition, adjustments to the SRR as described below shall be made.

i. For open spaces other than auditoriums, churches, movie theaters, museums and refrigerated warehouses, for buildings in climate zones 2 through 15, and when spaces have ceiling heights greater than 15 ft and floor areas greater than 5000 ft2, - builiding Floor area x 0.75 = Total primary daylit area+ Total skylit daylit area. See 5.4.5~~5.4.4~~ for detail description on Primary Daylit area and Skylit Daylit area.

ii. If the above condition is met and SRR ≤ 0.05, no adjustments are needed.

iii. If the condition is met and SRR > 0.05, skylight dimensions = Existing Dimension x [1- √ (0.05/SRR of Proposed Building)]

iv. If the condition is not met triggering the need for additional skylights, the baseline case shall be modeled with new skylights irrespective of the skylight location of the proposed case. The new skylights shall be distributed uniformly such that there is no overlapping of primary daylit areas from skylights or sidelights. The dimension of the new skylights shall be the same as the proposed design if calculated new SRR ≤ 0.05. If SRR > 0.05, skylight dimensions = Existing Dimension x [1- √ (0.05/SRR of Proposed Building)].

Note that the adjustments to SRR is done after adjustments to WWR, if any is completed.

Standard Design, Existing Buildings, Additions and Alterations

For alterations of existing vertical fenestration or skylights, where no fenestration area is added, the Fenestration Geometry of the standard design shall be the same as the proposed for the existing building.

For additions of vertical fenestration or skylights, where the additional fenestration causes the fenestration area to exceed the limit of 40% window to wall ratio (WWR) for the building, 40% WWR for the west orientation of the building, 5% skylight to roof

ratio (SRR) for existing buildings without atria 55 feet or higher, or 10% SRR for existing buildings with atria 55 feet or higher, the fenestration geometry for the standard design shall be adjusted from the proposed design according to the rules set forth under the *Standard Design* rules.

For additions of vertical fenestration and/or skylights that do not cause the fenestration area to exceed any of these limits, the fenestration geometry of the standard design shall be the same as the proposed design.

Skylight Requirement Exception Fraction

Applicability All buildings with interior ceiling heights greater than 15 feet

Definition This is the fraction of floor area that is exempt from the minimum skylight area requirement for spaces with high ceilings.

Identifying areas subject to §140.3 of the Standards

When a proposed space has ceiling heights greater than 15 feet, with exterior surfaces having a tilt angle less than 60 degrees (roofs) and no more than 3 stories above grade, the user shall enter the fraction of the modeled space that is exempt from requirements of §140.3 of the Standards. If the proposed design has skylights, the user shall also indicate the area of the proposed design daylight area under skylights in this space. When the user enters a value greater than 0 %for the fraction of the space area exempt to §140.3 of the Standards, the compliance software shall require that the user indicate at least one of the following exceptions:

1. The building is not located in climate zone 1 or climate zone 16.

2. Designed general lighting is less than 0.5 W/ft^2

3. Existing walls on plans result in enclosed spaces less than 5,000 ft^2

4. Future walls or ceilings on plans result in enclosed spaces less than 5,000 ft^2 or ceiling heights less than 15 feet.

5. Plans or documents show that space is an auditorium, religious building of worship, movie theater, museum, or refrigerated warehouses.

Units: Data Structure:

(a) Unitless fraction between 0 and 1

List: Four exceptions listed above (specified if fraction > 0)

Input Restrictions No restrictions, other than that the vertical fenestration type must agree with the type specified on the construction documents or the as-built drawings.

Standard Design Same as the proposed design

Standard Design, Existing Buildings Not applicable

Fenestration Construction

Applicability All fenestration

Definition A collection of values that together describe the performance of a fenestration system. The values that are used to specify the criteria are U-factor, SHGC and VT. U-factor and SHGC inputs are whole-window values.

Units Data structure: shall include at a minimum the following properties as specified by

NFRC ratings:

U-factor: whole window U-factor

SHGC: whole window solar heat gain coefficient

VT: visible transmittance

Input Restrictions

For new construction, performance information for fenestration shall be developed from NFRC test procedures or shall be equal to or more efficient than the requirements of Section110.6 of the Standards, and the default values in Tables 110.6-A and B of the Standards. Center-of-glass performance values for windows complying with the exception (maximum of 1,000 ft^2). Values entered shall be consistent with the specifications and the construction documents.

For manufactured products:

- U-factor, SHGC and VT shall be equivalent to NFRC rated values.
- -For products not rated by NFRC, U-factor, SHGC and VT shall be determined from CEC default tables (110.6 A and B).

For site built products:

- U-factor, SHGC and VT shall be equivalent to NFRC rated values.
- For products not rated by NFRC, U-factor, SHGC and VT shall:
- be determined from CEC default tables (110.6 A and B) when total site built fenestration > 1000 ft2
- be determined from methods outlined in NA-6 when total site built fenestration <=1000 ft2

For field fabricated products:

- U-factor, SHGC and VT shall be determined from CEC default tables (110.6 A and B)

For buildings with fenestration area that meets requirements for use of center-of-glass U-factor and SHGC, the window overall U-factor, SHGC and VT shall be determined by the following equations from the Reference Appendix NA6:

$U_T = C_1 + (C_2 \cdot U_c)$

$SHGC_T = 0.08 + (0.86 \cdot SHGC_c)$

$VT_T = VT_F \cdot VT_C$

Where,

U_T = U-factor Is the Total Performance of the fenestration including glass and frame

C_1 = Coefficient selected from Table NA6-5 in Reference Appendix NA6

C_2 = Coefficient selected from Table NA6-5 in Reference Appendix NA6

U_C = Center of glass U-factor calculated in accordance with NFRC 100 Section 4.5.3.1

$SHGC_T$ = SHGC Is

$SHGC_C$ = Center of glass SHGC calculated in accordance with NFRC 200 Section 4.5.1.1

VT_T = Is the Total Performance of the fenestration including glass and frame

VT_F = 0.53 for projecting windows, such as casement and awning windows

VT_F = 0.67 for operable or sliding windows

VT_F = 0.77 for fixed or non-operable windows

VT_F = 0.88 for curtain wall/storefront, Site-built and manufactured non-curb mounted skylights

VT_F = 1.0 for Curb Mounted manufactured Skylights

VT_C = Center of glass VT is calculated in accordance with NFRC 200 Section 4.5.1.1 or NFRC 202 for Translucent Products or NFRC 203 for Tubular Daylighting Devices and Hybrid Tubular Daylighting Devices or ASTM E972

For skylights, the default values shall be the alternate default U-factor and SHGC using default calculations specified above and in Reference Appendix NA6 or the U-factor and SHGC listed in Table 110.6-A and Table 110.6-B in the Standards.

For alterations, the U-factor, SHGC and VT must be equal to or more efficient than the mandatory requirements of Section 141.0 of the Standards.

Standard Design

For new construction, the requirements for vertical fenestration U factor, Solar Heat Gain Coefficient, and Visible light transmission by window type and framing type are specified in Table 140.3-B, C or D of the Standards.

~~For alterations, the U-factor, SHGC and VT in the standard design shall be modeled as the more efficient of either the existing conditions, or the values stated in Table 141.0-A of the Standards when the existing window area is unchanged, or Table 140.3-B, C or D of the Standards for all other cases~~.

Standard Design, Existing Buildings

For alterations, the U-factor, SHGC and VT in the standard design shall be modeled as the more efficient of either the existing conditions, or the values stated in Table 141.0-A of the Standards when the existing window area is unchanged, or Table 140.3-B, C or D of the Standards for all other cases.

External Shading Devices

Applicability

All fenestration

Definition

Devices or building features that are documented in the construction documents and shade the glazing, such as overhangs, fins, shading screens, and setbacks of windows from the exterior face of the wall. Objects that shade the building but are not part of the building and parts of the building that cause the building to shade itself are also modeled, but are not a part of this building descriptor. See *Shading of the Building Site*. The Title 24 compliance software shall be capable of modeling vertical fins and overhangs. Recessed windows may also be modeled with side fins and overhangs.

Units

Data structure: opening shade

Input Restrictions

No restrictions other than that the inputs must match the construction documents

Standard Design

The standard design building is modeled without external shading devices.

Internal Shading Devices

Applicability	All fenestration
Definition	Curtains, blinds, louvers, or other devices that are applied on the room side of the glazing material. Glazing systems that use blinds between the glazing layers are also considered internal shading devices. Glass coatings, components or treatments of the glazing materials are addressed through the *Fenestration Construction* building descriptor.
Units	Data structure: Indicates the type of control, or blind schedule if applicable
Input Restrictions	Interior shades shall only be modeled when automatic controls are present.
Standard Design	The standard design building shall be modeled with the same internal shading devices and shading schedule as the proposed design.

SHGC Dim Fraction

Applicability	Fenestration with switchable glazing
Definition	For switchable glazing, this is the fraction of the solar heat gain coefficient when darkened to the solar heat gain coefficient during normal operation. This can be applied when the solar heat gain exceeds a specified threshold, or controlled by an electrical signal.
Units	Unitless
Input Restrictions	Between 0 and 1
Standard Design	Not applicable

VT Dim Fraction

Applicability	Fenestration with switchable glazing
Definition	For switchable glazing, this is the fraction of the visible transmittance when darkened to the visible transmittance during normal operation. This can be applied when the solar heat gain exceeds a specified threshold, or controlled by an electrical signal.
Units	Unitless
Input Restrictions	Between 0 and 1
Standard Design	Not applicable

Switchable Solar Heat Gain Threshold

Applicability	Fenestration with automatically controlled switchable glazing.
Definition	For switchable glazing, this is the solar heat gain threshold above which the dynamic glazing is active (darkened). When the solar heat gain drops below this threshold, the glazing is switched back to being inactive (clearest setting). Indoor and outdoor air temperatures are the setpoints required for controlling the Switchable Solar Heat Gain Threshold. A flag may be used to indicate that this control is not used.
Units	Incident solar threshold (Btu/h-ft2)
Input Restrictions	As designed.

Standard Design	Not applicable

Switchable Space Temperature Threshold

Applicability	Fenestration with automatically controlled switchable glazing.
Definition	For switchable glazing, this is the space temperature above which the dynamic glazing is active (darkened). When the solar heat gain drops below this threshold, the glazing is switched back to being inactive (clearest setting). Indoor and outdoor air temperatures are the setpoints required for controlling the Switchable Solar Heat Gain Threshold. This may be used in combination with the solar heat gain and illuminance thresholds for control. A flag may be used to indicate that this control is not used.
Units	°F
Input Restrictions	The space heating and cooling setpoints are prescribed from Appendix 5.4B. A flag may be used to indicate that this control is not used.
Standard Design	Not applicable

Switchable Illuminance Threshold

Applicability	Fenestration with automatically controlled switchable glazing.
Definition	For switchable glazing, this is the illuminance threshold above which the dynamic glazing is regulated between active (darkened) and inactive (clearest setting). With a single illuminance setpoint the switchable glazing will adjust between the clearest and darkest setting to allow the desired illuminance level. A flag may be used to indicate that this control is not used.
Units	Lux
Input Restrictions	As designed During occupied hours, the recommendation for the illuminance threshold setpoint is to match a point within the recommended illumination levels, based on space type, from Appendix 5.4A. Values below this recommended range may require special documentation. During unoccupied hours, the recommendation is to have the Switchable Solar Heat Gain Threshold descriptor in control of the switchable glass.
Standard Design	Not Applicable

Switchable Glazing Schedule

Applicability	Fenestration with switchable glazing controlled by an electrical signal
Definition	For switchable glazing, this is an hourly schedule for the when the switchable glazing is darkened, when controlled by an electrical signal.
Units	Boolean: 1 if switchable glazing is active (darkened); 0 if not active
Input Restrictions	0 or 1 for schedule values
Standard Design	Not applicable

5.5.8 Below Grade Walls

Below Grade Wall Name	
Applicability	All projects, optional input
Definition	A unique name that keys the below grade wall to the construction documents
Units:	Text: unique
Input Restrictions	None
Standard Design	Not applicable

Below Grade Wall Geometry	
Applicability	All projects
Definition	A geometric construct that describes the dimensions and placement of walls located below grade. Below grade walls have soil or crushed rock on one side and interior space on the other side. Some simulation models take the depth below grade into account when estimating heat transfer, so the geometry may include height and width.
Units	Data structure: below grade wall geometry
Input Restrictions	As designed
Standard Design	The geometry of below grade walls in the standard design building is identical to the below grade walls in the proposed design.

Below Grade Wall Construction	
Applicability	All projects, required input
Definition	A specification containing a series of layers that result in a construction assembly for the proposed design. The first layer in the series represents the outside (or exterior) layer and the last layer represents the inside (or interior) layer. See the building descriptors above for below grade wall construction type.
Units	Data structure: construction assembly The construction can be described as a C-factor which is similar to a U-factor, except that the outside air film is excluded, or the construction can be represented as a series of layers, like exterior constructions.
Input Restrictions	The construction assembly, defined by a series of layers, must be equal to or more efficient than the mandatory R-value and C-factor requirements of Section 120.7 of the Standards for new construction, and Section 141.0 of the Standards for alterations. Note that these requirements only apply when the slab floor connected to the below grade wall is heated. For new construction, t~~here are no restrictions other than that t~~he inputs shall be in agreement with the construction documents. Values for the C-factor shall be taken from Table 4.3.5, 4.3.6 or 4.3.7 of Reference Appendix JA4. For alterations there are no restrictions.
Standard Design	For new construction, See Table 13~~Table 12~~. The standard design building shall use

default values for C-factor. The height shall be the same as specified in the proposed design.

For ***below grade*** walls, the standard design construction shall include the following layers:

Layer 1 CMU Solid Grout 115lb/ft3 – 8 in.~~Insulation Continuous~~ R – 0.87 C – 1.14~~insulation~~

~~Mass Wall R – (see ACM Appendix 5.5A)~~

~~Air Layer (3/4 in. or less) R – 0.90~~

~~Gypsum board (5/8 in.) R - 0.56~~

~~Inside Air Film R - 0.62~~

Table 13~~12~~ – Standard Design Building Below-Grade Wall Construction Assemblies

Construction	Layer	Thickness (inch)	Conductivity (Btu/h ft F)	Density (lb/ft²)	Specific Heat (Btu/lb F)	R-value (ft²·°F·h/Btu)	C-factor (Btu/ft²·°F·h)
NR	115 lb/ft3 CMU, solid grout	8	0.45	115	0.20	0.87	1.140
R-7.5 c.i.	115 lb/ft3 CMU, solid grout	8	0.45	115	0.20	0.87	
	R-10 continuous insulation	1.8	0.02	1.8	0.29	7.50	
	Total assembly					8.37	0.119
R-10 c.i.	115 lb/ft3 CMU, solid grout	8	0.45	115	0.20	0.87	
	R-10 continuous insulation	2.4	0.02	1.8	0.29	10.00	
	Total assembly					10.87	0.092
R-12.5 c.i.	115 lb/ft3 CMU, solid grout	8	0.45	115	0.20	0.87	
	R-10 continuous insulation	3.0	0.02	1.8	0.29	12.50	
	Total assembly					13.37	0.075

For alterations, the C-factor in the standard design shall be modeled as the more efficient of either the existing conditions, or the values stated above for new construction standard design.

For *below grade* walls, the alteration standard design assembly shall include the appropriate existing layers.

~~A formula for calculating acceptable monthly ground temperature (below grade exterior surface temperature) is shown below: (source: Energy Plus 7.0)~~

~~$T_{ext.surf} = T_{ave.space} - 3.6°F$~~

~~Where:~~

~~$T_{ext.surf}$ = Temperature of below grade exterior surfaces for each month (°F)~~

~~$T_{ave.space}$ = Average monthly dry bulb temperature of the conditioned below grade space (°F)~~

~~Compliance software may use alternate methods of modeling heat transfer between the below-grade walls and the surrounding soil.~~

5.5.9 Slab Floors in Contact with Ground

These building descriptors apply to slab-on-grade floors that are in direct contact with the ground.

Slab Floor Name

Applicability	All slab floors, optional
Definition	A unique name or code that relates the exposed floor to the construction documents.
Units	Text: unique
Input Restrictions	None
Standard Design	Not applicable

Slab Floor Type

Applicability	All slab floors, required
Definition	One of two classes for floors in contact with ground. The classes are: 1) Heated slab-on-grade floors and, 2) Unheated slab-on-grade floors. Heated slab-on-grade floors include all floors that are heated directly in order to provide heating to the space. Unheated slab-on-grade floors are all other floors in contact with ground.
Units	List: heated or unheated
Input Restrictions	None
Standard Design	The slab floor type in the standard design building is identical to the slab floor type in the proposed design.

Slab Floor Geometry

Applicability	All slab floors, required
Definition	A geometric construct representing a slab floor in contact with the earth. The geometric representation can vary depending on how the energy simulation software models slabs-on-grade. Some models require that only the perimeter of the slab be entered. Other models divide the slab into a perimeter band within 2 ft of the edge and the interior portion or core area, such that the perimeter area and the core area sum to the total area of the slab.
Units:	Data structure: as appropriate for the simulation tool This may include: Area, Perimeter Exposed
Input Restrictions	No restrictions
Standard Design	The geometry of the slab floor in the standard design building is identical to the slab floor in the proposed design.

Slab Floor Construction

Applicability	All slab floors, required input
Definition	A specification containing a series of layers that result in a construction assembly for the proposed design. The first layer in the series represents the outside (or exterior) layer and the last layer represents the inside (or interior) layer. See the building descriptors above for slab floor construction type. A description of how the slab is insulated (or not). How the construction is described will depend on the energy simulation model. The construction can be represented by an F-factor that represents the entire construction (floor and insulation).

Simple models may include just an F-factor, representing an instantaneous heat loss/gain to outside air. The F-factor could be related to the configuration of insulation in the proposed design. Other slab loss models may require that the surface area of the slab floor be divided between the perimeter and the interior. The insulation conditions then define heat transfer between both outside air and ground temperature.

The insulation condition for slabs includes the R-value of the insulation and the distance it extends into the earth at the slab edge and how far it extends underneath the slab.

Units

List

F-factor from Reference Appendix JA4; *this is one selection from list 1 and one selection from list 2. Note that some combinations from list 1 and list3 are not allowed – see Reference Appendix JA4 Table 4.4.8 and Table 4.4.7 for details.*

List 1: None, 12 in horizontal, 24 in horizontal, 36 in horizontal, 48 in horizontal, 12 in vertical, 24 in vertical, 36 in vertical, 48 in vertical, Fully insulated slab

List 2: R-0, R-5, R-7.5, R-10, R-15, R-20, R-25, R-30, R-35, R-40, R-45, R-50, R-55

Input Restrictions

The construction assembly, defined by an F-factor, must be equal to or more efficient than the mandatory F-factor requirements of Section 120.7 of the Standards for new construction, and Section 141.0 of the Standards for alterations.

For new construction, F-factors shall be taken from Table 4.4.8 of Reference Appendix JA4 for heated slab floors and Table 4.4.7 for unheated slab floors. For all methods, inputs shall be consistent with the construction documents. For heated slab floors, the F-factor shall be determined by the mandatory R-value and installation requirements in Section 110.8 of the Standards, and then that information is used in Table 4.4.8 of Reference Appendix JA4 to determine the required F-factor. For alterations the same requirements apply.

Standard Design

The slab type for the standard design shall match the slab type for the proposed design, and follow the below requirements. Slab loss shall be modeled with the simple method (F-factor).

For ***heated and unheated slab*** floors, the standard design construction shall include the following layers:

Layer 1 Concrete 140lb/ft3 – 6 in. R - 0.44

For new construction, the configuration of insulation and the F-factors for the standard design building ***heated slab*** floors are shown in Table 4.4.7~~8~~ in Reference Appendix JA4.

The F-factor for the standard design shall be the following:

Climate Zones 1-15 ~~:~~ 48 in. vertical, R-5 insulation F – 0.91

Climate Zone 16 ~~:~~ 48 in. vertical, R-10 insulation F – 0.78

For ***unheated slab*** floors the standard design s~~S~~lab f~~F~~loor c~~C~~onstruction shall be ***None***.

For alterations, the F-factor in the standard design shall be modeled as the more efficient of either the existing conditions, or the values stated above for new construction standard design.

5.5.10 Heat Transfer between Thermal zones

Partition Name	
Applicability	All partitions, optional
Definition	A unique name or code that relates the partition to the construction documents.
Units	Text: unique
Input Restrictions	The text should provide a key to the construction documents.
Standard Design	Not applicable

Partition Geometry	
Applicability	All partitions
Definition	A geometric construct that defines the position and size of partitions that separate one thermal zone from another. The construct shall identify the thermal zones on each side of the partition. Since solar gains are not generally significant for interior partitions, the geometry of partitions is sometimes specified as just an area along with identification of the thermal zones on each side.
Units	Data structure: surface with additional information identifying the two thermal zones that the partition separates.
Input Restrictions	No restrictions other than agreement with the construction documents
Standard Design	The geometry of partitions in the standard design building shall be identical to the proposed design.

Partition Construction	
Applicability	All partitions
Definition	A description of the construction assembly for the partition
Units	Data structure: construction assembly
Input Restrictions	No restrictions other than the need for agreement with the construction documents
Standard Design	Partitions in the standard design building shall be steel framed walls with 5/8 in. gypsum board on each side.

5.6 HVAC Zone Level Systems

This group of building descriptors relate to HVAC systems at the zone level. There is not a one-to-one relationship between HVAC components in the proposed design and the Standard Design since the Standard Design system is determined from building type, size, and heating source. ~~The eight Standard Design systems are shown as columns in .~~The applicability of each building descriptor for each of the 11 Standard Design systems is indicated in tables under the building descriptor Standard Design rules. ~~The building descriptors for zone level HVAC systems are shown as rows and the check marks "✓" indicate~~

~~that the building descriptor applies for the Standard Design system. Depending on the nature of the proposed design, any of the building descriptors could apply.~~ Additions and Alterations should follow the same requirements stated for new construction Proposed Designs and new construction Standard Designs; unless otherwise noted in the descriptor.

5.6.1 Space Temperature Control

~~***Control System Type***~~	
~~*Applicability*~~	~~All buildings~~
~~*Definition*~~	~~The type of control system for the building. This input affects baseline system specification for zone level controls, supply air temperature reset controls, ventilation controls and fan and pump static pressure part-load curves. See the following building descriptors:~~ ~~Ventilation Control Method~~ ~~Terminal Heating Control Type~~ ~~Pump Part-Load Curve~~ ~~Fan Part-load Curve~~
~~*Units*~~	~~None~~
~~*Input Restrictions*~~	~~List: can be one of the following inputs~~ ~~DDC Control to the Zone Level – direct digital control systems with control to the zone level~~ ~~Other – other control systems, including pneumatic and DDC systems without control to the zone level~~
~~*Standard Design*~~	~~DDC Control to the Zone Level~~

Space Thermostat Throttling Range	
Applicability	All ~~HVAC~~ thermal zones
Definition	The number of degrees that the room temperature must change to cause the HVAC system to go from no heating or cooling (i.e., space temperatures floating) to full heating or cooling.
Units	Degrees Fahrenheit (°F)
Input Restrictions	The prescribed value is 2°F. (This is equivalent to a +/- 1F temperature tolerance around the heating and cooling setpoint.) No input is needed and the prescribed value may not be overridden.
Standard Design	Same as the proposed design

Space Temperature Schedule	
Applicability	All ~~HVAC~~ thermal zones
Definition	An hourly space thermostat schedule
Units	Data structure: temperature schedule
Input Restrictions	~~The schedules specified in Appendix 5.4A and detailed in Appendix 5.4B shall be used as a default. When the default temperature schedule is overridden, the user must~~

	~~provide justification for use of nonstandard space temperature schedule assumptions~~Prescribed. The Schedule Group is specified for the given Space Type in Appendix 5.4A, and the schedule values are specified in Appendix 5.4B.
Standard Design	Schedules in the Standard Design shall be identical to the proposed design.

5.6.2 Terminal Device Data

Terminal Type	
Applicability	All ~~HVAC~~ thermal zones
Definition	A terminal unit includes any device serving a zone (or group of zones collected in a thermal zone) that has the ability to reheat or recool in response to the zone thermostat. This includes: • None (the case for single zone units) • VAV box • Series Fan-Powered VAV box • Parallel Fan-Powered VAV box • Induction-type VAV box • Dual-duct mixing box (constant volume and VAV) • Two and three duct mixing dampers (multi-zone systems) • Reheat coil (constant volume systems) • Perimeter induction units
Units	List (see above)
Input Restrictions	As designed
Standard Design	Table 14~~Table 13~~ specifies the HVAC terminal device for each of the Standard Design systems. See ~~Table 5 – HVAC System Map~~ for a summary of the HVAC mapping.

Field Coc

Table 14~~13~~ – Standard Design HVAC Terminal Devices

Standard Design System	Terminal Type
System 1 – PTAC	None
System 2 – FPFC	None
System 3 – PSZ-AC	None
System 5 – Packaged VAV with Reheat	VAV Box
System 6 – VAV with Reheat	VAV Box
System 7 – SZVAV	None
System 9 – Heating and Ventilation	None
System 10 – CRAH	None
System 11 – CRAC	None
System 12 – LAB	None
System 13 – Kitchen	None

5.6.3 Terminal Heating

This group of building descriptors applies to proposed design systems that have reheat coils at the zone level. The building descriptors are applicable for Standard Design systems 5 and 6.

Terminal Heat Type

Applicability Systems that have reheat coils at the zone level

Definition The heating source for the terminal unit. This includes:

- Electric resistance
- Gas furnace
- Oil furnace
- Hot water
- Steam

Units List (see above)

Input Restrictions As designed.

Standard Design Table 15~~Table 14~~ shows the terminal heat type for each Standard Design system.

Table 15~~14~~ – Baseline Building Terminal Heat Type

Baseline building System	Terminal Heat Type
System 1 – PTAC	None
System 2 – PTHP	None
System 3 – PSZ-AC	None
System 4 – PSZ-HP	None
System 5 – Packaged VAV with Reheat	Hot Water
System 6– VAV with Reheat	Hot Water
System 7 – SZVAV	None
System 8 – SZVAV HP	None
System 9 – Heating and Ventilation	None
System 10 – CRAH Unit	None
System 11 – CRAC Unit	None
System 12 – LAB	None
System 13 – Kitchen	None

Terminal Heat Capacity

Applicability Systems that have reheat coils at the zone level

Definition The heating capacity of the terminal heating source

Units Btu/h

Input Restrictions As designed. However, if the unmet load hours exceed ~~300~~150, the energy analyst and design team may have to increase the size of the equipment so that the unmet load hours are less than ~~300~~150. See Figure 12 Figure 2.

Standard Design The software shall automatically size the terminal heating capacity to be 25% greater than the design loads. See Figure 2.

Reheat Delta T

Applicability Systems that have reheat coils at the zone level

Definition This is an alternate method to enter the terminal heat capacity. It can be calculated as follows:

(3)

$$\Delta T_{reheat} = T_{reheat} - T_{cool_supply}$$
$$\Delta T_{reheat} = Q_{coil} / (1.1*CFM)$$

where

ΔT_{reheat}	heat rise across the terminal unit heating coil (°F)
T_{reheat}	heating air temperature at design (°F)
T_{cool_supply}	supply air temperature at the heating coil (°F)
Q_{coil}	heating coil load (Btu/h)
CFM	airflow (cfm)

Units Degrees Fahrenheit (°F)

Input Restrictions	As designed, but may need to be increased if zone unmet load hours are greater than ~~300~~150.
Standard Design	Method not used for standard design. (The temperature difference shall be no more than 40F.) See Heat Capacity above.

5.6.4 Baseboard Heat

Baseboard Capacity	
Applicability	All ~~HVAC~~ thermal zones
Definition	The total heating capacity of the baseboard unit(s)
Units	Btu/h
Input Restrictions	As designed
Standard Design	Not applicable to the standard design

Baseboard Heat Control	
Applicability	All ~~HVAC~~ thermal zones
Definition	Defines the control scheme of base board heating as either: • Controlled by a space thermostat
Units	List (see above)
Input Restrictions	Controlled by space thermostat is the only type allowed if baseboard heating is used.
Standard Design	Not applicable for the standard design

5.6.5 Zone Level Air Flow

5.6.5.1 VAV Air Flow

This group of building descriptors applies to proposed design systems that vary the volume of air at the zone level. The building descriptors are applicable for standard design systems 5 and 6.

Design Airflow	
Applicability	Systems that vary the volume of air at the zone level
Definition	The air delivery rate at design conditions
Units	cfm
Input Restrictions	As designed. If the unmet load hours in the proposed design are greater than ~~300~~150, the building descriptor may need to be modified by the user to meet the criterion.
Standard Design	For systems 5 and 6, the software shall automatically size the system airflow to meet the standard design loads based on a supply-air-to-room-air temperature difference of 20°F for exterior zones or 15°F for interior zones, the required ventilation air from Table 120.1-A of the Standard, or makeup air; whichever is greater. An exterior zone is defined as a type of thermal zone that has any exterior walls, ceilings or floors. An interior zone is defined as a type of thermal zone that has no surfaces exposed to ambient or below-grade conditions.

For kitchen MAU systems, the design airflow is the greater of the airflow required to meet the design cooling loads and the total exhaust CFM.

Terminal Minimum Stop

Applicability Systems that vary the volume of air at the zone level

Definition The minimum airflow that will be delivered by a terminal unit before reheating occurs

Units Unitless fraction of airflow (cfm) or specific airflow (cfm/ft²)

Input Restrictions This input must be greater than or equal to the outside air ventilation rate.

Standard Design For systems 5 and 6 set the minimum airflow to be the greater 20% of the peak supply air volume to the zone or the outside air ventilation rate from Table 120.1-A, Section 120.1(e) of the Standards.

For laboratories, the minimum airflow fraction shall be fixed at ~~1 (100% outside air)~~a value equivalent to 6 ACH.

Terminal Heating Control Type

Applicability VAV boxes with reheat

Definition The control strategy for the heating mode.

Single Maximum

In the single maximum control mode, the airflow is set to a minimum constant value in both the deadband and heating mode. This airflow can vary but is typically 30 to 50 percent of maximum. This control mode typically has a higher minimum airflow than the minimum used in the dual maximum below, resulting in more frequent reheat.

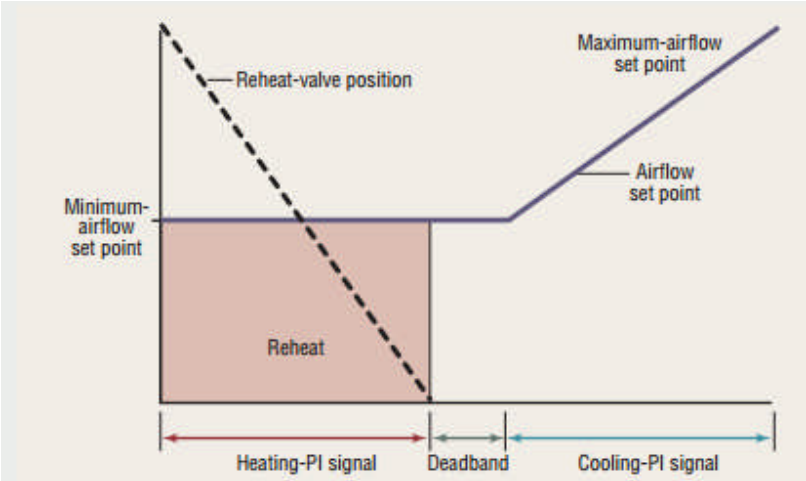

Single Maximum VAV Box Control

Courtesy: Taylor Engineering

Dual Maximum: raises the SAT as the first stage of heating, and increases the airflow to the zone as the second stage of heating.

1. The first stage of heating consists of modulating the zone supply air temperature setpoint up to a maximum setpoint no larger than 95ºF while the airflow is maintained at the dead band flow rate.

2. The second stage of heating consists of modulating the airflow rate from the dead band flow rate up to the heating maximum flow rate (50% of design flow rate).

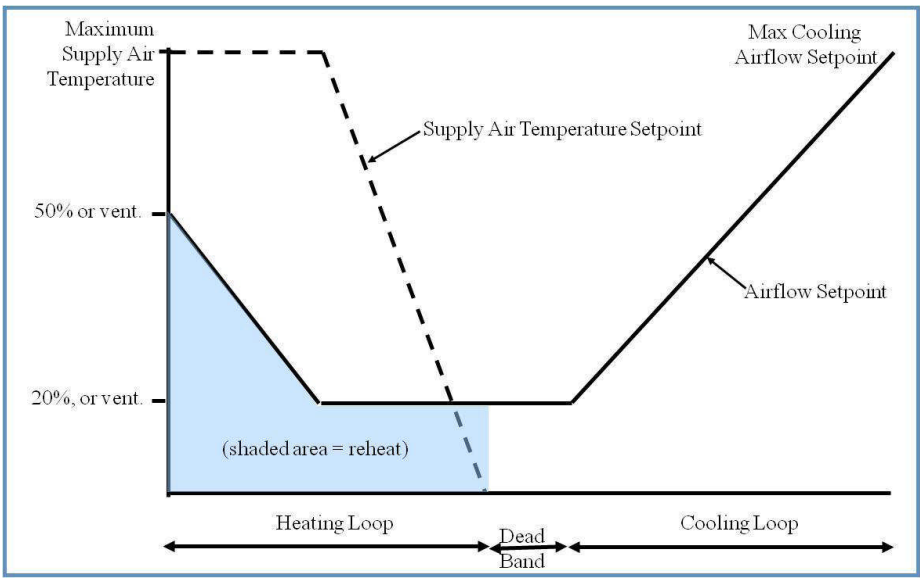

Figure 11~~6~~ – Dual Maximum Control Sequence

Units	List:
	Single Maximum
	Dual Maximum
Input Restrictions	Fixed at Single Maximum if Control System Type is not *DDC Control to the Zone Level*
Standard Design	Dual Maximum

5.6.5.2 Fan Powered Boxes

Fan Powered Box Type	
Applicability	~~HVAC~~ thermal zones that have fan powered boxes
Definition	Defines the type of fan-powered induction box. This is either: • Series; or • Parallel
Units	List (see above)
Input Restrictions	As designed
Standard Design	Not applicable

Fan Power	
Applicability	~~HVAC~~ thermal zones that have fan powered boxes
Definition	The rated power input of the fan in a fan-powered box.

Units	W or W/cfm
Input Restrictions	As designed
Standard Design	Not applicable

Fan Powered Box Induced Air Zone

Applicability	~~HVAC~~ thermal zones that have fan powered boxes
Definition	Zone from which a series or parallel fan-powered box draws its air
Units	List (of zones)
Input Restrictions	As designed
Standard Design	Not applicable

Parallel PIU Induction Ratio

Applicability	~~HVAC~~ thermal zones that have fan powered boxes
Definition	The ratio of induction-side airflow of a fan-powered box at design heating conditions to the primary airflow
Units	Ratio
Input Restrictions	As designed
Standard Design	Not applicable

Parallel Fan Box Thermostat Setpoint

Applicability	~~HVAC~~ thermal zones that have parallel fan powered boxes
Definition	The temperature difference above the heating setpoint at which the parallel fan is turned on
Units	Degrees Fahrenheit (°F)
Input Restrictions	2°F above the heating setpoint schedule
Standard Design	Not applicable

5.6.5.3 Zone Exhaust

This group of building descriptors describes the rate of exhaust and the schedule or control for this exhaust. An exhaust system can serve one thermal zone or multiple thermal zones. Energy is summed for the exhaust system level, not the thermal zone level.

This section also contains unique inputs for kitchen exhaust systems that must meet requirements of section 140.9 of the Standards.

Kitchen Exhaust Hood Length

Applicability	Exhaust fans in spaces of type Kitchen
Definition	The exhaust hood length
Units	ft
Input Restrictions	As designed
Standard Design	

	Same as the proposed design

Kitchen Exhaust Hood Style

Applicability	Exhaust fans in spaces of type Kitchen
Definition	The hood style as defined in Table 140.9-A of the Standards
Units	List: Wall-mounted canopy, Single Island, Double Island, Eyebrow, Backshelf/Passover
Input Restrictions	As designed
Standard Design	Same as the proposed design

Kitchen Exhaust Hood Cooking Duty

Applicability	Exhaust fans in spaces of type Kitchen
Definition	The hood cooking duty as defined in Table140.9-A of the Standards
Units	List: Light Duty, Medium Duty, Heavy Duty, Extra Heavy Duty
Input Restrictions	As designed
Standard Design	Same as the proposed design

Exhaust Fan Name

Applicability	All ~~HVAC~~ thermal zones
Definition	A reference to an exhaust fan system that serves the thermal zone
Units	Text or other unique reference to an exhaust fan system defined in the secondary systems section.
Input Restrictions	As designed
Standard Design	Same as the proposed design

Laboratory Exhaust Rate Type

Applicability	All laboratory zones
Definition	The type of load that dictates lab exhaust rate requirements
Units	List, either:
	Hood dominated
	Load dominated
Input Restrictions	As designed
Standard Design	Same as the proposed design

Exhaust Air Flow Rate

Applicability	All ~~HVAC~~ thermal zones
Definition	Rate of exhaust from a thermal zone
Units	cfm
Input Restrictions	

As designed for non-process zones

For laboratory zones, the exhaust air flow rate is prescribed:

15 ACH for hood dominated spaces, or

6 ACH for load dominated spaces

Standard Design Same as the proposed design for zones that are not of space type Kitchen. For kitchen space types, the baseline is a function of the Kitchen Exhaust Hood Length, Kitchen Exhaust Hood Style and Kitchen Exhaust Hood Cooking Duty, and is determined by Table 140.9-A.

Exhaust Minimum Air Flow Rate

Applicability All laboratory zones

Definition Rate of exhaust from a zone

Units cfm

Input Restrictions As designed for non-process zones

For laboratory zones, the exhaust air flow rate is the maximum of the hood scheduled exhaust air flow rate and the minimum ventilation rate

Standard Design For laboratory systems, the exhaust minimum air flow rate is the maximum of the hood scheduled exhaust flow rate and 6 ACH, the minimum ventilation rate

Exhaust Fan Schedule

Applicability All ~~HVAC~~ thermal zones

Definition Schedule indicating the pattern of use for exhaust air from the thermal zone. This input should consider the position of fume hood sash opening. For toilets and other exhaust applications, the schedule may coincide with the operation of the exhaust fan system.

Units Data structure: schedule, fraction

Input Restrictions As designed for non-process spaces

Commen VAV) and match App

For laboratory spaces, if the hoods are constant volume the schedule shall be fixed at 0.90 for all hours of the year (24/7).

For laboratory spaces, if the hoods are variable volume the schedule shall be prescribed at:

Hour	1-6	7	8	9	10	11	12	13	14	15	16	17	18	19	20-24
Fraction	0.2	0.3	0.4	0.5	0.7	0.8	0.2	0.5	0.7	0.9	0.8	0.5	0.4	0.3	0.2

Standard Design Same as the proposed design for non-process spaces

For kitchen exhaust systems with a flow rate exceeding 5,000 cfm, the standard design schedule shall be as follows:

Hour	1-6	7-9	10	11	12	13	14	15	16	17	18	19	20-24

Fraction	0.0	0.5	1.0	0.5	1.0	0.5	1.0	0.5	1.0	0.5	1.0	0.5	0.0

For laboratory spaces, the hood exhaust schedule shall be prescribed at:

Hour	1-6	7	8	9	10	11	12	13	14	15	16	17	18	19	20-24
Fraction	0.2	0.3	0.4	0.5	0.7	0.8	0.2	0.5	0.7	0.9	0.8	0.5	0.4	0.3	0.2

5.6.5.4 Outdoor Air Ventilation

Ventilation Source

Applicability All ~~HVAC~~ thermal zones

Definition The source of ventilation for an HVAC system. The choices are:

- Natural (by operable openings)
- Forced (by fan)

Units List: natural or forced

Input Restrictions For residential units and hotel/motel guest rooms, as designed. For all other occupancies, set to forced.

Standard Design For residential units, set to natural, for all other occupancies, set equal to the value for the proposed design.

Design Ventilation Rate

Applicability All ~~HVAC~~ thermal zones

Definition The quantity of ventilation air that is provided to the space for the specified thermal zone at maximum occupancy

Units cfm or cfm/occupant

Input Restrictions As designed, but not lower than code minimum (default value).

~~For both compliance and reach, the~~The default value shall be the larger of 15 cfm times the design occupancy from Appendix 5.4A or the conditioned floor area times the applicable ventilation rate from Appendix 5.4A or Table 120.1-A of the Standards.
.

Standard Design The standard design outside air ventilation rate shall be the larger of 15 cfm times the design occupancy from Appendix 5.4A, or the conditioned floor area of the space times the applicable ventilation rate in Appendix 5.4A or Table 120.1-A of the Standards.

Minimum Ventilation Rate

Applicability All ~~HVAC~~ thermal zones

Definition The minimum quantity of ventilation air that must be provided to the space when it is

occupied

Units cfm or cfm/ft²

Input Restrictions As designed, but not lower than code minimum (default value). The default value shall be the larger of 15 cfm times the design occupancy from Appendix 5.4A or the conditioned floor area times the applicable ventilation rate from Appendix 5.4A or Table 120.1-A of the Standards.

Standard Design For spaces ~~with~~ where demand control ventilation ~~or occupancy sensors~~is required, the minimum ventilation rate is specified by the greater of the rate in Table 120.1-A or 15 cfm times the scheduled occupancy for that hour;

For systems serving laboratories, the airflow minimum for each lab space ~~shall match those mandated by the Authority Having Jurisdiction~~shall be 6 ACH.

Commen
review doc

For systems serving kitchens, the minimum outside air ventilation rate is the exhaust air ventilation rate minus available transfer air (available transfer shall be calculated from the building minimum outside airflow less any exhaust airflows other than kitchen exhausts) and minus 0.05 cfm/ft^2 for exfiltration

for all other spaces, the minimum ventilation rate is the same as the design ventilation rate in the standard design.

Ventilation Control Method

Applicability All ~~HVAC~~ thermal zones

Definition The method used to determine outside air ventilation needed for each hour in the simulation. This information is reported to the system serving the zone. The method of controlling outside air at the system level in response to this information is discussed under secondary systems. Options at the zone level are:

- Occupant sensors: When the space is occupied, the outside air requirement is equal to the *design ventilation rate*; otherwise, the outside air requirement is the *minimum ventilation rate*.
- CO_2 sensors in the space: The outside air is varied to maintain a maximum CO_2 concentration in the space. This shall be approximated by multiplying the ventilation rate per occupant times the number of occupants for that hour. (When turnstile counts are used to automatically adjust ventilation levels based on occupancy, this method may also be used.)
- Fixed ventilation rate. Outside air is delivered to the zone at a constant rate and is equal to the design ventilation rate (see above).

Commen
work, sinc
to 0 during

Units List (see above)

Input Restrictions As designed

Standard Design For Title 24 compliance, if the design occupancy is greater than 25 persons per 1,000 ft² , ~~the proposed design has DDC to the zone level~~ and the system is a multizone system or a single zone system with any controls and an outside air economizer, set control method to *CO_2 sensors in the space*, otherwise set to *fixed ventilation rate*.

5.7 HVAC Secondary Systems

This group of building descriptors relate to the secondary HVAC systems. There is not a one-to-one relationship between secondary HVAC system components in the proposed design and the baseline building since the baseline building system is determined from building type, size and heating source. Where the Standard Design for a building descriptor varies with the standard design HVAC system selection, the baseline is specified as a table with the applicable value for each of the 11 baseline systems. ~~The eight baseline building systems are shown as columns in . The building descriptors are shown as rows and the check marks "✓" indicate that the building descriptor applies for the baseline building system. Depending on the nature of the proposed design, any of the building descriptors could apply.~~

The HVAC baseline systems are described in the summary tables below for reference. The details of individual building descriptor definitions can be found in section 5.7.1 and in subsections under ~~subsequent sections~~ 5.7~~ and 5.8~~.

Table 16~~15~~ – System #1 ~~and System #2~~ Description~~s~~

System Description:	Packaged Terminal Air Conditioner (#1) ~~or Packaged Terminal Heat Pump (#2)~~
Supply Fan Power:	N/A (fan power integral to unit efficiency), ventilation provided naturally through operable windows
Supply Fan Control:	Constant volume
Min Supply Temp:	50 ≤ T ≤ 60 DEFAULT: 20F below return air temperature
Cooling System:	Direct expansion (DX)
Cooling Efficiency:	Minimum SEER or EER based on equipment type and output capacity of ~~proposed~~ standard design unit(s). Adjusted EER is calculated to account for supply fan energy.
Maximum Supply Temp:	85 ≤ T ≤ 110 DEFAULT: 100
Heating System:	Gas furnace (#3) or heat pump (#4)
Heating Efficiency:	Minimum AFUE, Thermal Efficiency, COP or HSPF based on equipment type and output capacity of ~~proposed~~ standard design unit(s).
Economizer:	None
Ducts:	N/A (unducted)

Table 17 – System #2 Description

System Description:	Four-Pipe Fan Coil (#2)
Supply Fan Power:	0.35 W/cfm
Supply Fan Control:	Constant volume
Min Supply Temp:	50 < T < 60 DEFAULT: 20F below return air temperature
Cooling System:	Chilled water
Cooling Efficiency:	Minimum kW/ton and IPLV per Path B chiller requirements in Title 24 Section 110.2
Maximum Supply Temp:	85 < T < 110 DEFAULT: 100
Heating System:	Boiler
Heating Efficiency:	Minimum AFUE, Thermal Efficiency per Section 110.2 of Title 24 Part 6 for the applicable heating capacity
Economizer:	None
Ducts:	N/A (unducted)

Table 18~~16~~ – System #3 ~~and System #4~~ Description~~s~~

System Description:	Packaged Single Zone with Gas Furnace/Electric Air Conditioning (#3) ~~or Heat Pump (#4)~~
Supply Fan Power:	See Section 5.7.3
Supply Fan Control:	Constant volume
Min Supply Temp:	50 ≤ T ≤ 60 DEFAULT: 20F below return air temperature
Cooling System:	Direct expansion (DX)
Cooling Efficiency:	Minimum SEER or EER based on equipment type and output capacity of ~~proposed~~ standard design unit(s). Adjusted EER is calculated to account for supply fan energy.
Maximum Supply Temp:	85 ≤ T ≤ 110 DEFAULT: 100
Heating System:	Gas furnace (#3) or heat pump (#4)
Heating Efficiency:	Minimum AFUE, Thermal Efficiency, COP or HSPF based on equipment type and output capacity of ~~proposed~~ standard design unit(s).
Economizer:	**Integrated economizer** with dry-bulb high limit by climate zone, when mechanical cooling output capacity of the ~~proposed~~ standard design as modeled in the compliance run by the compliance software is over ~~65~~54,000 Btu/hr ~~and fan system volumetric capacity of the proposed design as modeled in the compliance run by the compliance software is over 2500 cfm~~
Ducts:	For ducts installed in unconditioned buffer spaces or outdoors as specified in §140.4(l), the duct system

efficiency shall be as modified by accounting for duct leakage rate, insulation level and the duct surface area in unconditioned space or outdoors; see applicable building descriptors.

Table 19~~17~~ – System #5 Description

System Description:	Packaged VAV with Boiler and Reheat
Supply Fan Power:	See Section 5.7.3
Supply Fan Control:	Individual VAV supply fan with less than 10 hp: VAV - forward curved fan with discharge damper Individual VAV supply fan greater than or equal to 10 hp: VAV - variable speed drive
Return Fan Control:	Same as supply fan
Minimum Supply Temp:	50 ≤ T ≤ 60 DEFAULT: 20F below return air temperature
Cooling System:	Direct expansion (DX)
Cooling Efficiency:	Minimum efficiency based on average ~~proposed~~ standard design output capacity of equipment unit(s)
Maximum Supply Temp:	90 ≤ T ≤ 110 DEFAULT: 105
Heating System:	Gas boiler
Hot Water Pumping System	Variable flow (2-way valves) riding the pump curve
Heating Efficiency:	Minimum efficiency based on average ~~proposed~~ standard design output capacity of equipment unit(s)
Economizer:	Integrated dry bulb economizer, when mechanical cooling output capacity of the ~~proposed~~ standard design as modeled in the compliance run by the compliance software is over ~~75~~54,000 Btu/hr ~~and fan system volumetric capacity of the proposed design as modeled in the compliance run by the compliance software is over 2500 cfm~~

Table 20~~18~~ – System #6 Description

System Description:	Chilled Water VAV With Reheat
Supply Fan Power:	See Section 5.7.3
Supply Fan Control:	Individual VAV supply fan with less than 10 hp:: VAV - forward curved fan with discharge damper Individual VAV supply fan with greater than or equal to 10 hp: VAV - variable speed drive
Return Fan Control:	Same as supply fan
Minimum Supply Temp:	50 ≤ T ≤ 60 DEFAULT: 20F below return air temperature
Cooling System:	Chilled water
Chilled Water Pumping System	Variable flow (2-way valves) with a VSD on the pump if three or more fan coils or air handlers. Constant volume flow with water temperature reset control if less than three fan coils or air handlers. Reset supply pressure by demand if ~~proposed~~ standard system has DDC controls.
Cooling Efficiency:	Minimum efficiency based on ~~average proposed~~ standard design output capacity of equipment unit(s)
Maximum Supply Temp:	90 ≤ T ≤ 110 DEFAULT: 105
Heating System:	Gas boiler
Hot Water Pumping System	Variable flow (2-way valves) riding the pump curve if three or more fan coils or air handlers. Constant volume flow with water temperature reset control if less than three fan coils or air handlers. Reset supply pressure by demand ~~if proposed system has DDC controls~~.
Heating Efficiency:	Minimum efficiency based on ~~average proposed~~ standard design output capacity of equipment unit(s)
Economizer:	Integrated dry bulb economizer, when mechanical cooling output capacity of the ~~proposed~~ standard design as modeled in the compliance run by the compliance software is over ~~75~~54,000 Btu/hr ~~and fan system volumetric capacity of the proposed design as modeled in the compliance run by the compliance software is over 2500 cfm~~

Table 21~~19~~ – System #7~~,8~~ Description

System Description:	Single-zone VAV System
Supply Fan Power:	See Section 5.7.3
Supply Fan Control	Variable-speed drive
Minimum Supply Temp:	50 ≤ T ≤ 60 DEFAULT: 20F below return air temperature
Supply Temp Control:	Supply temperature setpoint reset up 5°F on low cooling stage. Supply air temperature setpoint shall be linearly reset from minimum at 50% cooling load and above to maximum at 0% cooling load. Fan volume shall be linearly reset from 100% air flow at 100% cooling load to minimum air flow at 50% cooling load and below. Minimum fan volume setpoint shall be 50%. (this is effectively an "airflow first" sequence")
Cooling System:	Direct expansion
Cooling Efficiency:	Minimum efficiency based on the ~~proposed~~ standard output capacity of specific equipment unit(s)
Cooling Stages:	Two, with 50% total capacity at low cooling stage
Maximum Supply Temp:	90 ≤ T ≤ 110 DEFAULT: 100
Heating System:	Gas furnace
Hot Water Pumping System	Variable flow (2-way valves) riding the pump curve if three or more fan coils. Constant volume flow with water temperature reset control if less than three fan coils. Reset supply pressure by demand if ~~proposed~~ standard system has DDC controls.
Heating Efficiency:	Minimum efficiency based on the ~~proposed~~ standard output capacity of specific equipment unit(s)
Economizer:	Integrated dry bulb economizer with dry-bulb high limit based on climate zone

Table 22~~20~~ – System #9 Description

System Description:	Heating and ventilation only system
Supply Fan Power:	See fan power details
Supply Fan Control	Constant Volume
Minimum Supply Temp:	N/A
Cooling System:	None
Cooling Efficiency:	N/A
Maximum Supply Temp:	90 ≤ T ≤ 110 DEFAULT: 100
Heating System:	Gas furnace
Hot Water Pumping System	N/A
Heating Efficiency:	Minimum efficiency based on the ~~proposed~~ standard output capacity of specific equipment unit(s)
Economizer:	TBD

Table 23~~21~~ – System #10 Description

System Description:	Computer room air handler (CRAH)
Supply Fan Power:	See fan power details; 0.49 W/cfm baseline
Supply Fan Control	variable speed drive. Fan power ratio at part load = speed ratio ^3 (e.g. 12.5% of design power at 50% speed).
Minimum Supply Temp:	60F
Cooling System:	Chilled water
Cooling Efficiency:	Same as System #6 (Built-up VAV)
Maximum Supply Temp:	80
Heating System:	None
Economizer:	TBD
Supply Temp Control:	Supply air temperature setpoint shall be linearly reset from minimum at 50% cooling load and above to maximum at 0% cooling load. Fan volume shall be linearly reset from 100% air flow at 100% cooling load to minimum air flow at 50% cooling load and below. Minimum fan volume setpoint shall be 50%. (this is effectively an "airflow first" sequence")

Table 2422 – System #11 Description

System Description:	Computer room air conditioner (CRAC)
Supply Fan Power:	0.49 W/cfm at design flow (see equipment sizing) where economizer is required, 0.39 W/cfm where economizer is not required.
Supply Fan Control	Constant speed if total cooling capacity for the room < = 5 tons, otherwise: variable speed drive. Fan power ratio at part load = speed ratio ^3 (e.g. 12.5% of design power at 50% speed).
Return Fan Control:	No return fans
Minimum Supply Temp:	60F
Cooling System:	Air-cooled DX
Cooling Capacity:	Equipment sizing CFM and cooling capacity sized at 120% of the calculated room load. One fan system per room.
Cooling Efficiency:	Minimum packaged air conditioner efficiency based on calculated total cooling capacity for each room ● If cooling capacity > 20 tons then use 10 ton min efficiency ● If cooling capacity <20 tons then use capacity/2 min efficiency
Maximum Supply Temp:	80
Heating System:	None
Economizer:	No economizer if total cooling capacity for the room < 5 tons and building does not have any economizers, otherwise: Integrated differential dry bulb economizer
Supply Temp Control:	**VAV:** Supply air temperature setpoint shall be linearly reset from minimum at 50% cooling load and above to maximum at 0% cooling load. Fan volume shall be linearly reset from 100% air flow at 100% cooling load to minimum air flow at 50% cooling load and below. Minimum fan volume setpoint shall be 50%. (this is effectively an "airflow first" sequence") **CV:** supply air temperature setpoint modulates to meet the load.

5.7.1 Basic System Information

HVAC System Name

Applicability All system types

A unique descriptor for each HVAC System

Units Text, unique

Input Restrictions When applicable, this input should match the tags that are used on the plans.

Standard Design None

System Type

Applicability All system types

Definition A unique descriptor which identifies the following attributes of an HVAC System:

- Number of air decks (one to three);
- Constant or variable air flow;
- Type of terminal device; and
- Fan configuration for multiple deck systems.

Units List from the choices below

Input Restrictions List

PTAC – Packaged Terminal Air Conditioner

PTHP – Packaged Terminal Heat Pump

PSZ-AC – Packaged Single Zone

PSZ-HP – Packaged Single Zone Heat Pump

PVAV – Packaged VAV with Reheat

VAV – VAV with Reheat

PSZVAV – Single Zone VAV

PSZVAVHP – Single Zone VAV Heat Pump

HV – Heating and Ventilation Only

CRAC – Computer Room Air Conditioner

CRAH – Computer Room Air Handler

FPFC – Four-pipe fan coil

DFDD – Dual-fan dual duct

RADFLR – Radiant floor heating and cooling

~~CHB – Chilled beam~~

~~UFAD – Underfloor air distribution~~

~~DV – displacement ventilation~~

WSHP – water-source heat pump

~~GSHP – ground source heat pump~~

~~VRF – variable refrigerant flow~~

Standard Design Based on the prescribed system type in the HVAC system map (see ~~*Table 6 – HVAC System Descriptions*~~). The baseline system types are shown in the table below.

Field Coc

Table 25~~23~~ – Baseline Building System Type

Baseline Building System Type
System 1 – PTAC
System 2 – FPFC
System 3 – PSZ-AC
System 5 – Packaged VAV with Reheat
System 6 – VAV with Reheat
System 7 – PSZ-SZVAV
System 9 – Heating and Ventilation
System 10 – CRAC Unit
System 11 – CRAH Unit
System 12 – LAB
System 13 – Kitchen

Air Distribution Type

Applicability All system types

Definition Type of air distribution system that is coupled with the HVAC system. The choices are (overhead) mixing ventilation system, underfloor air distribution system (UFAD), and displacement ventilation system (DV).

Units	List: Mixing, UFAD, DV
Input Restrictions	As designed
Standard Design	Mixing

Thermal zone List

Applicability	All system types
Definition	Comprehensive list of all thermal zones served by a given HVAC system.
Units	None
Standard Design	Same as the proposed design
Input Restrictions	As designed

Total Cooling Capacity

Applicability	All system types
Definition	The installed cooling capacity of the project. This includes all: • Chillers; • Built-up DX; and, • Packaged cooling units.
Units	Cooling tons (12,000 Btu/h per ton)
Input Restrictions	As designed. This could be calculated by the program from the proposed design building description or a separate load calculation may be used. Unmet load hours for the simulation shall not exceed ~~300~~ 150 annually. Weather conditions used in sizing runs shall be based on 0.5% dry-bulb and 1% wet-bulb cooling design temperatures.
Standard Design	Autosize. The cooling capacity shall be oversized by 15%. If the number of unmet load hours exceeds ~~300~~150, increase the cooling capacity according to the procedures in Chapter 2.

5.7.2 System Controls

5.7.2.1 Control System Type

Control System Type

Applicability	All ~~buildings~~HVAC systems that serve more than one control zone, as well as the hydronic systems that serve building HVAC systems.
Definition	The type of control system for ~~the building~~multizone HVAC systems and their related equipment. This input affects ~~baseline~~ the proposed design system specification for zone level controls, supply air temperature reset controls, ventilation controls and fan and pump static pressure part-load curves. See the following building descriptors: Ventilation Control Method Terminal Heating Control Type Pump Part-Load Curve Fan Part-load Curve

Units	None
Input Restrictions	List: can be one of the following inputs DDC Control to the Zone Level – direct digital control systems with control to the zone level Other – other control systems, including pneumatic and DDC systems without control to the zone level
Standard Design	DDC Control to the Zone Level

5.7.2.2 Schedules

Cooling Schedule	
Applicability	All cooling systems
Definition	A schedule that represents the availability of cooling
Units	Data structure: schedule, on/off
Input Restrictions	~~For California Compliance and Reach calculations, the fan schedules from Appendix 5.4B shall be used as a default for cooling availability. When schedules other than the default values are used, supporting documentation shall be required. The cooling availability schedule shall be consistent with the supply fan schedule and thermostat schedules to reduce the likelihood of unmet load hours.~~ Schedule Group is prescribed in Appendix 5.4A and schedule values are prescribed in Appendix 5.4B. See Section 2.3.3 on how software shall assign schedules when the spaces served by the system are assigned to different schedule groups in Appendix 5.4A.
Standard Design	Same as the proposed design

Heating Schedule	
Applicability	All systems
Definition	A schedule that represents the availability of heating
Units	Data structure: schedule, on/off
Input Restrictions	Schedule Group is prescribed in Appendix 5.4A and schedule values are prescribed in Appendix 5.4B. See Section 2.3.3 on how software shall assign schedules when the spaces served by the system are assigned to different schedule groups in Appendix 5.4A. ~~For California Compliance and Reach calculations, the schedules from Appendix 5.4B shall be used as a default. When schedules other than the default values are used, supporting documentation shall be required. The heating availability schedule shall be consistent with the supply fan schedule.~~
Standard Design	Same as the proposed design

Air-Handler Schedule	
Applicability	All systems that do not cycle with loads
Definition	A schedule that indicates when the air handler operates continuously
Units	Data structure: schedule, on/off
Input Restrictions	

Schedule Group is prescribed in Appendix 5.4A and schedule values are prescribed in Appendix 5.4B. See Section 2.3.3 on how software shall assign schedules when the spaces served by the system are assigned to different schedule groups in Appendix 5.4A.

~~For the purpose of Compliance and Reach calculations, the fan schedule is defaulted to the applicable schedule from Appendix 5.4B. One of the schedules from Appendix 5.4B, shall be used as a default. When schedules other than the default values are used, supporting documentation shall be required.~~

When a fan system serves several occupancies, the fan schedule must remain ON to serve the operating hours of each occupancy.

Standard Design Same as the proposed design

Air Handler Fan Cycling

Applicability All fan systems

Definition This building descriptor indicates whether the system supply fan operates continuously or cycles with building loads. The fan systems in most commercial buildings operate continuously.

Units List: Continuous or Cycles with loads

Input Restrictions Continuous fan operation during occupied periods is a prescribed input

For natural ventilation systems, an air conditioner is modeled in the proposed design even though one is not specified for the proposed design. In this case, the air handler control is *Cycles with loads*. .

Standard Design Same as proposed design

Optimal Start Control

Applicability Systems with the control capability for flexible scheduling of system start time based on building loads.

Definition Optimal start control adjusts the start time of the HVAC unit such that the space is brought to setpoint just prior to occupancy. This control strategy modifies the heating, cooling, and fan schedules.

Units Boolean (Yes/No)

Input Restrictions No (not allowed)

Standard Design Not applicable

Night-Cycle HVAC Fan Control

Applicability All systems

Definition The control of an HVAC system that is triggered by the heating or cooling temperature setpoint for thermal zones during periods when the heating, cooling and fan systems are scheduled to be off. For this control, the space is controlled to the setback or setup temperature only; this control is not equivalent to a night purge control. The choices are:

- Cycle on call from any zone
- Cycle on call from the primary control zone
- Stay off

- Cycle zone fans only (for systems with fan-powered boxes) Restart fans below given ambient temperature.

Units None

Input Restrictions ~~As designed. Outside air dampers are set to closed during night-cycle control~~Prescribed value: Cycle on call from any zone.

Standard Design ~~Same as proposed~~Cycle on call from any zone

5.7.2.3 Cooling Control

Cooling Supply Air Temperature

Applicability Applicable to all systems

Definition The supply air temperature setpoint at design cooling conditions

Units Degrees Fahrenheit (°F)

Input Restrictions As designed

Standard Design 15F below the space temperature setpoint for interior zones; for all other zones, 20°F below the space temperature setpoint

Cooling Supply Air Temperature Control

Applicability Any cooling system

Definition The method of controlling the supply air temperature. Choices are:

- Fixed (constant)
- Reset by warmest zone
- Reset by outside air dry-bulb temperature
- Scheduled setpoint
- Staged setpoint (for Single Zone VAV and DX with multiple stages)

Units List (see above)

Input Restrictions

Standard Design For baseline building systems 1 through 4 and 11, the SAT control is fixed. For systems 5 through 8 and 10, the SAT control shall be reset by warmest zone. For system 9 (heating and ventilation) this input is not applicable.

Cooling Reset Schedule by OSA

Applicability When the proposed design resets SAT by outside air dry-bulb temperature

Definition A linear reset schedule that represents the SAT setpoint as a function of outdoor air dry-bulb temperature. This schedule is defined by the following data points (see Figure 12~~Figure 7~~):

- The coldest cooling supply air temperature
- The corresponding (hot) outdoor air dry-bulb setpoint
- The warmest cooling supply air temperature

- The corresponding (cool) outdoor air dry-bulb setpoint

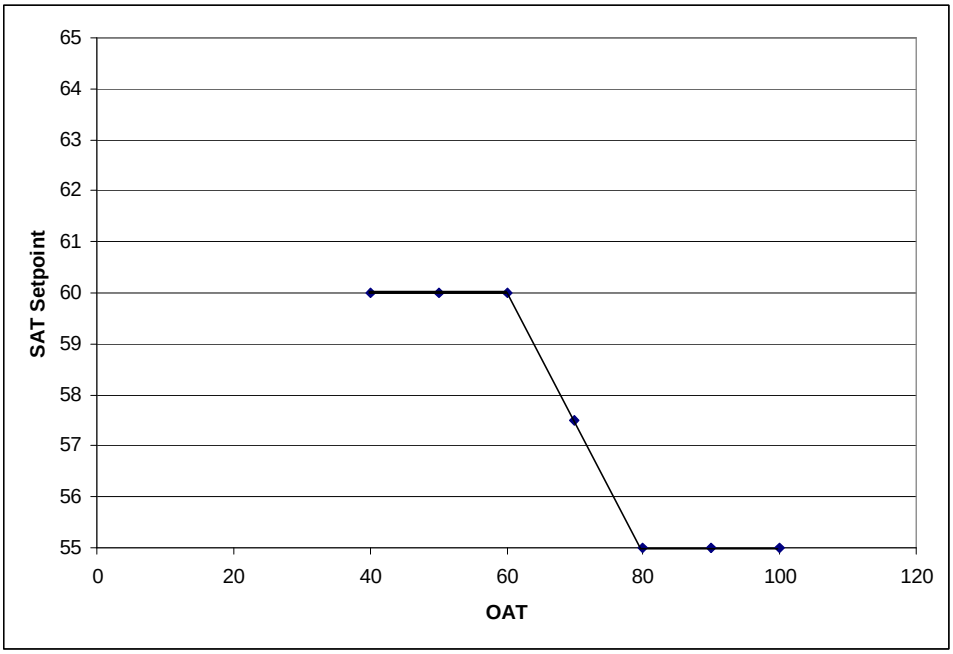

Figure 127 – SAT Cooling Setpoint Reset based on Outdoor Air Temperature (OAT)

Units	Data structure (two matched pairs of SAT and OAT, see above)
Input Restrictions	As Designed. For California Compliance and Reach, the schedule defaults to: Supply Air High = Supply Air Low + 5 Supply Low = (greater of SAT and 50F) Outside High = 80°F Outside Low = 60°F
Standard Design	Applicable for baseline building systems 5 and 6. For these systems, the minimum SAT shall be equal to the design conditions SAT when OAT is equal to or greater than 80 F. The maximum SAT shall be 5 F greater than the minimum when the OAT is 60 F or less.

5.7.2.4 Heating Control

Preheat Setpoint	
Applicability	Systems with a preheat coil located in the outside air stream
Definition	The control temperature leaving the preheat coil
Units	Degrees Fahrenheit (°F)
Input Restrictions	

	As designed
Standard Design	Not Applicable

Heating Supply Air Temperature

Applicability	All systems
Definition	The supply air temperature leaving the air handler when the system is in a heating mode (not the air temperature leaving the reheat coils in VAV boxes)
Units	Degrees Fahrenheit (°F)
Input Restrictions	As designed
Standard Design	105°F for system types 1-4; 70°F for system types 5 and 6; except 80°F for systems serving data centers

Heating Supply Air Temperature Control

Applicability Systems with the capability to vary heating SAT

Definition The method of controlling heating SAT. Choices are:

- Fixed (constant)
- Reset by coldest zone
- Reset by outside air dry-bulb temperature
- Scheduled setpoint

Units	Degrees Fahrenheit (°F)
Input Restrictions	As designed
Standard Design	Fixed (constant)

Heating Reset Schedule by OSA

Applicability Systems that reset the heating SAT by outside dry-bulb temperature (this typically applies to dual-duct systems or to single zone systems with hydronic heating coils)

Definition A linear reset schedule that represents the heating supply air temperature or hot deck supply air temperature (for dual duct systems) as a function of outdoor air dry-bulb temperature. This schedule is defined by the following data points (see Figure 13~~Figure 8~~):

- The hottest heating supply air temperature
- The corresponding (cold) outdoor air dry-bulb threshold
- The coolest heating supply air temperature
- The corresponding (mild) outdoor air dry-bulb threshold

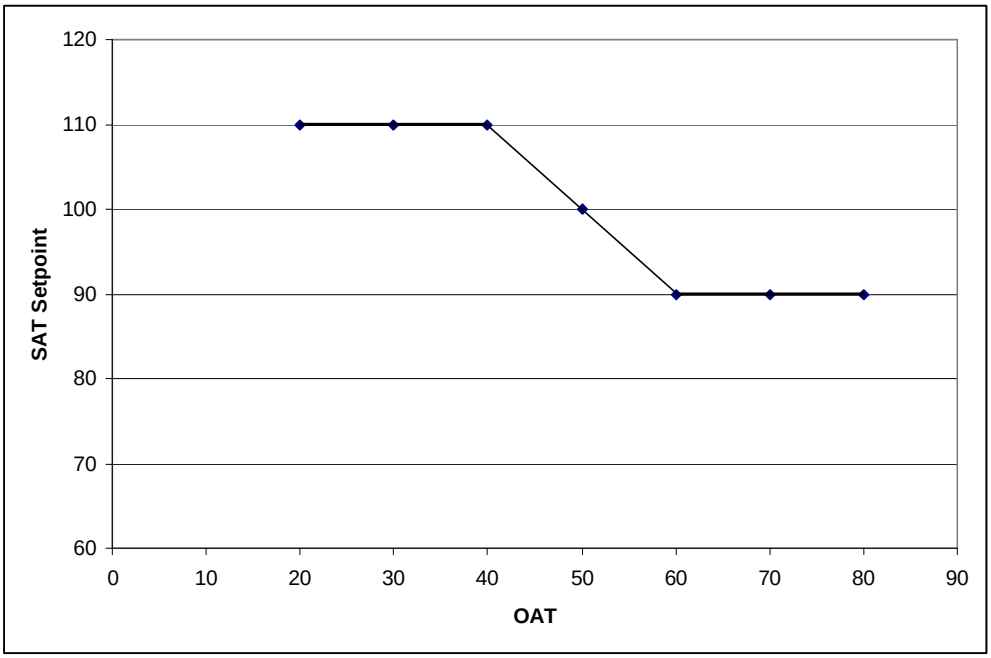

Figure 13~~8~~ – Example of SAT heating setpoint reset based on outdoor air temperature (OAT).

Units	Data structure (°F)
Input Restrictions	As designed
Standard Design	Not applicable

5.7.2.5 Night Purge

Night purge controls are not allowed for Title 24 compliance or reach.

Night Purge Availability Schedule	
Applicability	Systems that operate the fans for nighttime purge of heat gains
Definition	A schedule which represents the availability of night purge controls.
Units	Data structure: schedule, on/off
Input Restrictions	Not applicable
Standard Design	Not applicable

Night Purge Control	
Applicability	Systems that operate the fans for nighttime purge of heat gains
Definition	The control strategy for operation of nighttime purge. The control strategy may take account of indoor temperature, season, indoor temperature and other factors.
Units	Data structure
Input Restrictions	Not applicable (Night Purge Control is not allowed in the model)
Standard Design	Not applicable

Night Purge Fan Ratio

Applicability	Systems that operate the fans for nighttime purge of heat gains
Definition	The ratio of fan speed for a night purge cycle.
Units	Ratio
Input Restrictions	Not applicable
Standard Design	Not applicable

5.7.3 Fan Systems

5.7.3.1 Baseline Building Fan System Summary

The baseline building fan system is summarized in this section. See Section 5.7, Table 5 for the HVAC baseline building system mapping.

Total baseline building fan system power for the baseline building fan systems is given in the following section. This brake horsepower includes the supply fan, the return fan, and exhaust fans. Exhaust fans include kitchen hoods, toilets, fume hoods, and other miscellaneous fans that operate at design conditions.

When the proposed design has exhaust fans (toilets or kitchens), or fume hood exhaust systems, the baseline building has the same systems.

Table 26~~24~~ – Building Descriptor Applicability for Fan Systems

Inputs	Supply Fan	Return/Relief Fan	Exhaust Fans (Hoods)
Modeling Method	✓	Same as supply	✓
Air Rated Capacity	✓	✓	✓
Plenum Zone	X	✓	X
Return Air Path	X	✓	X
Fan Control Method	✓	Same as supply	✓
Brake Horsepower	✓	✓	✓
Static Pressure	✓	✓	✓
Fan Efficiency	✓	✓	✓
Motor Efficiency	✓	✓	✓
Fan Position	✓	X	X
Motor Position	✓	✓	X
Part-Load Power Curve	✓	✓	✓
Fan KW	✓	✓	✓

5.7.3.2 Supply Fans

Fan System Modeling Method

Applicability	All fan systems
Definition	Software commonly models fans in three ways. The simple method is for the user to

enter the electric power per unit of flow (W/cfm). This method is commonly used for unitary equipment and other small fan systems. A more detailed method is to model the fan as a system whereby the static pressure, fan efficiency, part-load curve, and motor efficiency are specified at design conditions. A third method is to specify brake horsepower at design conditions instead of fan efficiency and static pressure. This is a variation of the second method whereby brake horsepower is specified in lieu of static pressure and fan efficiency. The latter two methods are commonly used for VAV and other larger fan systems.

Units List: power-per-unit-flow, static pressure or brake horsepower

Input Restrictions As designed. The power-per-unit-flow method shall be used when no fan performance data is available for the proposed design cooling system, e.g. only EER or SEER are available.

Standard Design The baseline building shall use the static pressure method for all HVAC systems except the four-pipe fan coil system, which shall use the power-per-unit-flow method.

Supply Fan Design Air Rated Capacity

Applicability All fan systems

Definition The design air flow rate of the supply fan(s) at design conditions. This building descriptor sets the 100% point for the fan part-load curve.

Units cfm

Input Restrictions As designed. This input should be at least as great as the sum of the design air flow specified for each of the thermal zones that are served by the fan system. For multiple deck systems, a separate entry should be made for each deck.

Standard Design The program shall automatically size the air flow at each thermal zone to meet the loads. The design air flow rate calculation shall be based on a 20°F temperature differential between the supply air and the return air for exterior zones and a 15°F temperature differential for interior zones. The design supply air flow rate is the larger of the flow rate required to meet space conditioning requirements and the required ventilation flow rate. (The ventilation requirements may dictate supply air flow rate requirements for laboratory spaces and other spaces with special process requirements.) The supply fan design air flow rate shall be the sum of the calculated design air flow for the thermal zones served by the fan system.

Fan Control Method

Applicability All fan systems

Definition A description of how the supply (and return/relief) fan(s) are controlled. The options include:

- Constant volume
- Variable-flow, inlet or discharge dampers
- Variable-flow, inlet guide vanes
- Variable-flow, variable speed drive (VSD)
- Variable-flow, variable pitch blades
- Variable-flow, other
- Two-speed
- Constant volume, cycling (fan cycles with heating and cooling)

Units	List (see above)
Input Restrictions	As designed
Standard Design	Applicable to variable air volume systems
	Based on the prescribed system type. Refer to the HVAC System Map in **Error! Reference source not found.**.

Table 27~~25~~ – Baseline Building Fan Control Method

Baseline building System	Fan Control Method
System 1 – PTAC	Constant volume (Two-speed for systems greater than 72 kBtu/h baseline cooling capacity)
System 2 – ~~PTHP~~FPFC	Constant volume ~~(Two-speed for systems greater than 72 kBtu/h baseline cooling capacity,)~~
System 3 – PSZ-AC	Constant volume (Two-speed for systems greater than 72 kBtu/h baseline cooling capacity,)
~~System 4 – PSZ-HP~~	~~Constant volume(Two-speed for systems greater than 72 kBtu/h baseline cooling capacity)~~
System 5 – Packaged VAV with Reheat	Variable-flow, variable speed drive (VSD)
System 6 – VAV with Reheat	Variable-flow, variable speed drive (VSD)
System 7 – PSZ, Single Zone VAV	Variable-flow, ~~two~~variable-speed drive (VSD)
~~System 8 – PSZ, Single Zone VAV, HP~~	~~Variable-flow, two-speed drive (VSD)~~
System 9 – Heating and Ventilation	Constant volume
System 10 – CRAH Units	Variable-flow, variable speed drive (VSD)*
System 11 – CRAC Units	Variable-flow, variable speed drive (VSD)*

*** For CRAH Units, fan volume shall be linearly reset from 100% air flow at 100% cooling load to minimum airflow at 50% cooling load and below.**

Supply Fan Brake Horsepower

Applicability	All fan systems, except those specified using the power-per-unit-flow method
Definition	The design shaft brake horsepower of ~~the~~ each supply fan~~(s)~~. This input does not need to be supplied if the Supply Fan kW is supplied.
Units	Horsepower (hp)
Input Restrictions	As designed. If this building descriptor is specified for the proposed design, then the *Static Pressure* and *Fan Efficiency* are not.
	~~Series-powered fans that operate at design conditions should be included in the proposed fan brake horsepower calculations. Fans for parallel fan-powered boxes are not included.~~
	The compliance software shall apply the following rule to specify the proposed design bhp, based on user input:
	A Standard Motor Size table (hp) is defined as: 1/12, 1/8, ¼, ½, ¾, 1, 1.5, 2, 3, 5, 7.5, 10, 15, 20, 25, 30, 40, 50, 60, 75, 100, 125, 150, 200
	The user-entered brake horsepower for the proposed design is compared against the next smaller motor size from the user-entered Supply Fan Motor Horsepower. The proposed design Supply Fan Brake Horsepower (bhp) is set to the minimum of the user-entered bhp and 95% of the next smaller motor horsepower:
	Proposed bhp = max(User bhp, 95% x MHP_{i-1})
	Where User bhp is the user-entered supply fan brake horsepower,

MHPi is the proposed (nameplate) motor horsepower

MHPi-1 is the next smaller motor horsepower from the Standard Motor Size table above.

For example, if the proposed motor horsepower is 25, the next smaller motor horsepower from the table above is 20.

~~1. If the user-entered proposed bhp <= 95% of the next larger standard motor size, then proposed design Supply Fan Brake Horsepower = 95% (Next Larger Motor Size).~~

~~a. For example, if the user bhp=18 and the next larger motor size is 20 from the table above, since 18< 95% (20), Proposed Supply Fan Brake Horsepower = 95%(20)= 19 hp.~~

~~2. If the user-entered proposed bhp>95% of the next larger motor size, then the Proposed Supply Fan Brake Horsepower = 95% of the next larger motor size.~~

~~For example, if the user-entered proposed bhp=19.2 and the next larger motor size is 20, since 19.2>95%(20), the Proposed Supply Fan Brake Horsepower = 95%(25) = 23.75 hp, where 25 is the next larger motor size after 20 hp in the table.~~

Standard Design Not applicable

Supply Fan Motor Horsepower

Applicability All fan systems, except those specified using the power-per-unit-flow method

Definition The motor nameplate horsepower of the supply fan

Units List: chosen from a list of standard motor sizes: 1/12, 1/8, ¼, ½, ¾, 1, 1.5, 2, 3, 5, 7.5, 10, 15, 20, 25, 30, 40, 50, 60, 75, 100, 125, 150, 200

Input Restrictions As designed. This building descriptor is required for the static pressure or the brake horsepower methods

Standard Design Not applicable

Supply Fan Static Pressure

Applicability All fan systems~~, except those specified using the power-per-unit-flow~~ using the static pressure method

Definition The design static pressure for the supply fan. This is important for both fan electric energy usage and duct heat gain calculations.

Units Inches of water column (in. H_20)

Input Restrictions As designed. The design static pressure for the supply fan does not need to be specified if the supply fan brake horsepower (bhp) is specified.

Standard Design ~~Not applicable. When *Static Pressure* and *Fan Efficiency* are entered for the proposed design, the baseline building shall use *Brake Horsepower*.~~

The standard design for all systems except four-pipe fan coil (FPFC) is defined by the following table:

Airflow	Single Zone, 6 stories or less	Single Zone, 6 stories or less	Multiple Zone, less than 6 stories	Multiple Zone, greater than 6 stories
<2000 cfm	2.5”	3.0”	3.0”	3.5”

2000 cfm – 10,000 cfm	3.0”	3.5”	3.5”	4.0”
>10,000 cfm	3.5”	4.0”	4.0”	4.5”

An additional pressure drop allowance is available for special filtration requirements only for specific processes such as clean rooms. See *Process and Filtration Pressure Drop* for details.

Not applicable for the four-pipe fan coil system.

Supply Fan Efficiency

Applicability All fan systems~~, except those specified~~ using the ~~power-per-unit-flow~~ static pressure method

Definition The efficiency of the fan at design conditions; this is the static efficiency and does not include motor losses.

Units Unitless

Input Restrictions As designed. The supply fan efficiency does not need to be specified if the supply fan brake horsepower (bhp) is specified.

Standard Design For all standard design systems except the four-pipe fan coil:

The baseline Supply Fan Efficiency shall be 50% if the design supply air flow is less than 2000 cfm, 60% if the design supply air flow is between 2000 cfm and 10,000 cfm, or 62% if the design supply airflow is greater than 10,000 cfm.

For the four-pipe fan coil system, not applicable.

Supply Motor Efficiency

Applicability All supply fans, except those specified using the power-per-unit-flow method

Definition The full-load efficiency of the motor serving the supply fan

Units Unitless

Input Restrictions As designed. Not applicable when the power-per-unit-flow method is used.

Standard Design The motor efficiency is determined from Table 28~~Table 26~~ for the next motor size greater than the bhp.

Table 28~~26~~ – Minimum Nominal Efficiency for Electric Motors (%)

Motor Horse Power	
1	85.5
1.5	86.5
2	86.5
3	89.5
5	89.5
7.5	91.7
10	91.7
15	92.4
20	93.0
25	93.6
30	93.6
40	94.1
50	94.5
60	95.0
75	95.4
100	95.4
125	95.4
150	95.8
200	96.2
250	96.2
300	96.2
350	96.2
400	96.2
450	96.2
500	96.2

Fan Position

Applicability	All supply fans
Definition	The position of the supply fan relative to the cooling coil. The configuration is either draw through (fan is downstream of the coil) or blow through (fan is upstream of the coil).
Units	List (see above)
Input Restrictions	As designed.
Standard Design	Draw through

Motor Position

Applicability	All supply fans
Definition	The position of the supply fan motor relative to the cooling air stream. The choices are: in the air stream or out of the air stream.
Units	List (see above)

Input Restrictions	As designed.
Standard Design	In the air stream

Fan Part-Flow Power Curve

Applicability	All variable flow fan systems
Definition	A part-load power curve which represents the percentage full-load power draw of the supply fan as a function of the percentage full-load air flow. The curve is typically represented as a quadratic equation with an absolute minimum power draw specified.
Units	Unitless ratio
Input Restrictions	As designed. The user shall not be able to select VSD with Static Pressure Reset if the building does not have DDC controls to the zone level. The default fan curve shall be selected from Equation (4) and Table 29~~Table 27~~ for the type of fan specified in the proposed design.

$$\begin{aligned} &\textit{Greater of} \\ &PLR = a + b \cdot FanRatio + c \cdot FanRatio^2 + d \cdot FanRatio^3 \\ &PLR = PowerMin \end{aligned} \tag{4}$$

where

PLR	Ratio of fan power at part load conditions to full load fan power
PowerMin	Minimum fan power ratio
FanRatio	Ratio of cfm at part-load to full-load cfm
a, b, c and d	Constants from Table 29~~Table 27~~ below

Table 29~~27~~ – Fan Curve Default Values

Fan Type - Control Type	A	B	c	d	$\%Power_{Min}$
AF or BI riding the curve[a]	0.1631	1.5901	-0.8817	0.1281	70%
AF or BI with inlet vanes[a]	0.9977	-0.659	0.9547	-0.2936	50%
FC riding the curve[a]	0.1224	0.612	0.5983	-0.3334	30%
FC with inlet vanes[a]	0.3038	-0.7608	2.2729	-0.8169	30%
Vane-axial with variable pitch blades[a]	0.1639	-0.4016	1.9909	-0.7541	20%
Any fan with VSD ()[b]	0.0013	0.1470	0.9506	-0.0998	20%
VSD with static pressure reset[c]	-0.0031	0.0991	1.0268	-0.1128	20%

Data Sources:
a. ECB Compliance Supplement, public review draft, Version 1.2, March 1996, but adjusted to be relatively consistent with the curve specified in the PRM.
b. The fan curve for VSD is specified in Table G3.1.3.15
c. Advanced VAV System Design Guide, California Energy Commission, CEC Publication 500,-03-082 A-11, April 2005, but adjusted to be relatively consistent with the curve specified in the PRM..

Standard Design	Not applicable for baseline building systems 1-4. The curve *VSD with static pressure reset* fans shall be used for baseline building systems 5, 6, 10 and 11 . For systems 7,8 and 9 the baseline is not applicable.

Supply Fan Power Index

Applicability	Fan systems that use the power-per-unit-flow method

Definition	The supply fan power per unit of flow.
Units	kW/cfm
Input Restrictions	As designed or specified in the manufacturers' literature. For units with rated total cooling capacities less than 120,000 Btu/h, the user may default to a value calculated as follows:

$$Fan_{kw} = 0.365 \times \frac{Q_{rated}}{30{,}000} \quad (5)$$

where

Fan_{kw}	The supply fan power (kW)
Q_{rated}	The rated total cooling capacity (Btu/h)

Standard Design	Not applicable for all systems except the four-pipe fan coil (FPFC). For the FPFC system, the standard design is 0.35 W/cfm.

Process and Filtration Pressure Drop

Applicability	Any system with special requirements for filtration or other process requirements
Definition	Additional system pressure drop related to application-specific filtration requirements or other process requirements. Special documentation requirements may apply.
Units	List
Input Restrictions	Default is 0. Special documentation is required to claim any credit for filtration or other process requirements. Filtration shall be associated with process requirements (such as clean room or hospital areas).
Standard Design	0 (not applicable)

5.7.3.3 Return/Relief Fans

The baseline building has ~~a return fan when the baseline building system is type 3 through 8 and the proposed design has a return fan~~no return fan. For proposed design systems of type 5 or 6, the standard design system has a relief fan only if the standard design system has an economizer.

Plenum Zone

Applicability	Any system with return ducts or return air plenum
Definition	A reference to the thermal zone that serves as return plenum or where the return ducts are located
Units	Text, unique
Input Restrictions	As designed
Standard Design	~~Applicable when the baseline building has a return fan. Same as the proposed design when the proposed design has a plenum, otherwise, the return air ducts are assumed to be located in the space.~~ Not applicable

Return Air Path

Applicability	Any system with return ducts or return air plenum
Definition	Describes the return path for air. This can be one of the following: ducted return; plenum return; or direct-to-unit.
Units	List (see above)
Input Restrictions	As designed
Standard Design	Applicable when the baseline building has a ~~return~~ relief fan. For baseline building systems 1 and 2, the return air path shall be direct-to-unit. For baseline building systems 3 through 11 ~~and when the proposed design is direct-to-unit,~~ the baseline building shall be ducted return~~, otherwise the baseline building return air path shall be same as proposed design~~.

Return/Relief Air Rated Capacity

Applicability	All systems with a return or relief fan
Definition	The design air flow fan capacity of the return or relief fan(s). This sets the 100% fan flow point for the part-load curve (see below).
Units	cfm
Input Restrictions	As designed
Standard Design	~~Applicable when the baseline building has a return fan. The return fan air *Rated Capacity* shall be equal to the baseline building supply fan capacity less exhaust air flow.~~ The relief fan rated capacity shall be equal to the supply fan capacity minus the exhaust fan rated capacity, and minus 0.05 cfm/sf for exfiltration.

Return/Relief Fan Brake Horsepower

Applicability	Any system with return or relief fans that uses the brake horsepower method
Definition	The design shaft brake horsepower of the return/relief fan(s)
Units	Brake horsepower (bhp)
Input Restrictions	As designed. The compliance software shall apply the following pre-processing rule to specify the proposed design Return/Relief Fan Brake Horsepower, based on user input: A Standard Motor Size table (hp) is defined as: 1/12, 1/8, ¼, ½, ¾, 1, 1.5, 2, 3, 5, 7.5, 10, 15, 20, 25, 30, 40, 50, 60, 75, 100, 125, 150, 200 The return/relief fan brake horsepower is determined from user inputs of brake horsepower and motor horsepower for the proposed design, in the same manner as the Supply Fan Brake Horsepower. Proposed bhp = min (user bhp, 95% x $MHPi_{-1}$) Where Proposed bhp is the Return/Relief Fan Brake Horsepower used in the simulation, User bhp is the actual fan bhp as entered by the user, and MHP_{i-1} is the motor horsepower of the next smaller motor size from the Standard Motor Size Table above; MHP_i is the motor size that the user enters for the return/relief fan See the *Supply Fan Brake Horsepower* descriptor for further details.

~~1. If the user-entered proposed bhp <= 95% of the next larger standard motor size, then proposed design Supply Fan Brake Horsepower = 95% (Next Larger Motor Size).~~

~~a. For example, if the user bhp=18 and the next larger motor size is 20 from the table above, sine 18< 95% (20), Proposed Supply Fan Brake Horsepower = 95%(20)= 19 hp.~~

~~2. If the user-entered proposed bhp>95% of the next larger motor size, then the Proposed Return/Relief Fan Brake Horsepower = 95% of the next larger motor size.~~

~~For example, if the user entered proposed bhp=19.2 and the next larger motor size is 20, since 19.2>95%(20), the Proposed Return/Relief Fan Brake Horsepower = 95%(25) = 23.75 hp, where 25 is the next larger motor size after 20 hp in the table.~~

Standard Design ~~The bhp of the return fan shall be the system fan power index (W/cfm) multiplied by the supply airflow, the motor efficiency from ACM Table N2-20, and the return fan ratio. In other words, brake horsepower is allocated in proportion to the proposed design.~~ Not applicable

Return/Relief Fan Motor Horsepower

Applicability	All fan systems, except those specified using the power-per-unit-flow method
Definition	The motor nameplate horsepower of the supply fan
Units	List: chosen from a list of standard motor sizes: 1/12, 1/8, ¼, ½, ¾, 1, 1.5, 2, 3, 5, 7.5, 10, 15, 20, 25, 30, 40, 50, 60, 75, 100, 125, 150, 200
Input Restrictions	As designed. This building descriptor is required for the static pressure or the brake horsepower methods Relief fans, such as power exhaust fans, that do not operate at design conditions should not be included in the proposed return/relief fan brake horsepower calculations.
Standard Design	Not applicable

Return/Relief Design Static Pressure

Applicability	Any system with return or relief fans that uses the static pressure method
Definition	The design static pressure for return fan system. This is important for both fan electric energy usage and duct heat gain calculations.
Units	Inches of water column (in. H_20 gauge)
Input Restrictions	As designed. The design static pressure for the return fan does not need to be specified if the return fan brake horsepower (bhp) is specified.
Standard Design	
	For fans with design airflow less than 10,000 cfm, the static pressure is 0.75”.
	For fans with design airflow rate 10,000 cfm or greater, the static pressure is 1.0”

Return/Relief Fan Efficiency

Applicability	Any system with return or relief fans that uses the static pressure method
Definition	The efficiency of the fan at design conditions; this is the static efficiency and does not include the efficiency loss of the motor.
Units	

	Unitless
Input Restrictions	As designed. The return/relief fan efficiency does not need to be specified if the return fan brake horsepower (bhp) is specified.
Standard Design	Not applicable. When *Static Pressure* and *Fan Efficiency* are entered for the proposed design, the baseline building shall use *Brake Horsepower*. For design airflow less than 10,000 cfm, 40%. For design airflow 10,000 cfm or greater, 50%.

Return/Relief Motor Efficiency

Applicability	All return fans, except those specified using the power-per-unit-flow method
Definition	The full-load efficiency of the motor serving the supply fan
Units	Unitless
Input Restrictions	As designed. Not applicable when the power-per-unit-flow method is used.
Standard Design	From ACM Table 28~~Table 26~~

Motor Position

Applicability	All return fans
Definition	The position of the supply fan motor relative to the cooling air stream. The choices are: in the air stream or out of the air stream.
Units	List (see above)
Input Restrictions	As designed.
Standard Design	In the air stream

Fan Part-Flow Power Curve

Applicability	All return fans for variable flow fan systems.
Definition	A part-load power curve which represents the percentage full-load power draw of the supply fan as a function of the percentage full-load air flow.
Units	Unitless ratio
Input Restrictions	As designed. The default fan curve shall be selected from Equation (4) and Table 29~~Table 27~~ for the type of fan specified in the proposed design.
Standard Design	Not applicable for baseline building systems 1-4. The curve for VSD fans shall be used for baseline building systems 5-6, and 10 or 11 that have a return/relief fan. This is not applicable for baseline building systems 7, 8, 9.

Return/Relief Fan Power Index

Applicability	Any system with a return fan
Definition	The supply fan power per unit of flow
Units	kW/cfm
Input Restrictions	As specified in the manufacturers' literature
Standard Design	Not applicable

5.7.3.4 Exhaust Fan Systems

Exhaust fans include toilet exhaust and kitchen exhaust. Fume hoods in laboratories and other spaces are not included. Some systems typically operate at constant flow, while flow varies for other systems depending on, for instance, the position of the sash for fume hoods. Exhaust fan flow is specified and scheduled for each thermal zone. An exhaust fan system may serve multiple thermal zones. The baseline building has exhaust fans when the proposed design has exhaust fans. The exhaust air flow is the same for the baseline building and the proposed design.

Note: exhaust fans serving laboratories shall be modeled as a plug load in an unconditioned space equal to the scheduled motor horsepower of the exhaust fans.

Exhaust Fan Name	
Applicability	All exhaust systems serving multiple thermal zones
Definition	A unique descriptor for each exhaust fan. This should be keyed to the construction documents, if possible, to facilitate plan checking. Exhaust rates and schedules at the thermal zone level refer to this name.
Units	Text, unique
Input Restrictions	Where applicable, this should match the tags that are used on the plans.
Standard Design	The baseline building will have an exhaust system that corresponds to the proposed design. The name can be identical to that used for the proposed design or some other appropriate name may be used.

Exhaust Fan System Modeling Method	
Applicability	All exhaust fan systems
Definition	Compliance ~~Software~~ software ~~commonly~~ can model~~s~~ fans in three ways. See definition for supply system modeling method.
Units	List: power-per-unit-flow, static pressure or brake horsepower
Input Restrictions	As designed
Standard Design	The baseline building shall use the static pressure method.

Exhaust Fan Rated Capacity	
Applicability	All exhaust systems
Definition	The rated design air flow rate of the exhaust fan system. This building descriptor defines the 100% flow case for the part-flow curve. Actual air flow is the sum of the flow specified for each thermal zone, as modified by the schedule for each thermal zone.
Units	cfm
Input Restrictions	As designed
Standard Design	Same as proposed design

Fan Control Method	
Applicability	All exhaust fan systems
Definition	A description of how the exhaust fan(s) are controlled. The options include: • Constant volume

- Two-speed
- Variable-flow, inlet or discharge dampers
- Variable-flow, inlet guide vanes
- Variable-flow, variable speed drive (VSD)
- Variable-flow, variable pitch blades

Units List (see above)

Input Restrictions As designed, however, when exhaust fan flow at the thermal zone level is varied through a schedule, one of the variable-flow options shall be specified.

Standard Design The baseline building exhaust fan control shall generally be the same as the proposed design.

Exhaust Fan Schedule

Applicability All exhaust fan systems

Definition A schedule that indicates when the exhaust fan system is available for operation. Exhaust fan flow is specified at the thermal zone level.

Units Data structure: schedule, on/off

Input Restrictions As designed.

Standard Design Same as the proposed design for exhaust fans not serving Kitchen spaces.

For exhaust fans serving kitchen spaces, the fan control method is constant volume for fans with flow rate 5,000 cfm and below, and variable flow, variable speed drive for fans with flow rate greater than 5,000 cfm.

Exhaust Fan Brake Horsepower

Applicability All exhaust fan systems

Definition The design shaft brake horsepower of the exhaust fan(s).

Units Brake horsepower (bhp)

Input Restrictions As designed

The Compliance Software implements a pre-processing rule to specify the proposed design Exhaust Fan Brake Horsepower (bhp), based on user input:

A Standard Motor Size table (hp) is defined as: 1/12, 1/8, ¼, ½, ¾, 1, 1.5, 2, 3, 5, 7.5, 10, 15, 20, 25, 30, 40, 50, 60, 75, 100, 125, 150, 200

The exhaust fan brake horsepower is determined from user inputs of brake horsepower and motor horsepower for the proposed design, in the same manner as the Supply Fan Brake Horsepower.

Proposed bhp = max (user bhp, 95% x $MHPi_{-1}$)

Where Proposed bhp is the Return/Relief Fan Brake Horsepower used in the simulation,

User bhp is the actual fan bhp as entered by the user, and

MHP_{i-1} is the motor horsepower of the next smaller motor size from the Standard Motor Size Table above; MHP_i is the motor size that the user enters for the exhaust fan

See the *Supply Fan Brake Horsepower* descriptor for further details.

~~1. If the user-entered proposed bhp <= 95% of the next larger standard motor size, then proposed design Supply Fan Brake Horsepower = 95% (Next Larger Motor Size).~~

~~a. For example, if the user bhp=18 and the next larger motor size is 20 from the table above, sine 18< 95% (20), Proposed Supply Fan Brake Horsepower = 95%(20)= 19 hp.~~

~~2. If the user-entered proposed bhp>95% of the next larger motor size, then the Proposed Supply Fan Brake Horsepower = 95% of the next larger motor size.~~

~~For example, if the user-entered proposed bhp=19.2 and the next larger motor size is 20, since 19.2>95%(20), the Proposed Supply Fan Brake Horsepower = 95%(25) = 23.75 hp, where 25 is the next larger motor size after 20 hp in the table.~~

Standard Design Not applicable

Exhaust Fan Motor Horsepower

Applicability All fan systems, except those specified using the power-per-unit-flow method

Definition The motor nameplate horsepower of the supply fan

Units List: chosen from a list of standard motor sizes: 1/12, 1/8, ¼, ½, ¾, 1, 1.5, 2, 3, 5, 7.5, 10, 15, 20, 25, 30, 40, 50, 60, 75, 100, 125, 150, 200

Input Restrictions As designed. This building descriptor is required for the static pressure or the brake horsepower methods

Standard Design Not applicable

Exhaust Fan Design Static Pressure

Applicability Any system with return or relief fans that uses the static pressure method

Definition The design static pressure for exhaust fan system. This is important for both fan electric energy usage and duct heat gain calculations.

Units Inches of water column (in. H_20)

Input Restrictions As designed for exhaust fans not serving kitchens. The design static pressure for the exhaust fan does not need to be specified if the exhaust fan brake horsepower (bhp) is specified.

~~For kitchen exhaust fans, the static pressure is fixed at 2.5" w.c.~~

Standard Design For kitchen exhaust fans, the static pressure is fixed at 2.5" w.c.

For all other exhaust fans, For toilet exhaust fans: 0.75" if less than 1000 cfm, 1.25" if 1000 cfm or greater.

For lab exhaust, 4" if 6 stories or less, or 4.5" if greater than 6 stories.

Exhaust Fan Efficiency

Applicability Any exhaust fan system that uses the static pressure method

Definition The efficiency of the exhaust fan at rated capacity; this is the static efficiency and does

	not include losses through the motor.
Units	Unitless
Input Restrictions	For kitchen exhaust fans, the fan efficiency is prescribed at 50%. For all other exhaust fans, as designed. The exhaust fan efficiency does not need to be specified if the return fan brake horsepower (bhp) is specified.
Standard Design	For kitchen exhaust fans, the fan efficiency is 50%. For toilet exhaust, 45% if the design airflow is less than 1000 cfm, and 55% if 1000 cfm or greater. For lab exhaust, 62%.

Exhaust Fan Motor Efficiency

Applicability	All exhaust fan systems
Definition	The full-load efficiency of the motor serving the exhaust fan
Units	Unitless
Input Restrictions	As designed
Standard Design	From Table 29~~Table 27~~

Fan Part-Flow Power Curve

Applicability	All variable flow exhaust fan systems
Definition	A part-load power curve which represents the ratio full-load power draw of the exhaust fan as a function of the ratio full-load air flow.
Units	Unitless ratio
Input Restrictions	As designed. The default fan curve shall be selected from Equation (4) and Table 29~~Table 27~~ for the type of fan specified in the proposed design.
Standard Design	The baseline building fan curve shall be selected from Equation (4) and Table 29~~Table 27~~ for the type of fan specified in the proposed design.

Exhaust Fan Power Index

Applicability	All exhaust systems
Definition	The fan power of the exhaust fan per unit of flow. This building descriptor is applicable only with the power-per-unit-flow method.
Units	kW/cfm
Input Restrictions	As designed.
Standard Design	Not applicable

5.7.3.5 Garage Exhaust Fan Systems

Garage exhaust fan systems shall be modeled and included as part of regulated building energy use. Garage exhaust fans do not serve conditioned space and are not included as part of the fan power index for the building. These fans shall be modeled as constant volume fans, with the fan power determined by whether or not the fan has CO controls.

Garage Exhaust Fan Name

Applicability	All garage exhaust systems
Definition	A unique descriptor for each garage exhaust fan or fan system. Fans with equivalent efficiency and motor efficiencies may be combined and modeled as one fan.
Units	Text, unique
Input Restrictions	Where applicable, this should match the tags that are used on the plans.
Standard Design	The baseline building will have an exhaust system that corresponds to the proposed design. The name can be identical to that used for the proposed design or some other appropriate name may be used.

Garage Exhaust Fan System Modeling Method

Applicability	All exhaust fan systems
Definition	Software commonly models fans in three ways. See definition for supply system modeling method.
Units	List: power-per-unit-flow, static pressure or brake horsepower
Input Restrictions	Power-per-unit-flow (fixed value)
Standard Design	The baseline building shall use the power-per-unit-flow method.

Garage Exhaust Fan Rated Capacity

Applicability	All exhaust systems
Definition	The rated design air flow rate of the garage exhaust fan system.
Units	cfm
Input Restrictions	As designed
Standard Design	Same as proposed design

Garage Exhaust Fan Control Method

Applicability	All exhaust fan systems
Definition	The control method for the garage exhaust fan. This input determines the fan power for the exhaust fan; no other fan inputs are required.
Units	List: Constant Volume, CO Control
Input Restrictions	For systems with fan capacity below 10,000 cfm, either *Constant Volume or CO Control* For systems with fan capacity above 10,000 cfm, ~~either *Constant Volume or* ~~*CO Control* If *Constant Volume* is selected, proposed fan power is 0.35 W/cfm If *CO Control* is selected, proposed fan power is 0.044 W/cfm
Standard Design	The bhp exhaust fan bhp for the baseline building is calculated from the garage system fan power index (FPI) and the exhaust fan ratio through the following formula: FPI = bhp x 746 / η_m For garage fans with a supply air flowrate below 10,000 cfm, the baseline fan power is 0.35 W/cfm.

For garage fans with a design supply air flowrate of 10,000 cfm and above, the baseline fan power is 0.044 W/cfm.

5.7.4 Outdoor Air Controls and Economizers

5.7.4.1 Outside Air Controls

Maximum Outside Air Ratio	
Applicability	All systems with modulating outside air dampers
Definition	The descriptor is used to limit the maximum amount of outside air that a system can provide as a percentage of the design supply air. It is used where the installation has a restricted intake capacity.
Units	Ratio
Input Restrictions	~~One of the following choices:~~ For systems with capacity under 54,000 Btu/h without FDD, the maximum allowed value is 0.9. For systems with partially integrated economizers, the value is 0.85. For all other systems the maximum allowed value is 1. ~~All other systems: as designed~~
Standard Design	1.0 for all systems above 54,000 Btu/h cooling capacity and for systems serving laboratory spaces or occupancies; 0.9 for other systems

Design Outside Air Flow	
Applicability	All systems with outside air dampers
Definition	The rate of outside air that needs to be delivered by the system at design conditions. This input may be derived from the sum of the design outside air flow for each of the zones served by the system.
Units	cfm
Input Restrictions	As designed, but no lower than the ventilation rate of the standard design.
Standard Design	Minimum ventilation requirements specified by Standard 120(b)2 as the greater of 15 cfm/person and the minimum ventilation rates specified in Appendix 5.4 For systems serving laboratory spaces, the system shall be 100% outside air, with ventilation rates ~~determined by the Authority Having Jurisdiction~~of 6 ACH. See *ventilation control method* at the zone level.

Outdoor Air Control Method	
Applicability	All HVAC systems that deliver outside air to zones
Definition	The method of determining the amount of outside air that needs to be delivered by the system. Each of the zones served by the system report their outside air requirements on an hourly basis. The options for determining the outside air at the zone level are discussed above. This control method addresses how the system responds to this information on an hourly basis. Options include:

- Average Flow. The outside air delivered by the system is the sum of the outside air requirement for each zone, without taking into account the position of the VAV damper in each zone. The assumption is that there is mixing between zones through the return air fan.
- Critical Zone. The critical zone is the zone with the highest ratio of outside air to supply air. The assumption is that there is no mixing between zones. This method will provide greater outside air than the average flow method because when the critical zone sets the outside air fraction at the system, the other zones are getting greater outside air than required.

The quantity of outside air can be controlled in a number of ways, but a common method is to install a flow station at the outside air supply which modulates the position of the outside air and return dampers to maintain the desired outside air flow. With the average flow, a CO_2 sensor in the return air duct is another way to control the position of the outside air and return dampers.

Units List (see above)

Input Restrictions As designed

Standard Design ~~Same as proposed design~~Average Flow

5.7.4.2 Air Side Economizers

Economizer Control Type

Applicability All systems with an air-side economizer

Definition An air-side economizer increases outside air ventilation during periods when refrigeration loads can be reduced from increased outside air flow. The control types include:

- No economizer
- Fixed dry-bulb. The ~~system shifts to 100% outside air and shuts off the cooling~~ economizer is enabled when the temperature of the outside air is equal to or lower than ~~the supply air temperature~~temperature fixed setpoint (e.g., 75F).
- Differential dry-bulb. The ~~system shifts to 100% outside air~~economizer is enabled when the temperature of the outside air is lower than the return air temperature ~~but continues to operate the cooling system until the outside air temperature reaches the supply air temperature~~.
- ~~Fixed enthalpy and fixed dry-bulb. The system shifts to 100% outside air and shuts off the cooling when the enthalpy of the outside air is equal to or lower than the supply air enthalpy or the outside air temperature drops below a fixed dry-bulb limit.~~
- Differential enthalpy. The ~~system shifts to 100% outside air~~economizer is enabled when the enthalpy of the outside air is lower than the return air enthalpy ~~but continues to operate the cooling system until the outside air enthalpy reaches the supply air enthalpy~~.
- Differential dry-bulb and enthalpy. The system shifts to 100% outside air, or the maximum outside air position needed to maintain the cooling SAT setpoint, when the outside air dry-bulb is less than the return air dry-bulb AND the outside air enthalpy is less than the return air enthalpy. This control option requires additional sensors.

- Fixed or dry-bulb enthalpy. The economizer is enabled when the outside air dry-bulb and enthalpy are both below the fixed setpoints for the return air.
- Fixed dewpoint and dry-bulb. The system shifts to 100% outside air, or the maximum outside air position needed to maintain the SAT setpoint, when the dewpoint of the air and dry-bulb are below the specified setpoints.

Units List (see above)

Input Restrictions As designed

Standard Design The control should be no economizer when the baseline cooling capacity < 54,000 Btu/h. Otherwise the baseline building shall assume an integrated differential dry-bulb economizer.

An exception is that economizers shall NOT be modeled for systems serving high-rise residential or hotel/motel guestroom occupancies.

Economizer Integration Level

Applicability Airside economizers

Definition This input specifies whether or not the economizer is integrated with mechanical cooling. It is up to the modeling software to translate this into software-specific inputs to model this feature. The input could take the following values:

- Non-integrated. The system runs the economizer as the first stage of cooling. When the economizer is unable to meet the load, the economizer returns the outside air damper to the minimum position and the compressor turns on as the second stage of cooling.
- Partially Integrated. The system enables the economizer when the outside air conditions allow. If the economizer alone can meet the cooling load, the compressor is disabled. If the economizer alone cannot meet the cooling load, the compressor is enabled. Economizer and compressor operation alternate if the minimum discharge air temperature is not maintained. *(Note: this is modeled by modeling an integrated economizer with a limitation on the maximum outside air damper position.)*
- Integrated. The system can operate with the economizer fully open to outside air and mechanical cooling active (compressor running) simultaneously, even on the lowest cooling stage.

Units ~~Degrees Fahrenheit (°F)~~List

Input Restrictions List: Non-integrated, Integrated

Standard Design Integrated for systems above capacity ~~65~~54,000 Btu/h at ~~ARI~~AHRI conditions

Economizer High Temperature Lockout

Applicability Systems with *fixed dry-bulb* economizer

Definition It is the outside air setpoint temperature above which the economizer will return to minimum position.

Units Degrees Fahrenheit (°F)

Input Restrictions As designed

Standard Design Not Applicable

~~For California Compliance, the baseline building shall assume an integrated fixed dry-bulb economizer with the following limits:~~

~~Climate Zone 7: dry-bulb high limit of 69°F~~

~~Climate Zones 6, 8, 9: dry-bulb high limit of 71°F~~

~~Climate Zones 2, 4, 10: dry-bulb high limit of 73°F~~

~~Climate Zones 1, 3,5,11-16: dry-bulb high limit of 75°F~~

Economizer Low Temperature Lockout	
Applicability	Systems with air-side economizers
Definition	A feature that permits the lockout of economizer operation (return to minimum outside air position) when the outside air temperature is below the lockout setpoint.
Units	Degrees Fahrenheit (°F)
Input Restrictions	As designed
Standard Design	Not used

Economizer High Enthalpy Lockout	
Applicability	Systems with ~~fixed enthalpy or~~ differential enthalpy economizers
Definition	The outside air enthalpy above which the economizer will return to minimum position
Units	Btu/lb
Input Restrictions	As designed. The default is 28 Btu/lb.(High altitude locations may require different setpoints.) The compliance software shall apply a fixed offset and add 2 Btu/lb to the user-entered value.
Standard Design	No lockout limit

5.7.5 Cooling Systems

5.7.5.1 General

This group of building descriptors applies to all cooling systems.

Cooling Source	
Applicability	All systems
Definition	The source of cooling for the system. The choices are: • Chilled water • Direct expansion (DX) • Other
Units	List (see above)
Input Restrictions	As designed
Standard Design	The baseline building cooling source is shown in Table 30~~Table 28~~. See ~~Table 5 – HVAC System Map~~ for HVAC system mapping.

Field Coc

Table 30~~28~~ – Cooling Source for Baseline Building System

Baseline building System	Cooling Source
System 1 – PTAC	Direct expansion (DX)
System 2 – FPFC	Chilled water
System 3 – PSZ-AC	Direct expansion (DX)
System 5 – Packaged VAV with Reheat	Direct expansion (DX)
System 6 – VAV with Reheat	Chilled water
System 7 – PSZ, Single Zone VAV	Direct expansion (DX)
System 9 – Heating and Ventilation	None
System 10 – CRAH Unit for Data Centers	Chilled water
System 11 – CRAC Unit for Data Centers	Direct expansion (DX)

~~Gross~~ Total Cooling Capacity

Applicability All cooling systems

Definition The total gross cooling capacity (both sensible and latent) of a cooling coil or packaged DX system at ~~ARI~~AHRI conditions. The building descriptors defined in this chapter assume that the fan is modeled separately, including any heat it adds to the air stream. The cooling capacity specified by this building descriptor should not consider the heat of the fan.

Units ~~k~~Btu/h

Input Restrictions As designed. For packaged equipment that has the fan motor in the air stream such that it adds heat to the cooled air, the software shall ~~adjust the~~ calculate the net *total cooling capacity* as follows:

~~(6)~~

$$\cancel{Q_{t,adj} = Q_{t,rated} + BHP_{supply} / \eta_{motor} \times 2.545}$$

$$Q_{t,net,rated} = Q_{t,gross,rated} - Q_{fan,rated} \qquad (6)$$

where

$Q_{t,\cancel{adj}net,rated}$ The ~~adjusted~~ net total cooling capacity of a packaged unit as rated by AHRI (~~k~~Btu/h)

$Q_{t,gross,rated}$ The ~~ARI~~AHRI rated total cooling capacity of a packaged unit (~~k~~Btu/h) ~~from manufacturers' literature~~

Qfan,rated The heat generated by the fan and fan motor (if fan motor is in airstream) at AHRI rated conditions

~~BHP_{supply} The supply fan brake horsepower (bhp).~~

If the gross and net total cooling capacities at AHRI conditions are known, the fan heat at rated conditions is the difference between the two values. If the either the gross or net total cooling capacity is unknown, the fan heat at rated conditions shall be accounted for by using equation (7):

$$Q_{fan,rated} = Q_{t,gross,rated} \times 0.040 \qquad (7)$$

This equation 7 is based on an AHRI rated fan power of 0.365 W/cfm, and a cooling airflow of 400 cfm/ton.

If the number of unmet load hours in the proposed design exceeds ~~300~~150, the software shall warn the user to resize the equipment.

Standard Design The gross total cooling capacity of the systems in the baseline building is autosized by the compliance software, and then oversized by 15%.. Sizing calculations shall be based on 0.5% design dry-bulb and mean coincident wet-bulb.

Gross Sensible Cooling Capacity

Applicability All cooling systems

Definition The gross sensible cooling capacity of the coil or packaged equipment at ~~ARI~~AHRI conditions. The building descriptors defined in this chapter assume that the fan is modeled separately, including any heat it adds to the air stream. The cooling capacity specified by this building descriptor ~~should not consider the heat of the fan~~should be adjusted to calculate the net sensible cooling capacity, which includes the effect of fan motor heat.

Note that the sensible heat ratio (SHR) used by some energy simulation tools can be calculated from the sensible cooling capacity and total cooling capacity:

SHR = Sensible Cooling Capacity / Total Cooling Capacity

Units ~~k~~Btu/h

Input Restrictions As designed.

For packaged equipment, the compliance software adjusts the user input of gross sensible cooling capacity to account for the effect of fan motor heat as follows: ~~that has the fan motor located in the air stream such that it adds heat to the cooled air, the software shall adjust the *sensible cooling capacity* as follows:~~

~~(7)~~

$$\cancel{Q_{s,adj} = Q_{s,rated} + BHP_{supply} \times 2.545}$$

$$Q_{s,net,rated} = Q_{s,gross,rated} - Q_{fan,rated} \qquad (8)$$

where

$Q_{s,net,rated}$ The AHRI rated (from manufacturers' literature) or net sensible cooling capacity of a packaged unit (Btu/h)

$Q_{s,gross,rated}$ The AHRI rated (from manufacturers' literature) or gross sensible cooling capacity of a packaged unit (Btu/h)

$Q_{fan,rated}$ The heat generated by the fan and fan motor (if fan motor is in air stream) at AHRI rated or hourly conditions (Btu/h). See Gross Total Cooling Capacity building descriptor.

~~where~~

~~$Q_{s,adj}$ The adjusted sensible cooling capacity of a packaged unit (kBtu/h)~~

~~$Q_{s,rated}$ The ARI rated sensible cooling capacity of a packaged unit (kBtu/h)~~

~~BHP_{supply} The supply fan brake horsepower (bhp).~~

If the number of unmet load hours in the proposed design exceeds ~~300~~150, the software shall warn the user to resize the equipment.

Standard Design The ~~sensible~~ gross total cooling capacity of the systems serving the baseline building is autosized by the compliance software, and then oversized by 15%. Sizing calculations shall be based on 0.5% design dry-bulb and mean coincident wet-bulb.

Cooling Capacity Adjustment Curves

Applicability All cooling systems

Definition A curve that represents the available total cooling capacity as a function of cooling coil and/or condenser conditions. The common form of these curves is given as follows:

(6~~8~~)

$$Q_{t,available} = CAP_FT \times Q_{t,adj}$$

For air cooled direct expansion

(7~~9~~)

$$CAP_FT = a + b \times t_{wb} + c \times t_{wb}^{2} + d \times t_{odb} + e \times t_{odb}^{2} + f \times t_{wb} \times t_{odb}$$

For water cooled direct expansion

(8~~10~~)

$$CAP_FT = a + b \times t_{wb} + c \times t_{wb}^{2} + d \times t_{wt} + e \times t_{wt}^{2} + f \times t_{wb} \times t_{wt}$$

For chilled water coils

(9~~11~~)

$$CAP_FT = a + b \times t_{wb} + c \times t_{wb}^{2} + d \times t_{db} + e \times t_{db}^{2} + f \times t_{wb} \times t_{db}$$

where

$Q_{t,available}$	Available cooling capacity at specified evaporator and/or condenser conditions (MBH)
$Q_{t,adj}$	Adjusted capacity at ~~ARI~~AHRI conditions (Btu/h) (see Equation ~~(6)~~
CAP_FT	A multiplier to adjust $Q_{t,adj}$
t_{wb}	The entering coil wet-bulb temperature (°F)
t_{db}	The entering coil dry-bulb temperature (°F)
t_{wt}	The water supply temperature (°F)
t_{odb}	The outside-air dry-bulb temperature (°F)

Note: if an air-cooled unit employs an evaporative condenser, t_{odb} is the effective dry-bulb temperature of the air leaving the evaporative cooling unit.

Software may represent the relationship between cooling capacity and temperature in ways other than the equations given above.

Field Coc

Table 31~~29~~ –Cooling Capacity Curve Coefficients

	Air Cooled Direct Expansion		Water Cooled Direct Expansion		Chilled Water Coils	
Coefficient	Air-Source (PTAC)	Air-Source (Other DX)	Water-Source (Heat Pump)	Water-Source (Other DX)	Fan-Coil	Other Chilled Water
a	1.1839345	0.8740302	-0.2780377	0.9452633	0.5038866	2.5882585
b	-0.0081087	-0.0011416	0.0248307	-0.0094199	-0.0869176	-0.2305879
c	0.0002110	0.0001711	-0.0000095	0.0002270	0.0016847	0.0038359
d	-0.0061435	-0.0029570	-0.0032731	0.0004805	0.0336304	0.1025812
e	0.0000016	0.0000102	0.0000070	-0.0000045	0.0002478	0.0005984
f	-0.0000030	-0.0000592	-0.0000272	-0.0000599	-0.0010297	-0.0028721

Note: These curves are the DOE-2.1E defaults, except for Water-Source (Other DX), which is taken from the "ECB Compliance Supplement, public review draft prepared by the SSPC 90.1 ECB Panel, Version 1.2, March 1996.

Units Data structure

Input Restrictions As designed. The equations and coefficients given above are the default.

Standard Design Use the default curves or equivalent data for other models.

Coil Latent Modeling Method

Applicability All DX cooling systems

Definition The method of modeling coil latent performance at part-load conditions.

Units List

Input Restrictions One of the following values:

Bypass factor – used by DOE-2 based programs

NTU-effectiveness – used by EnergyPlus

Standard Design Same as proposed

Coil Bypass Factor

Applicability All DX cooling systems ~~(optional input)~~using the *bypass factor* Coil Latent Modeling Method

Definition The ratio of air that bypasses the cooling coil at design conditions to the total system airflow.

Units Ratio

Input Restrictions Prescribed values as shown in Table 32~~Table 30~~.

Table 32~~30~~ – Default Coil Bypass Factors

o System Type	o Default Bypass Factor
o Packaged Terminal Air-conditioners and Heat Pumps	o 0.241
o Other Packaged Equipment	o 0.190
o Multi-Zone Systems	o 0.078
o All Other	o 0.037

Standard Design Defaults

Coil Bypass Factor Adjustment Curve

Applicability All DX cooling systems ~~(optional input)~~using the *bypass factor* Coil Latent Modeling Method

Definition Adjustments for the amount of coil bypass due to the following factors:

- Coil airflow rate as a percentage of rated system airflow
- Entering air wet-bulb temperature
- Entering air dry-bulb temperature
- Part load ratio

Units Data structure

Input Restrictions Where applicable, prescribed (fixed) simulation engine defaults based on HVAC system type. The following default values shall be used for the adjustment curves:

(10~~12~~)

$$CBF_{adj} = CBF_{rated} \times COIL-BF-FFLOW \times COIL-BF-FT \times COIL-BF-FPLR$$

(11~~13~~)

$$\text{COIL-BF-FFLOW} = a + b \times CFMR + c \times CFMR^2 + d \times CFMR^3$$

(12~~14~~)

$$\text{COIL-BF-FT} = a + b \times T_{wb} + c \times T_{wb}^{\ 2} + d \times T_{db} + e \times T_{db}^{\ 2} + f \times T_{wb} \times T_{db}$$

(13~~15~~)

$$COIL-BF-FPLR = a + b \times PLR$$

where

CBF_{rated}	The coil bypass factor at ~~ARI~~AHRI rating conditions
CBF_{adj}	The coil bypass factor adjusted for airflow and coil conditions
CFMR	The ratio of airflow to design airflow
COIL-BF-FFLOW	A multiplier on the rated coil bypass factor to account for variation in air flow across the coil (take coefficients from Table 33~~Table 31~~)
COIL-BF-FT	A multiplier on the rated coil bypass factor to account for a variation in coil entering conditions (take coefficients from Table 34~~Table 32~~)
COIL-BF-FPLR	A multiplier on the rated coil bypass factor to account for the part load ratio (take coefficients from Table 35~~Table 33~~)
T_{wb}	The entering coil wet-bulb temperature (°F)
T_{db}	The entering coil dry-bulb temperature (°F)
PLR	Part load ratio

And the coefficients are listed in the tables below.

Table 33~~31~~ – Coil Bypass Factor Airflow Adjustment Factor

Coefficient	COIL-BF-FFLOW (PTAC)	COIL-BF-FFLOW (HP)	COIL-BF-FFLOW (PSZ/other)
a	-2.277	-0.8281602	-0.2542341
b	5.21140	14.3179150	1.2182558
c	-1.93440	-21.8894405	0.0359784
d		9.3996897	

Table 34~~32~~ – Coil Bypass Factor Temperature Adjustment Factor

Coefficient	COIL-BF-FT (PTAC)	COIL-BF-FT (HP)	COIL-BF-FT (PSZ, other)
a	-1.5713691	-29.9391098	1.0660053
b	0.0469633	0.8753455	-0.0005170
c	0.0003125	-0.0057055	0.0000567
d	-0.0065347	0.1614450	-0.0129181
e	0.0001105	0.0002907	-0.0000017
f	-0.0003719	-0.0031523	0.0001503

Table 35~~33~~ – Coil Bypass Factor Part Load Adjustment Factor

Coefficient	COIL-BF-FPLR (All Systems)
a	0.00
b	1.00

Standard Design Use defaults as described above.

Cooling Capacity Airflow Adjustment Curve

Applicability All DX cooling systems using the *NTU Effectiveness* Coil Latent Modeling Method

Definition Normalized curve that varies cooling capacity as a function of airflow, which affects system latent capacity

Units Data structure

Input Restrictions Where applicable, prescribed (fixed) simulation engine defaults based on HVAC system type. The following default values shall be used for the adjustment curves:

(14)

$$CoolCapacity_{adj} = CoolCapacity_{rated} \times COOL-CAP-FFLOW \times COOL-CAP-FT$$

(15)

where

CFMR The ratio of airflow to design airflow

COOL-CAP-FFLOW A multiplier on the rated coil capacity to account for variation in air flow across the coil (take coefficients from Table 33)

COOL-CAP-FT A multiplier on the rated coil bypass factor to account for a variation in coil entering conditions (take coefficients from Table 34)

The curve takes the form:

COOL-CAP-FFLOW = a + b x CFMR + c x $CFMR^2$ + d x $CFMR^3$

And the coefficients are listed in the tables below.

Table 36 – Cooling Capacity Airflow Adjustment Factor

Coefficient	COOL-CAP-FFLOW
a	0.47278589
b	1.2433415
c	-1.0387055
d	0.32257813

Standard Design Use defaults as described above.

5.7.5.2 Direct Expansion

Direct Expansion Cooling Efficiency

Applicability Packaged DX equipment

Definition The cooling efficiency of a direct expansion (DX) cooling system at ~~ARI~~AHRI rated conditions as a ratio of output over input in Btu/h per W, excluding fan energy. The abbreviation used for this full-load efficiency is EER.

For all unitary and applied equipment where the fan energy is part of the equipment efficiency rating, the EER shall be adjusted as follows:

(16)

$$EER_{adj} = \frac{Q_{t,rated} + BHP_{supply} \times 2.545}{\frac{Q_{t,rated}}{EER} - BHP_{supply} \times 0.7457}$$

where

EER_{adj}	The adjusted *Energy Efficiency Ratio* for simulation purposes
EER	The rated Energy Efficiency Ratio
$Q_{t,rated}$	The ~~ARI~~AHRI rated total cooling capacity of a packaged unit (kBtu/h)
BHP_{supply}	The supply fan brake horsepower (bhp) shall be taken from manufacturers' literature when available, otherwise use Equation (5).

Units Btu/h-W

Input Restrictions As designed. When possible, specify the SEER and EER for packaged equipment with cooling capacity less than 65,000 Btu/h from manufacturer's literature. For equipment with capacity above 65,000 Btu/h, specify EER.

When EER is not available for packaged equipment with SEER ratings (~~ARI~~AHRI cooling capacity of 65,000 Btu/h or smaller), it shall be calculated as follows:

(17)

EER = 10 – (11.5 – SEER) x 0.83 when SEER<=11.5

= 10 when SEER>=11.5

For Evaporative cooling systems that pass the requirements of the Western Cooling Challenge may be modeled with an EER as if the equipment were packaged unitary equipment. ~~The EER used is provided from the testing results, and may exceed 30 for some systems.~~See section 5.7.5.4.

Standard Design Use the minimum cooling efficiency (EER) from tables in Tables 110.2-A, 110.2-B and 110.2-E in Section 110.2 of the Standard.

Seasonal Energy Efficiency Ratio

Applicability Packaged DX equipment with ~~ARI~~AHRI cooling capacity of 65,000 Btu/h or smaller

Definition The seasonal cooling efficiency of a direct expansion (DX) cooling system at ~~ARI~~AHRI rated conditions as a ratio of output over input in Btu/h per W, excluding fan energy. The software must accommodate user input in terms of either the *Energy Efficiency Ratio (*EER) or the *Seasonal Energy Efficiency Ratio* (SEER). For equipment with SEER ratings, EER shall be taken from manufacturers' data when it is available.

Units Btu/h-W

Input Restrictions As designed. This input is required for small DX systems. The Direct Expansion Cooling Efficiency input is optional for these systems.

Standard Design Use the minimum SEER from the 2009 Appliance Efficiency Standards.

Direct Expansion Cooling Efficiency Temperature Adjustment Curve

Applicability Packaged DX equipment

Definition A curve that varies the cooling efficiency of a direct expansion (DX) coil as a function of evaporator conditions, condenser conditions, and for small packaged equipment, part-load ratio.

(18)

For air-cooled DX systems:

$$EIR_FT = a + b \times t_{wb} + c \times t_{wb}^{2} + d \times t_{odb} + e \times t_{odb}^{2} + f \times t_{wb} \times t_{odb}$$

(19)

For water-cooled DX systems:

$$EIR_FT = a + b \times t_{wb} + c \times t_{wb}^{2} + d \times t_{wt} + e \times t_{wt}^{2} + f \times t_{wb} \times t_{wt}$$

(20)

$$P_{operating} = P_{rated} \times EIR_FPLR \times EIR_FT \times CAP_FT$$

Commen
this equati

where

PLR Part load ratio based on available capacity (not rated capacity)

EIR-FT A multiplier on the EIR to account for the wet-bulb temperature entering the coil and the outdoor dry-bulb temperature

$Q_{operating}$	Present load on heat pump (Btu/h)
$Q_{available}$	Heat pump available capacity at present evaporator and condenser conditions (in Btu/h).
t_{wb}	The entering coil wet-bulb temperature (°F)
t_{wt}	The water supply temperature (°F)
t_{odb}	The outside-air dry-bulb temperature (°F)
P_{rated}	Rated power draw at ~~ARI~~AHRI conditions (kW)
$P_{operating}$	Power draw at specified operating conditions (kW)

Note: if an air-cooled unit employs an evaporative condenser, t_{odb} is the effective dry-bulb temperature of the air leaving the evaporative cooling unit.

Table 37~~34~~ – Cooling System Coefficients for EIR-FT

Coefficient	Water-Source (Heat Pump)	Water-Source (Other)	Air-Source (PTAC)	Air-Source (PSZ with Cool Cap <=65,000 Btu/h)	Air-Source (Other)
a	2.0280385	-1.8394760	-0.6550461	n/a (see Standard Design)	-1.0639310
b	-0.0423091	0.0751363	0.0388910	n/a	0.0306584
c	0.0003054	-0.0005686	-0.0001925	n/a	-0.0001269
d	0.0149672	0.0047090	0.0013046	n/a	0.0154213
e	0.0000244	0.0000901	0.0001352	n/a	0.0000497
f	-0.0001640	-0.0001218	-0.0002247	n/a	-0.0002096

Units Data structure

Input Restrictions For equipment larger than 135,000 Btu/h, the user may enter data on equipment performance as described below. In this case, the ACM compliance software shall use the algorithms described below to determine the temperature dependent performance curves for the proposed design equipment. If the user chooses not to enter data on temperature dependent performance, then the defaults shall be used.

For equipment with a capacity less than or equal to 135,000 Btu/h, but larger than 65,000 Btu/h, the user may not enter data on the temperature dependent equipment performance. However, the ACM compliance software vendor may work with manufacturers to collect such data and build this data into the ACM compliance software. The user may either select equipment for which the ACM compliance software vendor has collected or use the defaults.

NOTE: SECTION 2.5.2.6 OF THE NACM HAS SPECIFIC PROCEDURES FOR ENTERING IN USER DATA (FOR INSTANCE, THE NORMALIZED EIR MUST BE MODIFIED BY A F_{FDD} AND F_{AIR} ADJUSTMENT FACTORS BASED ON THE PRESENCE OF FDD AND AIRFLOW TESTING.)

Standard Design For all systems except packaged DX units with cooling capacity <= 65,000 Btu/h, use default curves from Table 55. For packaged DX units with cooling capacity less than or equal to 65,000 Btu/h that have SEER ratings, the user inputs EER and SEER, and the software generates the equipment performance curve based on the algorithm below.

NOTE: TITLE 24-2008 HAS A PROCEDURE FOR DEVELOPING A CURVE-FIT FOR THE EIR-FT BASED ON USER INPUTS OF SEER AND EER. THIS CURVE INCORPORATES BOTH TEMPERATURE EFFECTS AND PART-LOAD EFFECTS. SOFTWARE MUST BE ABLE TO GENERATE

A BI-QUADRATIC CURVE FROM INPUT DATA TO USE THIS APPROACH. SEE 2.5.2.7 – THIS ONLY APPLIES TO EQUIPMENT WITH SEER RATINGS.

This curve explains how the efficiency of the cooling equipment varies with the ODB and the EWB. This curve is derived from entered or default values of SEER and EER, using the procedures below.

The curve is defined as a bi-quadratic with the following coefficients.

COOL-EIR- FT =	CURVE-FIT
TYPE =	BI-QUADRATIC
DATA =	(67, 95, 1.0, $~~ARI~~AHRI Test Conditions
	57, 82, $NEIR_{57,82}$
	57, 95, $NEIR_{57,95}$,
	57,110,$NEIR_{57,110}$,
	67, 82, $NEIR_{67,82}$,
	67,110, $NEIR_{67,110}$,
	77, 82, $NEIR_{77,82}$,
	77, 95, $NEIR_{77,95}$,
	77,110, $NEIR_{77,110}$)
OUTPUT-MIN =	$NEIR_{67,82}$

$NEIR_{WBT,ODB}$ represents the normalized energy input ratio (EIR) for various entering wet-bulb (EWB) and outside dry-bulb (ODB) temperatures. The value represents the EIR at the specified EWB and ODB conditions to the EIR at standard ~~ARI~~AHRI conditions of 67° ºF wet-bulb and 95° ºF dry-bulb. The COOL-EIR-FT curve is normalized at ~~ARI~~AHRI conditions of 67° ºF entering wet-bulb and 95° ºF outside dry-bulb so $NEIR_{67,95}$ is one or unity, by definition. For other EWB and ODB conditions, values of NEIR are calculated with Equation N2-21~~Equation N2-21~~.

Formatte grammar

Equation N2-21

$$NEIR_{EWB,ODB} = \frac{EIR_{EWB,ODB}}{EIR_{67,95}}$$

The energy input ratio (EIR) is the unitless ratio of energy input to cooling capacity. EIR includes the compressor and condenser fan, but not the supply fan. If the energy efficiency ratio EERnf (EER excluding the fan energy) is known for a given set of EWB and ODB conditions, the EIR for these same conditions is given by Equation N2-22~~Equation N2-22~~ below. The units of EER are (Btu/h)/W.

Formatte grammar

Equation N2-22

$$EIR_{EWB,ODB} = \frac{3.413}{EERnf_{EWB,ODB}}$$

If the EER (including fan energy) is known for a given set of EWB and ODB conditions, then the EERnf (no fan) can be calculated from Equation N2-23~~Equation N2-23~~ below.

Equation N2-23

$$\begin{aligned} EERnf_{EWB,ODB} &= 1.0452 \times EER_{EWB,ODB} \\ &+ 0.0115 \times EER_{EWB,ODB}{}^{2} \\ &+ 0.000251 \times EER_{EWB,ODB}{}^{3} \times F_{FDD} \times F_{AIR} \end{aligned}$$

Equation N2-24

$$\begin{aligned} EERnf_{EWB,ODB} &= (1.0452 \times EER_{EWB,ODB} \\ &+ 0.0115 \times EER_{EWB,ODB}{}^{2} \\ &+ 0.000251 \times EER_{EWB,ODB}{}^{3}) \times F_{FDD} \times F_{AIR} \end{aligned}$$

The EER for different EWB and ODB conditions. These are given by the following equations.

Equation N2-25

$$EER_{67,82} = SEER$$

Equation N2-26

$$EER_{67,95} = \text{From Manufacturers Data} \quad \text{[when available]}$$
$$= 10 - (11.5 - SEER) \times 0.83 \quad \text{[default for SEER} < 11.5\text{]}$$
$$= 10 \quad \text{[default for SEER} \geq 11.5\text{]}$$

Equation N2-27

$$EER_{67,110} = EER_{67,95} - 1.8$$

Equation N2-28

$$EER_{57,ODB} = 0.877 \times EER_{67,ODB}$$

Equation N2-29

$$EER_{77,ODB} = 1.11 \times EER_{67,ODB}$$

F_{TXV} Refrigerant charge factor, default = 0.9. For systems with a verified TXV or verified refrigerant charge, the factor shall be 0.96.

F_{AIR} Airflow adjustment factor. Default cooling air flow shall be assumed in calculations for any system in which the air flow has not been tested, certified and verified. For ACM compliance software energy calculations the F_{air} multiplier shall be set to 0.925 for systems with default cooling air flow. For systems with air flow verified, F_{air} shall be 1.00.

EERnf Energy Efficiency Ratio at ~~ARI~~AHRI conditions without distribution fan consumption, but adjusted for refrigerant charge and airflow.

Commen
no longer

Direct Expansion Part-Load Efficiency Adjustment Curve

Applicability Packaged systems with direct expansion (DX) cooling

Definition A normalized performance adjustment curve to the rated efficiency (Energy Input Ratio) that describes how the efficiency varies at part-load conditions. At a value of 1 (full load), the normalized efficiency is 1 (same as part-load conditions).

The default curves are given as follows as adjustments to the energy input ratio (EIR)[8]:

(30)

$$PLR = \frac{Q_{operating}}{Q_{available}(t_{wb}, t_{odb/wt})}$$

[8] The EIR is the ratio of energy used by the system to cooling capacity in the same units. It is the reciprocal of the coefficient of performance (COP). EnergyPlus uses a part-load factor correlation for PLF as a function of PLR. The EnergyPlus PLF is related to the DOE-2 EIR(PLR) by the following: EIR-FPLR = PLR / PLF.

(31)

$$EIR_FPLR = a + b \times PLR + c \times PLR^2 + d \times PLR^3$$

$$PLF_FPLR = a + b \times PLR + c \times PLR^2 + d \times PLR^3$$

This curve may take the form of a part-load factor (PLF) or EIR-FLPR, which is the fraction of time the unit must run to meet the part-load for that hour. For example, at 40% of full load, the equipment might need to run 50% of the hour (for cycling losses).

Note that for small packaged equipment with SEER ratings (<65,000 Btu/h), the part-load efficiency curve is set to no degradation, since the part-load degradation is built-into the *Direct Expansion Cooling Efficiency Temperature Adjustment Curve*.

Default curves are provided for the different major classes of equipment.

Units Coefficients (three for a quadratic, or up to four for a cubic)

Input Restrictions The coefficients should sum to 1 (within a small tolerance). This corresponds to a curve output of 1 for an input of 1.

Standard Design The baseline part-load efficiency adjustment curves are shown in the tables below.

Table 38~~35~~ – Cooling System Coefficients for EIR-FPLR

Coefficient	Water-Source (Heat Pump)	Water-Source (Other)	Air-Source (PTAC)	Air-Source (PSZ with Cap<65,000 Btu/h)	Air-Source (Other)
a	0.1250000	0.2012301	0.1250000	0	0.2012301
b	0.8750000	-0.0312175	0.8750000	1	-0.0312175
c	0.0000000	1.9504979	0.0000000	0	1.9504979
d	0.0000000	-1.1205105	0.0000000	0	-1.1205105

Table 39~~36~~ – Cooling System Coefficients for Part-Load Factor (PLF) Correlation (EnergyPlus)

Coefficient	Water-Source (Heat Pump)	Water-Source (Other)	Air-Source (PTAC)	Air-Source (PSZ with Cap<65,000 Btu/h)	Air-Source (Other)
a	0.85	0	0.85	1	0
b	0.15	5.1091	0.15	0	5.1091
c	0	-8.5515	0	0	-8.5515
d	0	4.4744	0	0	4.4744

Refrigerant Charge Factor

Applicability Packaged systems

Definition An adjustment factor to the cooling efficiency and for heat pumps, heating efficiency, curves for packaged equipment. The refrigerant charge factor is a divisor in the term for cooling efficiency (energy input ratio) or multiplier in the adjustment of energy efficiency ratio that assumes slightly degraded performance if refrigerant charge is not verified through acceptance test procedures in the Nonresidential Appendix of the Standards.

Units Ratio

Input Restrictions ~~Refrigerant charge factor, default = 0.9. For systems with a verified TXV or verified refrigerant charge, the factor shall be 0.96.~~

Prescribed at 0.96.

~~For evaporative cooling systems that meet the Western Cooling Challenge requirements, the refrigerant charge factor shall be 0.96.~~

Standard Design The default shall be 0.96 for all systems with ~~ARI~~AHRI cooling capacity of 54,000 Btu/h or greater.

Airflow Adjustment Factor

Applicability Packaged systems

Definition An adjustment factor to the cooling efficiency and for heat pumps, heating efficiency, curves for packaged equipment. The airflow adjustment factor is a divisor in the term for cooling efficiency (energy input ratio) or multiplier in the term for energy efficiency ratio that assumes slightly degraded performance if airflow is not verified through acceptance test procedures in the Nonresidential Appendix of the Standards.

Units Ratio

Input Restrictions ~~For ACM compliance software energy calculations the airflow adjustment factor (F_{air}) multiplier shall be set to 0.925 for systems with default cooling air flow. For systems with air flow verified meeting the requirements of Reference Appendix NA9, F_{air} shall be 1.00.~~

Prescribed at 1.0.

~~For evaporative cooling systems that meet the Western Cooling Challenge requirements, the airflow adjustment factor shall be 1.00.~~

Standard Design The default shall be 1.00 for all systems with ~~ARI~~AHRI cooling capacity of 54,000 Btu/h or greater.

NOTE: THE FOLLOWING BUILDING DESCRIPTORS APPLY TO THE SINGLE-ZONE VAV SYSTEM, WHICH IS THE BASELINE FOR APPLICABLE BUILDINGS WITH ZONE COOLING LOADS OF 110,000 BTU/H OR GREATER, AND THE REQUIREMENT SCOPE EXPANDS TO UNITS WITH CAPACITY OF 75,000 BTU/H OR GREATER IN 2014 AND 65,000 BTU/H OR GREATER IN 2016.

TABLE 140.4-D EFFECTIVE DATES FOR FAN CONTROL SYSTEMS

Cooling System Type	Fan Motor Size	Cooling Capacity	Effective Date
DX Cooling	any	≥ 110,000 Btu/hr	1/1/2012
		≥ 75,000 Btu/hr	1/1/2014
		≥ 65,000 Btu/hr	1/1/2016
Chilled Water and Evaporative	≥ 5 HP	any	1/1/2010
	≥ 1 HP	any	1/1/2014
	≥ 1/4 HP	any	1/1/2016

Number of Cooling Stages

Applicability Single Zone VAV Systems and DX systems with multiple stages

Definition This applies to the baseline HVAC system Single Zone VAV. This system is a

	packaged unit with multiple compressors and a two-speed or variable-speed fan. Systems with unequally sized compressors may have additional cooling stages.
Units	None (Integer)
Input Restrictions	As Designed
Standard Design	The default shall be 2 for the Single Zone VAV baseline.

Total Cooling Capacity by Stage

Applicability	Single Zone VAV Systems and DX systems with multiple stages
Definition	This provides the total cooling capacity of each cooling stage, at ~~ARI~~AHRI rated conditions. The capacity is expressed as an array, with each entry a fraction of the total rated cooling capacity for the unit. For example, if the stage cooling capacity is 4 tons (48,000 Btu/h) and the total cooling capacity is 8 tons (96,000 Btu/h), the capacity is expressed as “0.50” for that stage.
Units	Array of fractions
Input Restrictions	As Designed
Standard Design	The default shall be (0.50, 1) for the Single Zone VAV baseline.

Sensible Cooling Capacity by Stage

Applicability	Single Zone VAV Systems and DX systems with multiple stages
Definition	This provides the sensible cooling capacity of each cooling stage, at AHRI rated conditions. The capacity is expressed as an array, with each entry a fraction of the total rated sensible cooling capacity for the unit. For example, if the stage sensible cooling capacity is 3.5 tons (42,000 Btu/h) and the total sensible cooling capacity is 7 tons (72,000 Btu/h), the capacity is expressed as "0.5" for that stage." ~~This provides the sensible cooling capacity of each cooling stage, at ARI rated conditions. The capacity is expressed as an array, with each entry a fraction of the total rated cooling capacity for the unit. For example, if the stage sensible cooling capacity is 3 tons (36,000 Btu/h) and the total cooling capacity is 9 tons (108,000 Btu/h), the capacity is expressed as “0.33” for that stage.~~
Units	Array of fractions
Input Restrictions	As Designed
Standard Design	The default shall be (0.50, 1) for the Single Zone VAV baseline.

Commen

Supply Air Temperature Reset by Stage

Applicability	Single Zone VAV Systems and DX systems with multiple stages
Definition	This provides the cooling supply air temperature setpoint deviation from the cooling design supply air temperature, specified in the building descriptor *Cooling Supply Air Temperature*. The temperature reset is expressed as an array, with each entry a deviation from the design supply air temperature. For example, an entry of “5” for a stage would indicate a 5°F reset (for example, 60°F from 55°F).
Units	Array of temperature differences, in degrees F
Input Restrictions	As Designed
Standard Design	The default shall be (5,0) for the Single Zone VAV baseline.

Number of Heating Stages

Applicability	Single Zone VAV Systems and DX systems with multiple stages
Definition	The number of heating stages provided by the system. Multiple stages could be provided via a heat pump or via a multiple-stage gas furnace.
Units	Integer
Input Restrictions	As Designed
Standard Design	The default shall be 2 for the Single Zone VAV baseline.

Heating Capacity by Stage

Applicability	Single Zone VAV Systems and DX systems with multiple stages
Definition	This provides the total heating capacity of each heating stage, at ~~ARI~~AHRI rated conditions. The capacity is expressed as an array, with each entry a fraction of the total rated cooling capacity for the unit. For example, if the stage heating capacity is 48,000 Btu/h and the heating capacity is 96,000 Btu/h, the capacity is expressed as "0.50" for that stage.
Units	Array of fractions
Input Restrictions	As Designed
Standard Design	The default shall be (0.50, 1) for the Single Zone VAV baseline.

Heating Supply Air Temperature by Stage

Applicability	Single Zone VAV Systems and DX systems with multiple stages
Definition	This provides the heating supply air temperature setpoint deviation from the design heating supply air temperature, specified in the building descriptor ~~*Cooling*~~ *Heating Supply Air Temperature*. The temperature reset is expressed as an array, with each entry a deviation from the design supply air temperature. For example, an entry of "-10" for a stage would indicate a 10°F reset (for example, 95°F from 105°F).
Units	Array of temperature differences, in degrees F
Input Restrictions	As Designed
Standard Design	The default shall be -10F for the first ~~cooling~~ heating stage and 0 for the second (high) ~~cooling~~ heating stage.

Supply Fan Low Speed Ratio

Applicability	Single Zone VAV Systems and DX systems with multiple stages and two-speed fans
Definition	This specifies the low fan speed setting on a Single Zone VAV system or DX system with multiple cooling stages.
Units	None (fraction)
Input Restrictions	As Designed
Standard Design	The default shall be ~~0.66~~the greater of 0.50 or the minimum outside air fraction for the Single Zone VAV baseline.

Supply Fan Low Power Ratio

Applicability	Single Zone VAV Systems and DX systems with multiple stages and two-speed fans
Definition	This specifies the fraction of full load fan power corresponding to low fan speed operation on a Single Zone VAV system or DX system with multiple cooling stages.
Units	None (fraction)
Input Restrictions	As Designed
Standard Design	The default shall be ~~0.40~~0.30, or the minimum power ratio calculated by applying the minimum outside air fraction to the "Any Fan with VSD" curve, for the Single Zone VAV baseline.

NOTE: THE FOLLOWING FOUR BUILDING DESCRIPTORS REPLACE THE PROCEDURE FROM THE 2008 NONRESIDENTIAL ACM APPENDIX D FOR DISTRIBUTION LOSSES FOR DUCTWORK IN UNCONDITIONED SPACES.

Duct Leakage Rate

Applicability	Packaged single-zone systems serving spaces less than 5,000 ft2 with ducts in unconditioned spaces
Definition	The duct air leakage rate from the supply and return duct of a packaged single zone system with ducts in unconditioned spaces.
Units	Ratio
Input Restrictions	The input may contain one of the following three values:

Table 40~~37~~ – Duct Leakage Factors

	as = ar =
Untested duct systems	0.82
Sealed and tested duct systems in existing buildings, System tested after HVAC equipment and/or duct installation	0.915
Sealed and tested new duct systems. System tested after HVAC system installation	0.96

Standard Design	The baseline value shall be 0.96~~, except: for systems that serve residential occupancies including hotel/motel guest rooms, the baseline value shall be the same as proposed.~~

~~***Duct Surface Area***~~

~~*Applicability*~~	~~Packaged single-zone systems serving non-residential spaces less than 5,000 ft2 with ducts in unconditioned spaces~~
~~*Definition*~~	~~The duct surface area used for duct heat transfer calculations.~~
~~*Units*~~	~~ft^2~~
~~*Input Restrictions*~~	~~Any positive number~~
~~*Standard Design*~~	~~For systems serving nonresidential occupancies, the default duct surface area shall~~

~~be:~~

~~The default duct surface area for supply and return shall be calculated as follows:~~

~~For supplies:~~

~~Equation ND1~~ $A_{s,total} = K_s A_{floor}$

~~Where K_s (supply duct surface area coefficient) shall be 0.25 for systems serving the top story only, 0.125 for systems serving the top story plus one other, and 0.08 for systems servings three or more stories.~~

~~For returns:~~

~~Equation ND2~~ $A_{r,total} = K_r A_{floor}$

~~Where K_r (return duct surface area coefficient) shall be 0.15 for systems serving the top story only, 0.125 for systems serving the top story plus one other, and 0.08 for systems servings three or more stories.~~

~~For systems serving residential occupancies, including hotel/motel guestrooms, the baseline shall be same as proposed.~~

~~Duct Surface Area Outdoors~~

~~*Applicability*~~	~~Packaged single-zone systems serving spaces less than 5,000 ft2 with ducts in unconditioned spaces~~
~~*Definition*~~	~~The duct surface area for the portion of ductwork located outdoors. The remainder of the supply ductwork for applicable systems (See Standard 140.4(k) is assumed to be in unconditioned space between the ceiling and roof.~~
~~*Units*~~	~~ft^2~~
~~*Input Restrictions*~~	~~Any positive number~~
~~*Standard Design*~~	~~For systems serving nonresidential spaces, the default duct surface area shall be:~~

~~If ducts are located outdoors, the outdoor duct surface area shall be calculated from the duct layout on the plans using measured duct lengths and nominal inside diameters (for round ducts) or inside perimeters (for rectangular ducts) of each outdoor duct run in the building that is within the scope of the calculation procedure. When using the default duct area, outdoor supply duct surface area shall be less than or equal to the default supply duct surface area; outdoor return duct surface area shall be less than or equal to the default return duct surface area.~~

~~The surface area of ducts located in the buffer space between ceilings and roofs shall be calculated from:~~

~~Equation ND-3~~ $A_{s,buffer} = A_{s,total} - A_{s,outdoors}$

~~Equation ND4~~ $A_{r,buffer} = A_{r,total} - A_{r,outdoors}$

~~For systems serving residential spaces including hotel/motel guestrooms, the baseline shall be the same as the proposed.~~

~~Duct Insulation Level~~

~~*Applicability*~~	~~Packaged single-zone systems serving spaces less than 5,000 ft2 with ducts in~~

	~~unconditioned spaces~~
~~*Definition*~~	~~The duct insulation R-value for supply and return ductwork for applicable systems~~
~~*Units*~~	~~h-ft^2-F / Btu~~
~~*Input Restrictions*~~	~~Any positive number~~
~~*Standard Design*~~	~~Nonresidential buildings: R-8 is the baseline insulation level for ductwork in both new construction and alterations of existing buildings~~ ~~Residential Buildings (including hotel/motel guestrooms): same as proposed~~

Minimum Unloading Ratio

Applicability	Packaged systems which use hot-gas bypass during low load conditions
Definition	The upper end of the hot-gas bypass operating range. This is the percentage of peak cooling capacity below which hot-gas bypass will operate. The actual unloading ratio shall be set to 50% of the user-entered minimum unloading ratio, with hot-gas-bypass operating below this level.
Units	Ratio
Input Restrictions	As designed. The user must enter this descriptor for each DX cooling system. If hot-gas bypass is not employed, a value of 0 may be entered. A maximum of 0.35 is allowed for units with a peak cooling capacity greater than or equal to 65 kBtu/h and less than 240 kBtu/h (20 tons), and a maximum value of 0.25 is allowed for units with a peak cooling capacity greater than 240 kBtu/h.
Standard Design	Not applicable

Commen
EnergyPlu

Minimum HGB Ratio

Applicability	Packaged systems which use hot-gas bypass during low load conditions
Definition	The lower end of the hot-gas bypass operating range. The percentage of peak cooling capacity below which hot-gas bypass will no longer operate (i.e. the compressor will cycle).
Units	Ratio
Input Restrictions	0
Standard Design	0

Commen
EnergyPlu

Condenser Type

Applicability:	All direct expansion systems including heat pumps
Definition	The type of condenser for a direct expansion (DX) cooling system. The choices are: • Air-Cooled • Water-Cooled • Air-Cooled with Evaporative Pre-cooler
Units	List (see above)
Input Restrictions	As designed
Standard Design	Based on the prescribed system type. Refer to the HVAC System Map in **Error! Reference source not found.**.

Table 41~~38~~ – Baseline Building Condenser Type

Baseline building System	Condenser Type
System 1 – PTAC	Air-cooled
System 2 – FPFC	Water-cooled
System 3 – PSZ-AC	Air-cooled
System 5 – Packaged VAV with Reheat	Air-cooled
System 6 – VAV with Reheat	~~Water-Cooled~~N/A
System 7 – Single Zone VAV	N/A
System 9 – Heating and Ventilation	N/A
System 10 – CRAH Unit	~~Water-Cooled~~N/A
System 11 – CRAC Unit	~~N/A~~Air-Cooled

Condenser Flow Type

Applicability: All direct expansion systems including heat pumps

Definition Describes water flow control for a water-cooled condenser. The choices are:

- Fixed Flow
- Two-position
- Variable Flow

Units List (see above)

Input Restrictions Default to fixed flow. If the variable-flow is selected, the software must indicate that supporting documentation is required on the output forms.

Standard Design ~~Always fixed flow~~Two-position

5.7.5.3 Evaporative Cooler

This is equipment that pre-cools the outside air that is brought into the building. It may be used with any type of cooling system that brings in outside air. This equipment is not applicable for the baseline building.

Evaporative Cooling Type

Applicability Systems with evaporative pre-cooling

Definition The type of evaporative pre-cooler, including:

- None
- Non-Integrated Indirect
- Non-Integrated Direct/Indirect
- Integrated Indirect
- Integrated Direct/Indirect
- ~~Western Cooling Challenge (high efficiency)~~

An integrated pre-cooler can operate together with the compression or CHW cooling. A non-integrated pre-cooler will shut down the evaporative cooling whenever it is unable to provide 100% of the cooling required.

In all cases, the evaporative pre-cooler must be modeled with 100% of the outside air routed through the pre-cooler.

~~The Western Cooling Challenge is a special case of evaporative cooling system that meets the performance and water use requirements defined by the challenge, sponsored by the Western Cooling Efficiency Center. Systems that pass this certification may be modeled like a DX unitary system, with an EER as specified by the results of the test. Special documentation requirements may apply.~~

Units None

Input Restrictions As designed

Standard Design Not applicable

Direct Stage Effectiveness

Applicability Systems with evaporative pre-cooling

Definition The effectiveness of the direct stage of an evaporative cooling system. Effectiveness is defined as follows:

$$DirectEFF = \frac{Tdb - Tdirect}{Tdb - Twb} \tag{32}$$

where

DirectEFF	The direct stage effectiveness
T_{db}	The entering air dry-bulb temperature
T_{wb}	The entering air wet-bulb temperature
T_{direct}	The direct stage leaving dry-bulb temperature

Units Numeric (0 <= eff <=1)

Input Restrictions As designed

Standard Design Not applicable

Indirect Stage Effectiveness

Applicability Systems with evaporative pre-cooling

Definition The effectiveness of the indirect stage of an evaporative cooling system. Effectiveness is defined as follows:

$$IndEFF = \frac{Tdb - Tind}{Tdb - Twb} \tag{33}$$

where

IndEFF	The indirect stage effectiveness
Tdb	The entering air dry-bulb temperature of the supply air
Twb	The entering air wet-bulb temperature of the “scavenger air”
Tind	The supply air leaving dry-bulb temperature

Units Numeric (0 <= eff <=1)

Input Restrictions As designed

Standard Design Not applicable

Evaporative Cooling Performance Curves

Applicability Systems with evaporative cooling

Definition A curve that varies the evaporative cooling effectiveness as a function of primary air stream airflow. The default curves are given as follows:

$$PLR = \frac{CFM_{operating}}{CFM_{design}} \tag{34}$$

$$EFF_FFLOW = a + b \times PLR + c \times PLR^2$$

where

PLR	Part load ratio of airflow based on design airflow
EFF-FFLOW	A multiplier on the evaporative cooler effectiveness to account for variations in part load
$CFM_{operating}$	Operating primary air stream airflow (cfm)
CFM_{design}	Design primary air stream airflow (cfm)

Table 42~~39~~ – Part Load Curve Coefficients – Evaporative Cooler Effectiveness

Coefficient	Direct	Indirect
a	1.1833000	1.0970000
b	-0.2575300	-0.1650600
c	0.0742450	0.0680690

Units Data structure

Input Restrictions User may input curves or use default curves. If defaults are overridden, the software must indicate that supporting documentation is required on the output forms.

Standard Design Not used.

Auxiliary Evaporative Cooling Power

Applicability Systems with evaporative cooling

Definition The auxiliary energy of the indirect evaporative cooler fan, and the pumps for both direct and indirect stages

Units - Watts

Input Restrictions As designed

Standard Design Not applicable

Evaporative Cooling Scavenger Air Source

Applicability Systems with evaporative cooling

Definition The source of scavenger air for an indirect section of an evaporative cooler. Options include:

- Return Air
- Outside Air

Units	List (see above)
Input Restrictions	As designed
Standard Design	Not applicable

5.7.5.4 Western Cooling Challenge (WCC) Equipment

A special credit is available in the 2013 ACM for equipment (including evaporative equipment) that meets efficiency and water use requirements of the Western Cooling Challenge, a program of the Western Cooling Efficiency Center. This compliance option triggers an Exceptional Condition and documentation requirements – see Chapter 3 of the ACM Reference Manual.

This equipment is modeled as high-efficiency DX equipment, with a constant volume fan, integrated economizer and fixed performance curve. Unlike the input model for a packaged DX equipment, the WCC equipment has many building descriptor inputs fixed (prescribed); therefore, rather than listing the WCC input restrictions as an option within each building descriptor, all requirements for WCC equipment are contained in this section.

Heating equipment must be specified separately, as the WCC test procedure does not include heating conditions. The heating system may be any system other than a heat pump.

Building Descriptor	Section	Proposed Input
System Type	5.7.1	PSZ-AC and PSZVAV-AC only
Cooling Supply Air Temperature	5.7.2.2	20F below return air temperature
Cooling Supply Air Temperature Control	5.7.2.2	Fixed (single zone system)
Heating Supply Air temperature	5.7.2.3	105F
Heating Supply Air Temperature Control	5.7.2.3	Fixed (constant)
Supply Fan Design Air Rated Capacity	5.7.3	400 cfm/ton
Fan Control Method	5.7.3	Constant Volume
Supply Fan Power Index	5.7.3.2	0.365 W/cfm
Maximum Outside Air Ratio	5.7.4.1	1
Design Outside Air Flow	5.7.4.1	*(as designed)*
Economizer Control Type	5.7.4.2	Differential dry-bulb
Economizer Integration Level	5.7.4.2	Integrated
Economizer High Temperature Lockout	5.7.4.2	n/a
Economizer low temperature lockout	5.7.4.2	n/a
Cooling Source	5.7.5	DX
Total Cooling Capacity	5.7.5	As designed *(NOTE: if there are unmet load hours, the user will have to enter a larger capacity system, or add a supplemental DX unit with standard efficiency (EER~11) to meet cooling load.)*

Sensible Cooling Capacity	5.7.5	As Designed
Cooling Capacity Adjustment Curves	5.7.5	Use Air-cooled DX defaults
Coil Bypass Factor (if used)	5.7.5	0.190
Direct Expansion Cooling Efficiency	5.7.5.2	As designed *(user enters EER from WCC test, and software makes adjustment for EER, removing fan power from efficiency as needed)*
Seasonal Energy Efficiency Ratio	5.7.5.2	n/a
Direct Expansion Cooling Efficiency Temperature Adjustment Curve	5.7.5.2	Use default curve
Direct Expansion Part-Load Efficiency Adjustment Curve	5.7.5.2	Use default curve
Refrigerant Charge Factor	5.7.5.2	1
Airflow Adjustment Factor	5.7.5.2	1
Duct Leakage Rate, Duct Surface Area, Duct Surface Area Outdoors, Duct Insulation Level	5.7.5.2	As designed *(for qualifying spaces)*
Minimum Unloading Ratio	5.7.5.2	0.25 (units > 240 kBtu/h) 0.35 (units >= 65 kBtu/h and < 120 kBtu/h)
Cooling Setpoint Schedule	5.4	Use default schedule for space type (this will be 75F when occupied, in most cases)
Heating		
Heating Source	5.7.6.1	As designed (but heat pump not allowed)
Preheat Coil	5.7.6.2	No preheat coil
Heating Coil Capacity	5.7.6.3	As designed
Furnace Capacity	5.7.6.4	As designed
Furnace Fuel Heating Efficiency	5.7.6.3	As designed
Furnace Fuel Heating Part Load Efficiency Curve	5.7.6.4	Fixed default curve
Furnace Fuel Heating Pilot	5.7.6.4	0
Furnace Fuel Heating Fan/Auxiliary	5.7.6.4	N/A
Heat recovery	5.7.6.6	*NOT ALLOWED for this credit*
Humidity Controls and Devices	5.7.7	None

~~5.7.5.4~~5.7.5.5 Evaporative Condenser

Evaporative Condenser Power

Applicability	Direct expansion systems with an evaporatively cooled condenser
Definition	The power of the evaporative precooling unit. This includes any pump(s) and/or fans that are part of the precooling unit.
Units	Watts
Input Restrictions	As designed
Standard Design	Not applicable

Evaporative Condenser Effectiveness

Applicability Direct expansion systems with an evaporatively cooled condenser

Definition The effectiveness of the evaporative precooling unit for a condenser. Effectiveness is defined as follows:

$$DirectEFF = \frac{Tdb - Tdirect}{Tdb - Twb} \tag{35}$$

where

DirectEFF	The direct stage effectiveness
Tdb	The outside air dry-bulb temperature
Twb	The outside air wet-bulb temperature
Tdirect	The direct stage leaving dry-bulb temperature (at the condenser inlet)

Units	Ratio
Input Restrictions	As designed
Standard Design	Not applicable

Evaporative Condenser Operation Range

Applicability Direct expansion systems with an evaporatively cooled condenser.

Definition The temperature range within which the evaporative condenser operates. Two values are provided:

$T_{maximum}$	The threshold outside air dry-bulb temperature below which evaporative condenser operates.
$T_{minimum}$	The threshold outside air dry-bulb temperature above which evaporative condenser operates.

Units	Degrees Fahrenheit (°F)
Input Restrictions	As designed
Standard Design	Not applicable

5.7.5.6 Four-Pipe Fan Coil Systems

This section contains building descriptors required to model four-pipe fan coil systems. Note that this system requires an outside air ventilation source to serve the zones and that an airside economizer is not available.

The fan coil fans shall be modeled with the power-per-unit-flow method. The standard design fan power shall be 0.35 W/cfm when the four-pipe fan coil is the standard design system. See the supply fan ACM section 5.7.3.2 for details.

Supply air flow rates are set at the zone level. Chilled water flow rates are set according to the rules in 5.8.5, Pumps.

Note that additional HVAC components (chiller, boiler, pumps) are needed to fully define this system. If a water-side economizer is specified with this system, refer to section 5.8.4 for a list of applicable building descriptors.

Capacity Control Method

Applicability	Four-pipe fan coil systems
Definition	The control method for the fan coil unit at the zone. The following choices are available: ConstantFanVariableFlow CyclingFan VariableFanConstantFlow VariableFanVariableFlow
Units	List (with choices above)
Input Restrictions	Not a User Input – Derived from building descriptors for fan control and chiller loop flow control
Standard Design	Cycling Fan

~~5.7.5.5~~5.7.5.7 Radiant Cooling

This section describes a floor-based radiant cooling system and the inputs required for Title 24 compliance evaluation.

Hydronic Tubing Length

Applicability	Floor-based radiant cooling systems
Definition	The length of the hydronic tubing in the slab
Units	ft
Input Restrictions	As designed
Standard Design	Not applicable

Hydronic Tubing Inside Diameter

Applicability

	Floor-based radiant cooling systems
Definition	The inside diameter of the hydronic tubing in the slab
Units	ft
Input Restrictions	As designed, between a minimum of ½" and a maximum of ¾"
Standard Design	Not applicable

Temperature Control Type

Applicability	Floor-based radiant cooling systems
Definition	The temperature used for control (operative temperature, mean air temperature, mean radiant temperature, ODB, OWB
Units	None
Input Restrictions	Fixed at Mean Air Temperature for compliance calculations
Standard Design	Not applicable

Rated Flow Rate

Applicability	Floor-based radiant cooling systems
Definition	The temperature used for control (operative temperature, mean air temperature, mean radiant temperature, ODB, OWB
Units	None
Input Restrictions	Fixed at Mean Air Temperature for compliance calculations
Standard Design	Not applicable

Cooling Control Temperature

Applicability	Variable Flow Systems
Definition	The temperature used for control (operative temperature, mean air temperature, mean radiant temperature, ODB, OWB
Units	None
Input Restrictions	Fixed at Mean Air Temperature for compliance calculations
Standard Design	Not applicable

Condensation Control Type

Applicability	Floor-based radiant cooling systems
Definition	The temperature used for control (operative temperature, mean air temperature, mean radiant temperature, ODB, OWB
Units	None
Input Restrictions	Fixed at Mean Air Temperature for compliance calculations
Standard Design	Not applicable

Condensation Control Dewpoint Offset

Applicability	Floor-based radiant cooling systems
Definition	

	The temperature difference above dewpoint that is the minimum cold water supply temperature
Units	None
Input Restrictions	Fixed at 2°F above dewpoint
Standard Design	Not applicable

Rated Pump Power Consumption

Applicability	Floor-based radiant cooling systems
Definition	The rated pump power at design conditions
Units	Watts
Input Restrictions	As Designed
Standard Design	Not applicable

Motor Efficiency

Applicability	Floor-based radiant cooling systems
Definition	The pump motor efficiency
Units	Decimal fraction
Input Restrictions	As Designed
Standard Design	Default motor efficiency from Table N2-20 (*Table numbering may change*) based on motor nameplate hp

Fraction of Motor Heat to Fluid

Applicability	Floor-based radiant cooling systems
Definition	Fraction of the heat from the motor inefficiencies that enters the fluid stream
Units	none
Input Restrictions	As designed. Default is 0.
Standard Design	Not applicable

Cooling High Water Temperature

Applicability	Floor-based radiant cooling systems
Definition	The high temperature used for control. If the water temperature is above the high temperature, the control temperature is set to the low control temperature.
Units	Deg F
Input Restrictions	As Designed
Standard Design	Not applicable

Cooling Low Water Temperature

Applicability	Floor-based radiant cooling systems
Definition	The temperature used for control of the water temperature. If the water temperature of

	the radiant cooling is below this temperature, cooling is disabled.
Units	Deg F
Input Restrictions	Fixed at 55°F
Standard Design	Not applicable

Condensation Control Type	
Applicability	Floor-based radiant cooling systems
Definition	The simulation program may have a means of detecting when condensation is likely to occur on floor surfaces in the space. When this occurs, the simulation can shut off the system to prevent condensation from occurring.
Units	List: None, Simple, Variable
Input Restrictions	As designed
Standard Design	Not applicable

~~5.7.5.6~~5.7.5.8 Chilled Beams

Reserved. Building descriptors will be added to define how chilled beams can be modeled for the proposed design. Chilled beams are not applicable to the standard design system.

~~5.7.5.7~~5.7.5.9 Ground-Source Heat Pumps

Reserved. Building descriptors will be added to define how ground-source heat pumps can be modeled for the proposed design. Chilled beams are not applicable to the standard design system.

~~5.7.5.8~~5.7.5.10 Variable Refrigerant Flow

Reserved. Building descriptors will be added to define how VRF systems can be modeled for the proposed design. Chilled beams are not applicable to the standard design system.

~~5.7.5.9~~5.7.5.11 Underfloor Air Distribution

Reserved. Building descriptors will be added to define how UFAD systems can be modeled for the proposed design. Chilled beams are not applicable to the standard design system.

5.7.6 Heating Systems

5.7.6.1 General

Heating Source	
Applicability	All systems that provide heating
Definition	The source of heating for the heating and preheat coils. The choices are: • Hot water • Steam

- Electric resistance
- Electric heat pump
- Gas furnace
- Gas heat pump (optional feature)
- Oil furnace
- Heat recovery ~~(for preheat coils in proposed designs)~~

Units	List (see above)
Input Restrictions	As designed
Standard Design	Based on the prescribed system type. Refer to the HVAC System Map in ~~Table 5~~**Error! Reference source not found.**.

Field Cod

Table 43~~40~~ – Heating Source for Baseline Building

Baseline Building System	Heating Source
System 1 – PTAC	~~Gas Furnace~~Hot water
System 2 – FPFC	Hot water
System 3 – PSZ-AC	Gas or Oil Furnace
System 5 – Packaged VAV with Reheat	Hot water
System 6 – VAV with Reheat	Hot water
System 7 – Single Zone VAV	Gas or Oil Furnace
System 9 – Heating and Ventilation	Gas or Oil Furnace
System 10 – CRAH Unit, Data Center	None
System 11 – CRAC Unit, Data Center	None

5.7.6.2 Preheat Coil

~~If the proposed design has a preheat coil and it can be modeled in the baseline building system, then the baseline building also has a preheat coil sized to meet the preheat coil temperature specified for the proposed design.~~

Preheat Coil Capacity

Applicability	Systems with a preheat coil located in the outside air stream
Definition	The heating capacity of a preheating coil at design conditions.
Units	Btu/h
Input Restrictions	As designed
Standard Design	~~The baseline building has a pre-heat coil when the proposed design has one. Autosize to maintain the preheat coil temperature of the proposed design.~~not applicable

Preheat Coil Efficiency

Applicability	Systems with a preheat coil with gas heating
Definition	The heating efficiency of a preheating coil at design conditions.
Units	Percentage
Input Restrictions	As designed. Default is 80%.
Standard Design	The baseline building has a pre-heat coil when the proposed design has one. Autosize

to maintain the preheat coil temperature of the proposed design.

5.7.6.3 Hydronic/Steam Heating Coils

Systems with boilers have heating coils, including baseline building systems 1, 5 and 6 and 10.

Heating Coil Capacity	
Applicability	All systems with a heating coil
Definition	The heating capacity of a heating coil at ~~ARI~~AHRI conditions
Units	Btu/h
Input Restrictions	As designed. Adjust the capacity if the number of unmet load hours exceeds ~~300~~150.
Standard Design	Autosize with a heating oversizing factor of 25%. If the number of unmet load hours for the baseline exceeds, reduce the heating coil capacity as indicated in Section 2.6.2.

5.7.6.4 Furnace

Furnace Capacity	
Applicability	Systems with a furnace
Definition	The full load heating capacity of the unit
Units	Btu/h
Input Restrictions	As designed. Adjust the capacity if the number of unmet load hours exceeds ~~300~~150.
Standard Design	Autosize with an oversizing factor of 25% (let the software determine heating capacity based on the building loads). If the number of unmet load hours for the baseline exceeds ~~300~~150, reduce the furnace capacity as indicated in Figure 2 and 2.6.2

Furnace Fuel Heating Efficiency	
Applicability	Systems with a furnace
Definition	The full load thermal efficiency of either a gas or oil furnace at design conditions. The software must accommodate input in either *Thermal Efficiency* (E_t) or *Annual Fuel Utilization Efficiency* (AFUE). Where AFUE is provided, E_t shall be calculated as follows:

Commen
AFUE to E
Residentia

(36)

1) All Single Package Equipment

$$E_t = 0.005163 \times AFUE + 0.4033$$

2) Split Systems, AFUE $\leq$ 83.5

$$E_t = 0.002907 \times AFUE + 0.5787$$

3) Split Systems, AFUE $>$ 83.5

$$E_t = 0.011116 \times AFUE - 0.098185$$

where

AFUE	The annual fuel utilization efficiency (%)
Et	The thermal efficiency (fraction)

Units	Fraction
Input Restrictions	As designed
Standard Design	The baseline efficiency requirement is located in Table E-3 of the 2009 Appliance Efficiency Standards. Use the heating input of the proposed design system to determine the size category.

Furnace Fuel Heating Part Load Efficiency Curve

Applicability	Systems with furnaces
Definition	An adjustment factor that represents the percentage of full load fuel consumption as a function of the percentage full load capacity. This curve shall take the form of a quadratic equation as follows:

Commen
2.1E, SDL

(37)

$$Fuel_{partload} = Fuel_{rated} \times FHeatPLC$$

(38)

$$FHeatPLC = \left(a + b \times \frac{Q_{partload}}{Q_{rated}} + c \times \left(\frac{Q_{partload}}{Q_{rated}} \right)^2 \right)$$

where

FHeatPLC	The Fuel Heating Part Load Efficiency Curve
$Fuel_{partload}$	The fuel consumption at part load conditions (Btu/h)
$Fuel_{rated}$	The fuel consumption at full load (Btu/h)
$Q_{partload}$	The capacity at part load conditions (Btu/h)
Q_{rated}	The capacity at rated conditions (Btu/h)

Table 44~~41~~ – Furnace Efficiency Curve Coefficients

Coefficient	Furnace
a	0.0186100
b	1.0942090
c	-0.1128190

Units	Data structure
Input Restrictions	Fixed
Standard Design	Fixed

Furnace Fuel Heating Pilot

Applicability	Systems that use a furnace for heating
Definition	The fuel input for a pilot light on a furnace
Units	Btu/h
Input Restrictions	As designed
Standard Design	Zero (pilotless ignition)

Furnace Fuel Heating Fan/Auxiliary

Applicability	Systems that use a furnace for heating
Definition	The fan energy in forced draft furnaces and the auxiliary (pumps and outdoor fan) energy in fuel-fired heat pumps
Units	Kilowatts (kW)
Input Restrictions	As designed
Standard Design	Not applicable

5.7.6.5 Electric Heat Pump

Electric Heat Pump Heating Capacity

Applicability	All heat pumps
Definition	The full load heating capacity of the unit, excluding supplemental heating capacity at ~~ARI~~AHRI rated conditions
Units	Btu/h
Input Restrictions	As designed
Standard Design	Autosize and use an oversizing factor of 25% (let the software determine heating capacity based on the building loads). The autosized equipment may need to be downsized to ensure that the number of unmet load hours do not exceed ~~300~~150.

Electric Heat Pump Supplemental Heating Source

Applicability	All heat pumps
Definition	The auxiliary heating source for a heat pump heating system. The common control sequence is to lock out the heat pump compressor when the supplemental heat is activated. Other building descriptors may be needed if this is not the case. Choices for supplemental heat include: • Electric resistance • Gas furnace • Oil furnace • Hot water • Other
Units	List (see above)
Input Restrictions	As designed
Standard Design	Electric resistance

Electric Heat Pump Heating Efficiency

Applicability	All heat pumps
Definition	The heating efficiency of a heat pump at ~~ARI~~AHRI rated conditions as a dimensionless ratio of output over input. The software must accommodate user input in terms of either the *Coefficient of Performance* (COP) or the *Heating Season Performance Factor* (HSPF). Where HSPF is provided, COP shall be calculated as follows:

(39)

1)All Single Package Equipment

$$COP = 0.2778 \times HSPF + 0.9667$$

2)All Split Systems

$$COP = 0.4813 \times HSPF - 0.2606$$

For all unitary and applied equipment where the fan energy is part of the equipment efficiency rating, the COP shall be adjusted as follows to remove the fan energy:

(40)

$$COP_{adj} = \frac{\frac{HCAP_{rated}}{3.413} - BHP_{supply} \times 0.7457}{\frac{HCAP_{rated}}{COP \times 3.413} - BHP_{supply} \times 0.7457}$$

where

COP_{adj}	The adjusted coefficient of performance for simulation purposes
COP	The ~~ARI~~AHRI rated coefficient of performance
$HCAP_{rated}$	The ~~ARI~~AHRI rated heating capacity of a packaged unit (kBtu/h)
BHP_{supply}	The supply fan brake horsepower (bhp).

Refer to building descriptor *Supply Fan BHP*.

Units Unitless

Input Restrictions As designed

Standard Design The minimum requirement is defined in Table 110.2-B of the Standards. Use the heating capacity of the proposed design to determine the size category.

Electric Heat Pump Heating Capacity Adjustment Curve(s)

Applicability All heat pumps

Definition A curve or group of curves that represent the available heat-pump heating capacity as a function of evaporator and condenser conditions. The default curves are given as follows:

(41)

$$Q_{available} = CAP_FT \times Q_{rated}$$

(42)

For air-cooled heat pumps:

$$CAP_FT = a + b \times t_{odb} + c \times t_{odb}^{2} + d \times t_{odb}^{3}$$

(43)

For water-cooled heat pumps:

$$CAP_FT = a + b \times t_{db} + d \times t_{wt}$$

where

$Q_{available}$	Available heating capacity at present evaporator and condenser conditions (kBtu/h)
t_{db}	The entering coil dry-bulb temperature (°F)
t_{wt}	The water supply temperature (°F)
t_{odb}	The outside-air dry-bulb temperature (°F)
Q_{rated}	Rated capacity at ~~ARI~~AHRI conditions (in kBtu/h)

Table 45~~42~~ – Heat Pump Capacity Adjustment Curves (CAP-FT)

Coefficient	Water-Source	Air-Source
a	0.4886534	0.2536714
b	-0.0067774	0.0104351
c	N/A	0.0001861
d	0.0140823	-0.0000015

Units Data structure

Input Restrictions User may input curves or use default curves. If defaults are overridden, supporting documentation shall be provided.

(SEE 2.5.2.7 OF THE 2008 NACM)

For air-cooled heat pumps, the user may enter the heating capacity at two different outdoor dry-bulb temperatures: 17°F and 47°F. The compliance software shall be able to generate a curve-fit of the following data points for normalized capacity as a function of outside air dry-bulb temperature:

DATA = (67,1.337)
= (57,1.175)
= (47,1.000)
= (17,CAP17/CAP47)
= (7,0.702×CAP17/CAP47)
= (-13, 0.153)

Standard Design Use default curves.

Electric Heat Pump Heating Efficiency Adjustment Curve(s)

Applicability All heat pumps

Definition A curve or group of curves that varies the heat-pump heating efficiency as a function of evaporator conditions, condenser conditions and part-load ratio. The default curves are given as follows:

(44)

$$PLR = \frac{Q_{operating}}{Q_{available}(t_{db}, t_{odb/wt})}$$

(45)

$$EIR_FPLR = a + b \times PLR + c \times PLR^2 + d \times PLR^3$$

Air Source Heat Pumps:

(46)

$$EIR_FT = a + b \times \left(\frac{t_{odb}}{t_{db}}\right) + c \times \left(\frac{t_{odb}}{t_{db}}\right)^2 + d \times \left(\frac{t_{odb}}{t_{db}}\right)^3$$

Water Source Heat Pumps:

(47)

$$EIR_FT = a + b \times t_{wt} + d \times t_{db}$$

(48)

$$P_{operating} = P_{rated} \times EIR_FPLR \times EIR_FT \times CAP_FT$$

where

PLR	Part load ratio based on available capacity (not rated capacity)
EIR-FPLR	A multiplier on the EIR of the heat pump as a function of part load ratio
EIR-FT	A multiplier on the EIR of the heat pump as a function of the wet-bulb temperature entering the coil and the outdoor dry-bulb temperature
$Q_{operating}$	Present load on heat pump (Btu/h)
$Q_{available}$	Heat pump available capacity at present evaporator and condenser conditions (Btu/h) .
t_{db}	The entering coil dry-bulb temperature (°F)
t_{wt}	The water supply temperature (°F)
t_{odb}	The outside air dry-bulb temperature (°F)
P_{rated}	Rated power draw at ~~ARI~~AHRI conditions (kW)
$P_{operating}$	Power draw at specified operating conditions (kW)

Table 46~~43~~ – Heat Pump Heating Efficiency Adjustment Curves

Coefficient	Air-and Water-Source EIR-FPLR	Water-Source EIR-FT	Air-Source EIR-FT
a	0.0856522	1.3876102	2.4600298
b	0.9388137	0.0060479	-0.0622539
c	-0.1834361	N/A	0.0008800
d	0.1589702	-0.0115852	-0.0000046

Units None

Input Restrictions User may input curves or use default curves. If defaults are overridden, documentation shall be provided.

The Compliance software shall be capable of generating a curve given user inputs of COP at 17°F and 47°F as follows:

DATA = (67,0.856)
= (57,0.919)
= (47,1.000)
= (17,COP47/COP17)
= (7,1.266×COP47/COP17)
= (-13, 3.428)

Standard Design	Use default curves

Commen
inputs for
location a
software t
conductio

	Electric Heat Pump Supplemental Heating Capacity
Applicability	All heat pumps
Definition	The design heating capacity of a heat pump supplemental heating coil at ~~ARI~~AHRI conditions
Units	Btu/h
Input Restrictions	As designed
Standard Design	Autosize

Electric Supplemental Heating Control Temp	
Applicability	All heat pumps
Definition	The outside dry-bulb temperature below which the heat pump supplemental heating is allowed to operate
Units	Degrees Fahrenheit (°F)
Input Restrictions	As designed. Default to 40°F
Standard Design	40°F

Commen
default for

Heat Pump Compressor Minimum Operating Temp	
Applicability	All heat pumps
Definition	The outside dry-bulb temperature below which the heat pump compressor is disabled
Units	Degrees Fahrenheit (°F)
Input Restrictions	As designed. Default to 17°F
Standard Design	17°F

Coil Defrost	
Applicability	Air-cooled electric heat pump
Definition	The defrost control mechanism for an air-cooled heat pump. The choices are: • Hot-gas defrost, on-demand • Hot-gas defrost, timed 3.5 minute cycle • Electric resistance defrost, on-demand • Electric resistance defrost, timed 3.5 minute cycle Defrost shall be enabled whenever the outside air dry-bulb temperature drops below 40°F.
Units	List (see above)
Input Restrictions	Default to use hot-gas defrost, timed 3.5 minute cycle. User may select any of the above.
Standard Design	The baseline building uses the default. **NOTE: THIS IS NOT DEFINED IN THE T24-2008 NACM.**

Coil Defrost kW

Applicability	Heat pumps with electric resistance defrost
Definition	The capacity of the electric resistance defrost heater
Units	Kilowatts (kW)
Input Restrictions	As designed. This descriptor defaults to 0 if nothing is entered.
Standard Design	Not applicable. Baseline building systems 2 and 4 use hot-gas, timed 3.5 minute cycle.

Crank Case Heater kW

Applicability	All heat pumps
Definition	The capacity of the electric resistance heater in the crank case of a direct expansion (DX) compressor. The crank case heater operates only when the compressor is off.
Units	Kilowatts (kW)
Input Restrictions	As designed. This descriptor defaults to 0.1 if nothing is entered.
Standard Design	Zero (0)

Crank Case Heater Shutoff Temperature

Applicability	All heat pumps
Definition	The outdoor air dry-bulb temperature above which the crank case heater is not permitted to operate.
Units	Degrees Fahrenheit (°F)
Input Restrictions	As designed. This descriptor defaults to 50°F.
Standard Design	50°F

5.7.6.6 Heat Recovery

Exhaust Air Sensible Heat Recovery Effectiveness

Applicability Any system with outside air heat recovery

Definition The effectiveness of an air-to-air heat exchanger between the building exhaust and entering outside air streams. Effectiveness is defined as follows:

$$HREFF = \frac{(EEAdb - ELAdb)}{(EEAdb - OSAdb)} \tag{49}$$

where

HREFF	The air-to-air heat exchanger effectiveness
EEAdb	The exhaust air dry-bulb temperature entering the heat exchanger
ELAdb	The exhaust air dry-bulb temperature leaving the heat exchanger
OSAdb	The outside air dry-bulb temperature

Units

	Ratio between 0 and 1
Input Restrictions	As designed
Standard Design	Not applicable

Exhaust Air Latent Heat Recovery Effectiveness

Applicability	Any system with outside air enthalpy heat recovery
Definition	The latent heat recovery effectiveness of an air-to-air heat exchanger between the building exhaust and entering outside air streams. Effectiveness is defined as follows:

(50)

$$HREFF = \frac{(EEAw - ELAw)}{(EEAw - OSAw)}$$

where

HREFF	The air-to-air heat exchanger effectiveness
EEAw	The exhaust air humidity ratio (fraction of mass of moisture in air to mass of dry air) entering the heat exchanger
ELAdb	The exhaust air humidity ratio leaving the heat exchanger
OSAdb	The outside air humidity ratio

Note that for sensible heat exchangers this term is not applicable.

Units	Ratio between 0 and 1
Input Restrictions	As designed
Standard Design	Not applicable

Condenser Heat Recovery Effectiveness

Applicability	Systems that use recover heat from a condenser
Definition	The percentage of heat rejection at design conditions from a DX or heat pump unit in cooling mode that is available for space or water heating.
Units	Percent (%)
Input Restrictions	As designed. The software must indicate that supporting documentation is required on the output forms if heat recovery is specified.
Standard Design	Not applicable

Heat Recovery Use

Applicability	Systems that use heat recovery
Definition	The end use of the heat recovered from a DX or heat pump unit. The choices are:

- Reheat coils
- Water heating

Units	List (see above)
Input Restrictions	As designed. The software must indicate that supporting documentation is required on

	the output forms if heat recovery is specified.
Standard Design	Not applicable

5.7.7 Humidity Controls and Devices

5.7.7.1 General

Humidifier Type	
Applicability	Optional humidifier
Definition	The type of humidifier employed. Choices include: • Hot-Water • Steam • Electric • Evaporative Humidification
Units	List (see above)
Input Restrictions	As designed
Standard Design	Evaporative Humidification (for computer rooms and data centers)

Humidistat Maximum Setting	
Applicability	Systems with humidity control
Definition	The control setpoint for dehumidification
Units	Percent (%)
Input Restrictions	As designed
Standard Design	Same as the proposed design

Humidistat Minimum Setting	
Applicability	Systems with humidity control
Definition	The control setpoint for humidification
Units	Percent (%)
Input Restrictions	As designed
Standard Design	Same as proposed design

5.7.7.2 Desiccant

Desiccant Type	
Applicability	Systems with desiccant dehumidification
Definition	Describes the configuration of desiccant cooling equipment The following configurations for desiccant systems are allowed:

Commen
DOE-2-.1

- LIQ-VENT-AIR1 – a liquid desiccant dehumidifying unit
- LIQ-VENT-AIR2 – a liquid desiccant dehumidifying unit combined with a gas-fired absorption chiller
- SOL-VENT-AIR1 – a solid desiccant dehumidifying unit
- NO-DESICCANT – the default, which indicates that no desiccant system is present

Units List (see above)

Input Restrictions As designed

Standard Design Not applicable

Desiccant Control Mode

Applicability Systems with desiccant dehumidification

Definition The method of controlling the operation of the desiccant unit. For liquid-based systems this can be either:

- Dry-bulb – the desiccant unit is turned on whenever the outside air dry-bulb exceeds a set limit.
- Evaporative cooling– cycles the desiccant unit on when an evaporative cooler is on to maintain a dewpoint setpoint.
- Dewpoint – cycles the desiccant unit on and off to maintain the dewpoint temperature of the supply air.

For solid-based systems the following configurations are possible:

- Dehumidification only – the desiccant unit cycles on and off to maintain indoor humidity levels
- Sensible heat exchanger plus regeneration – the desiccant unit includes a sensible heat exchanger to precool the hot, dry air leaving the desiccant unit. The air leaving the exhaust side of the heat exchanger is directed to the desiccant unit
- Sensible heat exchanger – the desiccant unit includes a heat exchanger, but the air leaving the exhaust side of the heat exchanger is exhausted to the outdoors

Units List (see above)

Input Restrictions As designed

Standard Design Not applicable

Desiccant Air Fraction

Applicability Systems with desiccant dehumidification

Definition The fraction of the supply air that passes through the desiccant unit. Typically either the minimum outside air fraction or all of the air passes through the desiccant system.

Units Ratio

Input Restrictions As designed

Standard Design Not applicable

Desiccant Heat Source

Applicability

Systems with desiccant dehumidification

Definition The source of heat that is used to dry out the desiccant. This can be either:

- Gas – Hydronic – the regeneration heat load is met with a gas-fired heater
- Hot water – the heat load is met with hot water from the plant

Units List (see above)

Input Restrictions As designed

Standard Design Not applicable

Liquid Desiccant Performance Curves

Applicability Systems with liquid-based desiccant dehumidification

Definition A set of performance curves that apply to liquid desiccant systems.

(51)

- $DESC-T-FTW = a + b \times T + c \times T^2 + d \times w + e \times w^2 + f \times T \times w$

(52)

- $DESC-W-FTW = a + b \times T + c \times T^2 + d \times w + e \times w^2 + f \times T \times w$

(53)

- $DESC-Gas-FTW = a + b \times T + c \times T^2 + d \times w + e \times w^2 + f \times T \times w$

(54)

- $DESC-kW-FTW = a + b \times T + c \times T^2 + d \times w + e \times w^2 + f \times T \times w$

where

DESC-T-FTW	temperature leaving desiccant unit
DESC-W-FTW	humidity ratio leaving desiccant unit
DESC-Gas-FTW	Gas usage of desiccant unit
DESC-kW-FTW	Electric usage of desiccant unit
T	entering air temperature
w	entering humidity ratio

Table 47~~44~~ – Liquid Desiccant Unit Performance Curves

Coefficient	DESC-T-FTW	DESC-W-FTW	DESC-Gas-FTW	DESC-kW-FTW
a	11.5334997	11.8993998	58745.8007813	3.5179000
b	0.6586730	-0.2695580	-1134.4899902	-0.0059317
c	-0.0010280	0.0044549	-3.6676099	0.0000000
d	0.2950410	0.0830525	3874.5900879	0.0040401
e	-0.0001700	0.0006974	-1.6962700	0.0000000
f	-0.0008724	0.0015879	-13.0732002	0.0000000

Units Data structure

Input Restrictions As designed, default to values in Table 47~~Table 44~~

Standard Design Not applicable

Desiccant Dewpoint Temperature Setpoint

Applicability	Systems with desiccant dehumidification
Definition	The setpoint dewpoint temperature of the air leaving the desiccant system
Units	Degrees Fahrenheit (°F)
Input Restrictions	As designed. Defaults to 50°F.
Standard Design	Not applicable

Desiccant Heat Exchanger Effectiveness

Applicability	Systems with desiccant dehumidification
Definition	The effectiveness of a sensible heat exchanger used with a desiccant system
Units	Ratio
Input Restrictions	As designed
Standard Design	Not applicable

Desiccant Heat Exchanger Pressure Drop

Applicability	Systems with desiccant dehumidification
Definition	The pressure drop across a sensible heat exchanger used with a desiccant system
Units	in. H_2O
Input Restrictions	As designed. Defaults to 1.0 in. H_2O
Standard Design	Not applicable

5.8 HVAC Primary Systems

5.8.1 Boilers

Boiler Name

Applicability	All boilers
Definition	A unique descriptor for each boiler, heat pump, central heating heat-exchanger or heat recovery device.
Units	None
Input Restrictions	User entry. Where applicable, this should match the tags that are used on the plans for the proposed design.
Standard Design	Boilers are only designated in the baseline model if the Baseline System is of type 1 (PTAC), type 5 (Packages VAV with Reheat) or type 6 (VAV with Reheat).

Boiler Fuel Source

Applicability All boilers

Definition The fuel source for the central heating equipment. The choices are:

- Gas
- Oil
- Electricity

Units List (see above)

Input Restrictions As designed

This input is restricted, based on the choice of Boiler Type, according to the following rules:

	Electricity	Gas	Steam
Steam Boiler			Allowed
Hot Water Boiler		Allowed	

Standard Design ~~Same fuel as the proposed design~~Gas

Boiler Type

Applicability All boilers

Definition The boiler type. Choices include:

- Steam Boiler
- Hot Water Boiler
- Heat-Pump Water Heater

Units List (see above)

Input Restrictions As designed

Standard Design The boiler type will be a hot water boiler for baseline systems 1, 5 and 7 All other system types do not have a boiler.

Boiler Draft Type

Applicability All boilers

Definition How combustion airflow is drawn through the boiler. Choices are:

- Natural (sometimes called atmospheric)
- Mechanical

Natural draft boilers use natural convection to draw air for combustion through the boiler. Natural draft boilers are subject to outside air conditions and the temperature of the flue gases.

Mechanical draft boilers enhance the air flow in one of three ways: 1) Induced draft, which uses ambient air, a steam jet, or a fan to induce a negative pressure which pulls

	flow through the exhaust stack; 2) Forced draft, which uses a fan and ductwork to create a positive pressure that forces air into the furnace, and 3) Balanced draft, which uses both induced draft and forced draft methods to bring air through the furnace, usually keeping the pressure slightly below atmospheric.
Units	List (see above)
Input Restrictions	As designed.
Standard Design	Mechanical (forced).

Number of Identical Boiler Units

Applicability	All boilers
Definition	The number of identical units for staging
Units	Numeric: integer
Input Restrictions	As designed. Default is 1.
Standard Design	The baseline building shall have one boiler for a when the baseline plant serves a conditioned floor area of 15,000 ft^2 or less, and have two equally size boilers for plants serving more than 15,000 ft^2.

~~***Boiler Heat Loss***~~

~~*Applicability*~~	~~All boilers~~
~~*Definition*~~	~~The boiler or heat-exchanger heat loss expressed as a percentage of full load output capacity. This loss only occurs when the boiler is firing.~~
~~*Units*~~	~~Percent (%)~~
~~*Input Restrictions*~~	~~Default is 2% for electric boilers and heat-exchangers and 0% for fuel-fired boilers. If the user overrides the default, supporting documentation is required.~~
~~*Standard Design*~~	~~Prescribed at 2% for electric boilers and heat-exchangers. Prescribed at 0% for fuel-fired boilers, since this loss is already incorporated into the overall thermal efficiency, combustion efficiency or AFUE of the boiler. **(THIS IS NOT EXPLICITLY MENTIONED IN THE 2008 T24 ACM.)**~~

Boiler Design Capacity

Applicability	All boilers
Definition	The heating capacity at design conditions
Units	Btu/h
Input Restrictions	Unmet load hours shall not exceed ~~300~~150. If they do, the proposed boiler capacity shall be increased incrementally until the unmet loads are reduced to ~~300~~ 150 or less.
Standard Design	The boiler is sized to be 25% larger than the peak loads of the baseline building. Baseline boilers shall be sized using weather files containing 99.6% heating design temperatures and 0.5% dry-bulb and 1% wet-bulb cooling design temperatures.

Boiler Efficiency Type

Applicability	All boilers
Definition	The full load efficiency of a boiler is expressed as one of the following:

- *Annual Fuel Utilization Efficiency* (AFUE) is a measure of the boiler's efficiency over a predefined heating season.
- *Thermal Efficiency* (E_t) is the ratio of the heat transferred to the water divided by the heat input of the fuel.
- *Combustion Efficiency* (E_c) is the measure of how much energy is extracted from the fuel and is the ratio of heat transferred to the combustion air divided by the heat input of the fuel.

Units List (see above)

Input Restrictions *Annual Fuel Utilization Efficiency* (AFUE), for all gas and oil-fired boilers with less than 300,000 Btu/h capacity.

Thermal Efficiency (E_t), for all gas and oil-fired boilers with capacities between 225,000 and 2,500,000 Btu/h.

Combustion Efficiency (E_c), for all gas and oil-fired boilers with capacities above 2,500,000 Btu/h.

Standard Design Same as proposed design

Commen Standards

Boiler Efficiency

Applicability All boilers

Definition The full load efficiency of a boiler at rated conditions (see efficiency type above) expressed as a dimensionless ratio of output over input. The software must accommodate input in either *Thermal Efficiency* (E_t) or *Annual Fuel Utilization Efficiency* (AFUE). Where AFUE is provided, E_t shall be calculated as follows:

$$\begin{aligned} &1)\ 75\% \le \text{AFUE} < 80\% \\ &E_t = 0.1 \times AFUE + 72.5\% \\ &2)\ 80\% \le \text{AFUE} \le 100\% \\ &E_t = 0.875 \times AFUE + 10.5\% \end{aligned} \tag{55}$$

All electric boilers will have an efficiency of 100%.

For applicable software, heat input ratio shall be defined as the inverse of thermal efficiency.

Units Ratio

Input Restrictions As designed

Standard Design Boilers for the baseline design are assumed to have the minimum efficiency as listed in Table E-4 of the 2009 CEC Appliance Efficiency Standards.

Boiler Part-Load Performance Curve

Commen section, m boilers tha curves wh temperatu manual ha Charles E

Applicability All boilers

Definition An adjustment factor that represents the percentage full load fuel consumption as a function of the percentage full load capacity. This curve shall take the form of a quadratic equation as follows:

(56)

$$Fuel_{partload} = Fuel_{design} \times FHeatPLC\left(Q_{partload}, Q_{rated}\right)$$

$$FHeatPLC = \left(a + b \times \frac{Q_{partload}}{Q_{rated}} + c \times \left(\frac{Q_{partload}}{Q_{rated}} \right)^2 \right)$$

where

FHeatPLC	The Fuel Heating Part Load Efficiency Curve
$Fuel_{partload}$	The fuel consumption at part load conditions (Btu/h)
$Fuel_{design}$	The fuel consumption at design conditions (Btu/h)
$Q_{partload}$	The boiler capacity at part load conditions (Btu/h)
Q_{rated}	The boiler capacity at design conditions (Btu/h)
a	Constant, 0.082597
b	Constant, 0.996764
c	Constant, -0.079361

Units Ratio

Input Restrictions Prescribed to the part-load performance curve in ACM Appendix 5.7.

Standard Design The baseline building uses the default

Boiler Minimum Unloading Ratio

Applicability All boilers

Definition The minimum unloading capacity of a boiler expressed as a percentage of the rated capacity. Below this level the boiler must cycle to meet the load.

Table 48~~45~~ – Default Minimum Unloading Ratios

Boiler Type	Default Unloading Ratio
Electric Steam	1%
Electric Hot Water	1%
Fuel-Fired Steam	25%
Fuel-Fired Hot Water	25%

Units Percent (%)

Input Restrictions As designed. If the user does not use the default value the software must indicate that supporting documentation is required on the output forms.

Standard Design Use defaults.

Hot Water Supply Temperature

Applicability All boilers

Definition The temperature of the water produced by the boiler and supplied to the hot water loop

Units Degrees Fahrenheit (°F)

Input Restrictions As designed

Standard Design Use 180°F for baseline boiler

Hot Water Return Temperature

Applicability	All boilers
Definition	The temperature of the water returning to the boiler from the hot water loop
Units	Degrees Fahrenheit (°F)
Input Restrictions	As designed
Standard Design	Use ~~130~~140°F for baseline boiler design.

Hot Water Supply Temperature Reset

Applicability	All boilers
Definition	Variation of the hot water supply temperature with outdoor air temperature.
Units	Degrees Fahrenheit (°F)
Input Restrictions	As designed (Not allowed for non-condensing boilers)
Standard Design	Not applicable

Formatte

5.8.2 Chillers

Chiller Name

Applicability	All chillers
Definition	A unique descriptor for each chiller
Units	Text, unique
Input Restrictions	User entry. Where applicable, this should match the tags that are used on the plans.
Standard Design	Chillers are only designated when the baseline system is of type 5 (VAV with reheat)

Chiller Type

Applicability All chillers

Definition The type of chiller, either a vapor-compression chiller or an absorption chiller.

Vapor compression chillers operate on the reverse-Rankine cycle, using mechanical energy to compress the refrigerant, and include:

- Reciprocating*
- Scroll*
- Screw*
- ~~Positive displacement – includes reciprocating (piston-style), scroll and screw compressors~~
- Centrifugal – uses rotating impeller blades to compress the air and impart velocity
- Direct Fired Single Effect Absorption – use a single generator & condenser
- Direct Fired Double Effect Absorption – use two generators/concentrators and condensers, one at a lower temperature and the other at a higher temperature. It is more efficient than the single effect, but it must use a higher temperature heat source.

- Indirect Fired Double Effect Absorption~~, Indirect-Fired~~
- ~~—~~
- ~~Gas Engine Driven Chiller~~

**** Positive displacement – includes reciprocating (piston-style), scroll and screw compressors***

Units List (see above)

Input Restrictions As designed

Standard Design The baseline building chiller is based on the design capacity of the proposed design as follows:

Table 49~~46~~ – Type and Number of Chillers

Building Peak Cooling Load	**Number and Type of Chiller(s)**
<= 300 tons	1 water-cooled screw chiller
>300 tons, < 600 tons	2 water-cooled screw chillers, sized equally
>= 600 tons	A minimum of two (2) water-cooled centrifugal chillers, sized to keep the unit size below 800 tons

Number of Identical Chiller Units

Applicability All chillers

Definition The number of identical units for staging.

Units None

Input Restrictions As designed. Default is 1.

Standard Design From Table 49~~Table 46~~ above, there is one chiller if the baseline system cooling load is 300 tons or less and two equally sized chillers for baseline system loads between 300 and 600 tons. For loads above 600 tons, two or more chillers of equal size are used, with no chiller larger than 800 tons.

Chiller Fuel Source

Applicability All chillers

Definition The fuel source for the chiller. The choices are:

- Electricity (for all vapor-compression chillers)
- Gas (Absorption units only, designated as direct-fired units)
- ~~Oil (Absorption units only, designated as direct-fired units)~~
- Hot Water (Absorption units only, designated as indirect-fired units)
- Steam (Absorption units only, designated as indirect-fired units)

Units List (see above)

Input Restrictions As designed.

This input is restricted, based on the choice of Chiller Type, according to the following rules:

	Electricity	Gas	Hot Water	Steam
Reciprocating	allowed			
Scroll	Allowed			
Screw	Allowed			
Centrifugal	Allowed			
Direct Fired Single Effect Absorption		Allowed	Allowed	Allowed
Direct Fired Double Effect Absorption		Allowed	Allowed	Allowed
Indirect Fired Absorption		Allowed	Allowed	Allowed

Standard Design Electricity

Chiller Rated Capacity

Applicability All chillers

Definition The cooling capacity of a piece of heating equipment at rated conditions.

Units Btu/h or tons

Input Restrictions As designed. If unmet load hours are greater than ~~300~~150 for any zone served by the chiller, the chiller ~~may have to be made larger~~shall be resized by the user.

Standard Design Determine loads for baseline building and oversize by 15%.

Chiller Rated Efficiency

Applicability All chillers

Definition The Efficiency of the chiller (Coefficient of Performance (COP) for air-cooled chillers and kW/ton for water-cooled, positive displacement chillers) at ~~ARI~~AHRI 550/590 rated full-load conditions.

Units Ratio (kW/ton ~~or~~, COP, EER or FIR, depending on chiller type)

Input Restrictions As designed. Must meet the minimum requirements of Table 110.2-D.

Standard Design Use the minimum efficiency requirements from Tables 110.2-D Path B.

If Chiller Type is Reciprocating, Scroll or Screw, use the efficiency for *Positive Displacement* chillers from Table 110.2-D.

Integrated Part-Load Value

Applicability All chillers

Definition The part-load efficiency of a chiller developed from a weighted average of four rating conditions, according to ~~ARI~~AHRI Standard 550.

Units Ratio (kW/ton)

Input Restrictions As designed. Must meet the minimum requirements of Table 110.2-D.

Standard Design Not used. When the standard design system has a chiller, the standard design will

always use Path B performance curves. ~~The proposed design input for IPLV, along with the Chiller Rated Efficiency, determines whether the chiller performance curves will use Path A or Path B.~~

Chiller Minimum Unloading Ratio

Applicability All chillers

Definition The minimum unloading capacity of a chiller expressed as a fraction of the rated capacity. Below this level the chiller must cycle to meet the load.

Table 5047 – Default Minimum Unloading Ratios

Chiller Type	Default Unloading Ratio
Reciprocating	25%
Screw	15%
Centrifugal	10%
Scroll	25%
Single Effect Absorption	10%
Double Effect Absorption	10%

Units Percent (%)

Input Restrictions As designed, but constrained to a minimum value of 10%.. If the user does not employ the default values, supporting documentation is required.

Standard Design Use defaults listed above.

Chiller Cooling Capacity Adjustment Curve

Commen
section, m
chillers tha
curves wh
the leaving
entering c
as chiller p
details.

Applicability All chillers

Definition A curve or group of curves or other functions that represent the available total cooling capacity as a function of evaporator and condenser conditions and perhaps other operating conditions. The default curves are given as follows:

$$Q_{available} = CAP_FT \times Q_{rated} \tag{57}$$

For air-cooled chillers:

$$CAP_FT = a + b \times t_{chws} + c \times t_{chws}^{2} + d \times t_{odb} + e \times t_{odb}^{2} + f \times t_{chws} \times t_{odb} \tag{58}$$

For water-cooled chillers:

$$CAP_FT = a + b \times t_{chws} + c \times t_{chws}^{2} + d \times t_{cws} + e \times t_{cws}^{2} + f \times t_{chws} \times t_{cws} \tag{59}$$

where

$Q_{available}$	Available cooling capacity at present evaporator and condenser conditions (MBH)
t_{chws}	The chilled water supply temperature (°F)
t_{cws}	The condenser water supply temperature (°F)
t_{odb}	The outside air dry-bulb temperature (°F)

Q_{rated} Rated capacity at ~~ARI~~AHRI conditions (MBH)

Note: If an air-cooled unit employs an evaporative condenser, t_{odb} is the effective dry-bulb temperature of the air leaving the evaporative cooling unit.

Separate curves are provided for Path A and Path B chillers in Appendix 5.7.

Table 51~~48~~ – Default Capacity Coefficients – Electric Air-Cooled Chillers

Coefficient	Scroll	Recip	Screw	Centrifugal
a	0.40070684	0.57617295	-0.09464899	N/A
b	0.01861548	0.02063133	0.03834070	N/A
c	0.00007199	0.00007769	-0.00009205	N/A
d	0.00177296	-0.00351183	0.00378007	N/A
e	-0.00002014	0.00000312	-0.00001375	N/A
f	-0.00008273	-0.00007865	-0.00015464	N/A

Table 52~~49~~ – Default Capacity Coefficients – Electric Water-Cooled Chillers

Coefficient	Scroll	Recip	Screw	Centrifugal
a	0.36131454	0.58531422	0.33269598	-0.29861976
b	0.01855477	0.01539593	0.00729116	0.02996076
c	0.00003011	0.00007296	-0.00049938	-0.00080125
d	0.00093592	-0.00212462	0.01598983	0.01736268
e	-0.00001518	-0.00000715	-0.00028254	-0.00032606
f	-0.00005481	-0.00004597	0.00052346	0.00063139

Table 53~~50~~ – Default Capacity Coefficients – Fuel- & Steam-Source Water-Cooled Chillers

Coefficient	Single Stage Absorption	Double Stage Absorption	Direct-Fired Absorption	Engine Driven Chiller
A	0.723412	-0.816039	1.000000	0.573597
B	0.079006	-0.038707	0.000000	0.0186802
C	-0.000897	0.000450	0.000000	0.000000
D	-0.025285	0.071491	0.000000	-0.00465325
E	-0.000048	-0.000636	0.000000	0.000000
F	0.000276	0.000312	0.000000	0.000000

Units Data structure

Input Restrictions Default curves are provided in Appendix 5.7. If the default curves are overridden, supporting documentation is required.

Standard Design Use default curve for Path A and Path B chiller as applicable.

Electric Chiller Cooling Efficiency Adjustment Curves

Applicability All chillers

Definition A curve or group of curves that varies the cooling efficiency of an electric chiller as a function of evaporator conditions, condenser conditions and part-load ratio. Note that for variable-speed chillers, the part-load cooling efficiency curve is a function of both part-load ratio and leaving condenser water temperature. The default curves are given as follows:

(60)

$$PLR = \frac{Q_{operating}}{Q_{available}\left(t_{chws}, t_{cws/odb}\right)}$$

$$EIR_FPLR = a + b \times PLR + c \times PLR^2$$

$$\text{variable-speed} \quad EIR_FPLR = a + b \times PLR + c \times PLR^2 + d \times t_{cws} + e \times t_{cws}{}^2 + f \times PLR \cdot t_{cws} + g \times PLR^3 + h \times t_{cws}{}^3 + i \times PLR^2 \cdot t_{cws} + j \times t_{cws}{}^2 \cdot PLR$$

$$\text{air-cooled} \quad EIR_FT = a + b \times t_{chws} + c \times t_{chws}{}^2 + d \times t_{odb} + e \times t_{odb}{}^2 + f \times t_{chws} \times t_{odb}$$

$$\text{water-cooled} \quad EIR_FT = a + b \times t_{chws} + c \times t_{chws}{}^2 + d \times t_{cws} + e \times t_{cws}{}^2 + f \times t_{chws} \times t_{cws}$$

$$P_{operating} = P_{rated} \times EIR_FPLR \times EIR_FT \times CAP_FT$$

where

PLR	Part load ratio based on available capacity (not rated capacity)
$Q_{operating}$	Present load on chiller (Btu/h)
$Q_{available}$	Chiller available capacity at present evaporator and condenser conditions (Btu/h)
t_{chws}	The chilled water supply temperature (°F)
t_{cws}	The condenser water supply temperature (°F)
t_{odb}	The outside air dry-bulb temperature (°F)
P_{rated}	Rated power draw at ~~ARI~~AHRI conditions (kW)
$P_{operating}$	Power draw at specified operating conditions (kW)

Note: If an air-cooled chiller employs an evaporative condenser, t_{odb} is the effective dry-bulb temperature of the air leaving the evaporative cooling unit.

Table 54~~51~~ – Default Efficiency EIR-FT Coefficients – Air-Cooled Chillers

Coefficient	Scroll	Reciprocating	Screw	Centrifugal
a	0.99006553	0.66534403	0.13545636	N/A
b	-0.00584144	-0.01383821	0.02292946	N/A
c	0.00016454	0.00014736	-0.00016107	N/A
d	-0.00661136	0.00712808	-0.00235396	N/A
e	0.00016808	0.00004571	0.00012991	N/A
f	-0.00022501	-0.00010326	-0.00018685	N/A

Table 55~~52~~ – Default Efficiency EIR-FT Coefficients – Water-Cooled Chillers

Coefficient	Scroll	Reciprocating	Screw	Centrifugal
a	1.00121431	0.46140041	0.66625403	0.51777196
b	-0.01026981	-0.00882156	0.00068584	-0.00400363
c	0.00016703	0.00008223	0.00028498	0.00002028
d	-0.00128136	0.00926607	-0.00341677	0.00698793
e	0.00014613	0.00005722	0.00025484	0.00008290
f	-0.00021959	-0.00011594	-0.00048195	-0.00015467

Table 56~~53~~ – Default Efficiency EIR-FPLR Coefficients – Air-Cooled Chillers

Coefficient	Scroll	Reciprocating	Screw	Centrifugal
a	0.06369119	0.11443742	0.03648722	N/A
b	0.58488832	0.54593340	0.73474298	N/A
c	0.35280274	0.34229861	0.21994748	N/A

Table 57~~54~~ – Default Efficiency EIR-FPLR Coefficients – Water-Cooled Chillers

Coefficient	Scroll	Reciprocating	Screw	Centrifugal	Variable-Speed
a	0.04411957	0.08144133	0.33018833	0.17149273	TBD
b	0.64036703	0.41927141	0.23554291	0.58820208	TBD
c	0.31955532	0.49939604	0.46070828	0.23737257	TBD
d	0	0	0	0	TBD
e	0	0	0	0	TBD
f	0	0	0	0	TBD
g	0	0	0	0	TBD
h	0	0	0	0	TBD
i	0	0	0	0	TBD
j	0	0	0	0	TBD

Units Data structure

Input Restrictions Default curves are specified in Appendix 5.7. If defaults are overridden, supporting documentation is required.

Standard Design Use default curves. A separate set of curves will be provided for Path A water-cooled chillers and Path B water-cooled chillers. The Path is determined by comparing software inputs of full-load efficiency and integrated part-load value with the requirements of Standards Table 110.2-D.

Fuel and Steam Chiller Cooling Efficiency Adjustment Curves

Applicability All chillers

Definition A curve or group of curves that varies the cooling efficiency of a fuel-fired or steam

chiller as a function of evaporator conditions, condenser conditions, and part-load ratio. The default curves are given as follows:

Default Curves for Steam-Driven Single and Double Effect Absorption Chillers

(61)

$$PLR = \frac{Q_{operating}}{Q_{available}(t_{chws}, t_{cws/odb})}$$
$$FIR_FPLR = a + b \times PLR + c \times PLR^2$$
$$FIR_FT = a + b \times t_{chws} + c \times t_{chws}^2 + d \times t_{cws} + e \times t_{cws}^2 + f \times t_{chws} \times t_{cws}$$
$$Fuel_{partload} = Fuel_{rated} \times FIR_FPLR \times FIR_FT \times CAP_FT$$

Default Curves for Direct-Fired Double Effect Absorption Chillers

(62)

$$PLR = \frac{Q_{operating}}{Q_{available}(t_{chws}, t_{cws/odb})}$$
$$FIR_FPLR = a + b \times PLR + c \times PLR^2$$
$$FIR_FT1 = a + b \times t_{chws} + c \times t_{chws}^2$$
$$FIR_FT2 = d + e \times t_{cws} + f \times t_{cws}^2$$
$$Fuel_{partload} = Fuel_{rated} \times FIR_FPLR \times FIR_FT1 \times FIR_FT2 \times CAP_FT$$

The default curves for engine driven chillers are the same format as those for the Steam-Driven Single and Double Effect Absorption Chillers but there are three sets of curves for different ranges of operation based on the engine speed.

where

PLR	Part load ratio based on available capacity (not rated capacity)
FIR-FPLR	A multiplier on the fuel input ratio (FIR) to account for part load conditions
FIR-FT	A multiplier on the fuel input ratio (FIR) to account for the chiller water supply temperature and the condenser water temperature
FIR-FT1	A multiplier on the fuel input ratio (FIR) to account for chilled water supply temperature
FIR-FT2	A multiplier on the fuel input ratio (FIR) to account for condenser water supply temperature
CAP-FT	A multiplier on the capacity of the chiller (see Equation (58))
$Q_{operating}$	Present load on chiller (in Btu/h)
$Q_{available}$	Chiller available capacity at present evaporator and condenser conditions (in Btu/h)
t_{chws}	The chilled water supply temperature (in °F)
t_{cws}	The condenser water supply temperature (in °F)
t_{odb}	The outside air dry-bulb temperature (°F)
$Fuel_{rated}$	Rated fuel consumption at ~~ARI~~AHRI conditions (in Btu/h)
$Fuel_{partload}$	Fuel consumption at specified operating conditions (in Btu/h)

Table 58~~55~~ – Default FIR-FPLR coefficients – Fuel- & Steam-Source Water-Cooled Absorption Chillers

Coefficient	Single Stage Absorption	Double Stage Absorption	Direct-Fired Absorption
a	0.098585	0.013994	0.13551150
b	0.583850	1.240449	0.61798084
c	0.560658	-0.914883	0.24651277
d	-0.243093	0.660441	0.00000000

Table 59~~56~~ – Default FIR-FPLR coefficients – Engine Driven Chillers

Coefficient	%Speed≤Min.	%Speed>Min. %Speed<60%	%Speed>60%
a	0.3802	1.14336	1.38861
b	2.3609	0.022889	-0.388614
c	0.0000	0.0000	0.0000
d	0.0000	0.0000	0.0000

Table 60~~57~~ – Default FIR-FT coefficients – Fuel- & Steam-Source Water-Cooled Absorption Chillers

Coefficient	Single Stage Absorption	Double Stage Absorption	Direct-Fired Absorption
a	0.652273	1.658750	4.42871284
b	0.000000	0.000000	-0.13298607
c	0.000000	0.000000	0.00125331
d	-0.000545	-0.290000	0.86173749
e	0.000055	0.000250	-0.00708917
f	0.000000	0.000000	0.0010251

Table 61~~58~~ – Default FIR-FT coefficients – Engine Driven Chillers

Coefficient	%Speed≤Min.	%Speed>Min. %Speed<60%	%Speed>60%
A	1.0881500	1.2362400	1.2362400
B	0.0141064	0.0168923	0.0168923
C	0.0000000	0.0000000	0.0000000
D	-0.00833912	-0.0115235	-0.0115235
E	0.0000000	0.0000000	0.0000000
F	0.0000000	0.0000000	0.0000000

Units	Data structure
Input Restrictions	User may input curves or use default curves. If defaults are overridden, supporting documentation is required.
Standard Design	Use default curves.

Chilled Water Supply Temperature

Applicability	All chillers
Definition	The chilled water supply temperature of the chiller at design conditions
Units	Degrees Fahrenheit (°F)
Input Restrictions	As designed
Standard Design	

The baseline chilled water supply temperature is set to 44°F.

Chilled Water Return Temperature

Applicability	All chillers
Definition	The chilled water return temperature setpoint
Units	Degrees Fahrenheit (°F)
Input Restrictions	As designed
Standard Design	The baseline chilled water return temperature is set to 64°F.

Chilled Water Supply Temperature Reset

Applicability	All chillers
Definition	The reset schedule for the chilled water supply temperature. The chilled water setpoint may be reset based on demand or outdoor air temperature.
Units	Degrees Fahrenheit (°F)
Input Restrictions	As designed..
Standard Design	Demand-based reset, up to 10°F from design chilled water supply temperature CHWRT goes from 64 to 60 when CHWST goes from 44 to 54.

Condenser Type

Applicability All chillers

Definition The type of condenser for a chiller. The choices are:

- Air-Cooled
- Water-Cooled
- Evaporatively-Cooled

Air-cooled chillers use air to cool the condenser coils. Water-cooled chillers use cold water to cool the condenser and additionally need either a cooling tower or a local source of cold water. Evaporatively-cooled chillers are similar to air-cooled chillers, except they use a water mist to cool the condenser coil which makes them more efficient.

Units	List (see above)
Input Restrictions	As designed
Standard Design	The baseline chiller is always assumed to have a water-cooled condenser, although the chiller type will change depending on the design capacity.

Air-Cooled Condenser Power

Applicability	All chillers with air-cooled condensers where fan energy is not part of the COP.
Definition	The energy usage of the condenser fan(s) at design conditions on an air-cooled chiller. This unit should only be used for chillers composed of separate evaporator and condenser sections where the fan energy is not part of the chiller COP.
Units	Kilowatts (kW)
Input Restrictions	As designed. The user must enter data for remote air-cooled condensing units.

Standard Design	Not applicable, since all baseline chillers have water-cooled condensers.

5.8.3 Cooling Towers

~~**Baseline Building**~~**Standard Design** **Summary**. ~~Baseline building~~ Standard Design system 6 has one or more cooling towers. One tower is assumed to be matched to each ~~baseline building~~ standard design chiller. Each ~~baseline building~~ standard design chiller has its own condenser water pump that operates when the chiller is brought into service. The range between the condenser water return (CWR) and condenser water supply (CWS) is 12 F. The baseline building pumping energy is assumed to be 12 W/gpm. The ~~baseline building~~ cooling tower is assumed to have a variable-speed fan that is controlled to provide a CWS equal to the design dry-bulb temperature when weather permits. ~~The tower fan modulates to maintain a CWS of the design wet-bulb temperature at low wet-bulb conditions. Under cooling conditions closer to design conditions, the CWS floats up to a maximum of 85 F (the design condition).~~ The design approach shall be 10°F.

Cooling Tower Name	
Applicability	All cooling towers
Definition	A unique descriptor for each cooling tower
Units	Text, unique
Input Restrictions	User entry. Where applicable, this should match the tags that are used on the plans.
Standard Design	Descriptive name that keys the baseline building plant

Cooling Tower Type	
Applicability	All cooling towers
Definition	The type of cooling tower employed. The choices are: • Open tower, centrifugal fan • Open tower, axial fan • Closed tower, centrifugal fan • Closed tower, axial fan Open cooling towers collect the cooled water from the tower and pump it directly back to the cooling system. Closed towers circulate the evaporated water over a heat exchanger to indirectly cool the system fluid.
Units	List (see above)
Input Restrictions	As designed
Standard Design	The baseline cooling tower is an open tower axial fan device

Cooling Tower Capacity	
Applicability	All cooling towers
Definition	The tower thermal capacity per cell adjusted to CTI (Cooling Technology Institute) rated conditions of 95 F condenser water return, 85 F condenser water supply, and 78 F wet-bulb with a 3 gpm/nominal ton water flow. The default cooling tower curves below are at unity at these conditions.
Units	Btu/h
Input Restrictions	

Commen
by the tow
Btu/h

	As designed
Standard Design	The baseline building chiller is autosized and increased by 15%. The tower is sized to supply 85 F condenser water at design conditions for the oversized chiller.

Cooling Tower Number of Cells

Applicability	All cooling towers
Definition	The number of cells in the cooling tower. Each cell will be modeled as equal size. Cells are subdivisions in cooling towers into individual cells, each with their own fan and water flow, and allow the cooling system to respond more efficiently to lower load conditions.
Units	Numeric: integer
Input Restrictions	As designed
Standard Design	Same as the proposed design.

Cooling Tower Total Fan Horse Power

Applicability	All cooling towers
Definition	The sum of the nameplate rated horsepower (hp) of all fan motors on the cooling tower. Pony motors should not be included.
Units	Gpm/hp or unitless if energy input ratio (EIR) is specified (If the nominal tons but not the condenser water flow is specified, the condenser design water flow shall be 3.0 gpm per nominal cooling ton.)
Input Restrictions	As designed, but the cooling towers shall meet minimum performance requirements in Table 110.2-G.
Standard Design	The cooling tower fan horsepower is 60 gpm/hp.

.

Cooling Tower Design Wet-Bulb

Applicability	All cooling towers
Definition	The design wet-bulb temperature that was used for selection and sizing of the cooling tower.
Units	Degrees Fahrenheit (°F)
Input Restrictions	As designed, based on the design conditions from Reference Appendix JA2 for the city most closely corresponding to local conditions.
Standard Design	Same as proposed design

Cooling Tower Design Entering Water Temperature

Applicability	All cooling towers
Definition	The design condenser water supply temperature (leaving tower) that was used for selection and sizing of the cooling tower.
Units	Degrees Fahrenheit (°F)
Input Restrictions	As designed. Default to 85°F.
Standard Design	85°F or 10°F above the design wet-bulb temperature, whichever is lower

Cooling Tower Design Return Water Temperature

Applicability	All cooling towers
Definition	The design condenser water return temperature (entering tower) that was used for selection and sizing of the cooling tower.
Units	Degrees Fahrenheit (°F)
Input Restrictions	As designed. Default to 95°F.
Standard Design	Set to a range of 10 F (10°F above the cooling tower design entering water temperature.

Cooling Tower Capacity Adjustment Curve(s)

Applicability	All cooling towers
Definition	A curve or group of curves that represent the available total cooling capacity as a function of outdoor air wet-bulb, condenser water supply and condenser water return temperatures. The default curves are given as follows:

Option 1 (DOE-2 based performance curves)

(63)

$$t_R = t_{cwr} - t_{cws}$$
$$t_A = t_{cws} - t_{owb}$$
$$t_A = a + b \times t_R + c \times t_R{}^2 + d \times FRA + e \times FRA^2 + f \times t_R \times FRA$$
$$FRA = \frac{-d - f \times t_R + \sqrt{(d + f \times t_R)^2 - 4 \times e \times \left(a + b \times t_R + c \times t_R{}^2 - t_A\right)}}{2 \times e}$$
$$FWB = a + b \times FRA + c \times FRA^2 + d \times t_{owb} + e \times t_{owb}{}^2 + f \times FRA \times t_{owb}$$
$$Q_{available} = Q_{rated} \times FWB \times \left(\frac{t_R}{10}\right)$$

Where

$Q_{available}$	Available cooling capacity at present outside air and condenser water conditions (MBH)
Q_{rated}	Rated cooling capacity at CTI test conditions (MBH)
t_{cws}	The condenser water supply temperature (in °F)
t_{cwr}	The condenser water return temperature (in °F)
t_{owb}	The outside air wet-bulb temperature (°F)
t_R	The tower range (in °F)
t_A	The tower approach (in °F)
FRA	An intermediate capacity curve based on range and approach
FWB	The ratio of available capacity to rated capacity (gpm/gpm).

Table 6~~259~~ – Default Capacity Coefficients – Cooling Towers

Commen
from DOE

Coefficient	FRA	FWB
a	-2.22888899	0.60531402
b	0.16679543	-0.03554536
c	-0.01410247	0.00804083
d	0.03222333	-0.02860259
e	0.18560214	0.00024972
f	0.24251871	0.00490857

Option 2: CoolTools performance curve (EnergyPlus)

Approach = Coeff(1) + Coeff(2)•FRair + Coeff(3)•$(FRair)^2$ +Coeff(4)•$(FRair)^3$ + Coeff(5)•FRwater + Coeff(6)•FRair•FRwater + Coeff(7)•$(FRair)^2$•FRwater + Coeff(8)•$(FRwater)^2$ + Coeff(9)•FRair•$(FRwater)^2$ + Coeff(10)•$(FRwater)^3$ + Coeff(11)•Twb + Coeff(12)•FRair•Twb + Coeff(13)•$(FRair)^2$•Twb + Coeff(14)•FRwater•Twb + Coeff(15)•FRair•FRwater•Twb + Coeff(16)•$(FRwater)^2$•Twb + Coeff(17)•$(Twb)^2$ + Coeff(18)•FRair•$(Twb)^2$ + Coeff(19)•FRwater•$(Twb)^2$ + Coeff(20)•$(Twb)^3$ + Coeff(21)•Tr + Coeff(22)•FRair•Tr + Coeff(23)•FRair•FRair•Tr + Coeff(24)•FRwater•Tr + Coeff(25)•FRair•FRwater•Tr + Coeff(26)•$(FRwater)^2$•Tr + Coeff(27)•Twb•Tr + Coeff(28)•FRair•Twb•Tr + Coeff(29)•FRwater•Twb•Tr + Coeff(30)•$(Twb)^2$•Tr + Coeff(31)•$(Tr)^2$ + Coeff(32)•FRair•$(Tr)^2$ + Coeff(33)•FRwater•$(Tr)^2$ + Coeff(34)•Twb•$(Tr)^2$ + Coeff(35)•$(Tr)^3$

Where

FRair – ratio of airflow to airflow at design conditions

FRwater – ratio of water flow to water flow at design conditions

Tr – tower range (deg F)

Twb – wet-bulb temperature

Coefficients for this performance curve are provided in Appendix 5.7.

Data structure

Input Restrictions User may only use one of the two default curves.

Standard Design Use one of the two default curves.

Cooling Tower Set Point Control

Applicability All cooling towers

Definition The type of control for the condenser water supply. The choices are:

- Fixed
- Wet-bulb reset

A fixed control will modulate the tower fans to provide the design condenser water supply temperature at all times when possible. A wet-bulb reset control will reset the condenser water setpoint to a fixed approach to outside air wet-bulb temperature. The approach defaults to 10°F. A lower approach may be used with appropriate documentation.

Units List (see above)

Input Restrictions

	As designed. ~~If the user does not use the default control, supporting documentation is required.~~
Standard Design	Fixed at the design wet-bulb temperature, as specified in Reference Appendix JA2

Cooling Tower Capacity Control

Applicability	All cooling towers
Definition	Describes the modulation control employed in the cooling tower. Choices include: • **Fluid Bypass** provides a parallel path to divert some of the condenser water around the cooling tower at part-load conditions • **Fan Cycling** is a simple method of capacity control where the tower fan is cycled on and off. This is and is often used on multiple-cell installations. • **Two-Speed Fan/Pony Motor**. From an energy perspective, these are the same. A lower horsepower pony motor is an alternative to a two-speed motor; the pony motor runs at part-load conditions (instead of the full sized motor) and saves fan energy when the tower load is reduced. Additional building descriptors are triggered when this method of capacity control is selected. • **Variable Speed Fan.** A variable frequency drive is installed for the tower fan so that the speed can be modulated.
Units	List (see above)
Input Restrictions	As designed.
Standard Design	Variable-speed fan ~~for all motors of 7.5 hp or larger, unless one of the following exceptions applies:~~ ~~EXCEPTION 1: heat rejection devices included as an integral part of equipment listed in Table 110.2-A through 110.2-E~~

Cooling Tower Low-Speed Airflow Ratio

Applicability	All cooling towers with two-speed or pony motors
Definition	The percentage full load airflow that the tower has at low speed or with the pony motor operating. This is equivalent to the percentage full load capacity when operating at low speed.
Units	Ratio
Input Restrictions	As designed.
Standard Design	~~0.50~~Not applicable

Cooling Tower Low-Speed kW Ratio

Applicability	All cooling towers
Definition	The percentage full load power that the tower fans draw at low speed or with the pony motor operating
Units	Ratio
Input Restrictions	Calculated, using the as-designed flow ratio and the cooling tower power adjustment curve below..
Standard Design	0.25

Cooling Tower Power Adjustment Curve

Applicability All cooling towers with VSD control

Definition A curve that varies the cooling tower fan energy usage as a function of part-load ratio for cooling towers with variable speed fan control. The default curve is given as follows:

(64)

$$PLR = \frac{Q_{operating}}{Q_{available}(t_R, t_A, t_{OWB})}$$

$$TWR_FAN_FPLR = a + b \times PLR + c \times PLR^2 + d \times PLR^3$$

$$P_{operating} = P_{rated} \times TWR_FAN_FPLR$$

where

PLR	Part load ratio based on available capacity (not rated capacity)
$Q_{operating}$	Present load on tower (in Btu/h)
$Q_{available}$	Tower available capacity at present range, approach, and outside wet-bulb conditions (in Btu/h).
t_{owb}	The outside air wet-bulb temperature (°F)
t_R	The tower range (°F)
t_A	The tower approach (°F)
P_{rated}	Rated power draw at CTI conditions (kW)
$P_{operating}$	Power draw at specified operating conditions (kW)

Table 63~~60~~ – Default Efficiency TWR-FAN-FPLR Coefficients – VSD on Cooling Tower Fan

Coefficient	TWR-FAN-FPLR
a	0.33162901
b	-0.88567609
c	0.60556507
d	0.9484823

Units Data structure

Input Restrictions User may input curves or use default curves. If defaults are overridden, supporting documentation is required.

Standard Design Use default curves from DOE 2, given above.

Cooling Tower Minimum Speed

Applicability All cooling towers with a VSD control

Definition The minimum fan speed setting of a VSD controlling a cooling tower fan expressed as a ratio of full load speed.

Units Ratio

Input Restrictions As designed. The default is 0.40.

Standard Design Not applicable

5.8.4 Water-side Economizers

Baseline Building Summary. None of the baseline building systems use a water-side economizer.

Water-Side Economizer Name

Applicability	All water-side economizers
Definition	The name of a water-side economizer for a cooling system
Units	Text, unique
Input Restrictions	Descriptive reference to the construction documents. The default is no water-side economizer.
Standard Design	No water economizer

Water Economizer Type

Applicability All water-side economizers

Definition The type of water-side economizer. Choices include:

- None
- Heat exchanger in parallel with chillers. This would be used with an open cooling tower is often referred to as a non-integrated economizer, because the chillers are locked out when the plant is in economizer mode.
- Heat exchanger in series with chillers. This would be used with an open cooling tower and is often referred to as an integrated, because the chillers can operate simultaneously with water economizer operation.
- Direct water economizer. This would be used with a closed cooling tower. In this case, a heat exchanger is not needed. This type works only as a non-integrated economizer. (also known as strainer-cycle)
- Thermo-cycle (also known as refrigerant migration). With thermo-cycle, bypass valves allow for the flow to vapor refrigerant to the condenser and allow gravity flow of liquid refrigerant to the evaporator without use of the compressor. Only some chillers have this capability and capacity may be limited under this mode. There is no additional piping; the cooler water from the tower is brought directly to the chiller(s) and the chiller(s) respond by shutting down the compressor and relying on thermal forces to drive the refrigerant. This method is also known as “thermosiphon” since thermal gradients passively move refrigerant between the evaporator and condenser.

Units	List (see above)
Input Restrictions	As designed
Standard Design	No water economizer

Water-Side Economizer HX Effectiveness

Applicability Water-side economizers with an open cooling tower

Definition The effectiveness of a water-side heat exchanger at design conditions. This is defined as:

(65)

$$\cancel{WSE_{eff} = \frac{t_{ea} - t_{la}}{t_{ea} - t_{ew}}}$$

$$Q_{econ} = m_{CHW} \times Cp_{CHW} \times \varepsilon \times (T_{CHW,R} - T_{CW,S})$$

Where

Qecon	The maximum load that the economizer can handle
m_{CHW}	The chilled water flow rate
Cp	The chilled water specific heat
$T_{CHW,R}$	The chilled water return temperature
$T_{CW,S}$	Condenser water supply temperature
WSE_{eff}	The effectiveness of the water-side economizer coil
t_{ea}	The entering coil air dry-bulb temperature (°F)
t_{la}	The leaving coil air dry-bulb temperature (°F)
t_{ea}	The entering coil water temperature (°F)

Units Ratio

Input Restrictions As designed. The default is 60%.

Standard Design No water economizer

Water-Side Economizer ~~Maximum T_{db}~~Operating Range

Applicability All water-side economizers

Definition The minimum temperature difference between the chilled water inlet to the heat exchanger and the condenser water inlet to the heat exchanger that is required to enable the ~~control temperature (outside air dry-bulb temperature) above which the~~ water-side economizer ~~is disabled~~.

Units Degrees Fahrenheit (°F)

Input Restrictions As designed. Defaults to ~~65~~ 4°F.

Standard Design No water economizer

Water-Side Economizer Maximum CWS

Applicability All water-side economizers

Definition The control temperature (condenser water supply temperature) above which the water-side economizer is disabled.

Units Degrees Fahrenheit (°F)

Input Restrictions As designed. Defaults to 50°F.

Standard Design No water economizer

~~***Water-Side Economizer CWS Setpoint***~~

~~*Applicability*~~ ~~All water-side economizers~~

~~*Definition*~~

	~~The design condenser water supply temperature for the cooling tower in economizer mode.~~
~~*Units*~~	~~Degrees Fahrenheit (°F)~~
~~*Input Restrictions*~~	~~As designed. Defaults to 45°F or 40°F for "Thermo Cycle." If a strainer cycle is specified, changeover temperature from economizer to mechanical cooling shall be set at 50°F.~~
~~*Standard Design*~~	~~No water economizer~~

Water-Side Economizer Availability Schedule	
Applicability	All water-side economizers
Definition	A schedule which represents the availability of the water-side economizer
Units	Data structure: schedule, on/off
Input Restrictions	As designed
Standard Design	No water economizer

Water-Side Economizer Auxiliary kW	
Applicability	Water-side economizers with an open tower
Definition	The electrical input (pumps and auxiliaries) for a dedicated pump for the chilled water side of the heat exchanger. This power is in excess of the condenser water pumps and cooling tower fans for the system during water-side economizer operation.
Units	KW or kW/ton
Input Restrictions	As designed
Standard Design	No water economizer

5.8.5 Pumps

Baseline Building Summary. Hot water pumping in the baseline building (systems 1, 5, and 6) shall be modeled as a variable flow primary only system. Two-way valves are assumed at the heating coils with a modulating bypass valve at the end of the loop. The bypass valve shall open as necessary to maintain minimum flow through the boiler when the system is activated. This will establish the minimum flow through the system.

Chilled water pumping in the baseline building (system 6) is a primary system. Each chiller has its own primary and condenser water pumps that operate when the chiller is activated. The chilled water pump shall be variable speed and the condenser water pump shall be fixed speed.

General Notes. The building descriptors in this section are repeated for each pumping system. See the Pump Service building descriptor for a list of common pump services.

Pump Name	
Applicability	All pumps
Definition	A unique descriptor for each pump
Units	Text, unique
Input Restrictions	User entry. Where applicable, this should match the tags that are used on the plans.
Standard Design	Same as the proposed design. If there is no equivalent in the proposed design, assign

a sequential tag to each piece of equipment. The sequential tags should indicate the pump service as part of the descriptor (e.g. CW for condenser water, CHW for chilled water, or HHW for heating hot water).

Pump Service

Applicability All pumps

Definition The service for each pump. Choices include:

- Chilled water
- Chilled water (primary)
- Chilled water (secondary)
- Heating water
- Heating water (primary)
- Heating water (secondary)
- Service hot water
- Condenser water
- Loop water (for hydronic heat pumps)

Units List (see above)

Input Restrictions As designed

Standard Design As needed by the baseline building system

Number of Pumps

Applicability All pumps

Definition The number of identical pumps in service in a particular loop, e.g. the heating hot water loop, chilled water loop, or condenser water loop

Units Numeric: integer

Input Restrictions As designed

Standard Design There will be one heating hot water pump for each boiler, one chilled water pump, and one condenser water pump for each chiller.

Water Loop Design

Applicability All pumps

Definition The heating and cooling delivery systems can consist of a simple primary loop system, or more complicated primary/secondary loops or primary/secondary/tertiary loops.

Units List (see above)

Input Restrictions As designed

Standard Design Assume primary loops only for heating hot water. For chilled water loops, a primary loop design is assumed s.

Pump Motor Modeling Method

Applicability All pumps

Definition	Software commonly models fans in one of two ways: The simple method is for the user to enter the electric power per unit of flow (W/gpm). This method is commonly used for smaller systems. A more detailed method requires a specification of the pump head, design flow, impeller and motor efficiency.
Units	List: Power-Per-Unit-Flow or Detailed
Input Restrictions	Either method may be used, as appropriate.
Standard Design	Detailed for Chilled Water and Condenser Water Pumps; Power-per-unit-flow for Heating hot water and Service hot water pumps

Pump Motor Power-Per-Unit-Flow

Applicability	All proposed design pumps that use the Power-Per-Unit-Flow method.
Definition	The electric power of the pump divided by the flow at design conditions.
Units	W/gpm
Input Restrictions	As designed
Standard Design	Not applicable for chilled water and condenser water pumps; 19 W/gpm for heating hot water and service hot water pumps

Pump Design Head

Applicability	All baseline building pumps and proposed design pumps that use the Power-Per-Unit-Flow method.
Definition	The head of the pump at design flow conditions.
Units	ft of water
Input Restrictions	As designed
Standard Design	For chilled water pumps, 40 ft plus an additional allowance of 0.03 ft/ton

For condenser water pumps, 54 ft

Impeller Efficiency

Applicability	All pumps in proposed design that use the detailed modeling method
Definition	The full load efficiency of the impeller
Units	Ratio
Input Restrictions	As designed
Standard Design	70%

Motor Efficiency

Applicability	All pumps in proposed design that use the detailed modeling method
Definition	The full load efficiency of the pump motor
Units	Ratio
Input Restrictions	As designed
Standard Design	Minimum requirement from Table 28~~Table 26~~ of the Nonresidential ACM Manual.

Pump Minimum Speed

Applicability	All two-speed or variable-speed pumps
Definition	The minimum pump speed for a two-speed for variable-speed pump. For two-speed pumps this is typically 0.67 or 0.5. Note that the pump minimum speed is not necessarily the same as the minimum flow ratio, since the system head may change.
Units	Ratio
Input Restrictions	As designed
Standard Design	The chilled water pumps for baseline building system 5 has variable speed drive. In these cases the Pump Minimum Speed shall be 0.10.

Pump Minimum Flow Ratio

Applicability	Primary Chilled water pumps
Definition	The minimum fraction of design flow ~~that passes through the chiller. minimum pump speed for a two-speed for variable-speed pump~~when the pump is operating at its minimum speed. Note that the pump minimum speed is not necessarily the same as the minimum flow ratio, since the system head may change.
Units	Ratio
Input Restrictions	As designed
Standard Design	0.3

Pump Design Flow (GPM)

Applicability	All pumps
Definition	The flow rate of the pump at design conditions. This is derived from the load, and the design supply and return temperatures.
Units	gpm or gpm/ton for condenser and primary chilled water pumps
Input Restrictions	Not a user input
Standard Design	The temperature change on the evaporator side of the chillers is 20 F (64 F less 44 F) and this equates to a flow of 1.2 gpm/ton. The temperature change on the condenser side of the chillers is 12 F, which equates to a flow of 2.0 gpm/ cooling ton. For hot water pumps servicing boilers, the flow rate in gpm shall be the boiler capacity in Btu/h / 15,000, which corresponds to a loop temperature drop of 30°F.

Pump Control Type

Applicability	All pumps
Definition	The type of control for the pump. Choices are: • Fixed speed, fixed flow • Fixed speed, variable flow (the default, with flow control via a valve) • Two-speed • Variable speed, variable flow
Units	None
Input Restrictions	As designed. The default is “Fixed Speed, Variable Flow” which models the action of a constant speed pump riding the curve against 2-way control valves.

Standard Design	The hot water and condenser water loops shall be primary loops only. The hot water pump shall be modeled as a fixed speed, variable flow pump (riding the pump curve). The chilled water pumps shall be modeled as variable-speed, variable flow, and the condenser water pumps shall be modeled as fixed speed. The hot water pumps shall be modeled as fixed-speed, variable flow, riding the curve.

Pump Operation

Applicability	All pumps
Definition	The type of pump operation can be either On-Demand, Standby or Scheduled. On-Demand operation means the pumps are only pumping when their associated equipment is cycling, so chiller and condenser pumps are on when the chiller is on and the heating hot water pump operates when its associated boiler is cycling. Standby operation allows hot or chilled water to circulate through the primary loop of a primary/secondary loop system or through a reduced portion of a primary-only system, assuming the system has appropriate 3-way valves. Scheduled operation means that the pumps and their associated equipment are turned completely off according to occupancy schedules, time of year, or outside conditions. Under scheduled operation, when the systems are on they are assumed to be in On-Demand mode.
Units	List (see above)
Input Restrictions	As designed
Standard Design	The baseline system pumps are assumed to operate in On-Demand mode. The chilled water and condenser pumps are tied to the chiller operation, cycling on and off with the chiller, and the heating hot water pumps are tied to the boiler operation.

Pump Part Load Curve

Applicability	All pumps
Definition	A part-load power curve for the pump

$$CIRC-PUMP-FPLR = a + b \times PLR + c \times PLR^2 + d \times PLR^3 \tag{66}$$

$$P_{pump} = P_{design} \times CIRC-PUMP-FPLR \tag{67}$$

where

PLR	Part load ratio (the ratio of operating flow rate in gpm to design flow rate in gpm)
P_{pump}	Pump power draw at part-load conditions (W)
P_{design}	Pump power draw at design conditions (W)

Table 6461 – Default Part-Load CIRC-PUMP-FPLR Coefficients – VSD on Circulation Pump

Coefficient	CIRC-PUMP-FPLRDefault (No Reset)	DP Reset
a	0.0015303 0	0
b	0.0052081 0.5726	0.0205
c	1.1086242 -0.301	0.4101
d	-0.1163556 0.7347	0.5753

	Source:
Units	Data structure
Input Restrictions	As designed. Default is curve above.*Default (No Reset)*. The *DP Reset* curve may only be selected if the DDC Control Type building descriptor indicates that the building has DDC controls.
Standard Design	Use the defaults described above.*DP Reset* curve if the standard design is System 6 (Built-up VAV) or System 10 (Computer Room Air Handler); otherwise the Standard Design is the *Default (No Reset)* curve.

5.8.6 Thermal Storage

There are multiple ways to model thermal storage in the proposed design. The baseline building does not have thermal storage. Stratified storage tanks with a chilled water storage medium are not supported by the ACM.

Storage Type	
Applicability	All thermal storage systems
Definition	A type of thermal energy storage (TES) that indicates the storage medium.
Units	List
Input Restrictions	Ice, Chilled Water
Standard Design	No thermal storage systems

Configuration	
Applicability	All thermal storage systems
Definition	Indication of how the TES is configured and operated in relation to the chilled water cooling
Units	List
Input Restrictions	Series, Chiller Upstream
	Series, Chiller Downstream
	Parallel
Standard Design	No thermal storage systems

Ice Storage Type	
Applicability	All thermal storage systems with Storage Type=Ice
Definition	

	Indication of the storage type for ice storage
Units	List
Input Restrictions	IceOnCoilExternal
	IceOnCoilInternal
Standard Design	No thermal storage systems

Storage Capacity

Applicability	All thermal storage systems using ice storage
Definition	Nominal Storage Capacity of the tank
Units	GJ
Input Restrictions	None
Standard Design	No thermal storage systems

Tank Volume

Applicability	All thermal storage systems using ice storage
Definition	Nominal Storage Capacity of the tank
Units	m^3
Input Restrictions	None
Standard Design	No thermal storage systems

CHW Setpoint Schedule

Applicability	All thermal storage systems using ice storage
Definition	Nominal Storage Capacity of the tank
Units	Series, deg F
Input Restrictions	None
Standard Design	No thermal storage systems

Deadband Temperature Difference

Applicability	All thermal storage systems using chilled water
Definition	The deadband temperature difference between enabling and disabling use of the TES system for cooling
Units	Degrees F
Input Restrictions	None
Standard Design	No thermal storage systems

Minimum Temperature Limit

Applicability	All thermal storage systems using chilled water
Definition	The minimum allowed temperature of the tank, below which charging of the tank cannot occur
Units	

	Deg F
Input Restrictions	None
Standard Design	No thermal storage systems

Storage Tank Location Indicator

Applicability	All thermal storage systems using ice storage
Definition	Nominal Storage Capacity of the tank
Units	List
Input Restrictions	Schedule, Zone, or Exterior.
	If *Schedule*, the ambient temperature schedule must be specified. If *Zone*, the Zone name must be specified.
Standard Design	No thermal storage systems

Storage Tank Heat Gain Coefficient

Applicability	All thermal storage systems using chilled water
Definition	The heat transfer coefficient between the tank and the ambient surroundings
Units	W/K
Input Restrictions	None
Standard Design	No thermal storage systems

Use Side Heat Transfer Effectiveness

Applicability	All thermal storage systems using chilled water
Definition	The heat transfer effectiveness between the use side water and the tank water
Units	none
Input Restrictions	Between 0 and 1
Standard Design	No thermal storage systems

Use Side Design Flow Rate

Applicability	All thermal storage systems using chilled water
Definition	Design flow rate through the use side of the storage tank
Units	gpm
Input Restrictions	None
Standard Design	No thermal storage systems

Source Side Heat Transfer Effectiveness

Applicability	All thermal storage systems using chilled water
Definition	The heat transfer effectiveness between the source side water and the tank water
Units	none
Input Restrictions	Between 0 and 1
Standard Design	

	No thermal storage systems

Source Side Design Flow Rate

Applicability	All thermal storage systems using chilled water
Definition	Design flow rate through the source side of the storage tank
Units	gpm
Input Restrictions	None
Standard Design	No thermal storage systems

Tank Recovery Time

Applicability	All thermal storage systems using ice storage
Definition	This is the time in hours for the tank to cool from 14.4°C to 9°C. This input is only used if the source side design flow rate is not specified.
Units	hours
Input Restrictions	None
Standard Design	No thermal storage systems

5.8.7 Heat Recovery Equipment

Heat Recovery Name

Applicability	All heat recovery systems
Definition	A name assigned to a heat recovery system. This would provide a link to the construction documents.
Units	Text, unique
Input Restrictions	As designed
Standard Design	No heat recovery systems

Heat Recovery Device Type

Applicability	All heat recovery systems
Definition	The type of heat recovery equipment. Choices include: • Double-Bundled Chiller • Generator • Engine-Driven Chiller • Air Conditioning Unit • Refrigerated Casework
Units	List (see above)
Input Restrictions	As designed

Standard Design	Heat recovery systems are not included in the baseline system.

Heat Recovery Loads

Applicability	All heat recovery systems
Definition	The loads met by the heat recovery system. Choices include: • Service water heating • Space heating • Process heating More than one load may be selected.
Units	List (see above)
Input Restrictions	As designed
Standard Design	Not required in the baseline system.

5.8.8 Plant Management

Plant management is a method of sequencing equipment. Separate plant management schemes may be entered for chilled water systems, hot water systems, etc. The following building descriptors are specified for each load range, e.g. when the cooling load is below 300 tons, between 300 tons and 800 tons, and greater than 800 tons.

Equipment Type Managed

Applicability	All plant systems
Definition	The type of equipment under a plant management control scheme. Choices include: • Chilled water cooling • Hot water space heating • Condenser water heat rejection • Service water heating • Electrical generation
Units	None
Input Restrictions	As designed
Standard Design	Same as the proposed design

Equipment Schedule

Applicability	All plant equipment
Definition	A schedule which identifies when the equipment is in service.
Units	Data structure
Input Restrictions	As designed
Standard Design	Where multiple equipment is used, they shall be staged in operation.

Equipment Operation	
Applicability	All plant equipment
Definition	Equipment operation can be either On-Demand or Always-On. On-Demand operation means the equipment cycles on when it is scheduled to be in service and when it is needed to meet building loads, otherwise it is off. Always-On means that equipment runs continuously when it scheduled to be in service.
Units	None
Input Restrictions	As designed; the default is On-Demand.
Standard Design	Assume On-Demand operation

Equipment Staging Sequence	
Applicability	All plant equipment
Definition	The staging sequence for plant equipment (chillers and boilers) indicates how multiple equipment will be staged on and off when a single piece of equipment is unable to meet the load.
Units	Structure – this should include (a) the percent of capacity above which additional equipment is staged on; (b) the percent of capacity below which one plant equipment is staged off
Input Restrictions	As designed.
Standard Design	Compliance software shall bring up each boiler to 90 percent capacity prior to the staging of the next boiler. Compliance software shall bring up each chiller to 90 percent capacity prior to the staging of the next chiller.

5.9 Miscellaneous Energy Uses

Miscellaneous energy uses are defined as those that may be treated separately since they have little or no interaction with the conditioned thermal zones or the HVAC systems that serve them.

5.9.1 Water Heating

Water heating systems shall always be modeled for both the proposed design and baseline building when the proposed building is expected to have a water heating load, even if no water heating is shown on the plans or specifications for the proposed design. In such instances, an electric resistance system shall be modeled for both the proposed design and baseline building, meeting the efficiency requirements of the baseline standard.

When the construction documents show a water heating system, the layout and configuration of the baseline building system shall be the same as the proposed design, e.g. the baseline building shall have the same number of water heaters and the same distribution system.

5.9.1.1 System Loads and Configuration

Water Heating System Name	
Applicability	All water heating systems
Definition	A unique descriptor for each water heating system. A system consists of one or more water heaters, a distribution system, an estimate of hot water use, and a schedule for that use. Nonresidential buildings will typically have multiple systems, perhaps a separate electric water heater for each office break room, etc. Other building types such as hotels and hospitals may have a single system serving the entire building.
Units	Text, unique
Input Restrictions	Where applicable, this should match the tags that are used on the plans such that a plan reviewer can make a connection.
Standard Design	The naming convention for the baseline building system shall be similar to the proposed design.

Water Heating Peak Use	
Applicability	All water heating systems, required
Definition	An indication of the peak hot water usage (e.g. service to sinks, showers, and kitchen appliances, etc.). When specified per occupant, this value is multiplied by design occupancy density values and modified by service water heating schedules to obtain hourly load values which are used in the simulation. Peak consumption is commonly specified as gallons per hour per occupant, dwelling unit, hotel room, patient room, or floor area. If consumption is specified in gallons per hour, then additional inputs would be needed such as supply temperature, cold water inlet temperature, etc. ~~It is also common to specify~~Software that specifies peak use as a thermal load in Btu/h. ~~In the latter case, there is an~~ can apply ACM rules for ~~implied assumption for~~ the mains (cold water inlet) temperature~~,~~ and supply temperature to convert the prescribed peak use from gph/person to Btu/h-person~~, distribution losses, and other factors.~~ The thermal load does not include conversion efficiencies of water heating equipment.
Units	~~Btu/h or gallons/h~~ gph/person
Input Restrictions	Prescribed values from Appendix 5.4A.
Standard Design	~~Hot water consumption or load in the baseline building shall be the same as the proposed design, except in cases where a specific measure is specified for the proposed design that will reduce water consumption. Examples of such measures include: low-flow terminal devices or controls, alternative sanitizing technologies, or heat recovery laundry or showers drains.~~ Same as proposed

Water Heating Schedule	
Applicability	All water heating systems, required
Definition	A fractional schedule reflecting the time pattern of water heating use. This input modifies the water heating peak use, described above.
Units	Data structure: schedule, fractional
Input Restrictions	The schedules from Appendix 5.4A shall be used.
Standard Design	

Hot water schedules for the baseline building shall be the same as the proposed design, except in cases where a specific measure is specified for the proposed design that will reduce water consumption and the impact of the measure can be best approximated through an adjustment to the schedule. In general, such measures would be addressed through an adjustment to the water heating, peak use (see above).

Water Heating System Configuration

Applicability	All water heating systems, required
Definition	The configuration and layout of the water heating system, including the number of water heaters; the size, location, length and insulation of distribution pipes; recirculation systems and pumps; and any other details about the system that would affect the energy model.
Units	Data structure
Input Restrictions	None
Standard Design	The baseline building shall have the same configuration and layout as the proposed design.

Water Mains Temperature Schedule

Applicability	All water heating systems, required
Definition	A monthly temperature schedule indicating the water mains temperature. This temperature and the setpoint temperature is used to convert the load into a water flow rate.
Units	Data structure: schedule, deg F
Input Restrictions	The schedules from Appendix 5.4A shall be used. The water mains temperature schedule shall be fixed for a given climate zone.
Standard Design	The schedules from Appendix 5.4A shall be used. The water mains temperature schedule shall be fixed for a given climate zone.

5.9.1.2 Water Heaters

This section describes the building descriptors for water heaters. Typically, a building will have multiple water heating systems and each system can have multiple water heaters, so these building descriptors may need to be specified more than once.

Water Heater Name

Applicability	All water heaters
Definition	A unique descriptor for each water heater in the system. Some systems will have multiple pieces of equipment, for instance a series of water heaters plumbed in parallel or a boiler with a separate storage tank.
Units	Text, unique
Input Restrictions	Where applicable, this should match the tags that are used on the plans such that a plan reviewer can make a connection.
Standard Design	The naming convention for the baseline building system shall be similar to the proposed design.

Water Heater Type and Size

Applicability All water heaters

Definition This building descriptor includes information needed to determine the criteria from baseline standards. The choices are listed below.

- Electric water heaters (storage and instantaneous)
    - Small (≤ 12 kW)
    - Large (> 12 kW)
    - Heat pump
- Gas storage water heaters
    - Small (≤ 75,000 Btu/h)
    - Large (> 75,000 Btu/h)
- Gas instantaneous water heaters
    - Small (> 50,000 and < 200,000 Btu/h)
    - Large (≥ 200,000 Btu/h), <10 gal
    - Large (≥ 200,000 Btu/h), >= 10 gal
- Oil storage water heaters
    - Small (≤ 105,000 Btu/h)
    - Large (> 105,000 Btu/h)
- Oil instantaneous water heaters
    - Small (≤ 210,000 Btu/h)
    - Large (> 210,000 Btu/h), <10 gal
    - Large (> 210,000 Btu/h), >= 10 gal
- Gas hot water supply boiler
- Oil hot water supply boiler

Units List (see above)

Input Restrictions The water heater type shall agree with equipment specified in the construction documents.

Standard Design Water heaters in the baseline system shall be the same as those in the proposed design, except when the proposed design has a heat pump water heater, in which case the baseline building system shall have an electric storage water heater.

Commen
heaters fo
modeling
heater, wi

Rated Capacity

Applicability All water heaters

Definition The heating capacity of a water heater at the rated conditions specified in DOE 10 CFR Part 430 or ANSI Z21.10.

Units Thousands of British Thermal Units per hour (MBH)

Input Restrictions As designed. If the loads are not met, autosize.

Standard Design Autosize

Storage Volume	
Applicability	Gas-fired water heaters
Definition	The storage volume of a gas-fired water heater. This is used in the Standby loss calculations and baseline calculations of Energy Factor.
Units	gallons
Input Restrictions	As designed. If the loads are not met, autosize.
Standard Design	Autosize

Energy Factor	
Applicability	Equipment covered by NAECA, which includes small storage and instantaneous water heaters
Definition	The energy factor (EF) is the ratio of the energy delivered by the water heater divided by the energy used, in the same units. EF is calculated according to the DOE 10 CFR Part 430 test procedure, which specifies a 24-hour pattern of draws, a storage temperature, inlet water temperature, and other test conditions. These conditions result in the energy delivered for the test period. Energy inputs are measured for the same test period and the EF ratio is calculated.
Units	Unitless ratio
Input Restrictions	Building descriptors for the proposed design should be consistent with equipment specified on the construction documents or observed in the candidate building.
Standard Design	The EF for the baseline building system shall be determined from the CEC Appliance Efficiency Regulations. The following baseline EF applies for water heaters: Gas-fired storage type water heaters: 0.67 – 0.0019 x V Oil-fired water heaters: 0.59 – 0.0019 x V Electric storage water heaters: 0.97 – 0.00132 x V Gas-fired instantaneous: 0.62 – 0.0019 x V Electric instantaneous: 0.93 – 0.00132 x V Heat pump water heaters: 0.97 – 0.00132 x V Where V is the rated volume in gallons.

Thermal Efficiency	
Applicability	Oil and gas fired water heaters not covered by NAECA
Definition	The full load efficiency of a water heater at rated conditions expressed as a dimensionless ratio of output over input. This is also referred to as recovery efficiency.
Units	Unitless ratio
Input Restrictions	Building descriptors for the proposed design should be consistent with equipment specified on the construction documents or observed in the candidate building. For NAECA covered water heaters that have specified an Energy Factor but not a recovery efficiency, the default recovery efficiency is as follows: Gas Water Heaters: η_{th} = 0.78 Electric Water Heaters: η_{th} = 0.97
Standard Design	Baseline efficiency is set from the Appliance Efficiency Regulations

Commen
to be high

Tank Standby Loss

Applicability Water heaters not covered by NAECA

Definition The tank standby loss for storage tanks, which includes the effect of recovery efficiency.

Units Btu/h for the entire tank

Input Restrictions Standby loss is calculated by the following:

$$STBY = 453.75 \times S \times VOL$$

where

S = The standby loss fraction listed in the Commission's Appliance Database of Certified Water Heaters,

VOL = The actual storage capacity of the water heater as listed in the Commission's Appliance Database of Certified Water Heaters

Standard Design

Tank Off-Cycle Loss Coefficient

Applicability Water heaters

Definition The tank standby loss coefficient (UA) for the water heater. For small water heater covered by NAECA, the loss coefficient is a derived parameter, a function of the Energy Factor and recovery efficiency

Units Btu/h-deg F

Input Restrictions For NAECA covered water heaters, the loss coefficient is calculated by the following:

$$UA = \frac{1/EF - 1/RE}{67.5 \times (\frac{24}{41094} - \frac{1}{RE \cdot Pon})}$$

where

EF = The energy factor of the rated water heater (Unitless)

RE = The recovery efficiency of the rated water heater. If this data is not available the default shall be 0.78 for gas water heaters and 0.93 for electric water heaters.

Pon = The input power to the water heater, in Btu/h

Standard Design The baseline loss coefficient for NAECA water heaters shall be:

10 Btu/h-F for gas-fired water heaters

Commen
with the E
and using

Off Cycle Parasitic Losses

Applicability Water heater

Definition The rate of parasitic losses, such as a pilot light or controls, when the water heater is not heating.

Units Watts

Input Restrictions As designed

Standard Design

0

Off Cycle Fuel Type

Applicability	Water heater
Definition	The type of fuel that serves energy using parasitic equipment, such as a pilot light or controls, when the water heater is not heating.
Units	List: Electricity, Gas, Oil, Propane
Input Restrictions	As designed
Standard Design	Not applicable

On Cycle Parasitic Losses

Applicability	Water heater
Definition	The rate of parasitic losses, such as a pilot light or controls, when the water heater is not heating. This may be different than off cycle losses if the flue energy is considered.
Units	Watts
Input Restrictions	As designed
Standard Design	0

On Cycle Fuel Type

Applicability	Water heater
Definition	The type of fuel that serves energy using parasitic equipment, such as a pilot light or controls, when the water heater is not heating.
Units	List: Electricity, Gas, Oil, Propane
Input Restrictions	As designed
Standard Design	Electricity

Water Heater Ambient Location

Applicability	Water heater
Definition	The location of the water heater for determining losses and energy interaction with the surroundings
Units	List: Schedule, Zone, Outdoors
Input Restrictions	As designed
Standard Design	Zone

Tank Standby Loss Fraction

Applicability	Title 24 Standards
Definition	The tank standby loss fraction for storage tanks.
Units	Unitless
Input Restrictions	Prescribed to the value listed in the Commission's Appliance Database of Certified Water Heaters
Standard Design	

TBD

THE PART-LOAD CURVE PROCEDURE IN TITLE 24 CAN BE AN ALTERNATE METHOD OF SPECIFYING THE EFFECTS OF STANDBY AND PARASITIC LOSSES ON PERFORMANCE. THE PRIMARY METHOD IS TO SPECIFY A LOSS COEFFICIENT FOR THE STORAGE TANK.

Fuel Water Heater Part Load Efficiency Curve

Applicability Water Heating equipment for which a loss coefficient is not specified (alternate method)

Definition A set of factors that adjust the full-load thermal efficiency for part load conditions. The factor is set as a curve.

Units Percent (%)

Input Restrictions The following default curve shall be used unless detailed information is provided to justify alternative values. The default curve shall take the form of a quadratic equation as follows:

(68)

$$Fuel_{partload} = Fuel_{design} \times FHeatPLC$$

$$FHeatPLC = \left(a + b \times \frac{Q_{partload}}{Q_{rated}} + c \times \left(\frac{Q_{partload}}{Q_{rated}} \right)^2 \right)$$

where

FHeatPLC	The fuel heating part load efficiency curve
$Fuel_{partload}$	The fuel consumption at part load conditions (Btu/h)
$Fuel_{design}$	The fuel consumption at design conditions (Btu/h)
$Q_{partload}$	The water heater capacity at part load conditions (Btu/h)
Q_{rated}	The water heater capacity at design conditions (Btu/h)
a	Constant, 0.021826
b	Constant, 0.977630
c	Constant, 0.000543

For Title 24, the coefficients shall be determined by the following :

(SEE NACM 2.6.1.1)

a = STBY / INPUT

b = INPUT

$$a = \frac{STBY}{INPUT}$$

$$b = \frac{(INPUT \times RE^*) - STBY}{SRL}$$

* or Thermal Efficiency (TE)

PLRn = Part-load ratio for the nth hour and shall always be less than 1. PLR n is calculated from the following equation:

$$PLR_n = \frac{SRL \times F_{whpl(n)}}{INPUT \times RE^*}$$

* or Thermal Efficiency (TE)

INPUT = The input capacity of the water heater expressed in Btu/hr.

STBY = Hourly standby loss expressed in Btu/hr. For large storage gas water heaters STBY is listed in the CEC's appliance database. The value includes pilot energy and standby losses. For all other systems refer to equation N2-62.

For Boilers, Instantaneous gas or other storage type water heaters, not in the scope of Covered Consumer Products as defined in the Title 10 or the Code of Federal Regulations, Part 430;

$$STBY = 453.75 \times S \times VOL$$

where

S = The standby loss fraction listed in the Commission's Appliance Database of Certified Water Heaters,

VOL = The actual storage capacity of the water heater as listed in the Commission's Appliance Database of Certified Water Heaters,

Required inputs and standard and proposed design assumptions depend on the type of water heater and whether or not it is a DOE covered consumer product.

Standard Design Not applicable

~~***Water Heating Schedule***~~

~~*Applicability*~~	~~All buildings~~
~~*Definition*~~	~~An hourly normalized load schedule that defines how the water heating load varies for each hour of the year.~~
~~*Units*~~	~~Structure (set of 8760 normalized values between 0 and 1)~~
~~*Input Restrictions*~~	~~Prescribed to values in Appendix 5.5~~
~~*Standard Design*~~	~~Same as proposed design~~

5.9.1.3 Recirculation Systems

This section describes the building descriptors for hot water recirculation systems. The baseline building has a recirculation system when the proposed design does. This is one aspect of the *water heating system configuration* (see above).

Recirculating systems shall follow the rules set forth in Appendix E of the 2013 Residential ACM Manual.

5.9.1.4 Water Heating Auxiliaries

External Storage Tank Insulation

Applicability	All water heating systems that have an external storage tank
Definition	Some water heating systems have a storage tank that is separate from the water

	heater(s) that provides additional storage capacity. This building descriptor addresses the heat loss related to the external tank, which is an additional load that must be satisfied by the water heater(s).
Units	R-value (h-ft2-F/Btu)
Input Restrictions	As specified in manufacturer data and documented on the construction documents
Standard Design	Heat loss associated with the storage tank in the baseline building shall meet the requirements for an unfired storage tank in the baseline standards which is an insulation R-value of 12.5. The surface area and location of the storage tank shall be the same as the proposed design.

External Storage Tank Area

Applicability	All water heating systems that have an external storage tank
Definition	Some water heating systems have a storage tank that is separate from the water heater(s) that provides additional storage capacity. This documents the entire exterior surface area of the tank.
Units	ft2
Input Restrictions	As specified in manufacturer specifications
Standard Design	Not applicable

External Storage Tank Location

Applicability	All water heating systems that have an external storage tank
Definition	Location of the storage tank, used to determine the heat loss rate and energy exchange with the surroundings
Units	List: Schedule, Zone, Outdoors
Input Restrictions	As designed
Standard Design	Not applicable

Heat Recovery

Applicability	Water heating systems that are coupled to heat recovery equipment
Definition	Building equipment such as air conditioners, chillers, gas fired generators, etc. produce thermal energy that may be recovered and used to heat water. The heat producing characteristics are generally defined for the equipment that is producing the heat, not the equipment that is receiving the heat (water heaters in this case). The building descriptors will vary depending on the equipment. The models for heat producing equipment need to produce output on an hourly basis so that the schedule of heat production and heating needs can be aligned and evaluated in the water heating model.
Units	Data structure: depends on the equipment producing the heat
Input Restrictions	There are no restrictions, other than agreement with the construction documents.
Standard Design	Not applicable

Solar Thermal

Applicability

	Water heating systems with a solar thermal system
Definition	A solar thermal water heating system consists of one or more collectors. Water is passed through these collectors and is heated under the right conditions. There are two general types of solar water heaters: integrated collector storage (ICS) systems and active systems. Active systems include pumps to circulate the water, storage tanks, piping, and controls. ICS systems generally have no pumps and piping is minimal. Solar systems may be tested and rated as a complete system or the collectors may be separately tested and rated. SRCC OG-300 is the test procedure for whole systems and SRCC OG-100 is the test procedure for collectors. The building descriptors used to define the solar thermal system may vary with each software application and with the details of system design. The solar fraction shall be estimated by the f-chart procedure for solar water heating systems.
Units	Unitless fraction
Input Restrictions	The solar fraction provided by the solar DHW system shall be between 0 and 1.
Standard Design	The baseline building has no solar auxiliary system.

Combined Space Heating and Water Heating	
Applicability	Projects that use a boiler to provide both space heat and water heating
Definition	A system that provides both space heating and water heating from the same equipment, generally the space heating boiler. Such systems are restricted by the baseline standards, but may be modeled in the candidate building. The restrictions are due to the misalignment of the space heating load and the water heating load. The first is highly intermittent and weather dependent, while the latter is more constant and not generally related to the weather.
Units	Data structure
Input Restrictions	The proposed design may have a combined space and water heating system.
Standard Design	The baseline building shall be modeled with separate space heating and water heating systems, meeting the prescriptive requirements for each. The water heating system shall use the same fuel as the combined boiler.

5.9.2 Exterior Lighting

RESERVED FOR FUTURE USE

5.9.3 Swimming Pools

Swimming pools must meet applicable mandatory requirements and are not required to be modeled for California Title 24 compliance or Reach.

5.9.4 Other Electricity Use

This set of building descriptors should be used to include any miscellaneous electricity use that would add to the electric load of the building and would be on the building meter. These energy uses are assumed to be outside the building envelope and do not contribute heat gain to any thermal zone.

Miscellaneous Electric Power

Applicability	All buildings with miscellaneous electric equipment located on the building site
Definition	The power for miscellaneous equipment.
Units	Watts (W)
Input Restrictions	As designed.
Standard Design	Same as the proposed design

Miscellaneous Electric Schedule

Applicability	All buildings with miscellaneous electric equipment located on the building site
Definition	The schedule of operation for miscellaneous electric equipment. This is used to convert electric power to energy use.
Units	Data structure: schedule, fractional
Input Restrictions	The schedule specified for the building should match the operation patterns of the system.
Standard Design	Same as the proposed design

5.9.5 Other Gas Use

Commen
prevent ic
other critic
heating el
sensors to
moisture;
the heatin
source tog
The energ
estimate c
snow-melt
used for b
proposed

This set of building descriptors should be used to include any miscellaneous gas use that would add to the load of the building and would be on the building meter. These energy uses are assumed to be outside the building envelope and do not contribute heat gain to any thermal zone.

Other Gas Power

Applicability	All buildings that have commercial gas equipment
Definition	Gas power is the peak power which is modified by the schedule (see below).
Units	Btu/h-ft^2
Input Restrictions	As designed
Standard Design	Same as the proposed design

Other Gas Schedule

Applicability	All buildings that have commercial gas equipment
Definition	The schedule of operation for commercial gas equipment. This is used to convert gas power to energy use.
Units	Data structure: schedule, fractional
Input Restrictions	Continuous operation is prescribed.
Standard Design	Same as the proposed design

5.10 On-Site Power Generation

Building projects may incorporate other on-site electricity generation equipment, such as cogeneration plants or fuel cells that make electricity and produce heat. Projects may also include wind turbines. These systems may be modeled in various ways and the building descriptors described below should be considered an example of one set. In all cases, the baseline building will be modeled without on-site generation equipment. If there is no thermal link between the power generation equipment and building equipment (such as heat recovery from CHP), on-site power generation can be modeled in a separate process; otherwise, it needs to be linked to the building simulation.

RESERVED FOR FUTURE USE – onsite power generation systems are not currently modeled for Title 24 compliance or reach. Qualifying solar water heating systems are specified by a solar fraction, and referenced in Section 5.9.

5.11 Common Data Structures

This section describes common data structures referenced in this chapter. The data structures presented here define objects and example parameters needed to define them. The parameters described are the most common for energy simulation engines. However, other parameters or data constructs are acceptable; however, the fields used by the simulation program must be mapped to the fields used by the building descriptor..

5.11.1 Schedule

This data structure provides information on how equipment, people, lights, or other items are operated on an hourly basis. The ultimate construct of a schedule is an hourly time series for the simulation period, typically 8,760 hours (365 days, 24 hours/day). However, software has often built up the hourly schedule from 24-hour schedules for different day types: weekdays, Saturdays, Sundays, holidays, etc.

There are several types of schedules:

- **Temperature** schedules specify a temperature to be maintained in a space, a temperature to be delivered from an air handler, or the leaving temperature from a chiller or other equipment.
- **Fraction** schedules specify the fraction of lights that are on, the fraction of people that are in the space, the fraction of maximum infiltration, or other factors.
- **On/off** schedules specify when equipment is operating or when infiltration is occurring.
- **Time period** schedules define periods of time for equipment sequencing, utility tariffs, etc. A time period schedule typically breaks the year in to two or more seasons. For each season, day types are identified such as weekday, Saturday, Sunday and holidays. Each day type in each season is then divided into time periods.

5.11.2 Holidays

A series of dates defining holidays for the simulation period. Dates identified are operated for the schedule specified for holidays.

5.11.3 Surface Geometry

This data structure represents the location, size, and position of a surface. Surfaces include roofs, walls, floors, and partitions. Surfaces are typically planar and can be represented in various manners, including the following:

- Rectangular surfaces may be represented by a height and width along with the X, Y, and Z of surface origin and the tilt and azimuth
- Surfaces may also be represented by a series of vertices (X, Y, and Z coordinates defining the perimeter of a surface). More complex polygons may be represented in this manner.

5.11.4 Opening Geometry

This data structure represents the location and size of an opening within a surface. The most common method of specifying the geometry of an opening is to identify the parent surface, the height and width of the opening, and the horizontal and vertical offset (X and Y coordinates relative to the origin of the parent surface). An opening can also include a recess into the parent surface, which provides shading. However, other geometric constructs are acceptable.

5.11.5 Opening Shade

This data structure describes the dimensions and position of external shading devices such as overhangs, side fins, or louvers that shade the opening. Overhangs are specified in terms of the projection distance, height above the opening, and extension distance on each side of the opening.

5.11.6 Construction Assembly

This data structure describes the layers that make up the construction of a wall, roof, floor, or partition. Typically, a construction consists of a sequence of materials, described from the outside surface to the inside surface.

5.11.7 Fenestration Construction

This data structure describes the frame, glass, and other features of a window or skylight. Information may be defined in multiple ways, but the criteria themselves are published as a combination of U-factor, solar heat gain coefficient (SHGC), and visible light transmission (VT). Some simulation programs use more detailed methods of describing the performance of fenestration that take into account the angle of incidence of sun striking the fenestration and other factors, such as the properties of each pane and the fill. The compliance software only uses whole window performance properties (U-factor, SHGC, VT).

5.11.8 Material

This data structure describes a material that is used to build up a construction assembly. Typical material properties include specific heat, density, conductivity, and thickness. Materials can also be described in terms of their thermal resistance. The latter approach is sometimes used to approximate construction layers that are not homogeneous, such as framing members in combination with cavity insulation.

5.11.9 Slab Construction

This data structure describes the composition of a slab-on-grade. The compliance model has building descriptors for the perimeter length and the F-factor, which represents the heat loss per lineal foot.

5.11.10 Exterior Surface Properties

This data structure describes the characteristics of exterior surfaces. Exterior surface properties may include emissivity, reflectivity, and roughness. The first two govern radiation exchange from the surface, while the latter governs the magnitude of the exterior air film resistance.

5.11.11 Occupant Heat Rate

This data structure represents the rate of heat and moisture generated by building occupants. This is typically specified in terms of a sensible heat rate and a latent heat rate. Both are specified in Btu/h.

5.11.12 Furniture and Contents

This data structure represents the thermal mass effect of furniture and other building contents. This is expressed in terms of lb/ft^2 for the space in question.

5.11.13 Reference Position in a Space

This data structure locates a reference point in a space, typically for the purposes of daylighting control. The typical construct for the reference point is a set of coordinates (X, Y, and Z) relative to the space coordinate system.

5.11.14 Two Dimensional Curve

This data structure explains one parameter in terms of another. An example is a curve that modifies the efficiency of an air conditioner relative to the fraction of time that the equipment operates within the period of an hour, for example. The relationship can be expressed in terms of the X and Y coordinates of points on the curve or it can be expressed as an equation.

5.11.15 Three Dimensional Curve

This data structure explains one parameter in terms of two others. An example is a curve that modifies the efficiency of an air conditioner relative to the outside air dry-bulb temperature and the wet-bulb temperature of air returning to the coil. The relationship is a three-dimensional surface and can be expressed in terms of the X and Y coordinates of points on the curve or it can be expressed as an equation.

5.11.16 Temperature Reset Schedule

This data structure describes the relationship between one temperature and another. For example, the independent variable might be outside air temperature and the dependent variable is supply air temperature. In this case, a common schedule would be to set the supply air temperature at 55°F when the outside air temperature is 80°F or warmer and at 62°F when the outside air temperature is 58°F or

cooler with the supply air temperature scaling between 55°F and 62°F when the outside air temperature is between 80°F and 58°F.