
CODES AND STANDARDS ENHANCEMENT INITIATIVE (CASE)

Hydronic Low Temperature Radiant Cooling Systems

2013 California Building Energy Efficiency Standards

California Utilities Statewide Codes and Standards Team

September 2011



This report was prepared by the California Statewide Utility Codes and Standards Program and funded by the California utility customers under the auspices of the California Public Utilities Commission.

Copyright 2011 Pacific Gas and Electric Company, Southern California Edison, SoCalGas, SDG&E.

All rights reserved, except that this document may be used, copied, and distributed without modification.

Neither PG&E, SCE, SoCalGas, SDG&E, nor any of its employees makes any warranty, express or implied; or assumes any legal liability or responsibility for the accuracy, completeness or usefulness of any data, information, method, product, policy or process disclosed in this document; or represents that its use will not infringe any privately-owned rights including, but not limited to, patents, trademarks or copyrights

CONTENTS

- 1. Purpose 4**
- 2. Overview 5**
- 3. Methodology 8**
 - 3.1 Data Collection on Status of Radiant Cooling Technologies 8
 - 3.1.1 Literature Review 8
 - 3.1.2 Interviews with Manufacturers and Designers 8
 - 3.1.3 Review Field Monitored Data 9
 - 3.2 Simulation Tools Review 9
 - 3.3 Building Energy Analysis 9
 - 3.4 Stakeholder Meeting Process 10
- 4. Analysis and Results 11**
 - 4.1 Status of Radiant Cooling Technologies 11
 - 4.1.1 Summary of Literature 11
 - 4.1.2 Summary of Interviews 12
 - 4.2 EnergyPlus Simulation Capabilities 15
 - 4.2.1 Low Temperature Radiant System: Variable Volume 16
 - 4.2.2 Low Temperature Radiant System: Constant Volume 21
 - 4.3 Energy Simulation Analysis and Results 27
 - 4.3.1 Prototype Design 27
 - 4.3.2 Simulation Analysis Setup 28
 - 4.3.3 Simulation Results 32
 - 4.3.4 Proposed ACM Recommendations 41
- 5. Recommended Language for the Standards Document, ACM Manuals, and the Reference Appendices 43**
- 6. Bibliography and Other Research 44**
 - 6.1 Experts Consulted 44
 - 6.2 Reports Reviewed 44
- 7. Appendix: Simulation Prototype Plan 46**

FIGURES

Figure 1: Projected Savings from Radiant Cooling 12

Figure 2: 3D Rendition of Radiant Zones..... 29

Figure 3: Radiant System Inputs for Sensitivity Analysis 30

Figure 4: Radiant System Inputs for Annual Energy Savings Analysis 31

Figure 5: Site Monitored Data July 5th 2010..... 32

Figure 6: Modeled Space Mean Temperature vs. Site Data 33

Figure 7: Modeled Radiant CHW Supply and Temp July 5th vs. Site Data 34

Figure 8: Modeled Radiant CHW Supply and Temp March 4th vs. Site Data..... 34

Figure 9: Modeled Space Temperature – March 4th vs. Site Data..... 35

Figure 10: Sensitivity of Zone Temperature to CHW Supply Temp..... 36

Figure 11: Sensitivity of Heat Extraction from Slab to CHW Supply Temp 36

Figure 12: Sensitivity Runs – Floor Slab Temperature (July 5th)..... 37

Figure 13: Sensitivity Runs – Floor Slab Temperature (March 4th) 38

Figure 14: Sensitivity Run – Slab CHW Supply Flow Rate (July 5th) 39

Figure 15: Sensitivity Run – Slab CHW Supply Flow Rate (March 4th)..... 39

Figure 16: Annual Energy Usage for Runs R1-R4 40

Figure 17: Energy Savings - Constant Temp, Variable Flow (R2) vs. Constant Temp, Flow (R1)..... 40

Figure 18: Energy Savings -Variable Temp, Constant Flow (R3) vs. Constant Temp, Flow (R1)..... 40

Figure 19: Energy Savings - Variable Temp, Variable Flow (R4) vs. Constant Temp, Flow (R1) 40

Figure 20: Prototype Store Plan..... 46



1. Purpose

Hydronic radiant cooling systems rely on chilled water flowing through pipes to distribute cooling throughout a building rather than a conventional system that uses chilled air and ductwork. Radiant cooling systems rely mainly on the direct cooling of occupants by radiative heat transfer, because the pipes, which are commonly run through ceilings or floors, maintain cooler surface temperatures. Because the radiative surface is typically a whole floor or ceiling surface, the water can be as warm as 65°F and still provide comfort.

Due to water's superior ability to store and transport energy when compared to air, thermal energy can be transported in water through pipes with lower pump energy than that used by fans to deliver conditioned air in a building. By controlling water flow and temperature of water entering the embedded water pipes, independent control of different areas of the building can be achieved.

In many climates, dehumidification is an important aspect of air conditioning. Radiant cooling systems require exacting design and, possibly, added equipment and controls to assure that indoor environments are comfortable and free from excess moisture that can result in surface condensation. To maintain indoor air quality, a separate ventilation system to supply fresh air is needed.

This CASE topic proposes the creation of a dedicated system type in the nonresidential Alternative Compliance Method (ACM) for modeling hydronic radiant cooling systems for the proposed design when the performance method for compliance is used.

2. Overview

a. Measure Title	Nonresidential ACM Capabilities to Model Radiant Cooling Systems
b. Description	Provide an optional HVAC system type in the Nonresidential Alternative Calculation Method (ACM) for hydronic floor-based radiant cooling systems.
c. Type of Change	<p>Modeling - The change would modify the calculation procedures or assumptions used in making performance calculations when using radiant cooling systems in the proposed building. This change will add the capability to explicitly model the performance of hydronic floor-based radiant cooling systems in the performance method for the proposed building.</p> <p>This change will modify the nonresidential ACM section 3.3 to add optional simulation capabilities for hydronic floor-based radiant cooling systems for the proposed design.</p>
d. Energy Benefits	Radiant cooling systems are projected to save significant energy (40%+) when compared with air-based cooling systems. For this CASE, we are proposing a modeling method change to better capture savings from radiant cooling systems in the performance method.
e. Non-Energy Benefits	<p>Radiant cooling systems offer improved thermal comfort over air-based systems for building occupants.</p> <p>Radiant cooling systems also operate much quieter resulting in less noise in the space.</p>

f. Environmental Impact

Material Increase (I), Decrease (D), or No Change (NC): (All units are lbs/year)

	Mercury	Lead	Copper	Steel	Plastic	Others (Identify)
Per Prototype Building ¹	NC	NC	NC	NC	NC	NC

1. For description of prototype buildings refer to Methodology section below.

Water Consumption:

	On-Site (Not at the Powerplant) Water Savings (or Increase) (Gallons/Year)
Per Prototype Building ¹	NA

1. For description of prototype buildings refer to Methodology section below.

Radiant cooling systems are closed loop systems similar to four pipe fan coil systems which are the code baseline system and thus no additional water is consumed onsite by this system.

Water Quality Impacts:

Potential increase (I), decrease (D), or no change (NC) in contamination compared to the base case assumption, including but not limited to: mineralization (calcium, boron, and salts), algae or bacterial buildup, and corrosives as a result of PH change.

	Mineralization (calcium, boron, and salts)	Algae or Bacterial Buildup	Corrosives as a Result of PH Change	Others
Impact (I, D, or NC)	NC	NC	NC	NC
Comment on reasons for your impact assessment	Radiant cooling systems are closed loop systems similar to four pipe fan coil systems which are the code baseline system.	Radiant cooling systems are closed loop systems similar to four pipe fan coil systems which are the code baseline system.	Radiant cooling systems are closed loop systems similar to four pipe fan coil systems which are the code baseline system.	

<p>g. Technology Measures</p>	<p>Measure Availability: Radiant cooling systems are readily available in the market and are manufactured by several manufacturers. Radiant tubing systems are manufactured and sold by at least three manufacturers in the state of California. In addition, components of radiant systems such as manifolds, PEX piping, thermostats and other controls are readily available for commercial use.</p> <p>Useful Life, Persistence, and Maintenance: Once properly installed, radiant cooling systems operate and last as long as traditional hydronic heating and cooling systems such as four pipe fan coil systems.</p>
<p>h. Performance Verification of the Proposed Measure</p>	<p>Current Acceptance Testing requirements in Title 24 as applicable to HVAC systems and hydronic systems will be applicable to the measures proposed in this CASE topic.</p>
<p>i. Cost Effectiveness No cost-effectiveness analysis is needed for this CASE topic since no mandatory or prescriptive requirements are being proposed.</p>	
<p>j. Analysis Tools</p>	<p>EnergyPlus is needed to evaluate the energy use and peak demand use and savings for hydronic radiant cooling systems.</p>
<p>k. Relationship to Other Measures</p>	<p>There are no other measures directly related to this topic. This CASE supports the California Energy Commission intent of opening nonresidential compliance analysis to tools including EnergyPlus.</p>

3. Methodology

This section describes the methodology that we followed to assess the measure availability, energy savings and feasibility of the proposed code change. The key elements of the methodology are as follows:

- ◆ Data Collection
- ◆ Review of Simulation Tool Capabilities
- ◆ Savings Analysis

This work was publicly vetted through our stakeholder outreach process, which through in-person meetings, webinars, email correspondence and phone calls, requested and received feedback on the direction of the proposed changes. The stakeholder meeting process is described at the end of the Methodology section.

3.1 Data Collection on Status of Radiant Cooling Technologies

HMG evaluated the availability, market readiness and savings potential for radiant cooling technologies by collecting data from a combination of sources. We conducted a literature review of scientific papers, journal articles, and industry publications; conducted interviews with manufacturers and mechanical engineers; and held ongoing communications with leading research groups.

3.1.1 Literature Review

HMG conducted a literature review of the technical potential and applicability of hydronic radiant cooling technologies as well as energy simulation modeling protocols for these systems. HMG reviewed manufacturers' literature, research papers, conference presentations and reports on studies conducted by leading national laboratories such as the Pacific Northwest National Laboratories (PNNL) and National Renewable Energy Laboratory (NREL).

A short list of selected literature most relevant to the CASE topics is presented in Section 6. A summary of the literature review is presented in Section 4.1.1.

3.1.2 Interviews with Manufacturers and Designers

HMG developed a comprehensive questionnaire to collect information about radiant cooling systems from manufacturers, distributors, and practicing engineers who have experience with radiant cooling technologies. Using the questionnaire, HMG collected information on the following topics:

- ◆ Types of radiant cooling systems
- ◆ Availability and sales channels
- ◆ Relative market share of various types of radiant cooling systems
- ◆ Costs (purchase and installation)
- ◆ Performance ratings
- ◆ Control strategies
- ◆ Condensation control

- ◆ Field validation of system performance
- ◆ Occupant feedback on system operation
- ◆ Interest in stakeholder process participation

The interviews were structured in sections, and questions were tailored differently for each trade (manufacturer/ distributor/ engineer). Consequently, the questions were relevant to each interviewee, and information was gathered for each stage in the process (manufacturing, distribution, design and installation). Respondents were encouraged to give free-form answers, rather than chose from a prescribed set of answers, to elicit feedback beyond the content of the specific question. HMG chose this structure so that all relevant information could be gathered from the survey, even if a particular issue was not explicitly asked on the survey. A copy of the survey is presented in the Appendix.

3.1.3 Review Field Monitored Data

HMG collaborated with the Western Cooling Efficiency Center (WCEC) staff who are evaluating the performance of a radiant cooling system installed in a retail store. WCEC is working for a leading retailer on energy analysis of a retail store in Sacramento, California that has a hydronic radiant cooling system with pipes embedded in the floor slab under the main sales floor areas. This store also uses an innovative method for providing cold water to the radiant system that combines fluid coolers, chillers and refrigeration equipment that are staged to achieve optimal efficiency for both space cooling and refrigeration equipment. The building also uses an indirect evaporative cooling system for dedicated outdoor air supply (DOAS). This strategy is more complex than the average radiant cooling installations and HMG's review concentrated on the performance of the radiant slab in response to the temperature and flow rate of chilled water flowing through the slab.

3.2 Simulation Tools Review

HMG reviewed the capabilities of energy simulation tools to evaluate energy use of hydronic radiant cooling technologies. This included a review of existing algorithms in the nonresidential Alternate Calculation Method (ACM) for the 2008 Title 24 standards, the engineering manual for the DOE2.1 E simulation tool, and the reference manuals for EnergyPlus.

In addition, HMG collaborated with a leading mechanical engineer – Peter Simmonds - with extensive experience with designing radiant cooling systems to evaluate the simulation tools and ACM requirements against the 'real-world' applications and tools used by designers to design, specify and verify radiant system operation.

3.3 Building Energy Analysis

HMG conducted energy simulation analysis using the EnergyPlus simulation engine for a hydronic radiant cooling system with pipes embedded in the floor. The intent was to evaluate the capabilities of the EnergyPlus simulation engine to simulate various control strategies that are commonly employed for hydronic radiant cooling systems.

HMG developed a prototype design based on the radiantly cooled retail store in Sacramento described in Section 4.3.1. Initial simulation runs were conducted to compare the EnergyPlus simulation results with field monitored data. A set of sensitivity runs were then conducted by varying temperature and flow-rate of water entering the radiant cooling pipes embedded in the floor. Finally, HMG conducted

a comparative study of annual energy use of various control strategies using the same prototype design.

Final energy analysis and recommendations are described in Section 4 of this report.

3.4 Stakeholder Meeting Process

All of the main approaches, assumptions, and methods of analysis used in this proposal have been presented for review at one of two public Nonresidential HVAC Stakeholder Meetings funded by the California investor-owned utilities (Pacific Gas and Electric, Southern California Edison, and Southern California Gas Company).

At each meeting, the utilities' CASE team asked for feedback on the proposed language and analysis thus far. The CASE team then sent out a summary of the meeting discussion and a summary of outstanding questions and issues.

A record of the Stakeholder Meeting presentations, summaries, and other supporting documents can be found at www.calcodes.com.

Stakeholder meetings were held on the following dates and locations:

- ◆ First HVAC Stakeholder Meeting: April 27th 2010, California Lighting Technology Center, Davis, CA
- ◆ Second HVAC Stakeholder Meeting: December 9th 2010, Webinar

4. Analysis and Results

This section describes our analysis and assumptions in detail.

4.1 Status of Radiant Cooling Technologies

4.1.1 Summary of Literature

HMG reviewed existing literature on calculation and simulation methods, savings estimates, costs and validation results for radiant cooling systems.

Radiant cooling has received positive press recently due to successes with radiant cooling installations by WalMart which has installed the system on an experimental basis in several stores. These high efficiency prototype stores have been developed as a way to evaluate promising technologies that can meet stringent cost-effectiveness criteria while also being on the leading edge of the efficiency spectrum for retail stores.

In a December 2010 ASHRAE Journal article, Ian Doebber, Michael Deru (NREL) and Mike Moore (Newport Partners) provide a detailed case study of one such store in Sacramento. This store, named as the high-efficiency prototype 6 or HE6 incorporates several efficiency features including hydronic radiant cooling in the sales floor. The store decouples comfort cooling from space ventilation such that a dedicated outdoor air supply (DOAS) system provides continuous ventilation as required by Title 24 while the radiant cooling system provides sensible cooling. The DOAS system is also capable of handling latent loads and provide sensible space cooling as needed if the radiant system does not meet loads. The DOAS system used is an indirect evaporative cooling system. The radiant cooling system itself is served cold water by a combination of chillers and fluid coolers that serve both the need for the radiant system as well as chilled water for refrigeration systems. The store was modeled by NREL using EnergyPlus to develop the control scheme and to explore various options for the configuration of the radiant system prior to store construction.

The radiant system design for this high efficiency prototype made several changes from then standard practices for radiant hydronic floor-based systems. As described in more detail in the following section, installing radiant piping in the floor can be time consuming and adds significant costs to the project. For this store, WalMart worked with the radiant system supplier to develop a rapid install system consisting of pre-assembled pipe ‘mats’ that can be easily rolled out on site rather than installing individual pipe loops. Other measures to reduce first costs over a standard radiant floor included reducing slab thickness, eliminating under-slab insulation, and specifying smaller diameter tubing resting directly on the compacted gravel base below the slab.

The resulting system is projected to save significant energy compared to a traditional air-based cooling system based on energy simulations with EnergyPlus. The combined radiant cooling/DOAS system is projected to save 40%-58% over a constant volume (CAV) air-based system for cooling and ventilation and 19%-37% over a high efficiency variable air volume (VAV) system as seen in Figure 1. The savings are projected to be higher for the system that has variable flow of water into the radiant piping as well as variable temperature of the water entering the piping.

	Standard Efficiency CAV DX RTUs	High Efficiency VAV DX RTUs	Radiant Floor DOAS: Constant Flow-Variable Supply Temperature	Radiant Floor DOAS: Variable Flow-Variable Supply Temperature
DX and chiller	189,855	125,866	41,365	32,916
Pumps	–	–	22,728	16,163
Fluid coolers	–	–	121,302	61,810
Fans	247,914	217,964	78,838	73,240
Total HVAC	437,769	343,830	264,233	184,130
Savings Over CAV baseline (%)	0%	21%	40%	58%

Figure 1: Projected Savings from Radiant Cooling¹

In a research report submitted to the Department of Energy (DOE) Building Technologies Program, PNNL conducted energy simulation studies for new construction medium-sized office buildings to achieve 50% energy savings relative to a building that just meets ANSI/ASHRAE/IESNA Standard 90.1-2004. PNNL concluded that meeting the 50% target would not be feasible even with a high-efficiency VAV system. Instead this report recommends the use of hydronic radiant floors for heating/cooling combined with a DOAS system for ventilation to achieve the 50% savings threshold. This package provides a national-weighted average energy savings of 56% over the Standard 90.1-2004 for 16 climate zones (savings for the different climate zones are weighted by construction square footage per location). Replacing the radiant and DOAS combination with a high efficiency VAV system provides weighted average savings potential of 46% overall. PNNL conducted cost-effectiveness analysis of the two packages of measures and concluded that the primary package with radiant systems has an average payback of 7.6 years, and the package with VAV systems has an average payback of 4.6 years. The energy savings analysis was conducted using EnergyPlus version 3.0.

HMG reviewed the workplan for an ASHRAE funded tool (ASHRAE RP-1383) to evaluate thermal comfort and radiant environment in a simple space. This tool uses EnergyPlus algorithms to calculate space radiant temperatures but then makes a substantial improvement over EnergyPlus by providing results on spatial distribution of temperatures across the space interior surfaces. EnergyPlus on the other hand provides one temperature per surface assuming a perfect distribution of temperature over the surface. RP-1383 includes reporting of thermal comfort in the space based on the comfort criteria in ASHRAE Standard 55. RP-1383 can thus allow for more sophisticated analysis of radiant temperature conditions in the space. However, this is still a research tool and is not yet ready for distribution or use by the typical energy modeler. The tool is limited to one rectilinear space and is not currently linked with the rest of the EnergyPlus code and thus cannot be used for whole building energy simulation.

4.1.2 Summary of Interviews

HMG conducted interviews with individuals representing manufactures, designers and dealers of hydronic radiant cooling system. A total of 11 people were interviewed based on their familiarity and

¹ Source – Doebber Ian, Moore Mike P.E., Deru Michael P.E. “Radiant Slab Cooling for Retail.” ASHRAE Journal vol. 52, no. 12, December -2010.

direct experience with radiant cooling projects. This included four design engineers, five manufacturers and two owners' representatives. Following is a summary of the interview findings.

System Type

There are three system types available for floor-based radiant cooling systems

- PEX pipe systems
- PEX pipe 'mats', and
- Radiant panels

PEX pipe systems involve pipes embedded in the concrete floor at the time of construction of the slab, usually 2"-4' below the slab interior surface. To achieve this, each length of pipe needs to be manually installed by tying the pipe to spacers that suspend the pipe at the specific depth below the slab finished surface. A typical labor crew with some experience with radiant tubing can lay and tie 1000-1200 ft of pipes per person per day. At this rate, installing radiant pipes in large buildings can add significant upfront labor costs. This is a significant barrier to greater adoption of radiant technologies.

PEX pipe 'mats' are a recent innovation in radiant tubing to overcome this barrier where the radiant tubing comes in pre-installed sections and can be rolled out onsite in pre-determined lengths and widths. This saves significant amount of time (manufacturer estimates range from 60%-80% reduction in labor hours) and thus costs for installing radiant systems. Currently at least two manufacturers have such modular radiant pipe mats available.

Radiant panels are more common in wooden floors where pre-assembled radiant panels are installed underneath the wood floor. The panels themselves consist of metal or PEX piping that is then covered with metal fins to distribute the effects of the chilled water in the pipe to a broader surface area of the wooden floor.

Building Types Suitable for Radiant Cooling

Building types suitable for radiant cooling include institutional buildings, airports, museums, universities, churches, commercial "Big-Box" retail and office buildings with a lobby or foyer. Radiant systems are also a good cooling solution for any building with high solar gains. Many recent applications of radiant systems have been for projects seeking LEED certification.

Typical Radiant Cooling Piping Sizes

While radiant pipes can come in various sizes, the typical radiant cooling installation uses pipe sizes between ½"-¾" diameter with 5/8" diameter being the most common. Typical spacing for radiant pipes is 6"-9" on center for cooling and can be up to 12" for heating.

Radiant Cooling Control Strategies

There are several control strategies employed in practice to regulate the performance of the radiant cooling system. All of these involve supply water temperature and flow rate controls through the pipes. The simplest and some argue the most stable control strategy is to keep both the supply temperature and flow rate constant throughout the day. The radiant system is a self-regulating system whereby the heat extraction from the slab increases as the delta between the slab temperature and supply water temperature increases. Conversely, during periods of low cooling needs, there is

minimal heat extraction from the slab and the radiant system can ‘coast’ at a set temperature. Variable temperature with constant flow systems are getting more common, though some use variable temperature and variable flow for optimized control which is the most complex strategy.

Radiant cooling systems can be controlled using similar thermostatic controls as air-based systems. In addition, radiant systems can be controlled using the mean radiant temperature (MRT) and operative temperature. The most common strategy though is to maintain a set zone air temperature similar to traditional DX systems.

With radiant cooling systems, it is possible to ‘charge’ the slab at night or off-peak with chilled water and then let the system float during the peak periods to reduce peak demand. The argument is that the slab is cold enough due to the night cooling and it retains enough of that ‘coolth’ to maintain comfort in the space during peak periods. Some people have claimed that this strategy can also save energy compared to running the system continuously. However the general consensus of the interviews is that the pre-cooling or night-cooling strategies are not used in the field due to concerns about the slab being too cold in the early morning causing discomfort, but more importantly, the potential for condensation on the slab surface. There are systems however that use an optimal start or adaptive control that varies the temperature and/or flow of water to the slab to reduce energy use and provide steady space conditions while avoiding condensation.

Radiant systems are designed to meet sensible loads only and do not provide any humidity control. Dedicated air systems are required to handle the latent loads as well as minimum outdoor ventilation requirements for buildings. Latent loads are not a big issue in California due to the weather conditions. Interviewees expressed concerns about the amount of outdoor air supply mandated by code for retail buildings which results in large DOAS systems and the energy use of these systems makes the overall energy consumption higher for the radiant/DOAS combination.

Condensation Control

Condensation on the radiantly cooled slab surface is a cause for concern with radiant systems. This can occur if the slab temperature is lower than the dewpoint of the ambient air in the space. To avoid this issue it is standard practice to maintain the slab surface temperature at least a degree or two above the dewpoint temperature of space air. To achieve this, the controls have to continuously monitor the indoor dry bulb and humidity conditions as well as slab surface temperature to determine if the slab is reaching dewpoint temperature. In the California context, this is made easier due to the warm/dry summer conditions. In some installations, designers can set a threshold temperature based on typical weather patterns in a given location. ASHRAE specifies slab surface temperature maintained at or above 66° F to prevent floors from being too cold or causing condensation at typical indoor air conditions.

Analyzing Radiant System Performance

Analyzing the performance of radiant cooling systems requires sophisticated analysis tools that are currently not in prevalence for code compliance or energy efficiency analysis. Manufacturers have developed and use their own finite element analysis programs to evaluate performance of radiant cooling systems. Mechanical engineers who specialize in radiant cooling system design have also developed custom spreadsheet tools based on first principles and rules of thumb. Of the commercially available software, EnergyPlus is the only full-featured energy simulation software that can model the performance of radiant cooling systems.

Of the rules of thumb for verifying radiant system performance, one that is most commonly cited is the rate of heat extraction expected from a slab due to cold water flowing through the slab. The consensus of experts and manufacturers is that 12-18 btu-h/sf heat extraction is a reasonable performance for a floor-based radiant cooling system. In a building with high direct solar gains on the slab, the system capacity can significantly increase to 25-32 btu-h/sf.

Costs of radiant systems vary significantly depending on the type of product used for radiant tubing in the slab, the source for cold water for the radiant system and the complexity of controls. Typical costs for newer rapid-install radiant piping mats range from \$1-\$2/sf for the radiant piping and associated fittings and valves. Total installed cost of pipes depends on the type of radiant pipes, but a conservative estimate from RS Means is about \$4-\$5.25/sf without the cost of controls. The cost of controls ranges from \$2-\$30/sf depending on the number of sensors needed, zoning and the complexity of the control scheme. The cost of the cooling water source (chiller/fluid cooler) is separate from these costs as is the cost for the DOAS system. As a point of reference, researchers and Pacific Northwest National Laboratory (PNNL) estimated the total cost of the entire system including DOAS and central plant to be about \$9.30/sf.

4.2 EnergyPlus Simulation Capabilities

EnergyPlus includes a fully integrated suite of HVAC system options that can model performance of radiant cooling systems. EnergyPlus includes three major improvements over the DOE2.1E simulation engine which enables it to calculate energy use for radiant cooling systems:

- ◆ The space load calculation accounts for the radiant effects of interior surface temperature of the envelope. The surface temperatures are calculated based on the transient heat transfer through the envelope assemblies that accounts for thermal mass and bi-directional heat transfer.
- ◆ The envelope construction assemblies account for the storage of heat/cool through sources embedded within the construction assemblies. Further these sources and the amount of heat/cool that is added to the construction assembly can be controlled.
- ◆ EnergyPlus allows more than one system type to be defined for a given space and allows the user to set preference for which system takes priority over the other(s).

EnergyPlus offers a range of models for system modules for radiant/convective systems:

- ◆ ZoneHVAC:Baseboard:Convective:Electric
- ◆ ZoneHVAC:Baseboard:RadiantConvective:Water
- ◆ ZoneHVAC:Baseboard:RadiantConvective:Steam
- ◆ ZoneHVAC:Baseboard:RadiantConvective:Electric
- ◆ ZoneHVAC:Baseboard:Convective:Water
- ◆ ZoneHVAC:HighTemperatureRadiant
- ◆ ZoneHVAC:LowTemperatureRadiant:Electric
- ◆ **ZoneHVAC:LowTemperatureRadiant:ConstantFlow**
- ◆ **ZoneHVAC:LowTemperatureRadiant:VariableFlow**

Of these system types, the two that are relevant to hydronic radiant cooling systems are the last two ‘LowTemperatureRadiant’ systems highlighted in bold text above. Below are details of the simulation inputs and outputs for these two modules.

4.2.1 Low Temperature Radiant System: Variable Volume

This system is zonal equipment that is intended to model any “radiant system” where water is used to supply/remove energy to/from a building surface (wall, ceiling, or floor). Control is accomplished by throttling the hot or chilled water flow to the unit.

The radiant system model is self-contained in that it controls the system operation based on control criteria defined by input syntax within the radiant cooling module and not via a zone thermostat such as is used for forced air systems. If the radiant system is serving a zone with forced air equipment, the radiant system will follow the priority order established by the zone thermostat but will still base its response on the controls defined by the user for the radiant system. EnergyPlus allows the radiant system to be controlled based on zone air temperature but this is achieved through inputs within the radiant model and not referenced to the zone thermostat used for the forced air equipment.

Following are key inputs and outputs of the variable volume model excerpted from the EnergyPlus Input/Output Reference Manual.

Simulation Inputs

Field: Availability Schedule Name

This field is the name of the schedule (Ref: Schedule) that denotes whether the hydronic low temperature radiant system can run during a given hour. A schedule value greater than 0 (usually 1 is used) indicates that the unit is available and can be on during the hour. A value less than or equal to 0 (usually 0 is used) denotes that the unit is not available and must be off for the hour.

Field: Zone Name

This field is the name of the zone (Ref: Zone) in which the hydronic low temperature radiant system is principally located and intended to affect. A system that is between two zones will still act upon each zone; however, the zone name referenced here should be the zone that controls the radiant system response.

Field: Surface Name or Radiant Surface Group Name

This field is the name of the surface (Ref: BuildingSurface) or surface list (Ref: ZoneHVAC:LowTemperatureRadiant:SurfaceGroup) in which the hydronic tubing is embedded/contained. This specification attaches the source or sink from the radiant system to a particular surface and the contribution of the system to the heat balances of that surface. If this field is a surface list, then the source or sink is attached to all of the surfaces in the list with the radiant system surface group defining the breakdown of how flow rate is split between the various surfaces. Only base surfaces (e.g., BuildingSurface:Detailed) are valid. Window/Door surfaces and Internal Mass are not valid surface types for embedded radiant systems.

Field: Hydronic Tubing Inside Diameter

This field is the inside diameter of the tubes through which water is circulated for the system being defined by this statement. The inside diameter should be recorded in meters and is used to determine the convective heat transfer from the water to the inside surface of the hydronic tubing.

Field: Hydronic Tubing Length

This field is the total length of pipe embedded in the surface named above in the surface name field. The length of the tube should be entered in meters and is used to determine the effectiveness of heat transfer from the fluid being circulated through the tubes and the tube/surface. Longer tubing lengths result in more heat will be transferred to/from the radiant surface to the circulating fluid. Note that if the user elects to autosize this field that a standard zone thermostat such as would be used for a forced air system must be defined as autosizing calculations are based on the zone thermostat value and not on the radiant system control values.

Field: Temperature Control Type

This field specifies along with the throttling range and setpoint schedules how the user wishes to control the hydronic radiant system. The temperature denoted in the setpoint schedule can refer to one of five different temperatures: the zone mean air temperature, the zone mean radiant temperature, the zone operative temperature, the outdoor dry-bulb temperature, or the outdoor wet-bulb temperature. The choice of temperature is controlled by the current field—temperature control type. The user must select from the following options:

- ◆ MeanAirTemperature
- ◆ MeanRadiantTemperature
- ◆ OperativeTemperature
- ◆ OutdoorDryBulbTemperature
- ◆ OutdoorWetBulbTemperature

Operative temperature for radiant system controls is the average of Mean Air Temperature and Mean Radiant Temperature. If the user does not select a control type, MeanAirTemperature control is assumed by EnergyPlus.

Field: Maximum Hot Water Flow

This field is the maximum flow rate of hot water through the radiant system in m³/sec. The controls for the radiant system will vary the flow rate of hot water through the surface using zero flow and the maximum flow rate specified in this field as the lower and upper bounds, respectively. Note that if the user elects to autosize this field that a standard zone thermostat such as would be used for a forced air system must be defined as autosizing calculations are based on the zone thermostat value and not on the radiant system control values.

Field: Heating Water Inlet Node Name

This field contains the name of the hot water inlet node to the radiant system. Note that this node name must also show up in the branch description when defining the plant demand side network in a manner identical to defining a heating coil.

Field: Heating Water Outlet Node Name

This field contains the name of the hot water outlet node to the radiant system. Note that this node name must also show up in the branch description when defining the plant demand side network in a manner identical to defining a heating coil.

Field: Heating Control Throttling Range

This field specifies the range of temperature in degrees Celsius over which the radiant system throttles from zero flow rate up to the maximum defined by the maximum hot water flow rate field described above. The throttling range parameter is used in conjunction with the control temperature to define the response of the system to various zone conditions. The heating control temperature schedule specifies the “setpoint” temperature where the flow rate to the system is at half of the maximum flow rate. For example, if the heating control temperature setpoint is currently 15°C and the heating throttling range is 2°C, the water flow rate to the radiant system will be zero when the controlling temperature (MAT, MRT, Operative Temperature, ODB, or OWB; see control type field above) is at or above 16°C and the maximum flow rate when the controlling temperature is at or below 14°C. This represents a throttling range of 2°C around the setpoint of 15°C. In between 14°C and 16°C, the flow rate to the radiant system is varied linearly.

Field: Heating Control Temperature Schedule Name

This field specifies the heating setpoint or control temperature for the radiant system in degrees Celsius. Used in conjunction with the previous field (heating control throttling range), it will define whether or not the system is running and the current flow rate. Water flow rate to the system is varied linearly around the setpoint temperature based on the throttling range and the maximum heating flow rate parameters (see above). It should be noted that this control schedule will allow different setpoint temperatures throughout the year for heating. The control of the radiant system is based solely on the heating control temperature schedule, the cooling control temperature schedule (see below), and the control temperature type listed above. The radiant system will not use any zone thermostat that might be used by other systems serving the zone in which the radiant system resides.

Field: Maximum Cold Water Flow

This field is the maximum flow rate of cold water through the radiant system in m³/sec. The controls for the radiant system will vary the flow rate of cold water through the surface using zero flow and the maximum flow rate specified in this field as the lower and upper bounds, respectively. Note that this field is optional and not required for a heating only system. Note also that if the user elects to autosize this field that a standard zone thermostat such as would be used for a forced air system must be defined as autosizing calculations are based on the zone thermostat value and not on the radiant system control values.

Field: Cooling Water Inlet Node Name

This field contains the name of the cold water inlet node to the radiant system. Note that this node name must also show up in the branch description when defining the plant demand side network in a manner identical to defining a cooling coil. As with the maximum cold water flow rate, this field is optional and not required for a heating only system.

Field: Cooling Water Outlet Node Name

This field contains the name of the cold water outlet node to the radiant system. Note that this node name must also show up in the branch description when defining the plant demand side network in a

manner identical to defining a cooling coil. As with the maximum cold water flow rate, this field is optional and not required for a heating only system.

Field: Cooling Control Throttling Range

This field specifies the range of temperature in degrees Celsius over which the radiant system throttles from zero flow rate up to the maximum defined by the maximum cold water flow rate field described above. The throttling range parameter is used in conjunction with the control temperature to define the response of the system to various zone conditions. The cooling control temperature schedule specifies the “setpoint” temperature where the flow rate to the system is at half of the maximum flow rate. For example, if the cooling control temperature setpoint is currently 25°C and the cooling throttling range is 2°C, the water flow rate to the radiant system will be zero when the controlling temperature (MAT, MRT, Operative Temperature, ODB, or OWB; see control type field above) is at or below 24°C and the maximum flow rate when the controlling temperature is at or above 26°C. This represents a throttling range of 2°C around the setpoint of 25°C. In between 24°C and 26°C, the flow rate to the radiant system is varied linearly.

Field: Cooling Control Temperature Schedule Name

This field specifies the cooling setpoint or control temperature for the radiant system in degrees Celsius. Used in conjunction with the previous field (cooling control throttling range), it will define whether or not the system is running and the current flow rate. Water flow rate to the system is varied linearly around the setpoint temperature based on the throttling range and the maximum cooling flow rate parameters (see above). It should be noted that this control schedule will allow different setpoint temperatures throughout the year for cooling. The control of the radiant system is based solely on the heating control temperature schedule listed above, the cooling control temperature schedule, and the control temperature type listed above. The radiant system will not use any zone thermostat that might be used by other systems serving the zone in which the radiant system resides.

Field: Condensation Control Type

When radiant systems do cooling, there is the possibility that condensation will occur on the surface that is being cooled. This is due to the fact that the surface temperature may drop below the dew-point temperature of the space. When this occurs, condensation on the surface will occur. In EnergyPlus, users have several options for handling this situation including: Off and SimpleOff. When the user chooses the Off option, EnergyPlus will not do anything other than produce a warning message when condensation is predicted to occur. The program will simply continue on; no moisture will be removed from the zone air and there will be no adjustment of the surface temperature as a result of the condensation. When the user chooses the SimpleOff option, the program will predict cases where condensation will occur and shut-off the radiant system to avoid this situation. With this option, the users also have the opportunity to adjust when the system will shut down. This is specified with the next parameter (field: condensation differential parameter). This parameter is optional and EnergyPlus will use the SimpleOff strategy when this parameter is not specified.

Field: Condensation Control Dewpoint Offset

This optional parameter is only valid with the SimpleOff condensation handling algorithm (see previous input parameter). It establishes the difference between the calculated dew-point temperature of the space and the allowed surface temperature to which the surface can drop before the radiant system shuts down in degrees Celsius. This parameter can be any positive, negative, or zero value.

When this parameter is zero, the radiant system will shut down when the surface temperature drops to the dew-point temperature or below. When this parameter is positive, the radiant system will shut down when the surface is the number of degrees Celsius above the dew-point temperature. This allows some extra safety to avoid condensation. When this parameter is negative, the radiant system will shut down when the surface temperature is the number of degrees Celsius below the dew-point temperature. While not recommended, this strategy allows the user to simulate a situation where small amounts of condensation are tolerable.

Simulation Outputs

Hydronic Low Temp Radiant Heating Rate[W]

This field reports the heating input rate to the low temperature radiant system in Watts. This is the heat source to the surface that is defined as the radiant system. The heating rate is determined by the zone conditions and the control scheme defined in the user input.

Hydronic Low Temp Radiant Heating Energy[J]

This field reports the heating input to the low temperature radiant system in Joules. This is the heat source to the surface that is defined as the radiant system. The heating rate is determined by the zone conditions, the control scheme defined in the user input, and the timestep.

Hydronic Low Temp Radiant Cooling Rate[W]

This field reports the cooling input rate to the low temperature radiant system in Watts. This is the heat sink to the surface that is defined as the radiant system. The cooling rate is determined by the zone conditions and the control scheme defined in the user input.

Hydronic Low Temp Radiant Cooling Energy[J]

This field reports the cooling input to the low temperature radiant system in Joules. This is the heat sink to the surface that is defined as the radiant system. The cooling rate is determined by the zone conditions, the control scheme defined in the user input, and the timestep.

Hydronic Low Temp Radiant Water Mass Flow Rate[kg/s]

This field reports the mass flow rate of water through the low temperature radiant system in kilograms per second.

Hydronic Low Temp Radiant Water Inlet Temp[C]

This field reports the temperature of water entering the low temperature radiant system in Celsius.

Hydronic Low Temp Radiant Water Outlet Temp[C]

This field reports the temperature of water leaving the low temperature radiant system in Celsius.

Hydronic Low Temp Radiant Time Condensation Occurring[s]

This field reports the amount of time when condensation is occurring. When using the Off condensation control, this simply reports the amount of time when condensation occurs. When using the SimpleOff condensation control, this indicates the amount of time when the system has been shut off because of the potential danger of condensation.

4.2.2 Low Temperature Radiant System: Constant Volume

This low temperature radiant system (hydronic) is a component of zone equipment that is intended to model any “radiant system” where water is used to supply/remove energy to/from a building surface (wall, ceiling, or floor).

The constant flow system differs from the variable flow system described above in what it controls. The variable flow system varies the flow rate through the radiant system based on some control temperature. The constant flow system keeps flow rate constant via a local circulation pump and varies the water temperature that is sent to the radiant system. This is accomplished with a mixing valve that is controlled by a sensor.

One of the other differences between this model and the variable flow hydronic radiant system is that the constant flow radiant system has a built-in local secondary loop. It will recirculate flow coming out of the system and mix this with flow from the supply loop to arrive at the desired inlet temperature to the radiant system (note that this model has the temperature sensor AFTER the pump to insure proper inlet temperature to the radiant system). The local loop also contains a pump which is assumed to be upstream of the radiant system and after the mixing valve. So, the local loop can have some recirculation. The flow from the main loop may also bypass the radiant system if more than enough flow is available and the main loop is also a constant flow system.

Following are key inputs to and outputs from the variable volume model excerpted from the EnergyPlus Input/Output Reference Manual.

Simulation Inputs

Field: Name

This field is an unique user assigned name for an instance of a constant flow low temperature radiant system. Any reference to this unit by another object will use this name.

Field: Availability Schedule Name

This field is the name of the schedule (ref: Schedule) that denotes whether the constant flow low temperature radiant system can run during a given hour. A schedule value greater than 0 (usually 1 is used) indicates that the unit is available and can be on during the hour. A value less than or equal to 0 (usually 0 is used) denotes that the unit is not available and must be off for the hour.

Field: Zone Name

This field is the name of the zone (Ref: Zone) in which the constant flow low temperature radiant system is principally located and intended to affect. A system that is between two zones will still act upon each zone; however, the zone name referenced here should be the zone that controls the radiant system response.

Field: Surface Name or Radiant Surface Group Name

This field is the name of the surface (Ref: BuildingSurface:Detailed) or surface list (Ref: ZoneHVAC:LowTemperatureRadiant:SurfaceGroup) in which the hydronic tubing is embedded/contained. This specification attaches the source or sink from the radiant system to a particular surface and the contribution of the system to the heat balances of that surface. If this field is a surface list, then the source or sink is attached to all of the surfaces in the list with the radiant system surface group defining the breakdown of how flow rate is split between the various surfaces. Only

base surfaces (BuildingSurface:Detailed) are valid. Window/Door surfaces and Internal Mass are not valid surface types for embedded radiant systems.

Field: Hydronic Tubing Inside Diameter

This field is the inside diameter of the tubes through which water is circulated for the system being defined by this statement. The inside diameter should be recorded in meters and is used to determine the convective heat transfer from the water to the inside surface of the hydronic tubing.

Field: Hydronic Tubing Length

This field is the total length of pipe embedded in the surface named above in the surface name field. The length of the tube should be entered in meters and is used to determine the effectiveness of heat transfer from the fluid being circulated through the tubes and the tube/surface. Longer tubing lengths result in more heat being transferred to/from the radiant surface to the circulating fluid.

Field: Temperature Control Type

This field specifies along with setpoint (control) and water schedules how the user wishes to control the constant flow radiant system. The temperature denoted in the setpoint schedule can refer to one of five different temperatures: the zone mean air temperature, the zone mean radiant temperature, the zone operative temperature, the outdoor dry-bulb temperature, or the outdoor wet-bulb temperature. The choice of temperature is controlled by the current field—temperature control type. The user must select from the following options:

- ◆ MeanAirTemperature
- ◆ MeanRadiantTemperature
- ◆ OperativeTemperature
- ◆ OutdoorDryBulbTemperature
- ◆ OutdoorWetBulbTemperature

Operative temperature for radiant system controls is the average of Mean Air Temperature and Mean Radiant Temperature. If the user does not select a control type, MeanAirTemperature control is assumed by EnergyPlus. See the throttling range and control temperature schedule fields below for more information.

Field: Rated Flow Rate

This field is the maximum flow rate of water through the radiant system in m³/sec. This flow rate is held constant by the local component pump, but the user has the option of varying this flow rate via a schedule (see next input field). The constant flow system will accept this flow rate and control the inlet temperature based on the control and water temperature schedules defined below.

Field: Pump Flow Rate Schedule Name

This field modifies the maximum flow rate of water through the radiant system in m³/sec. This input is “optional”. If the user does not enter a schedule, the flow rate through the radiant system is assumed to be constant during all hours that it is operating based on the value entered in the previous input field. Note that the values for this schedule must be between zero and one.

Field: Rated Pump Head

This numeric field contains the pump's rated head in Pascals.

Field: Rated Power Consumption

This numeric field contains the pump's rated power consumption in Watts.

Field: Motor Efficiency

This numeric field contains the pump's efficiency in decimal form (0 = 0%, 1 = 100%).

Field: Fraction of Motor Inefficiencies to Fluid Stream

This numeric field contains the pump's fraction of power loss to the fluid.

Field: Heating Water Inlet Node Name

This field contains the name of the hot water inlet node to the radiant system. Note that this node name must also show up in the branch description when defining the plant demand side network in a manner identical to defining a heating coil.

Field: Heating Water Outlet Node Name

This field contains the name of the hot water outlet node to the radiant system. Note that this node name must also show up in the branch description when defining the plant demand side network in a manner identical to defining a heating coil.

Field: Heating High Water Temperature Schedule Name

This field specifies the high water temperature in degrees Celsius for the temperature control of a constant flow radiant heating system. Water and control temperatures for heating work together to provide a linear function that determines the water temperature sent to the radiant system. The current control temperature (see Temperature Control Type above) is compared to the high and low control temperatures at the current time. If the control temperature is above the high temperature, then the system will be turned off and the water mass flow rate will be zero. If the control temperature is below the low temperature, then the inlet water temperature is set to the high water temperature. If the control temperature is between the high and low value, then the inlet water temperature is linearly interpolated between the low and high water temperature values.

Field: Heating Low Water Temperature Schedule Name

This field specifies the low water temperature in degrees Celsius for the temperature control of a constant flow heating radiant system. For more information on its interpretation, see Heating High Water Temperature Schedule above.

Field: Heating High Control Temperature Schedule Name

This field specifies the high control temperature in degrees Celsius for the temperature control of a constant flow heating radiant system. For more information on its interpretation, see Heating High Water Temperature Schedule above.

Field: Heating Low Control Temperature Schedule Name

This field specifies the low control temperature in degrees Celsius for the temperature control of a constant flow heating radiant system. For more information on its interpretation, see Heating High Water Temperature Schedule above.

Field: Cooling Water Inlet Node Name

This field contains the name of the cold water inlet node to the radiant system. Note that this node name must also show up in the branch description when defining the plant demand side network in a manner identical to defining a cooling coil. As with the maximum cold water flow rate, this field is optional and not required for a heating only system.

Field: Cooling Water Outlet Node Name

This field contains the name of the cold water outlet node to the radiant system. Note that this node name must also show up in the branch description when defining the plant demand side network in a manner identical to defining a cooling coil. As with the maximum cold water flow rate, this field is optional and not required for a heating only system.

Field: Cooling High Water Temperature Schedule Name

This field specifies the high water temperature in degrees Celsius for the temperature control of a constant flow radiant cooling system. Water and control temperatures for heating work together to provide a linear function that determines the water temperature sent to the radiant system. The current control temperature (see Temperature Control Type above) is compared to the high and low control temperatures at the current time. If the control temperature is above the high temperature, then the inlet water temperature is set to the low water temperature. If the control temperature is below the low temperature, then system will be turned off and the water mass flow rate will be zero. If the control temperature is between the high and low value, then the inlet water temperature is linearly interpolated between the low and high water temperature values. For more information and a graph of how the water and control schedules affect the system operation, please consult the Engineering Reference document.

Field: Cooling Low Water Temperature Schedule Name

This field specifies the low water temperature in degrees Celsius for the temperature control of a constant flow cooling radiant system. For more information on its interpretation, see Cooling High Water Temperature Schedule above.

Field: Cooling High Control Temperature Schedule Name

This field specifies the high control temperature in degrees Celsius for the temperature control of a constant flow cooling radiant system. For more information on its interpretation, see Cooling High Water Temperature Schedule above.

Field: Cooling Low Control Temperature Schedule Name

This field specifies the low control temperature in degrees Celsius for the temperature control of a constant flow cooling radiant system. For more information on its interpretation, see Cooling High Water Temperature Schedule above.

Field: Condensation Control Type

When radiant systems do cooling, there is the possibility that condensation will occur on the surface that is being cooled. This is due to the fact that the surface temperature may drop below the dew-point

temperature of the space. When this occurs, condensation on the surface will occur. In EnergyPlus, users have several options for handling this situation including: Off and SimpleOff. When the user chooses the Off option, EnergyPlus will not do anything other than produce a warning message when condensation is predicted to occur. The program will simply continue on; no moisture will be removed from the zone air and there will be no adjustment of the surface temperature as a result of the condensation. When the user chooses the SimpleOff option, the program will predict cases where condensation will occur and shut-off the radiant system to avoid this situation. With this option, the users also have the opportunity to adjust when the system will shut down. This is specified with the next parameter (field: condensation differential parameter). This parameter is optional and EnergyPlus will use the SimpleOff strategy when this parameter is not specified.

Field: Condensation Control Dewpoint Offset

This optional parameter is only valid with the SimpleOff condensation handling algorithm (see previous input parameter). It establishes the difference between the calculated dew-point temperature of the space and the allowed surface temperature to which the surface can drop before the radiant system shuts down in degrees Celsius. This parameter can be any positive, negative, or zero value. When this parameter is zero, the radiant system will shut down when the surface temperature drops to the dew-point temperature or below. When this parameter is positive, the radiant system will shut down when the surface is the number of degrees Celsius above the dew-point temperature. This allows some extra safety to avoid condensation. When this parameter is negative, the radiant system will shut down when the surface temperature is the number of degrees Celsius below the dew-point temperature. While not recommended, this strategy allows the user to simulate a situation where small amounts of condensation are tolerable.

Simulation Outputs

Constant Flow Low Temp Radiant Heating Rate[W]

This field reports the heating input rate to the low temperature radiant system in Watts. This is the heat source to the surface that is defined as the radiant system. The heating rate is determined by the zone conditions and the control scheme defined in the user input.

Constant Flow Low Temp Radiant Heating Energy[J]

This field reports the heating input to the low temperature radiant system in Joules. This is the heat source to the surface that is defined as the radiant system. The heating rate is determined by the zone conditions, the control scheme defined in the user input, and the timestep.

Constant Flow Low Temp Radiant Cooling Rate[W]

This field reports the cooling input rate to the low temperature radiant system in Watts. This is the heat sink to the surface that is defined as the radiant system. The cooling rate is determined by the zone conditions and the control scheme defined in the user input.

Constant Flow Low Temp Radiant Cooling Energy[J]

This field reports the cooling input to the low temperature radiant system in Joules. This is the heat sink to the surface that is defined as the radiant system. The cooling rate is determined by the zone conditions, the control scheme defined in the user input, and the timestep.

Constant Flow Low Temp Radiant Water Mass Flow Rate[kg/s]

This field reports the mass flow rate of water through the low temperature radiant system in kilograms per second. This should be identical to the pump flow rate for the system.

Constant Flow Low Temp Radiant Injection Mass Flow Rate[kg/s]

This field reports the mass flow rate of water that is injected into the radiant system from the main loop. A valve will control the injection and recirculation mass flow rates (see next field) to match the temperature controls specified by the user and dictated by the current simulation conditions.

Constant Flow Low Temp Radiant Recirculation Mass Flow Rate[kg/s]

This field reports the mass flow rate of water that is recirculated from the radiant system outlet and mixed with the injection flow from the main loop. A valve will control the injection and recirculation mass flow rates (see next field) to match the temperature controls specified by the user and dictated by the current simulation conditions.

Constant Flow Low Temp Radiant Water Inlet Temp[C]

This field reports the temperature of water entering the low temperature radiant system in Celsius. This may differ from the inlet node temperature for the component since this component has its own local secondary loop.

Constant Flow Low Temp Radiant Water Outlet Temp[C]

This field reports the temperature of water leaving the low temperature radiant system in Celsius. This may differ from the outlet node temperature for the component since this component has its own local secondary loop.

Constant Flow Low Temp Pump Water Inlet Temp[C]

This field reports the temperature of water entering the low temperature radiant system pump in Celsius. This may differ from the inlet node temperature for the component since this component has its own local secondary loop. It is assumed that the pump is upstream of the radiant system.

Constant Flow Low Temp Pump Electric Power[W]

This field reports the rate of electric power consumption for the pump which supplies flow to the constant flow radiant system in Watts.

Constant Flow Low Temp Pump Electric Consumption[J]

This field reports the electric power consumption for the pump which supplies flow to the constant flow radiant system in Joules.

Constant Flow Low Temp Radiant Pump Water Mass Flow[kg/s]

This field reports the mass flow rate of water through the low temperature radiant system pump in kilograms per second. This should be identical to the flow rate for the system.

Constant Flow Low Temp Pump Heat to Fluid[W]

This field reports the rate at which heat is added to the fluid stream as it passes through the pump in Watts. This heat is reflected in the radiant system inlet temperature which will be different from the pump inlet temperature if this field has a non-zero value.

Constant Flow Low Temp Pump Heat to Fluid Energy[J]

This field reports the amount of heat energy added to the fluid stream as it passes through the pump in Joules. This heat is reflected in the radiant system inlet temperature which will be different from the pump inlet temperature if this field has a non-zero value.

Constant Flow Low Temp Radiant Time Condensation Occurring[s]

This field reports the amount of time when condensation is occurring. When using the Off condensation control, this simply reports the amount of time when condensation occurs. When using the SimpleOff condensation control, this indicates the amount of time when the system has been shut off because of the potential danger of condensation.

4.3 Energy Simulation Analysis and Results

4.3.1 Prototype Design

HMG conducted energy simulation analysis for a prototype building design based on a retail store in Sacramento, CA that has hydronic radiant cooling system.

Building Description

The prototype design has the main sales floor (including merchandise aisles, grocery, check-out areas) in the middle of the store. Ancillary spaces such as storage, offices, and spaces occupied by tenants are on the perimeter of the store. A detailed plan of the store is presented in the Appendix for reference. For the energy simulation analysis, only the merchandise and checkout areas of the store were modeled since the hydronic radiant cooling system is installed in those sections of the store.

Construction

Walls are constructed of eight inch uninsulated concrete blocks. The built up roof is insulated with R30 rigid insulation. The floor is four inch thick concrete slab-on-grade with hydronic pipes located within the slab. The roof over the central merchandise areas has evenly spaced rows of double-glazed 5x6 skylights.

System Type(s)

The store has two separate systems - the radiant system provides sensible cooling and a dedicated outside air system (DOAS) provides ventilation air and dehumidification.

Radiant System

The as-designed radiant floor cooling system is separated into the “front merchandise” zone and “back merchandise” zone which are further divided into several sub-zones that can be individually controlled. Each of the radiant floor zones is designed for a maximum flow of 306 gpm through half-inch piping. Chilled water to the radiant floors is provided by an air-cooled chiller. In addition, three fluid coolers provide waterside economizing for the radiant floor. For the energy simulation analysis, the chilled water source was modeled as district cooling to minimize the complexity of modeling chillers and fluid coolers.

DOAS System

Four separately controlled dedicated outside air unit provide ventilation air, additional cooling using indirect-direct evaporative cooling, and heating, to both zones.

4.3.2 Simulation Analysis Setup

HMG conducted building energy simulation analysis for the prototype store using EnergyPlus version 6.0.0, which is the latest version as of October 2010.

The simulation analysis was conducted in three stages. First an EnergyPlus model of the radiant floor was compared to the monitored site data to compare EnergyPlus input capabilities versus the operation of the store for a design day condition. The slab surface temperature and the resulting space mean air temperature were key performance metrics used for comparison.

Second, sensitivity analysis was performed by adjusting various inputs to the EnergyPlus model to evaluate impact on slab surface temperature and space mean air temperature.

Third, a comparative analysis was conducted to compare the constant flow and variable flow modules in EnergyPlus in terms of their ability to model slab surface temperatures and resulting space air temperatures on an annual basis as well as associate energy usage.

Initial Model Development

The radiant system as operated in the store uses both a variable temperature and variable water flow controls. The input capabilities for both of the low-temperature radiant hydronic systems in EnergyPlus assume a constant supply temperature to the slab. Thus it was not possible to directly model the variable temperature through input keywords identified in Section 4.2 of this document.

To get around this limitation, HMG modeled the system in EnergyPlus using the low temperature variable volume system which allows modeling of the variable flow explicitly. A temperature schedule was separately added to the chilled water supply side at the plant to model the variable chilled water supply temperature. This work-around allowed HMG to model the system as a variable flow and variable temperature system. Site monitored chilled water supply temperatures and flow rates were obtained from the energy management system, converted to hourly schedules, and implemented in EnergyPlus using the schedule setpoint manager.

HMG chose July 5th, 2010 as a representative summer design-day condition to specify a chilled water supply temperature schedule at 15 minute intervals based on actual data recorded onsite.

To simplify the energy modeling and allow a focus on the radiant cooling component of the system, purchased chilled water was used as the chilled water source rather than explicitly defining chillers and fluid coolers that provide the chilled water to the radiant floor systems.

HMG used mean air temperature for thermostatic control in the analysis based on monitored data. A cooling temperature control setpoint of 76°F and a cooling throttling range of 2.7°F was used based on site data. Under these conditions, the radiant system flow rate is approximately 50% of total flow when the zone mean temperature is 76°F, at minimum flow at 73.3°F, and at full flow when zone mean temperature is 78.7°F.

HMG simplified the zoning of the radiant system by combining similar zones to form a ‘front merchandise radiant zone’ and ‘back merchandise radiant zone’. Each of these zones is

approximately 54,000 square feet. The front and left walls of the front radiant zone are modeled as exterior walls and the remaining walls have adiabatic conditions since they face other conditioned zones. The front zone experiences higher infiltration rates than the back zone due to the entrance doors and more exterior wall area that is exposed to ambient conditions. A 3D rendition of the building using Google Sketchup is provided below in Figure 2.

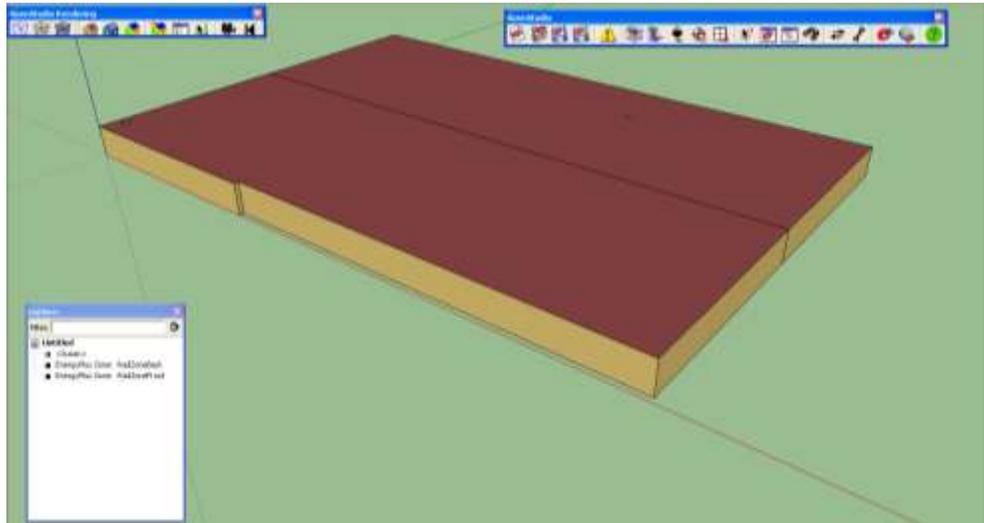


Figure 2: 3D Rendition of Radiant Zones

For simplicity, and to provide cold ventilation air to the space, the DOAS serving the radiant zones was modeled as a packaged unitary system without the energy recovery feature that exists in the store.

Sensitivity Analysis

Once the base model was setup and compared with site conditions for the design day, HMG conducted a sensitivity analysis on the initial model by varying temperature of water entering the slabs, internal heat gains (varying occupant density), and the control temperature choice of mean air temperature, mean radiant temperature and operative temperature. The sensitivity analysis provided feedback on whether the radiant cooling module responds to the inputs appropriately by adjusting the slab surface temperatures and mean air temperatures appropriately. A proper response by the simulation tool would provide confidence in the ability of the tool to model various input conditions and provide meaningful results.

Sensitivity Analysis of EnergyPlus Control Algorithms

The initial model and sensitivity analysis focused on a strategy that matched the onsite conditions the best. For the second phase of the CASE analysis, HMG modified the initial model to study the impact of control schemes that are possible within EnergyPlus – constant and variable temperature, and constant and variable slab supply flows through the slab – as seen in Figure 3.

Parameters/ Run#	R4	R3	R2	R1
Controls	Variable Temp,	Variable Temp,	Constant Temp,	Constant Temp,

	Variable Flow	Constant Flow	Variable Flow	Constant Flow
Inside pipe diameter	0.5"	0.5"	0.5"	0.5"
Hydronic pipe length	19,768'	19,768'	19,768'	19,768'
Maximum Cold Water Flow (GPM)	612	612	612	612
Temperature Control Type	Mean Air Temp	Mean Air Temp	Mean Air Temp	Mean Air Temp
Temperature Control Setpoint (Variable Flow)	76°F	N/A	76°F	N/A
Cooling Throttling Range (Variable Flow)	2.7°F	N/A	2.7°F	N/A
Slab Supply Temperature	63°F - 68°F	63°F - 68°F	68°F	68°F

Figure 3: Radiant System Inputs for Sensitivity Analysis

Annual Energy Savings Analysis

For the final phase of the CASE analysis, the Runs 1-4 above were modified to make them more 'generic' by using control temperatures and flow rates based on findings from interviews with stakeholders rather than matching the specific control scheme in the prototype store. These revised runs R1 through R4 were simulated for the entire year to estimate whole building annual energy consumption and peak electric demand. The 2013 CEC TDV version 4 and 2013 CA weather files for CZ 12 (Sacramento) were used for the energy savings analysis. Simulation inputs are provided in Figure 4.

Runs R1 and R3 were modeled using the EnergyPlus *LowTemperatureRadiant:ConstantFlow* system type to simulate a constant flow system on an annual basis. Using space mean air temperature as the control variable, the slab supply temperature in run R3 was controlled in a range of 63°F – 68°F. Run R1 was simulated with a constant 63°F slab supply temperature. Runs R2 and R4 were modeled using the *LowTemperatureRadiant:VariableFlow* system. This system does not directly model variable temperature for the slab supply temperature, though an hourly schedule could be applied on a seasonal or monthly basis to simulate a varying slab supply temperature during a 24-hour period. Employing such a schedule for Title 24 compliance is not realistic due to the difficulties in verifying and enforcing the schedule during code compliance verification. Therefore for the run R4 annual energy analysis, the slab supply temperature was simulated at a constant 65.2°F. This temperature approximates the average annual slab temperature based on monitored data.

Parameters/Run#	Inputs for R4	Inputs for R3	Inputs for R2	Inputs R1
System Controls	Variable Temp, Variable Flow	Variable Temp, Constant Flow	Constant Temp, Variable Flow	Constant Temp, Constant Flow
EnergyPlus Module	Low Temperature Radiant: Variable Flow	Low Temperature Radiant: Constant Flow	Low Temperature Radiant: Variable Flow	Low Temperature Radiant: Constant Flow
Maximum Cold Water Flow (GPM)	300	300	300	300
Temperature Control Type	Mean Air Temp	Mean Air Temp	Mean Air Temp	Mean Air Temp
Temperature Control Setpoint (Variable Flow)	76°F	N/A	76°F	N/A
Cooling Throttling Range (Variable Flow)	2.7°F	N/A	2.7°F	N/A
Slab Supply Temperature	65.2	63°F - 68°F	63°F	63°F

Figure 4: Radiant System Inputs for Annual Energy Savings Analysis

4.3.3 Simulation Results

This section presents results of energy simulation analysis conducted using EnergyPlus for the simulation prototype and parameters described in Section 4.3.2.

Initial Model Development

The simulated space and slab temperatures using the initial model described in the previous section were compared to the site monitored data for the design day of July 5th. Site monitored data for July 5th is shown in Figure 5 and shows that both the slab CHW supply temperature and the flowrate through the slab varies over the course of the day. The resultant slab surface temperature and zone mean air temperature also vary over the day accordingly. The mean air temperature is driven by the DOAS system that runs continuously through the occupied periods of the store to meet the minimum fresh air ventilation requirements.

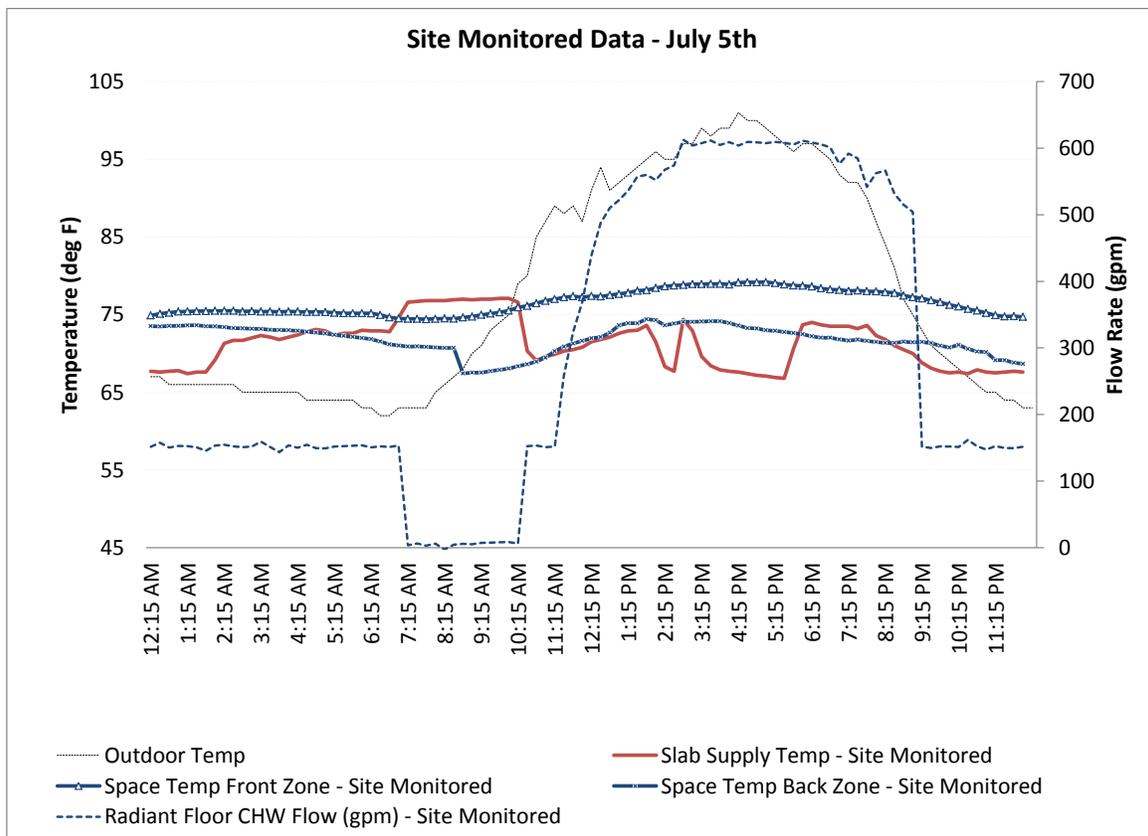


Figure 5: Site Monitored Data July 5th 2010

It is not clear why the front and back zones in the store are at different mean air temperatures since both zones are supposed to be controlled identically by the control system per the control schematics for the system. For the sake of our analysis, the front zone space mean temperature was used to compare with simulated results since that zone is closest to operating according to control schematics. Note that the site monitored data shows that the slab supply is shut off for three hours between 7:15 am and 10:15 am. This is an anomaly that is not part of the control schematic and as such was ignored in the energy simulations.

The EnergyPlus model results are presented in Figure 6 and Figure 7 below. Figure 6 shows that the EnergyPlus model maintains the same internal space temperature as the site data on the design day. However, the model predicts a much more immediate response to the system operation than is seen on site.

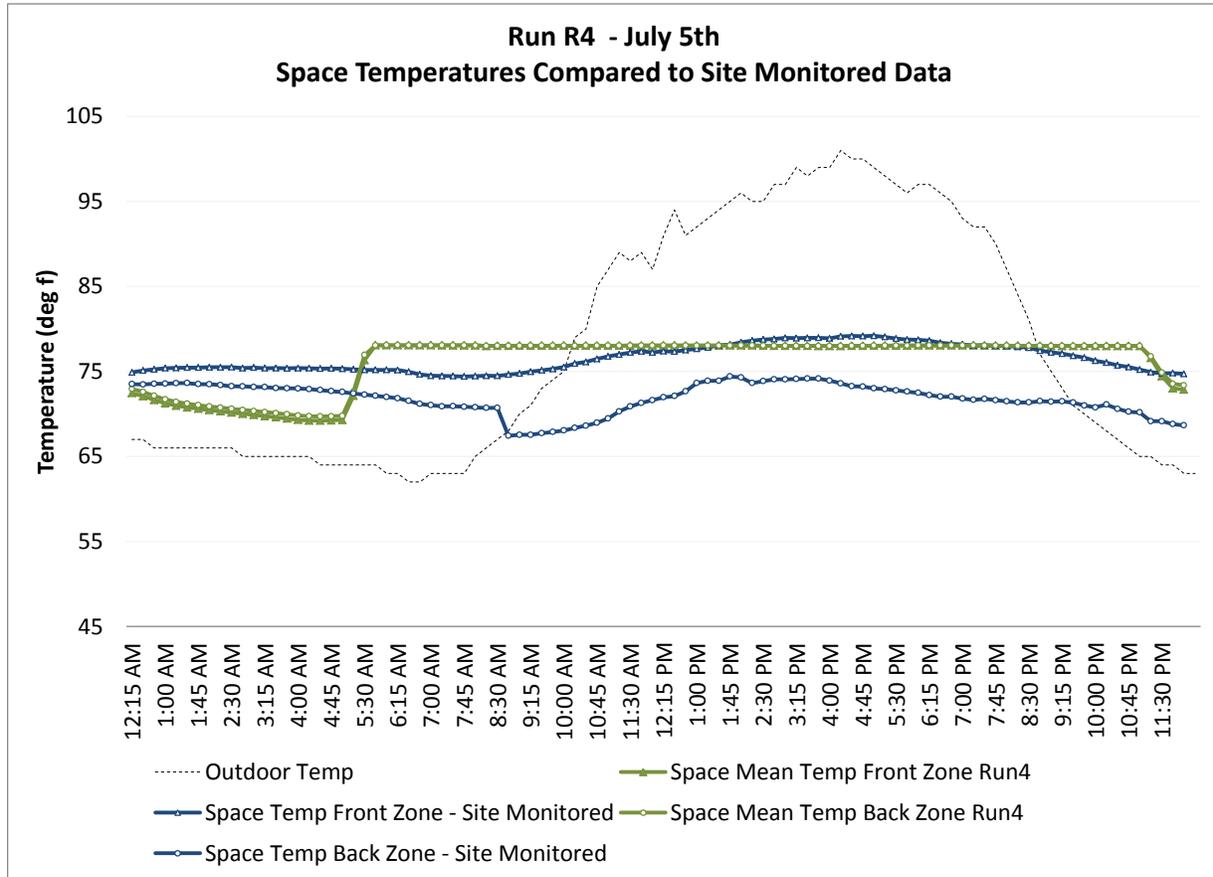


Figure 6: Modeled Space Mean Temperature vs. Site Data

This immediate response of the system is better seen by comparing the flow rate of supply water on site versus the flow rate of water as modeled in EnergyPlus in Figure 7. While the flow rate on site varies between 150 and 600 gpm in a gradual manner beginning at 7 a.m. based on outdoor temperature and operating schedule of the store, the EnergyPlus model shows rapid increase from zero to 600 gpm at store opening and then stays on all day at the maximum flow rate.

To verify that EnergyPlus can actually modulate the flow rates in a more gradual nature, HMG reviewed the simulation data for March 4th – a more temperate day with some cooling loads. As seen in Figure 8, the system flow-rate gradually increases over the morning as opposed to July 4th - and tracks closely the monitored data from July 4th. This suggests that EnergyPlus perceives that the system is undersized for the July 5th conditions and thus the flow-rate maxes out at peak conditions. EnergyPlus seems to thus make conservative predictions of system efficacy.

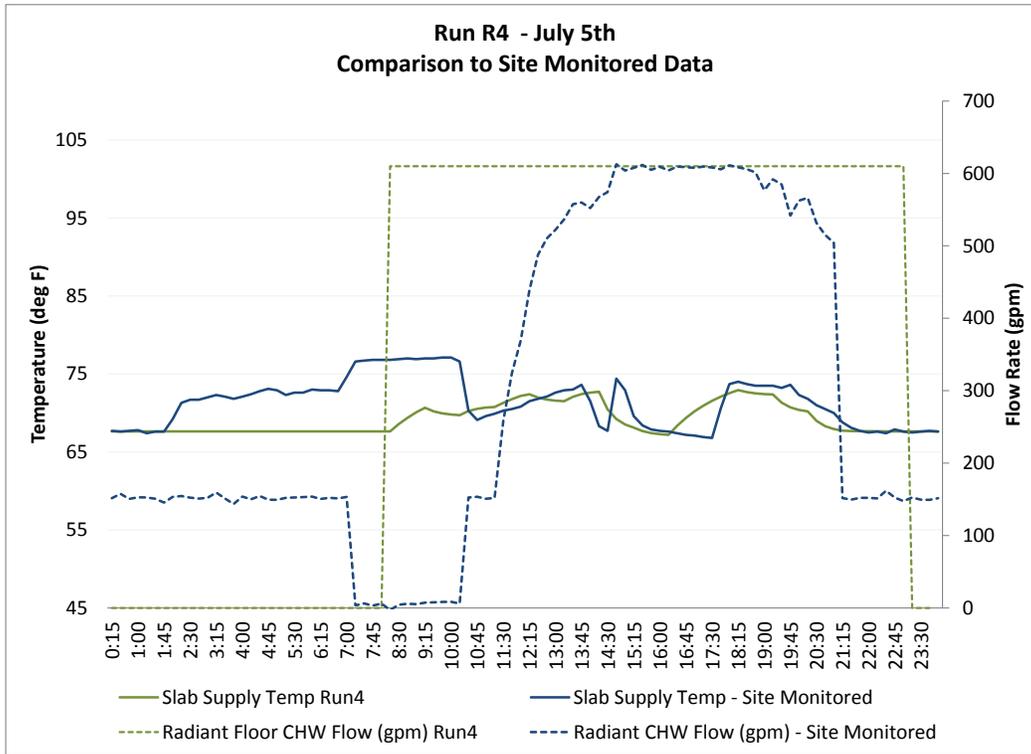


Figure 7: Modeled Radiant CHW Supply and Temp July 5th vs. Site Data

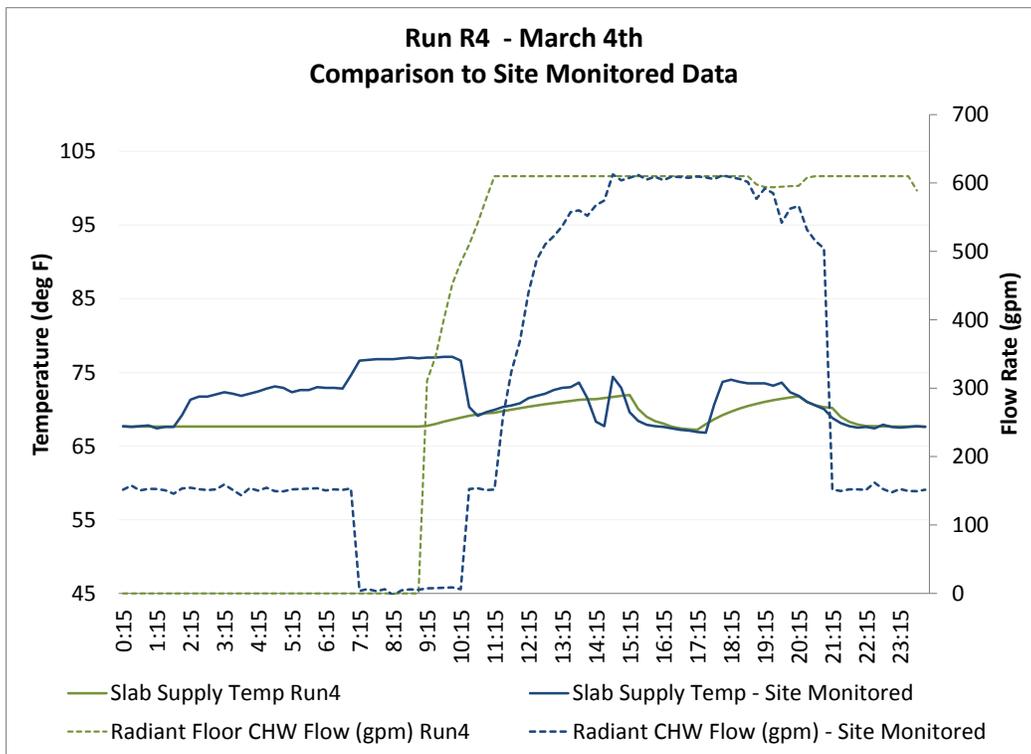


Figure 8: Modeled Radiant CHW Supply and Temp March 4th vs. Site Data

The EnergyPlus output for resulting space temperature on March 4th provided in Figure 9 shows the space temperature varying at the same rate as the monitored data for July 5th during regular operating hours.

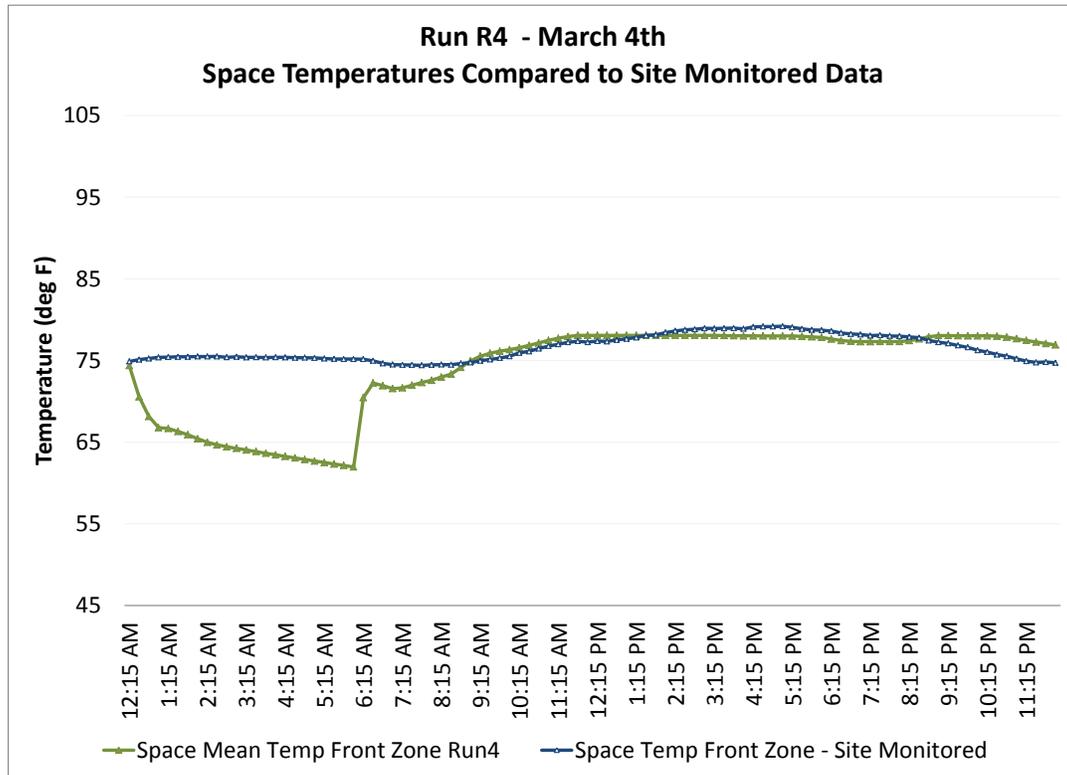


Figure 9: Modeled Space Temperature – March 4th vs. Site Data

Sensitivity Analysis

To further understand the differences in EnergyPlus output versus the inputs to the software, HMG conducted sensitivity analysis of the model inputs.

As seen in Figure 10, the EnergyPlus output in terms of space temperature varies proportionally to the temperature of the water flowing through the slab – the higher the temperature of water entering the slab, the higher the resulting space temperature.

This is explained further by looking at the difference in temperature of the water entering the slab and the temperature of the water exiting the slab shown in Figure 11. The rate of heat extraction from the slab increases as the temperature of water entering the slab decreases resulting in a higher delta between the slab supply and return temperatures. Conversely, as the slab supply temperature increases the system extracts less heat from the slab and results in a smaller delta in supply and return temperatures.

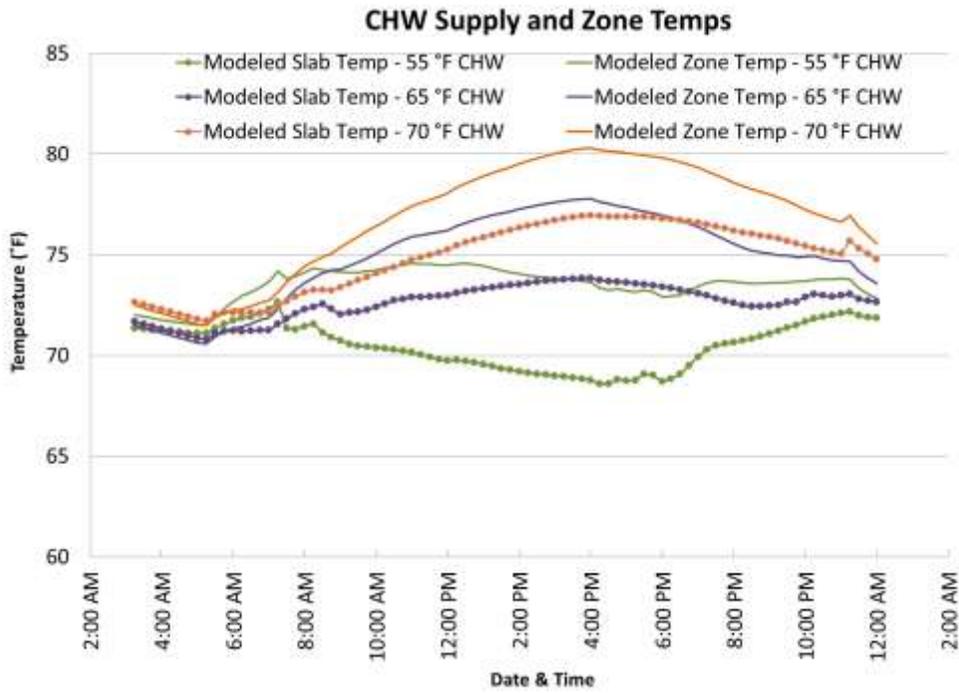


Figure 10: Sensitivity of Zone Temperature to CHW Supply Temp

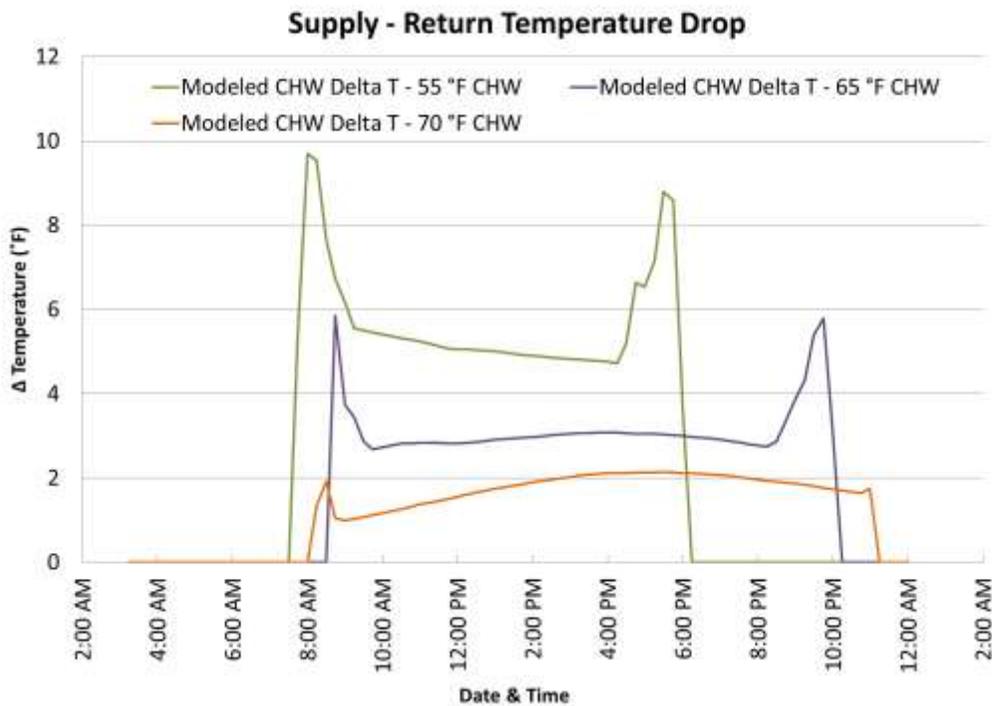


Figure 11: Sensitivity of Heat Extraction from Slab to CHW Supply Temp

Sensitivity Analysis of EnergyPlus Control Algorithms

After the initial sensitivity analysis of slab supply temperature inputs, HMG conducted a sensitivity analysis of the various control schemes available in EnergyPlus as described in Section 4.3.2 Figure 3.

Figure 12 shows the resulting floor slab surface temperatures as a result of the cold water flowing through the radiant slab. Run#2 (constant temp, variable flow) and Run#3 (variable temp, constant flow) result in slab surface temperatures within a degree of the monitored slab temperatures while Run# 1(constant temp, constant flow) and the Run#4 (variable temp, variable flow) have slab temperatures about a degree or two higher during the day. Note that the slab temperature for Run #4 are identical to the slab temperature for Run #3 and Run #1 results match Run#2, hence they do not show up separately in Figure 12.

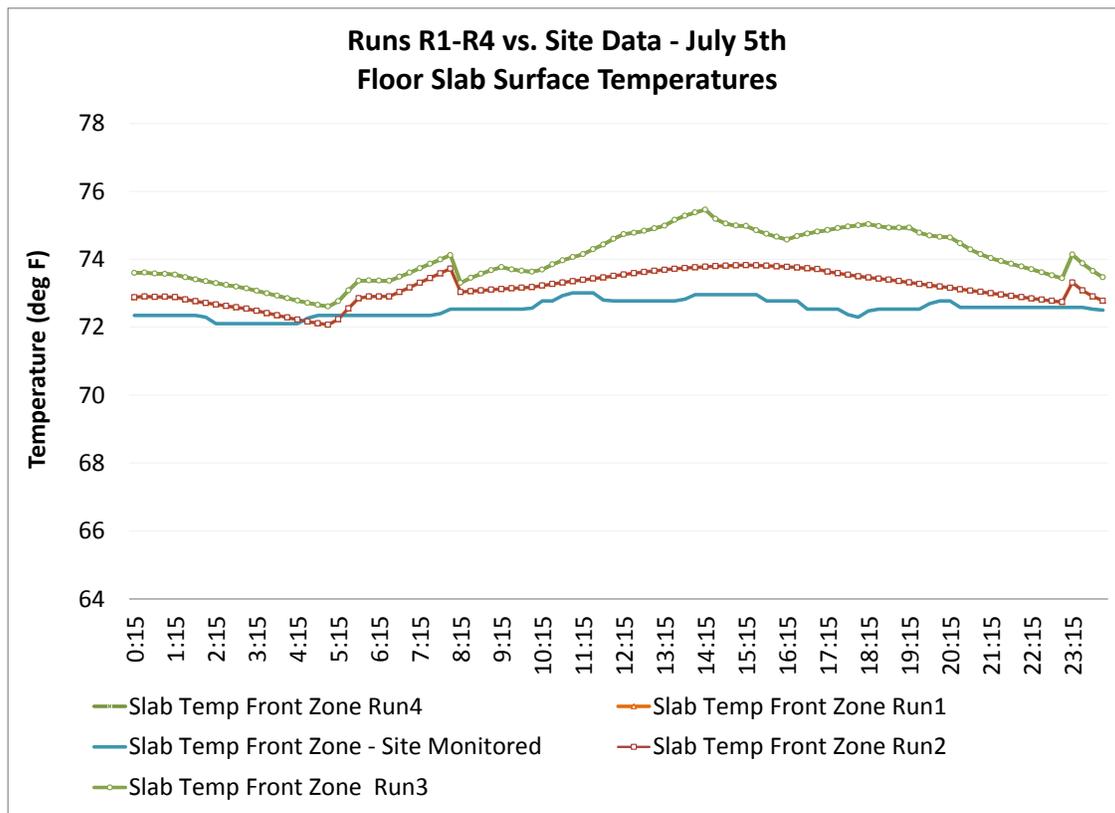


Figure 12: Sensitivity Runs – Floor Slab Temperature (July 5th)

The same four runs show that slab surface temperatures are maintained at or below 72°F for much of the day on March 4th while the slab temperatures dip at night to t 68 °F. The system shuts off the water supply to the slab or increases slab supply temperature (depending on the strategy modeled) to maintain the slab surface temperature at least two degrees from dew point temperature to avoid condensation on the slab.

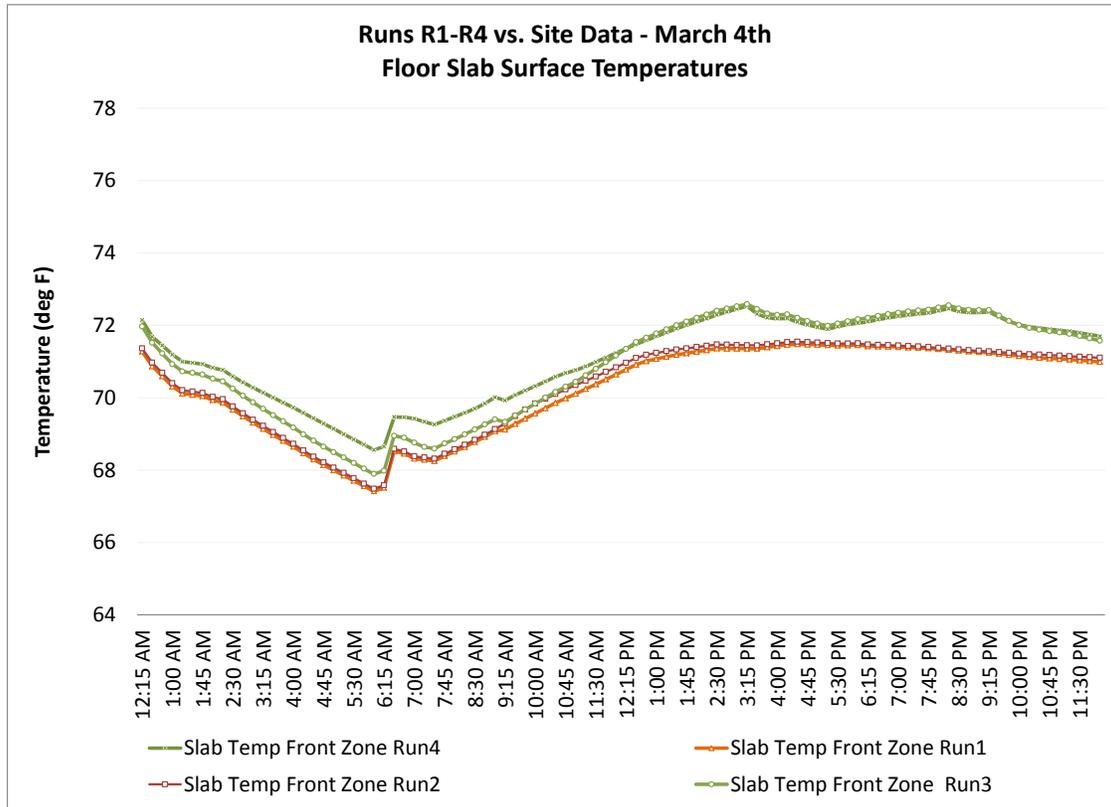


Figure 13: Sensitivity Runs – Floor Slab Temperature (March 4th)

Figure 14 and Figure 15 show the slab CHW supply flow rate for July 5th (hot day) versus March 4th (mild day) respectively. On July 5th, regardless of the strategy used for cooling the flow rate is maxed out for much of the day while on March 4th the variable flow strategies show a change in CHW flow to the slab suggesting it is responding based on the cooling needs of the space.

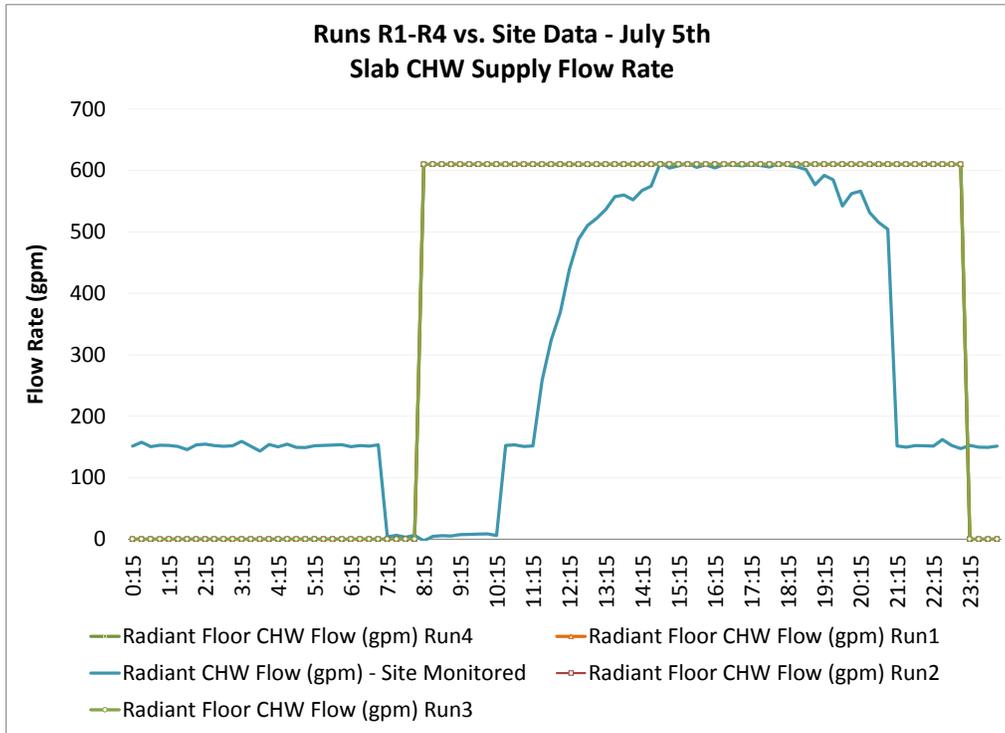


Figure 14: Sensitivity Run – Slab CHW Supply Flow Rate (July 5th)

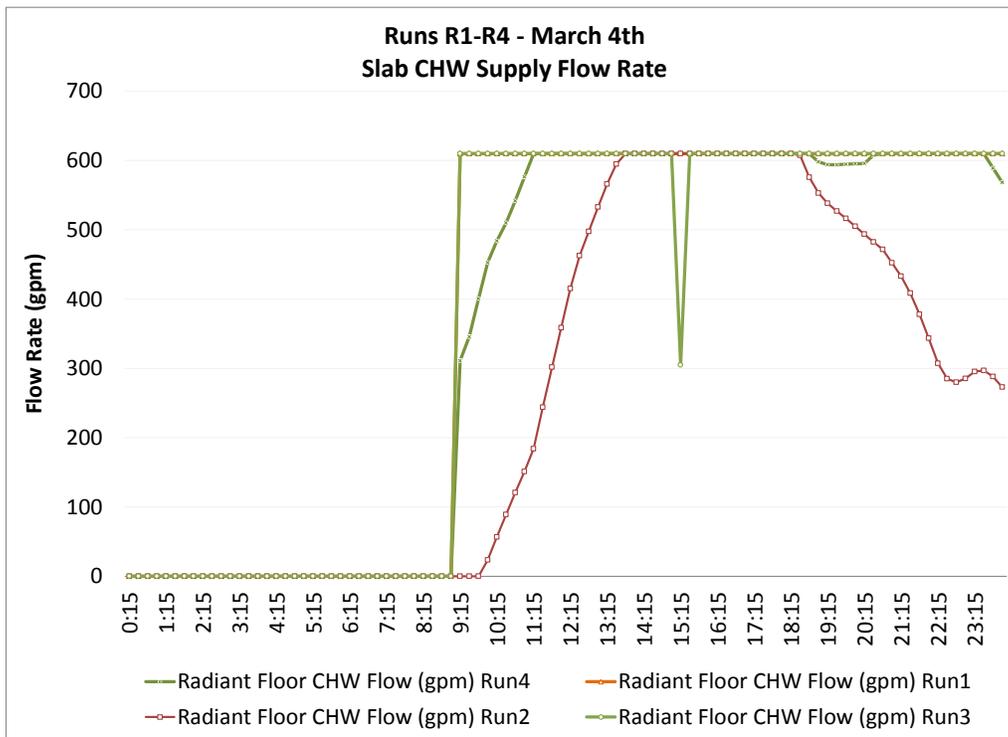


Figure 15: Sensitivity Run – Slab CHW Supply Flow Rate (March 4th)

Energy and Demand Savings Comparison of EnergyPlus Control Modules

Figure 4 summarizes the radiant floor system EnergyPlus inputs for the annual energy consumption. Figure 16 summarizes annual energy use and peak demand for the four control strategies. Figure 17 through Figure 19 provide annual energy savings estimates of runs R2 through R4 when compared to the constant temperature, constant flow radiant floor system run R1.

	Electricity Usage	Average Peak Demand (July 1 - Sept 30, 12:00 pm)	TDV Electricity Usage
EnergyPlus Run	(kwh/yr)	kW	(kBtu/yr)
R1	2,186,034	494	54,972,814
R2	2,152,327	481	53,929,222
R3	2,186,338	497	54,976,322
R4	2,078,319	463	52,034,867

Figure 16: Annual Energy Usage for Runs R1-R4

Run R2	Electricity Savings	Peak Demand Savings	TDV Electricity Savings
	(kwh/yr)	(kW)	kBtu/yr
Per Prototype Building	33,706	13	1,043,592
Savings per square foot	0.31	0.00	9.61

Figure 17: Energy Savings - Constant Temp, Variable Flow (R2) vs. Constant Temp, Flow (R1)

Run R3	Electricity Savings	Peak Demand Savings	TDV Electricity Savings
	(kwh/yr)	(kW)	kBtu/yr
Per Prototype Building	(304)	(3)	(3,508)
Savings per square foot	(0.00)	(0.00)	(0.03)

Figure 18: Energy Savings -Variable Temp, Constant Flow (R3) vs. Constant Temp, Flow (R1)

Run R4	Electricity Savings	Peak Demand Savings	TDV Electricity Savings
	(kwh/yr)	(kW)	kBtu/yr
Per Prototype Building	107,714	31	2,937,947
Savings per square foot	0.99	0.00	27.04

Figure 19: Energy Savings - Variable Temp, Variable Flow (R4) vs. Constant Temp, Flow (R1)

All four strategies use similar amounts of energy compared to each other. The variable flow systems tend to show less energy use than constant flow systems. The main reason for the energy decrease in Run#4 is the slab supply temperature being higher than the other three strategies per Figure 4.

4.3.4 Proposed ACM Recommendations

HMG recommends that hydronic radiant cooling systems be modeled through a new optional system type description in Nonresidential Alternative Compliance Manual Section 3.3.5.

HMG further proposes modeling rules for low-temperature hydronic radiant systems that can model the following strategies using the built-in capabilities in EnergyPlus:

- Constant flow systems with constant and variable supply temperature
- Variable flow systems with constant supply temperature

Since the EnergyPlus simulation modules cannot directly model variable supply temperature with variable flow systems, HMG does not recommend explicit modeling of variable temperature in the ACM with variable flow systems. It is possible to model the variable flow and variable temperature strategy using a supply temperature schedule as used by HMG in the energy savings analysis, but the enforceability of such a custom schedule would be limited. HMG recommends that a variable flow and variable temperature system be modeled using the “low temperature radiant with variable flow” object using an average supply temperature. HMG also proposes the following limits be added to the inputs that would be deemed acceptable for ACM modeling of hydronic radiant systems:

Low-Temperature Radiant with Variable Flow

Input Keyword	Inputs available in EnergyPlus	Acceptable Range for ACM
Surface Name or Radiant Surface Group Name	Walls, Floors, Ceilings	Floors
Hydronic Tubing Length	X > 0, no max, no default, can autosize	No-autosizing allowed – need specific input. Max 350 ft/loop.
Hydronic Tubing Inside Diameter	X >0, no max, default = 1/2”	1/2”-3/4”
Temperature Control Type	Operative Temperature, Mean Space Air Temp, Mean Radiant Temp, ODB, OWB	Mean Space Air Temp (use current NACM thermostat setpoints)
Maximum Cold Water Flow Rate	No default, no max	No default, no max
Cooling Control Temperature	No default, user input	No default, user input
Condensation Control Type	Off, SimpleOff, VariableOff	SimpleOff, VariableOff
Condensation Control Dewpoint Offset	No min or max	2 deg F above dewpoint

Low-Temperature Radiant with Constant Flow

Input Keyword	Inputs available in EnergyPlus	Acceptable Range for ACM
Surface Name or Radiant Surface Group Name	Walls, Floors, Ceilings	Floors
Hydronic Tubing Length	X > 0, no max, no default, can autosize	No-autosizing allowed – need specific input. Max 350 ft/loop.
Hydronic Tubing Inside Diameter	X > 0, no max, default = 1/2”	1/2”-3/4”
Temperature Control Type	Operative Temperature, Mean Air Temp, Mean Radiant Temp, ODB, OWB	Mean Space Air Temp (use current NACM thermostat setpoints)
Rated Flow Rate	No default, user input	User input
Rated Pump Power Consumption	No default, user input	User input
Motor Efficiency	0-100%	T24 default for proposed design
Fraction of Motor Inefficiencies to Fluid Stream	0-1.0. Default =0	User Input
Cooling High Water Temperature	Max supply water temp. No limits.	User Input
Cooling Low Water Temperature	Min supply water temp. No limits	Min – 55 deg F
Condensation Control Type	Off, SimpleOff	SimpleOff
Condensation Control Dewpoint Offset	No min or max	2 deg F above dewpoint

5. Recommended Language for the Standards Document, ACM Manuals, and the Reference Appendices

The proposed nonresidential ACM language will be developed in coordination with the California Energy Commission (CEC) contractors who are developing the 2013 ACM. These efforts include making the ACM software neutral through the use of standard data dictionary definitions being developed by the CEC contractors instead of DOE2.1E specific keywords and calculation algorithms.

6. Bibliography and Other Research

This section lists research studies, reports, presentations and personal communications that provided background for this CASE topic.

6.1 Experts Consulted

HMG consulted with experts at various organizations per below:

- Peter Simmonds – Peter Simmonds provided technical oversight to the CASE team. Mr. Simmonds provided references to research reports and articles on radiant cooling applications, shared his extensive knowledge of designing radiant cooling systems including rules of thumb and detailed calculation procedures for radiant cooling system design.
- National Renewable Energy Laboratories (NREL) – Ian Doebber of NREL shared results from monitoring projects conducted by NREL for the WalMart high efficiency stores in Sacramento, CA and Las Vegas, NV. Mr Doebber also shared simulation results for the Sacramento store conducted using EnergyPlus and documented in an ASHRAE journal article. Brent Griffith of NREL provided assistance with troubleshooting EnergyPlus models developed by HMG.

6.2 Reports Reviewed

- Doebber Ian, Moore Mike P.E., Deru Michael P.E. “Radiant Slab Cooling for Retail.” ASHRAE Journal vol. 52, no. 12, December -2010.
- Strand, R.K., Pedersen, C.O. “Implementation of a Radiant Heating and Cooling Model into an Integrated Building Energy Analysis Program.” ASHRAE Trans. 1997, Vol.103, Part 1, Paper number PH-97-14-2, 949-958.
- Strand, R.K., Pedersen, C.O. “Modeling Radiant Systems in an Integrated Heat Balance Based Energy Simulation Program.” ASHRAE 2002 Annual Conference Proceedings.
- Simmonds Peter. “Control Strategies for Combined Heating and Cooling Radiant Systems.” ASHRAE Trans., 1994, vol.100, part 1, paper no.NO-94-13-4, 1031-1039.
- Simmonds Peter. “Practical Applications of Radiant Heating and Cooling to Maintain Comfort Conditions.” ASHRAE Trans., 1996, vol.102, part 1, paper no. AT-96-7-2, 659-666. 1996.
- Genest Frederic, Minea Vasile. “High-Performance Retail Store with Integrated HVAC Systems.” ASHRAE Trans., vol. 112, pt. 2, paper no. QC-06-032, p. 342-348.
- Simmonds Peter, Mehlomakulu Bungane, Ebert Thilo. “Radiant Cooled Floors— Operation and Control Dependant upon Solar Radiation.” ASHRAE Transactions, vol. 112(2):358-367, 2006
- ANSI/ASHRAE Standard 55-2010, Thermal Environmental Conditions for Human Occupancy.
- 2009 ASHRAE Handbook—Fundamentals, Chapter 9, Thermal Comfort.
- Olesen, B.W., Michel, E., Bonnefoi, F., De Carli, M. 2000. “Heat exchange coefficient between floor surface and space by floor cooling: theory or a question of definition.” ASHRAE Transactions 106(1):684-694.
- DOE. 2010. “EnergyPlus Energy Simulation Software.” Washington, D.C., U.S. Department of Energy. www.eere.energy.gov/buildings/energyplus/.

7. Appendix: Simulation Prototype Plan

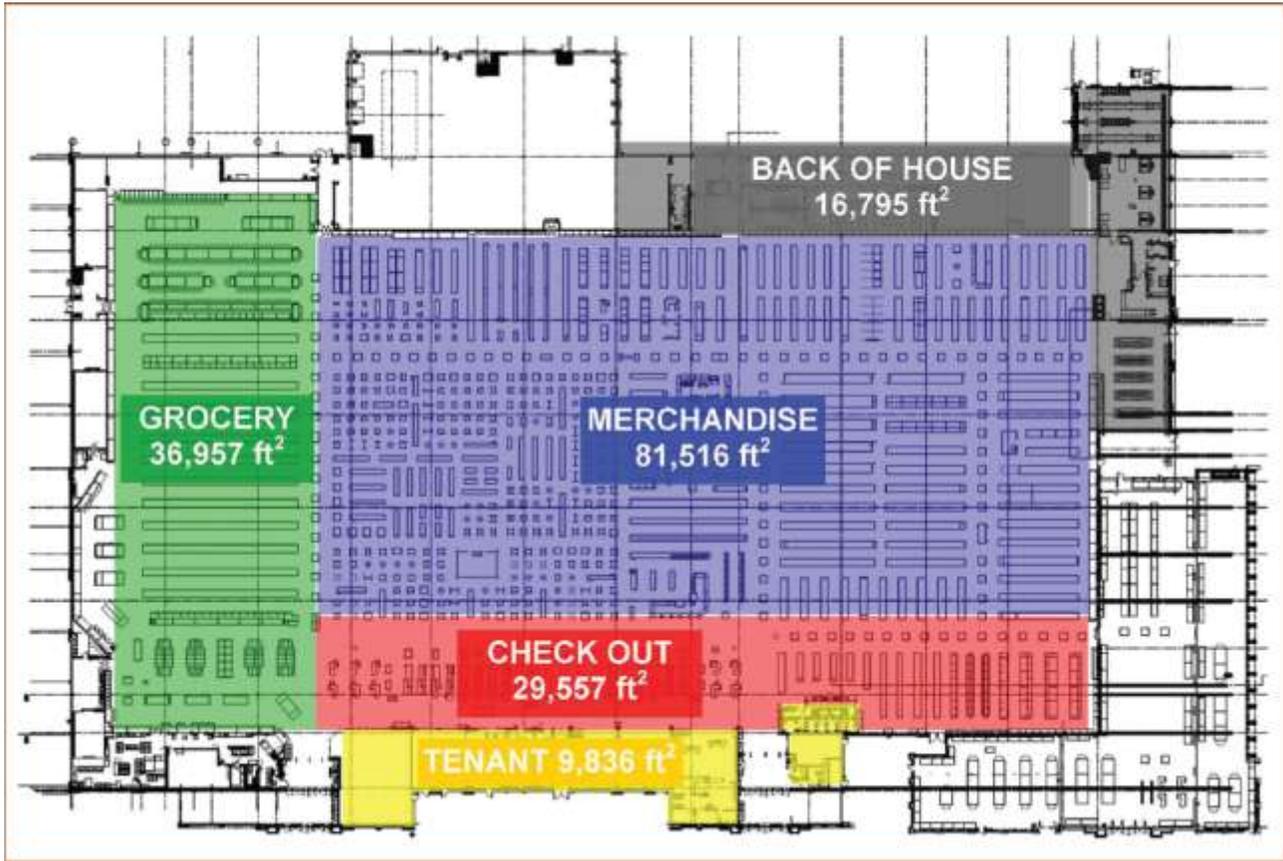


Figure 20: Prototype Store Plan

Source: Doebber Ian, Moore Mike P.E., Deru Michael P.E. "Radiant Slab Cooling for Retail." ASHRAE Journal vol. 52, no. 12, December -2010.